


BUILDING KEYMAP

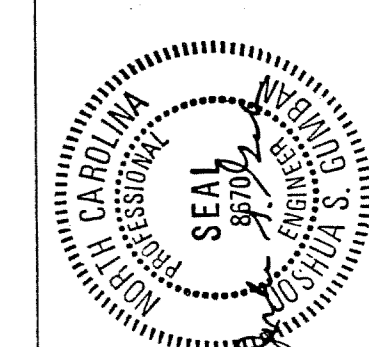

SCIENCE BUILDING  
UNIVERSITY OF NORTH CAROLINA AT WILMINGTON  
CODE 49388 ITEM 301 ID#081280801A

SHEET TITLE:

SECOND FLOOR PLAN - AREA TWO  
WEST

SECOND FLOOR  
SCALE: 1/4" = 1'-0"

AREA TWO  
AS BUILT

DRAWING REVISIONS		
NO.	DATE	REMARKS

DATE: 5/16/94  
PROJECT#: 8962  
DESIGNED BY: JSG  
DRAWN BY: GRM  
CHECKED BY: JSG

SHEET NO.:

LE7

**WALLS**  
Earl Walls Associates  
Laboratory Design Consultants  
5348 Carroll Canyon Road  
San Diego, California 92121  
(619)457-2400

- REFERENCE NOTES:
- MAKE CONNECTION TO VACUUM PUMP RECEPTACLE IN CABINET BELOW. SEE LAB FURNISHING DWG. DETAIL.
  - ALL RECEPTACLE AND TELCO/DATA OUTLETS IN THIS ROOM SHALL BE AT +18".
  - 3/4" C, 2 #12, 2 #10 AND 1 #10 GROUND.
  - IN OVERHEAD SERVICE CARRIER SEE LAB FURNISHING DRAWINGS.
  - CONNECT TO GLASSWARE WASHER.
  - CONNECT TO STERILIZER CONTROLS.
  - CONNECT TO STERILIZER.
  - 3/4" C, 2 #12, 3 #10, AND 1 #10 GROUND.
  - EMERGENCY OFF PUSHBUTTON STATION SHALL DE-ENERGIZE BOTH PANELS 2LPFF AND 2LPGG.
  - TO SHUNT-TRIP MAIN BREAKER OF RESPECTIVE PANEL.
  - PROVIDE CONDUIT SEAL IN CONDUIT ENTERING ENVIRONMENTAL ROOM ENCLOSURE. COORDINATE LOCATION.
  - LOCATE J-BOX FOR ENVIRONMENTAL ROOM CONTROL OUTSIDE ABOVE ENVIRONMENTAL ROOM. COORDINATE LOCATION. EXTENSION TO ENVIRONMENTAL ROOM CONTROL PANEL BY ENVIRONMENTAL ROOM MGR.
  - 1-1/4" C, 3 #2 AND 1 #8 GROUND.
  - BOTH EMERGENCY OFF PUSHBUTTON STATIONS SHALL DE-ENERGIZE BOTH PANELS 2LPW AND 2LPX.
  - 3/4" C, 2 #12, 2 #10 AND 1 #10 GROUND.
  - J-BOX AT +6" TO TOP.
  - UNDER BENCH TOP.
  - TO NEARBY TELCO/DATA CLOSET. SEE CATEGORY "E" BUILDING ELECTRICAL DRAWINGS.

ADD ALTERNATE - L1