


3/27/2019 10:09:05 AM

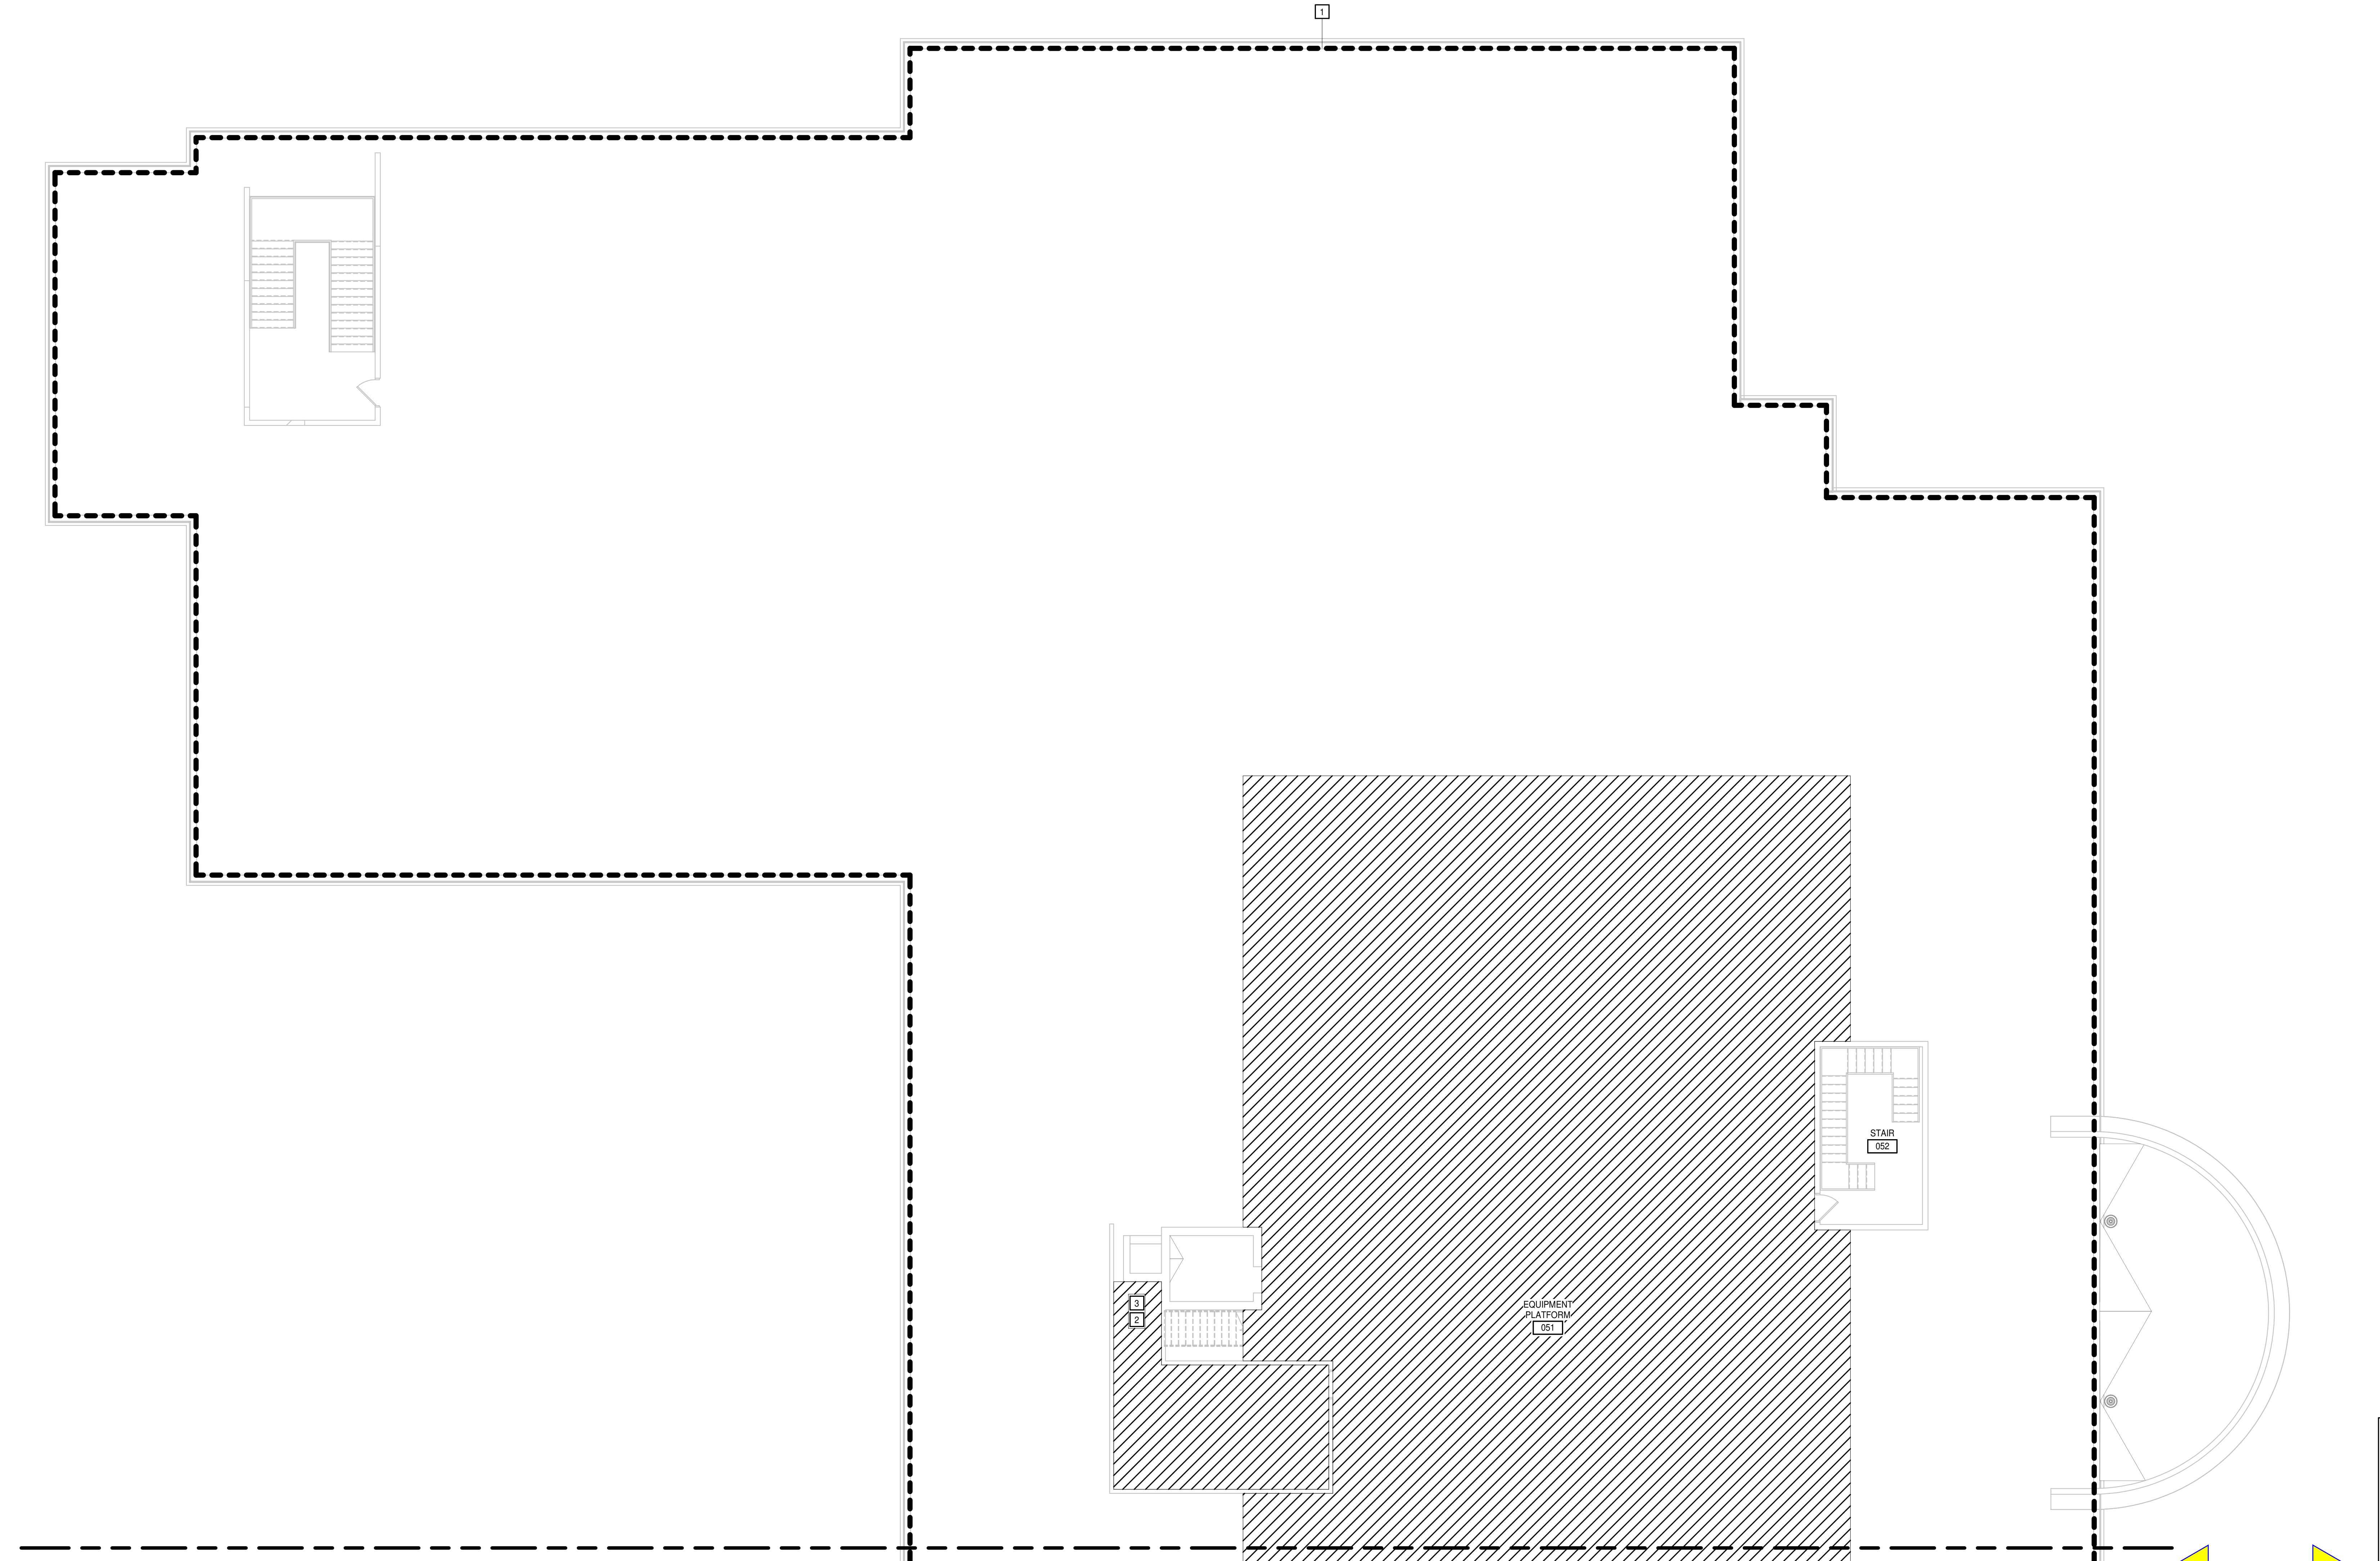


ATTIC FLOOR PLAN - AREA A - FIRE PROTECTION  
1/8" = 1'-0"

FIRE PROTECTION KEYNOTES

APPLIES TO DRAWINGS FP2.3.A  
REPRESENTED BY [A]

1. PROVIDE NEW WET PIPE SPRINKLER SYSTEM THROUGHOUT THE ATTIC.
2. PROVIDE NEW ATTIC WET PIPE SYSTEM ZONE CONTROL ASSEMBLY; REFER TO ZONE CONTROL ASSEMBLY DETAIL ON FP0.1.
3. ROUTE NEW ATTIC SYSTEM DRAIN DOWN IN CHASE BELOW TO TIE INTO SECOND FLOOR DRAIN.

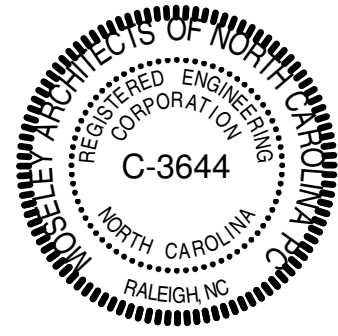

Dobo Hall Renovation - Package A

SCO PROJECT NO. 18-19798-01A  
UNC Wilmington  
4978 CAHILL DR, WILMINGTON, NC 28403

PROJECT NO.	DATE
580999	MARCH 27, 2019
REVISIONS	
DATE	DESCRIPTION

ATTIC FLOOR PLAN  
- AREA A - FIRE PROTECTION

FP2.3.A