KEYNOTES

APPLIES TO THIS DRAWING

1. CONNECT TO FUME HOOD FULL SIZE OF FUME HOOD CONNECTION.
2. CONNECT 6"ø TO POINT EXHAUST EXTRACTION ARM. COORDINATE CONNECTION WITH LAB EQUIPMENT. BALANCE TO 100 CFM. PROVIDE MANUAL VOLUME DAMPER IN HORIZONTAL OR VERTICAL ABOVE THE CEILING.
3. PROVIDE WALL SWITCH FOR AUTOCLAVE HOOD EXHAUST.
4. LOCATION OF DOWN DUCT STATIC PRESSURE SENSOR FOR AHU-1.
5. LOCATION OF DOWN DUCT STATIC PRESSURE SENSOR FOR AHU-2.

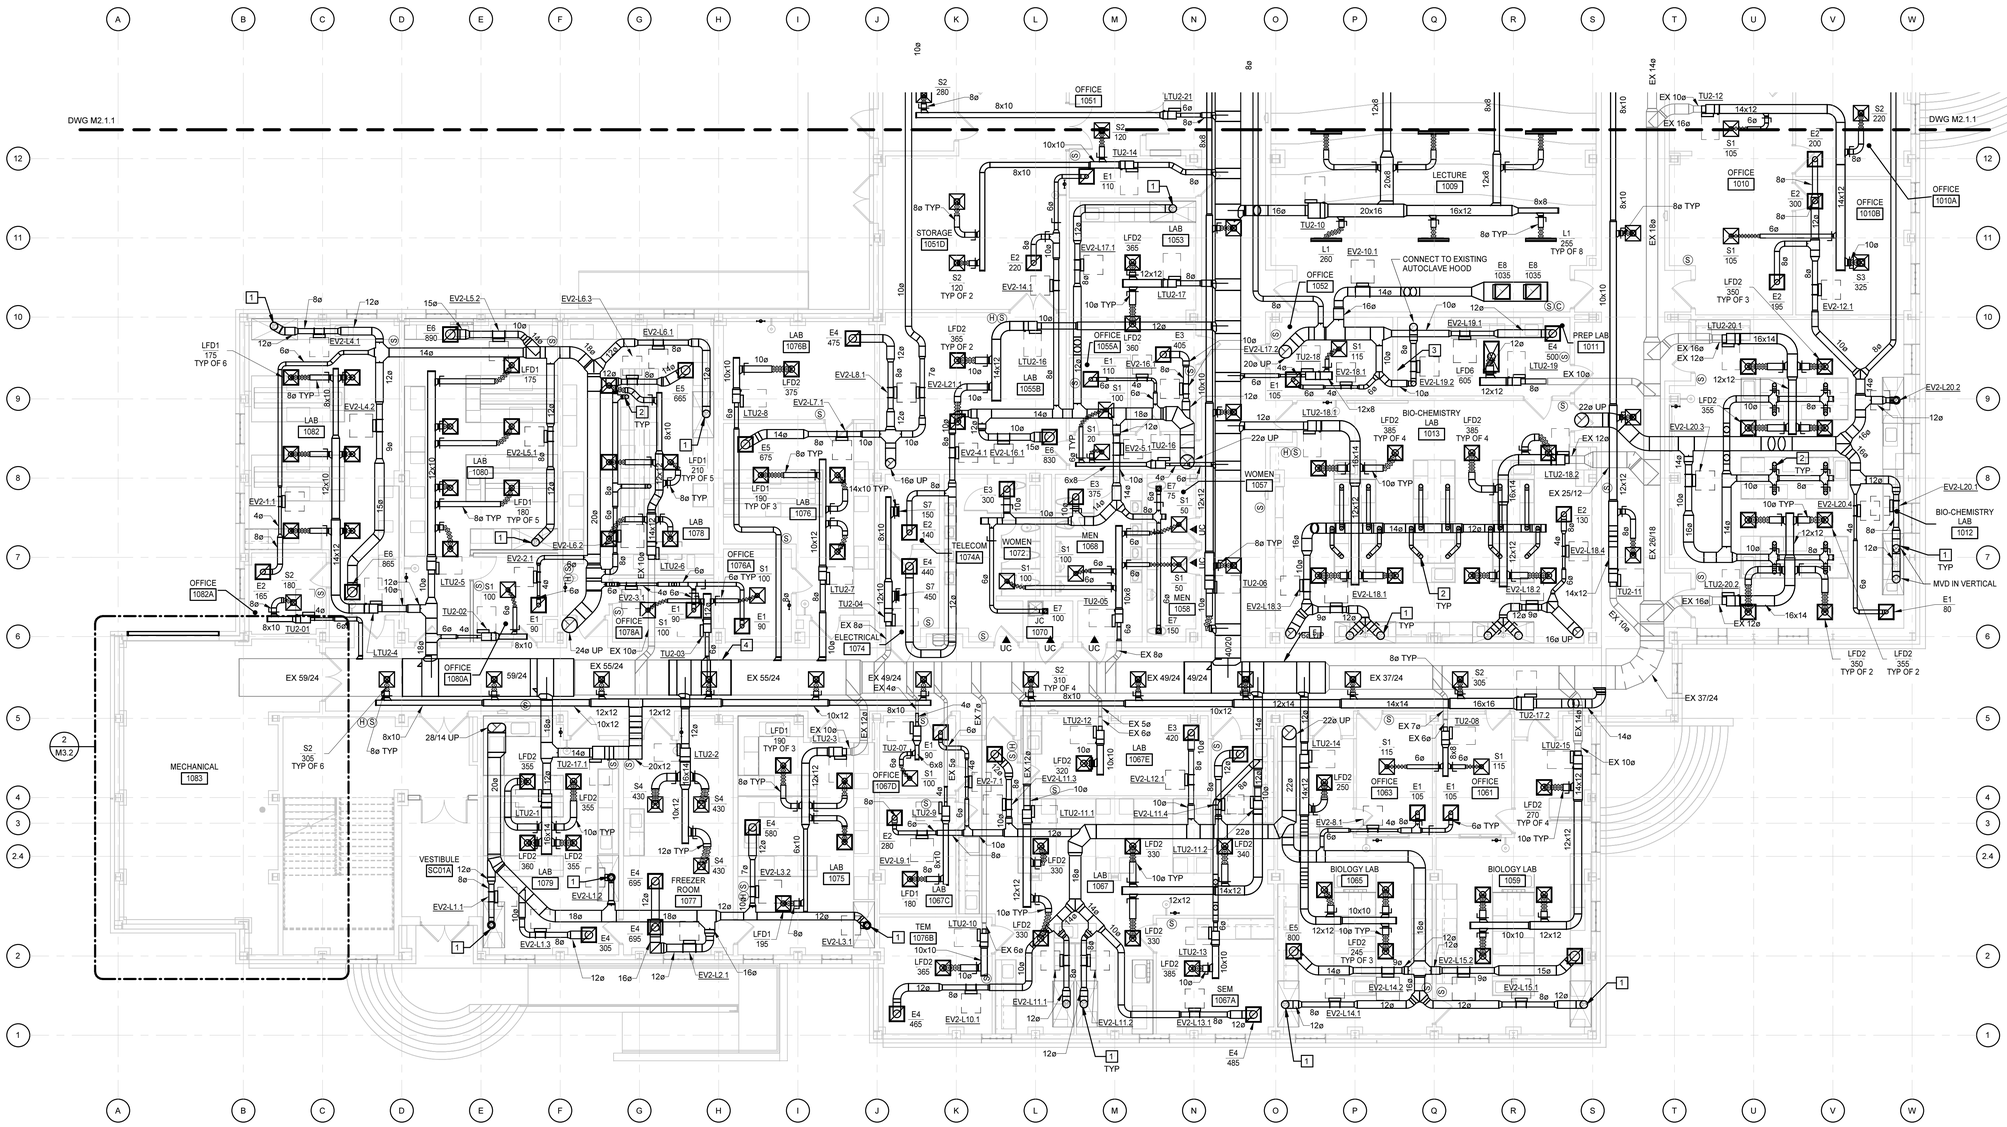

FIRST FLOOR PLAN - PART B - DUCTWORK

1/8" = 1'-0"



3/26/2019 4:31:56 PM

MOSELEYARCHITECTS
911 N. WEST STREET, SUITE 205 RALEIGH, NORTH CAROLINA 27603
PHONE (919) 840-0091
MOSELEYARCHITECTS.COM

PROGRESS PRINT NOT FOR CONSTRUCTION

Dobo Hall Renovation - Package A

SCO PROJECT NO. 18-19798-01A
UNC Wilmington
4978 CAHILL DR, WILMINGTON, NC 28403

PROJECT NO.	DATE:
580999	MARCH 27, 2019

REVISIONS

DATE	DESCRIPTION

FIRST FLOOR PLAN - PART B - DUCTWORK

M2.2.1