KEYNOTES

APPLIES TO THIS DRAWING

1. CONNECT TO FUME HOOD FULL SIZE OF FUME HOOD CONNECTION.
2. CONNECT 6"ø TO POINT EXHAUST EXTRACTION ARM. COORDINATE CONNECTION WITH LAB EQUIPMENT. BALANCE TO 100 CFM. PROVIDE MANUAL VOLUME DAMPER IN HORIZONTAL OR VERTICAL ABOVE THE CEILING.
3. LOCATION OF DOWN DUCT STATIC PRESSURE SENSOR FOR AHU-3.
4. LOCATION OF DOWN DUCT STATIC PRESSURE SENSOR FOR AHU-4.
5. CONNECT 4"ø TO CABINET EXHAUST. COORDINATE CONNECTION WITH LAB EQUIPMENT. BALANCE TO 50 CFM. PROVIDE MANUAL VOLUME DAMPER IN HORIZONTAL OR VERTICAL ABOVE THE CEILING.

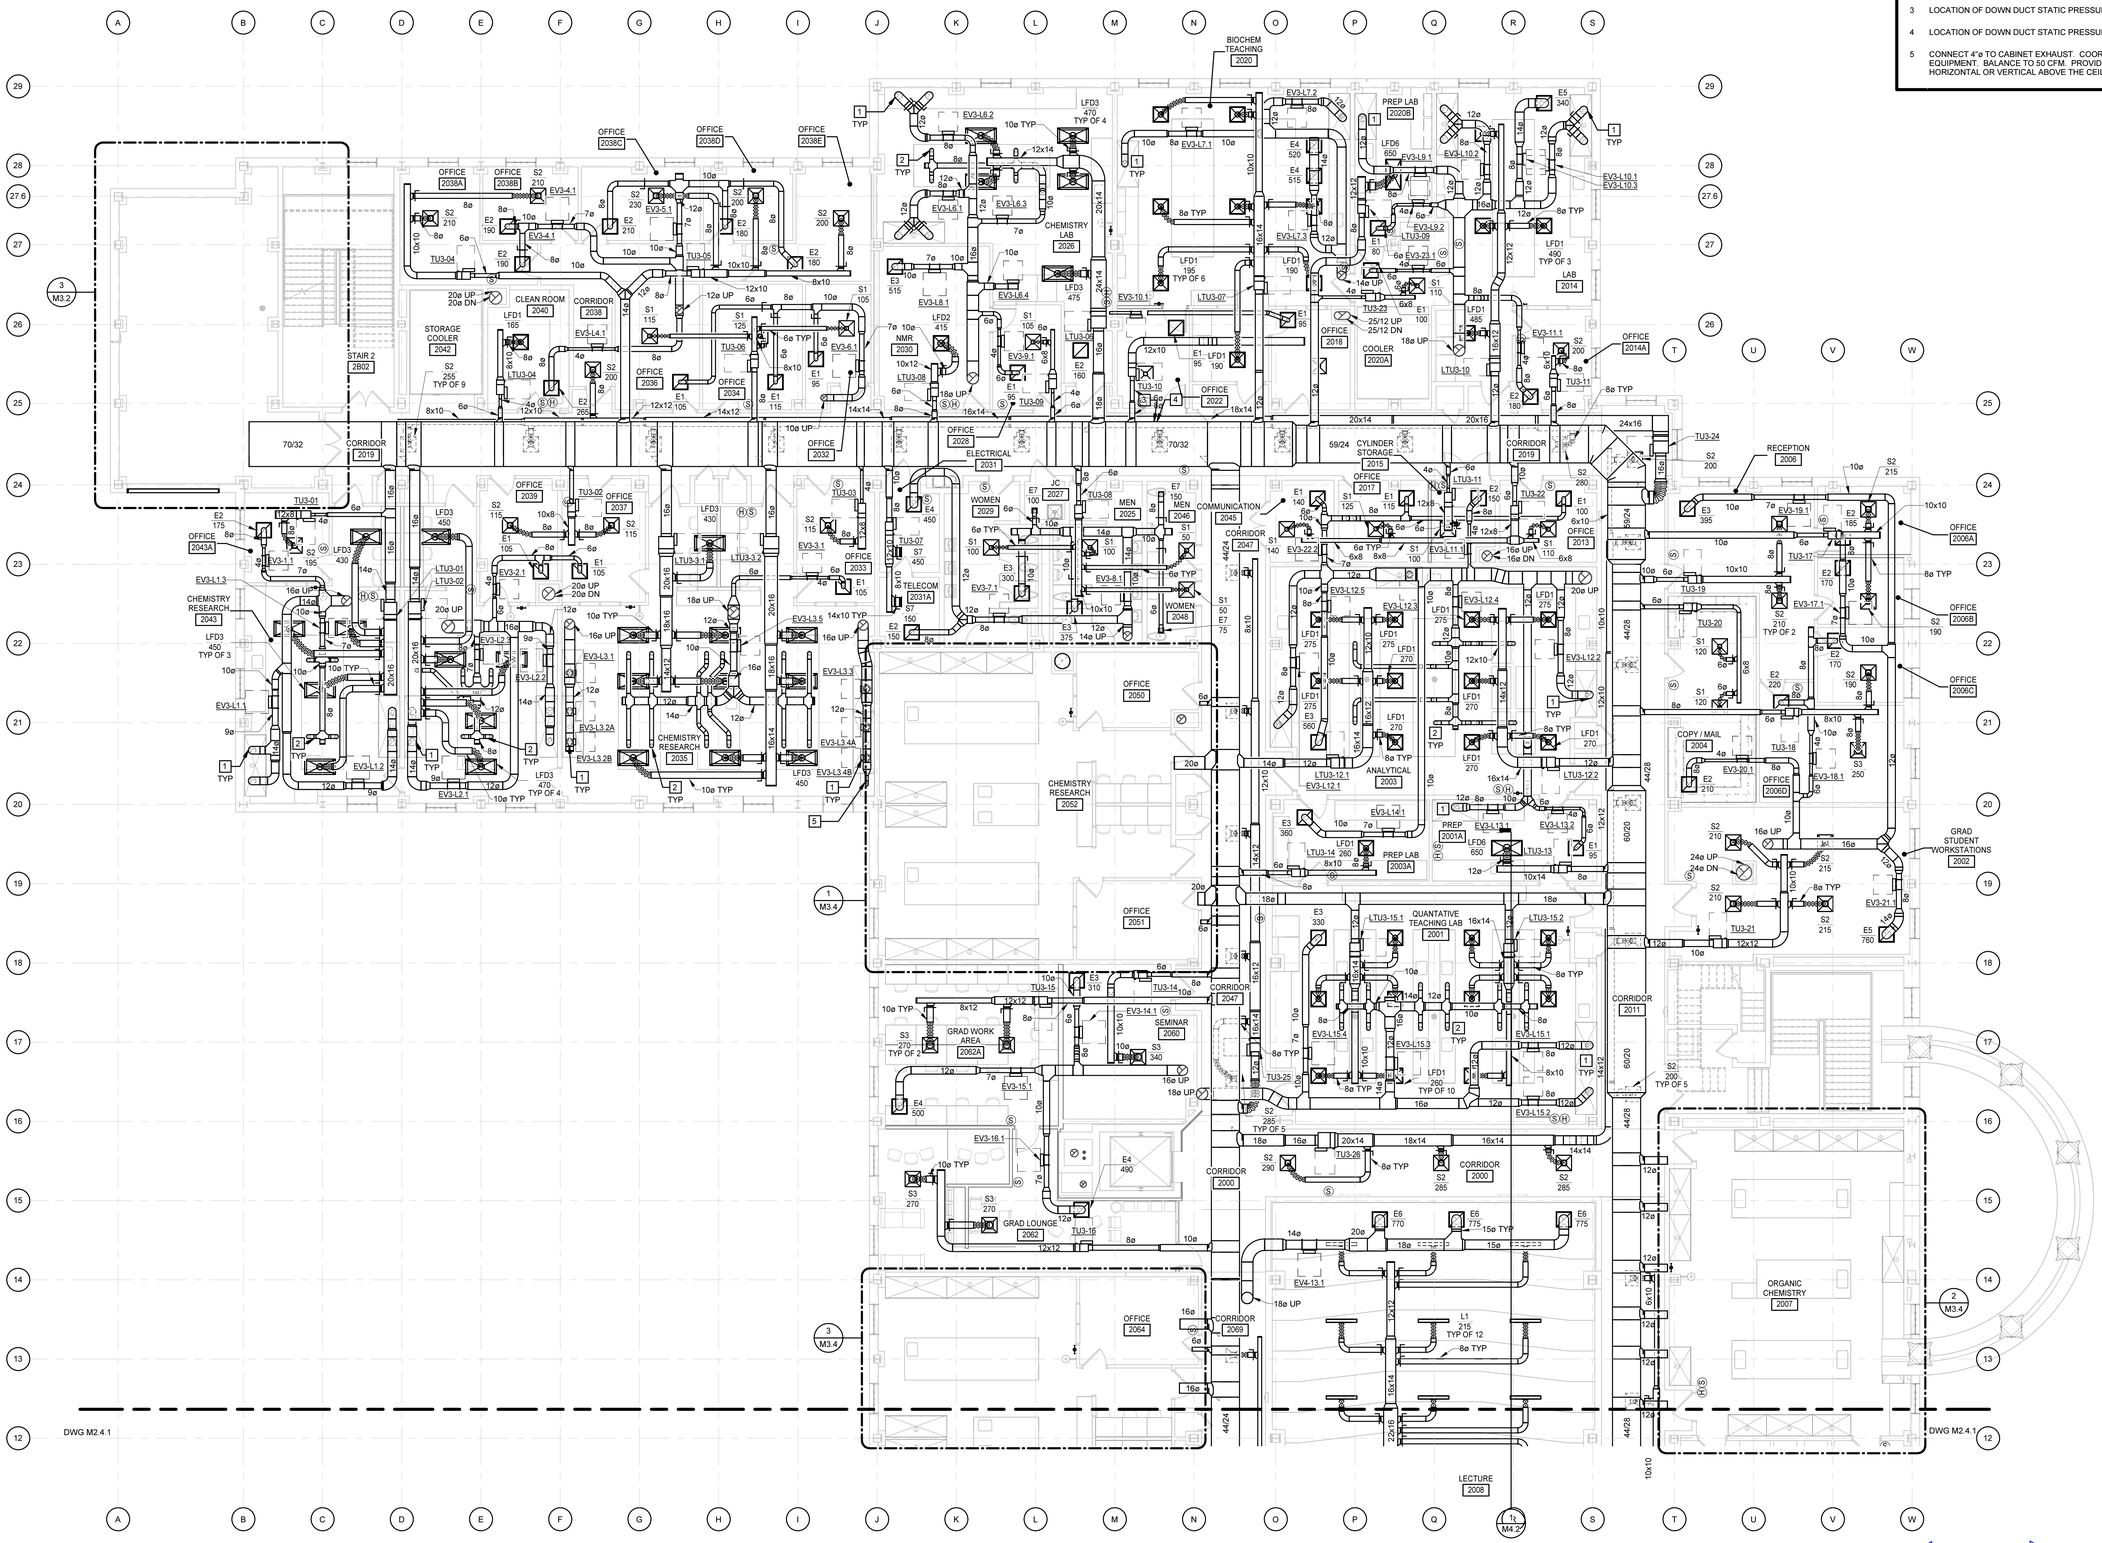

SECOND FLOOR PLAN - PART A - DUCTWORK

1/8" = 1'-0"



MOSELEY ARCHITECTS
911 N. WEST STREET, SUITE 205 RALEIGH, NORTH CAROLINA 27603
PHONE (919) 840-0091
MOSELEYARCHITECTS.COM

PROGRESS PRINT NOT FOR CONSTRUCTION

Dobo Hall Renovation - Package A

SCO PROJECT NO. 18-19798-01A
UNC Wilmington
4978 CAHILL DR, WILMINGTON, NC 28403

PROJECT NO.	DATE
580999	MARCH 27, 2019

REVISIONS

DATE	DESCRIPTION

SECOND FLOOR PLAN - PART A - DUCTWORK

M2.3.1

3/26/2019 4:32:23 PM