



5 AHU-1 ISOMETRIC

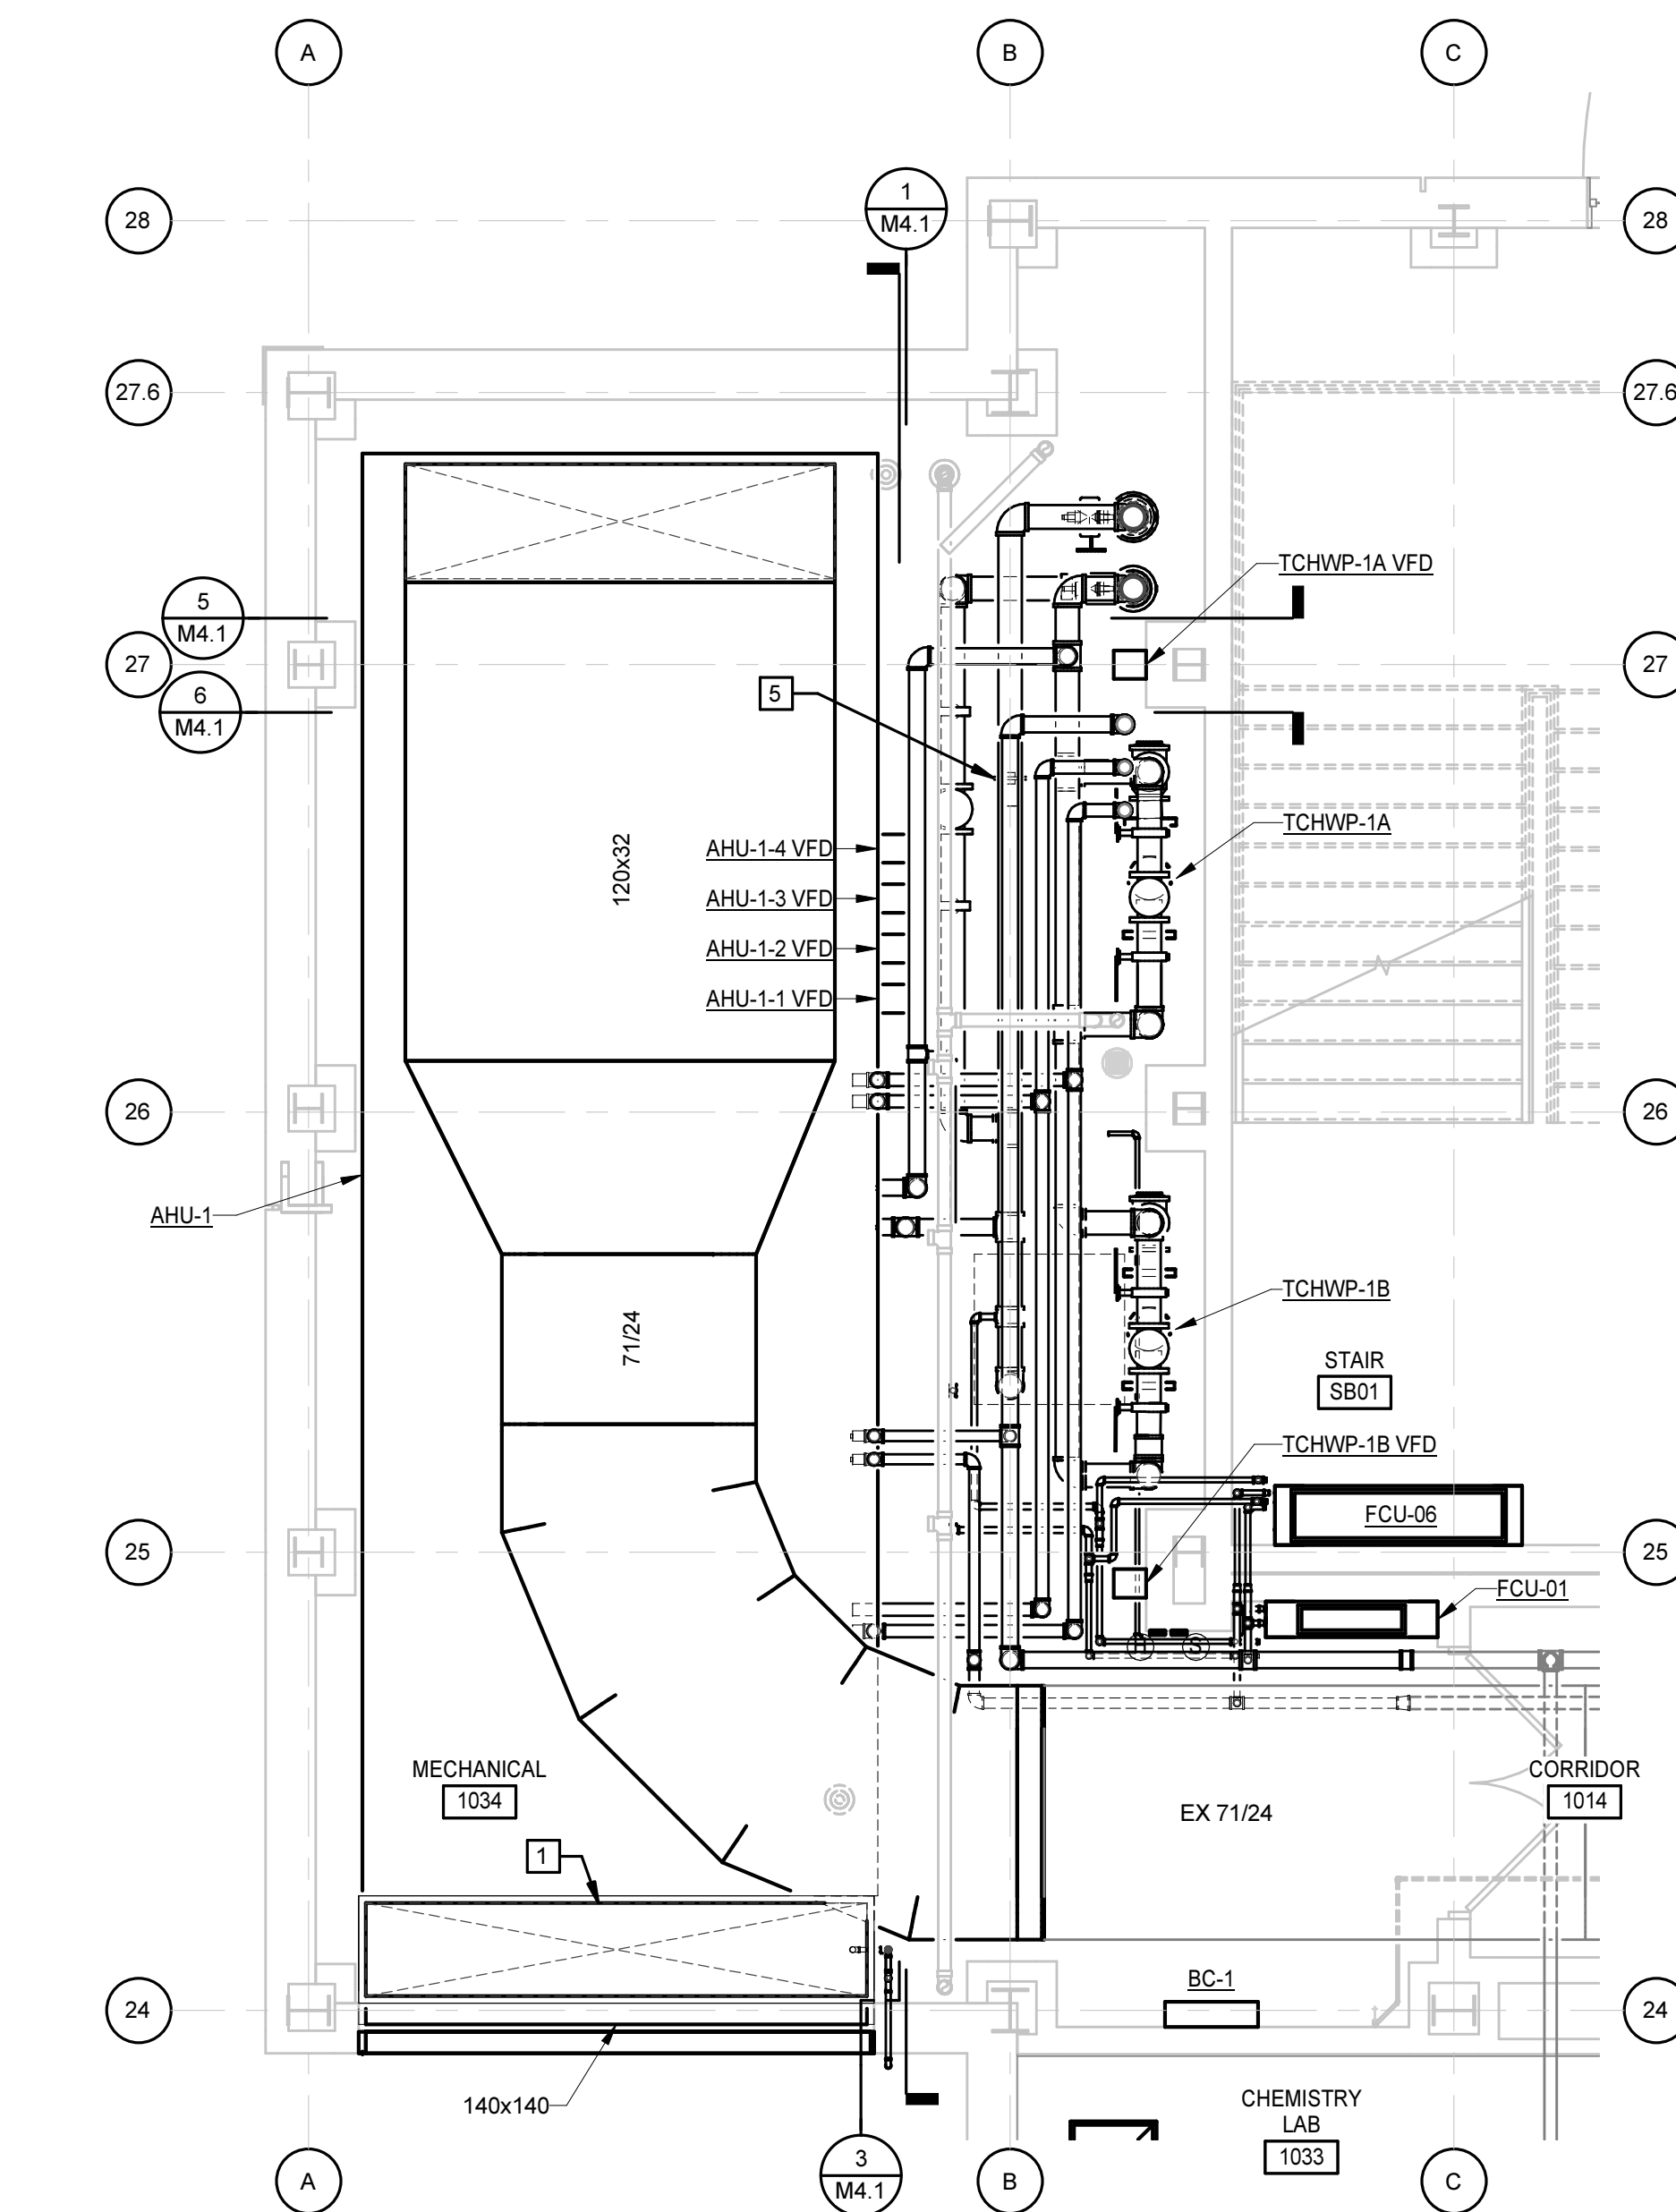


1 ENLARGED PLAN - 10-MECHANICAL - (AHU-1)

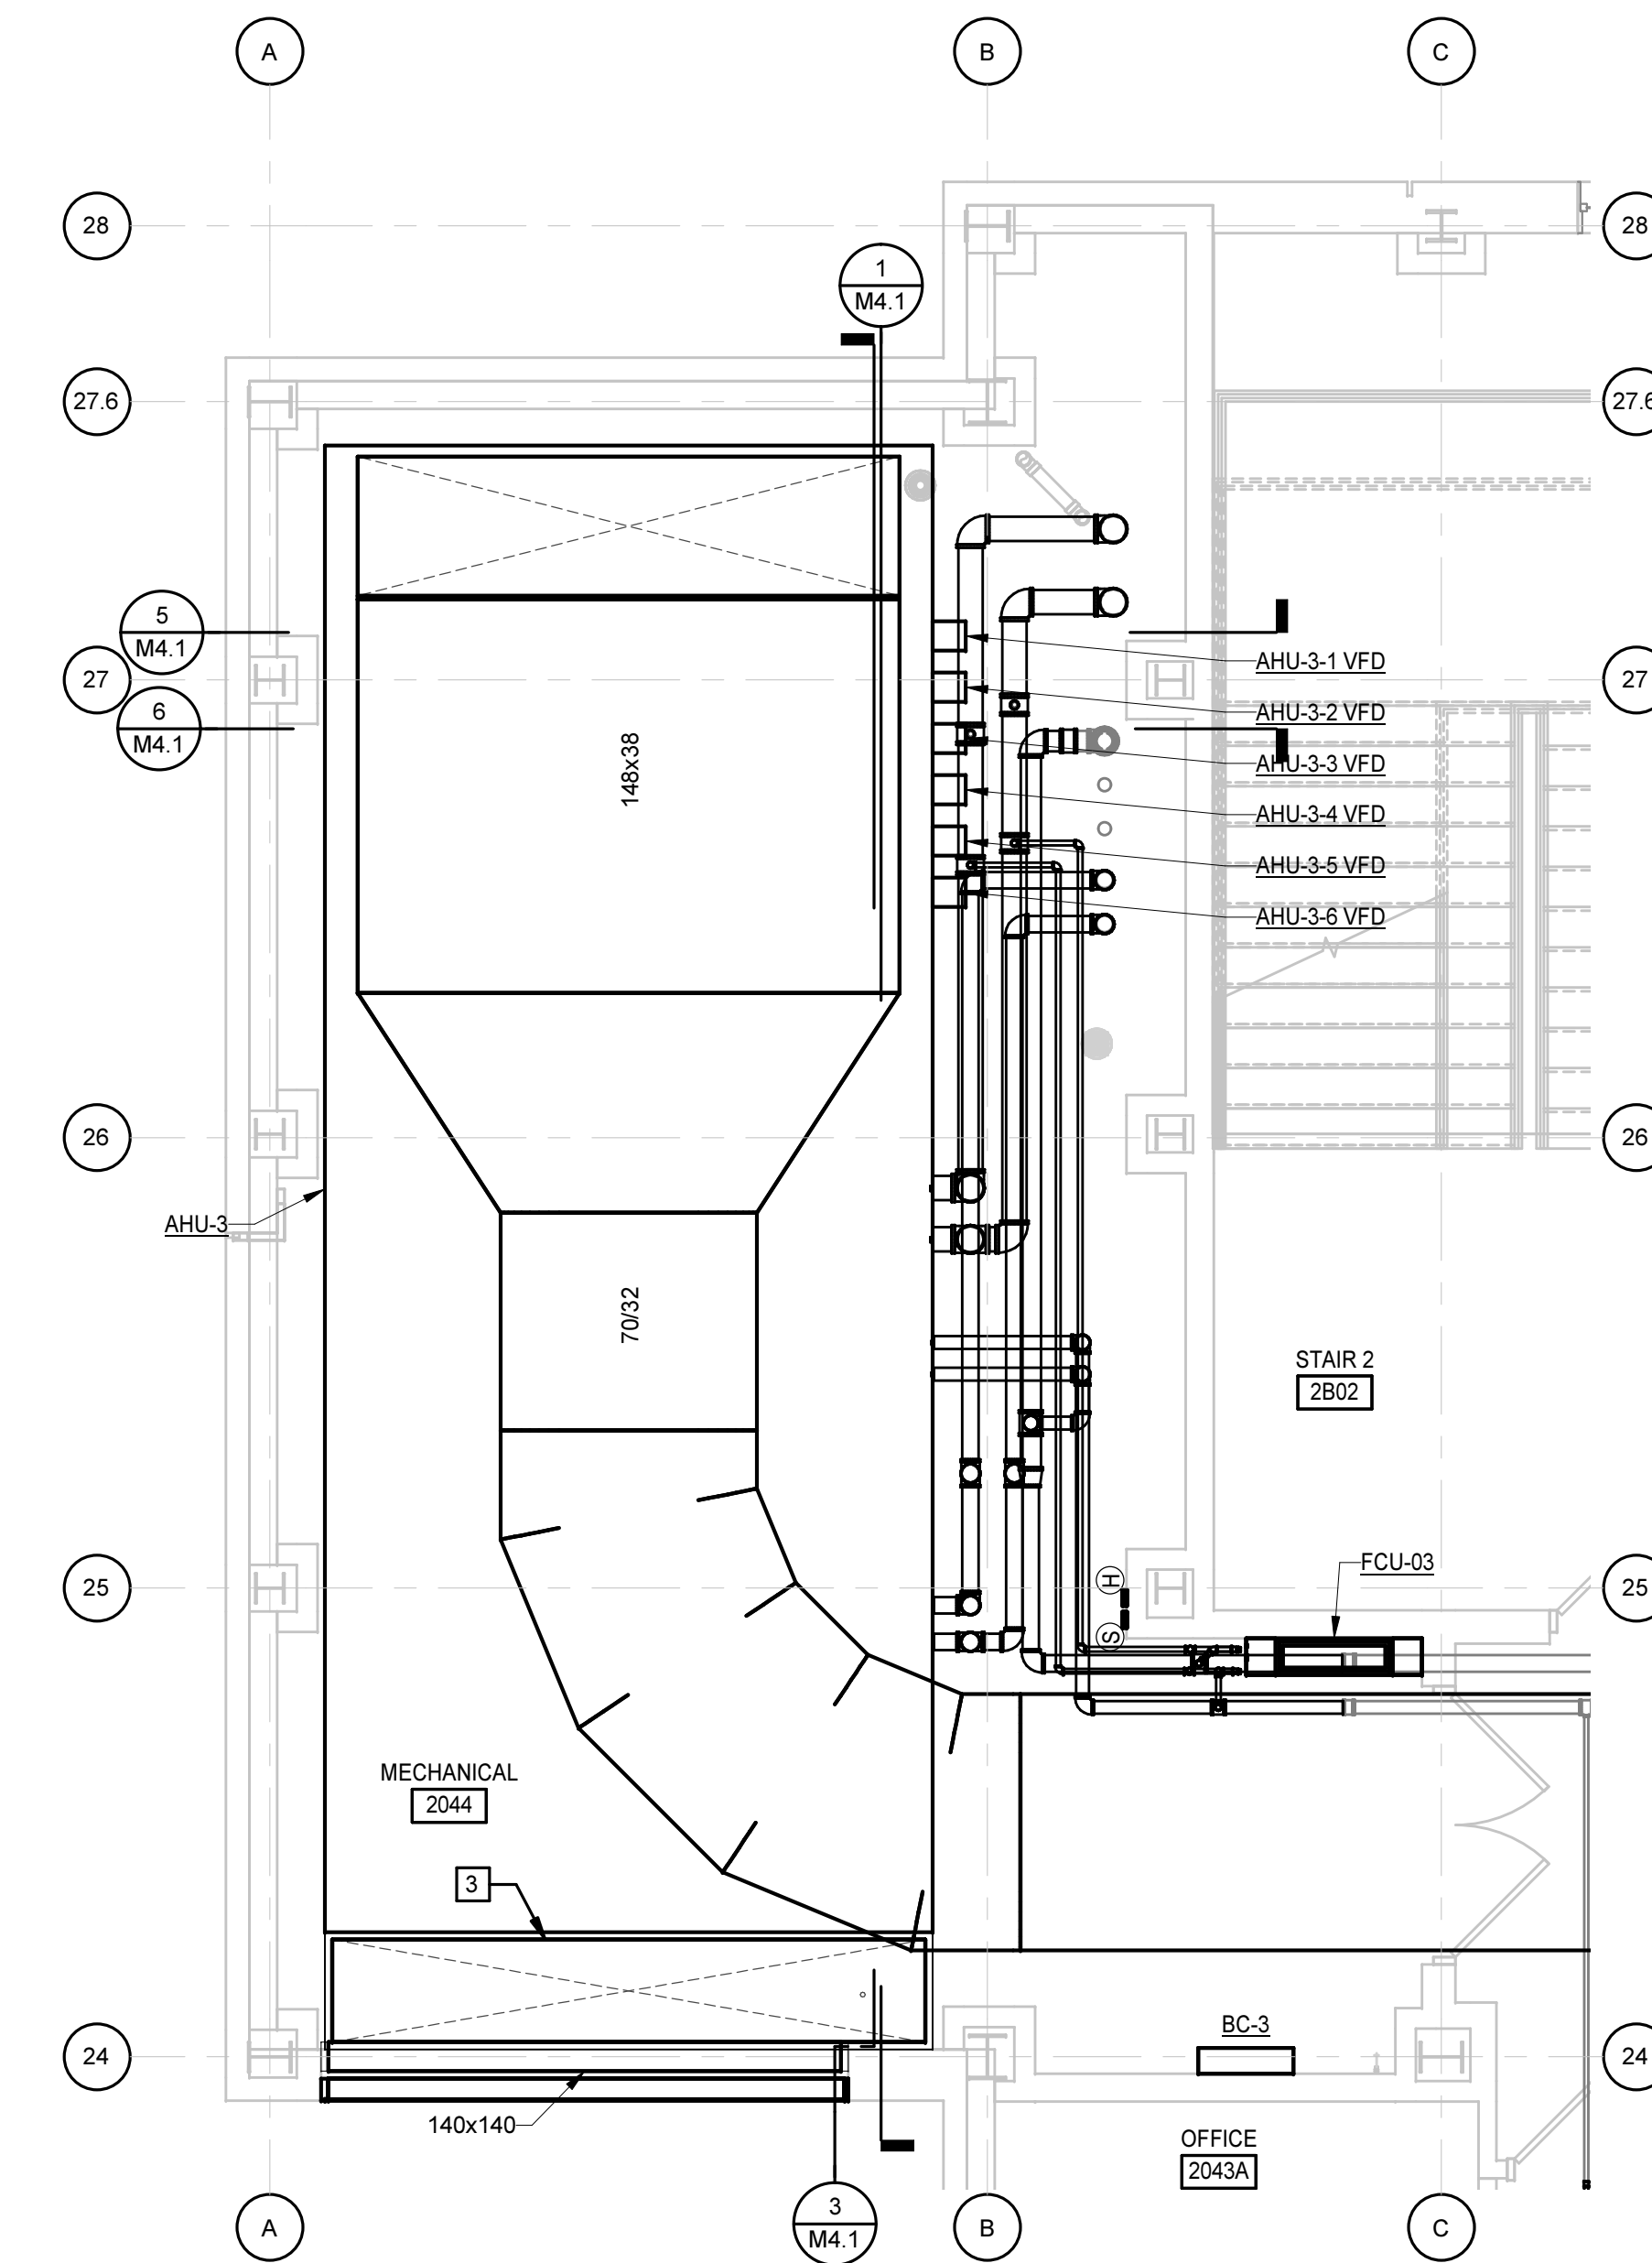


3 ENLARGED PLAN - 30-MECHANICAL - (AHU-3)


KEYNOTES	
APPLIES TO THIS DRAWING	
1	140x26 INSULATED SHEET METAL INTAKE PLENUM. HEIGHT AS INDICATED IN SECTION. PROVIDE ACCESS DOOR FOR CLEANING.
2	140x26 INSULATED SHEET METAL INTAKE PLENUM. HEIGHT AS INDICATED IN SECTION. PROVIDE ACCESS DOOR FOR CLEANING.
3	162x28 INSULATED SHEET METAL INTAKE PLENUM. HEIGHT AS INDICATED IN SECTION. PROVIDE ACCESS DOOR FOR CLEANING.
4	162x24 INSULATED SHEET METAL INTAKE PLENUM. HEIGHT AS INDICATED IN SECTION. PROVIDE ACCESS DOOR FOR CLEANING.
5	INSTALL CHILLED WATER FLOW/BTU METER IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS.

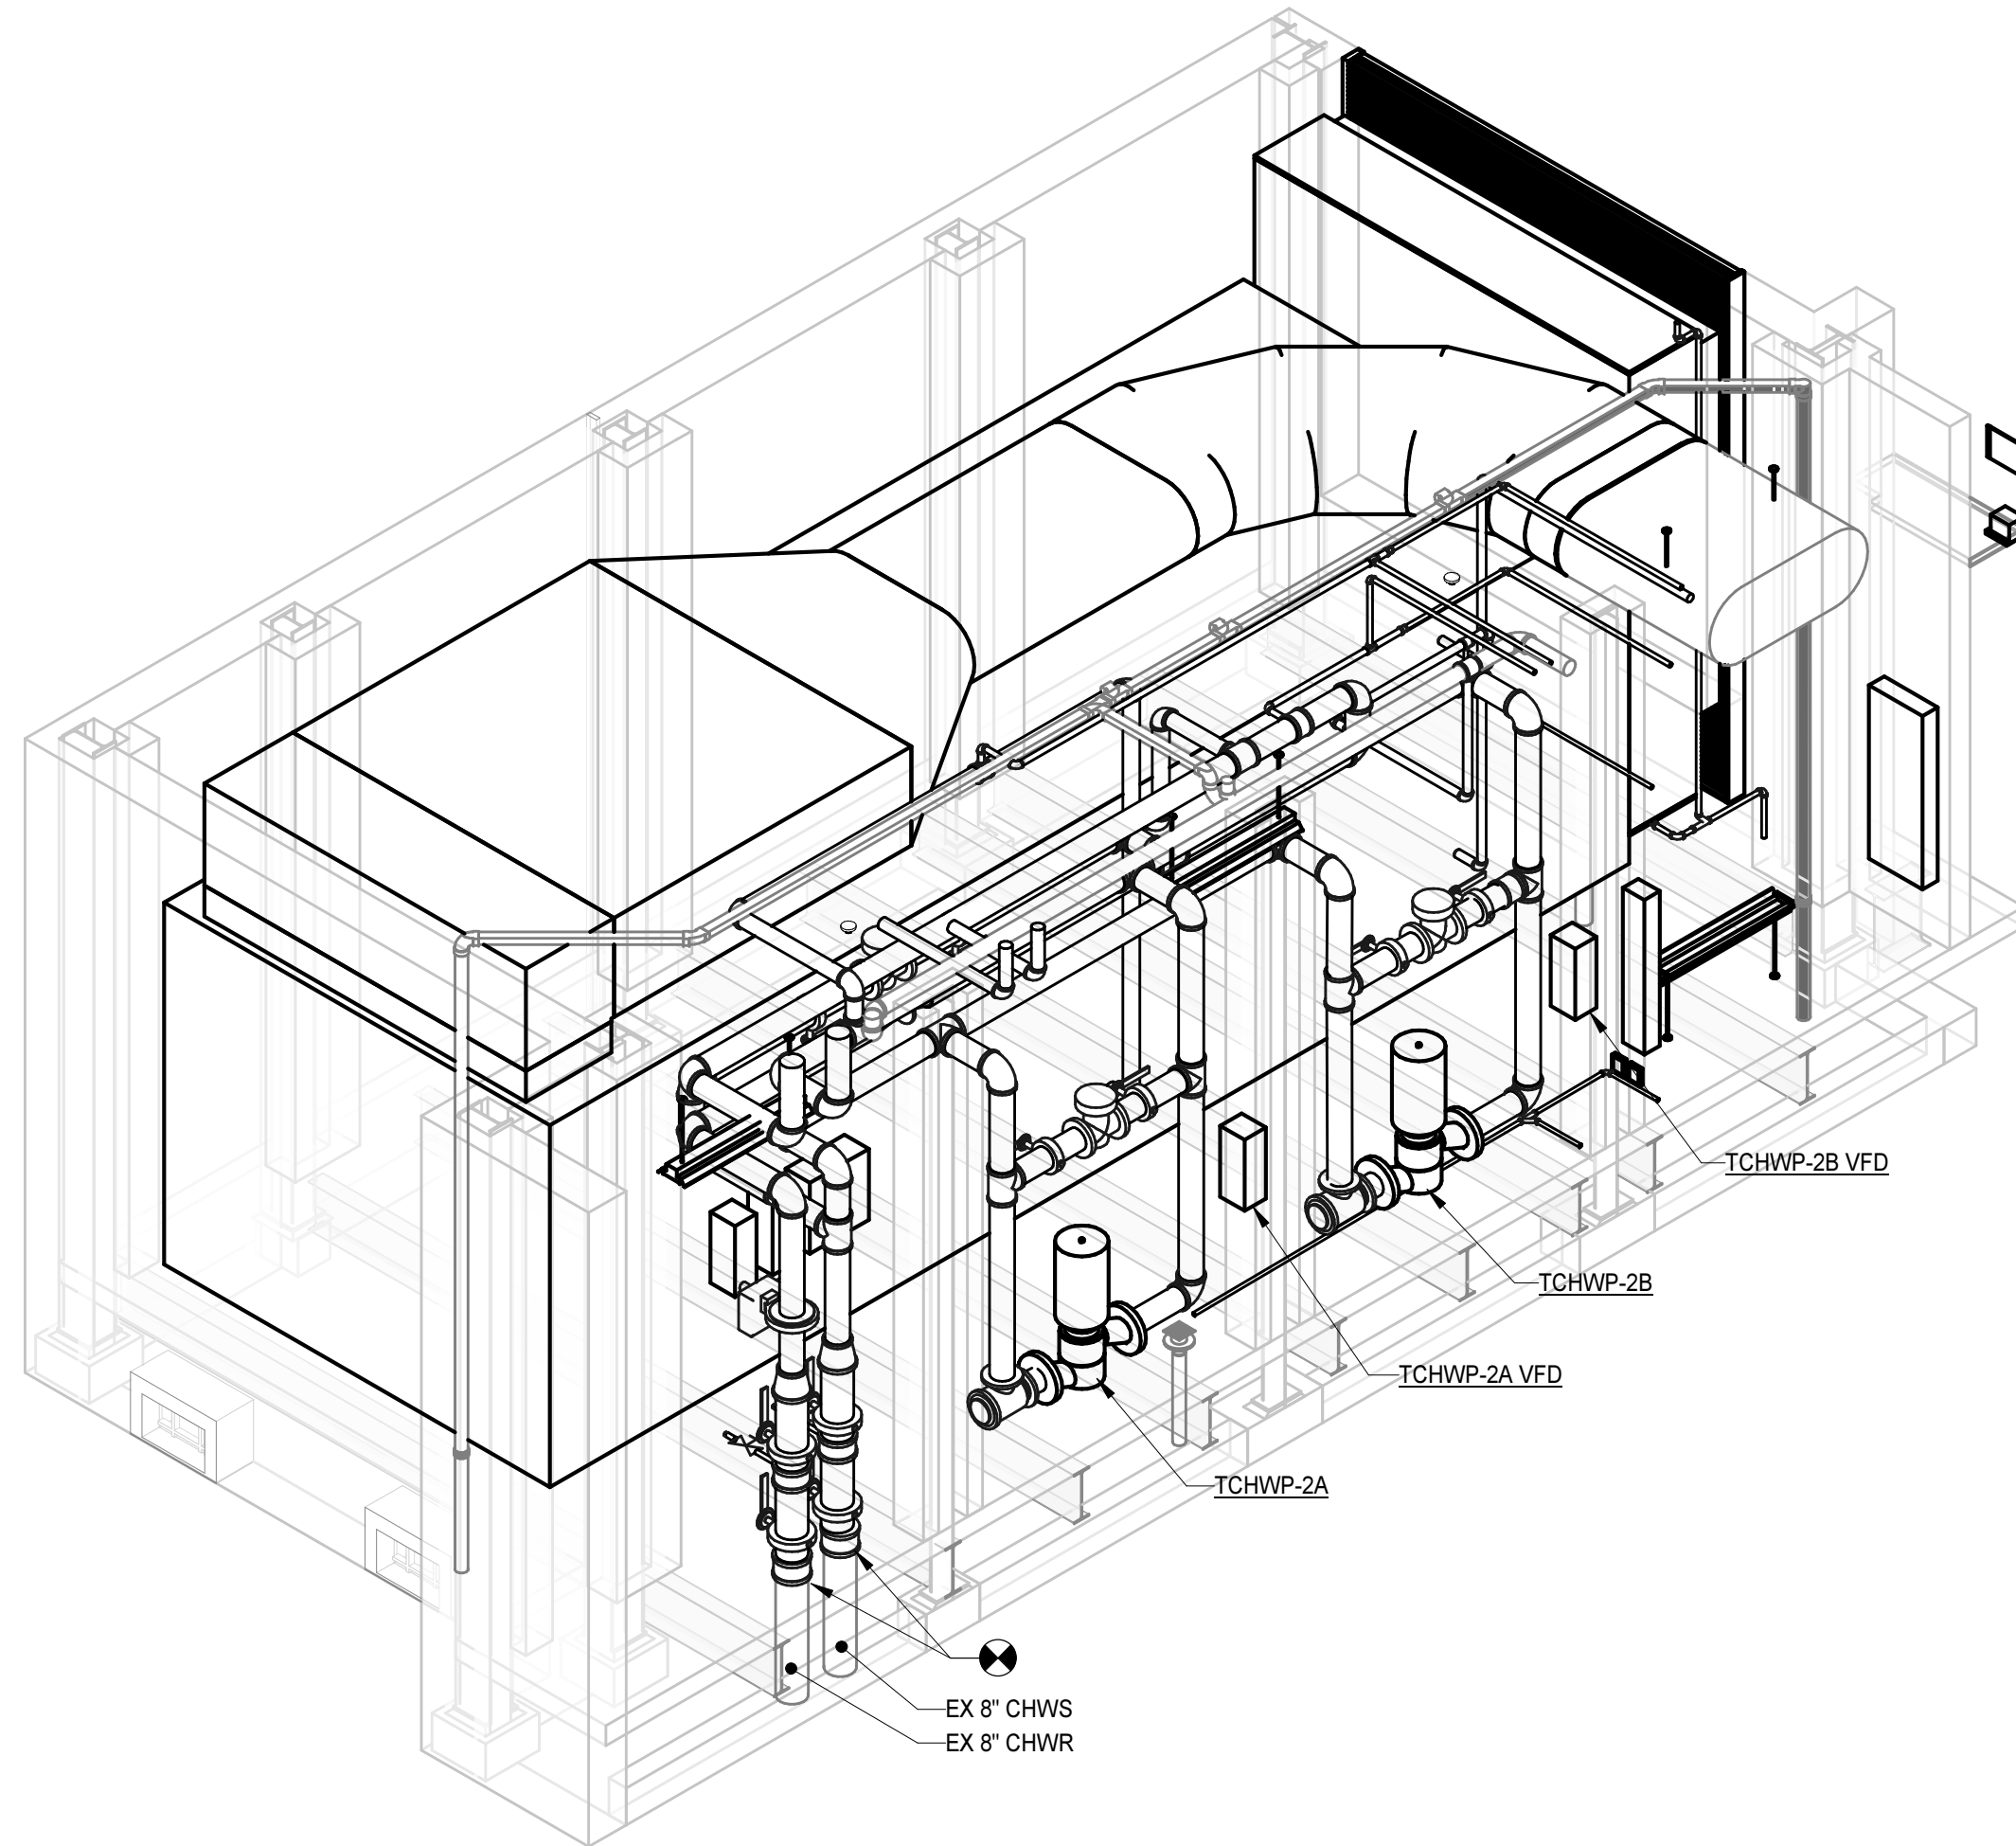

6 AHU-2 ISOMETRIC

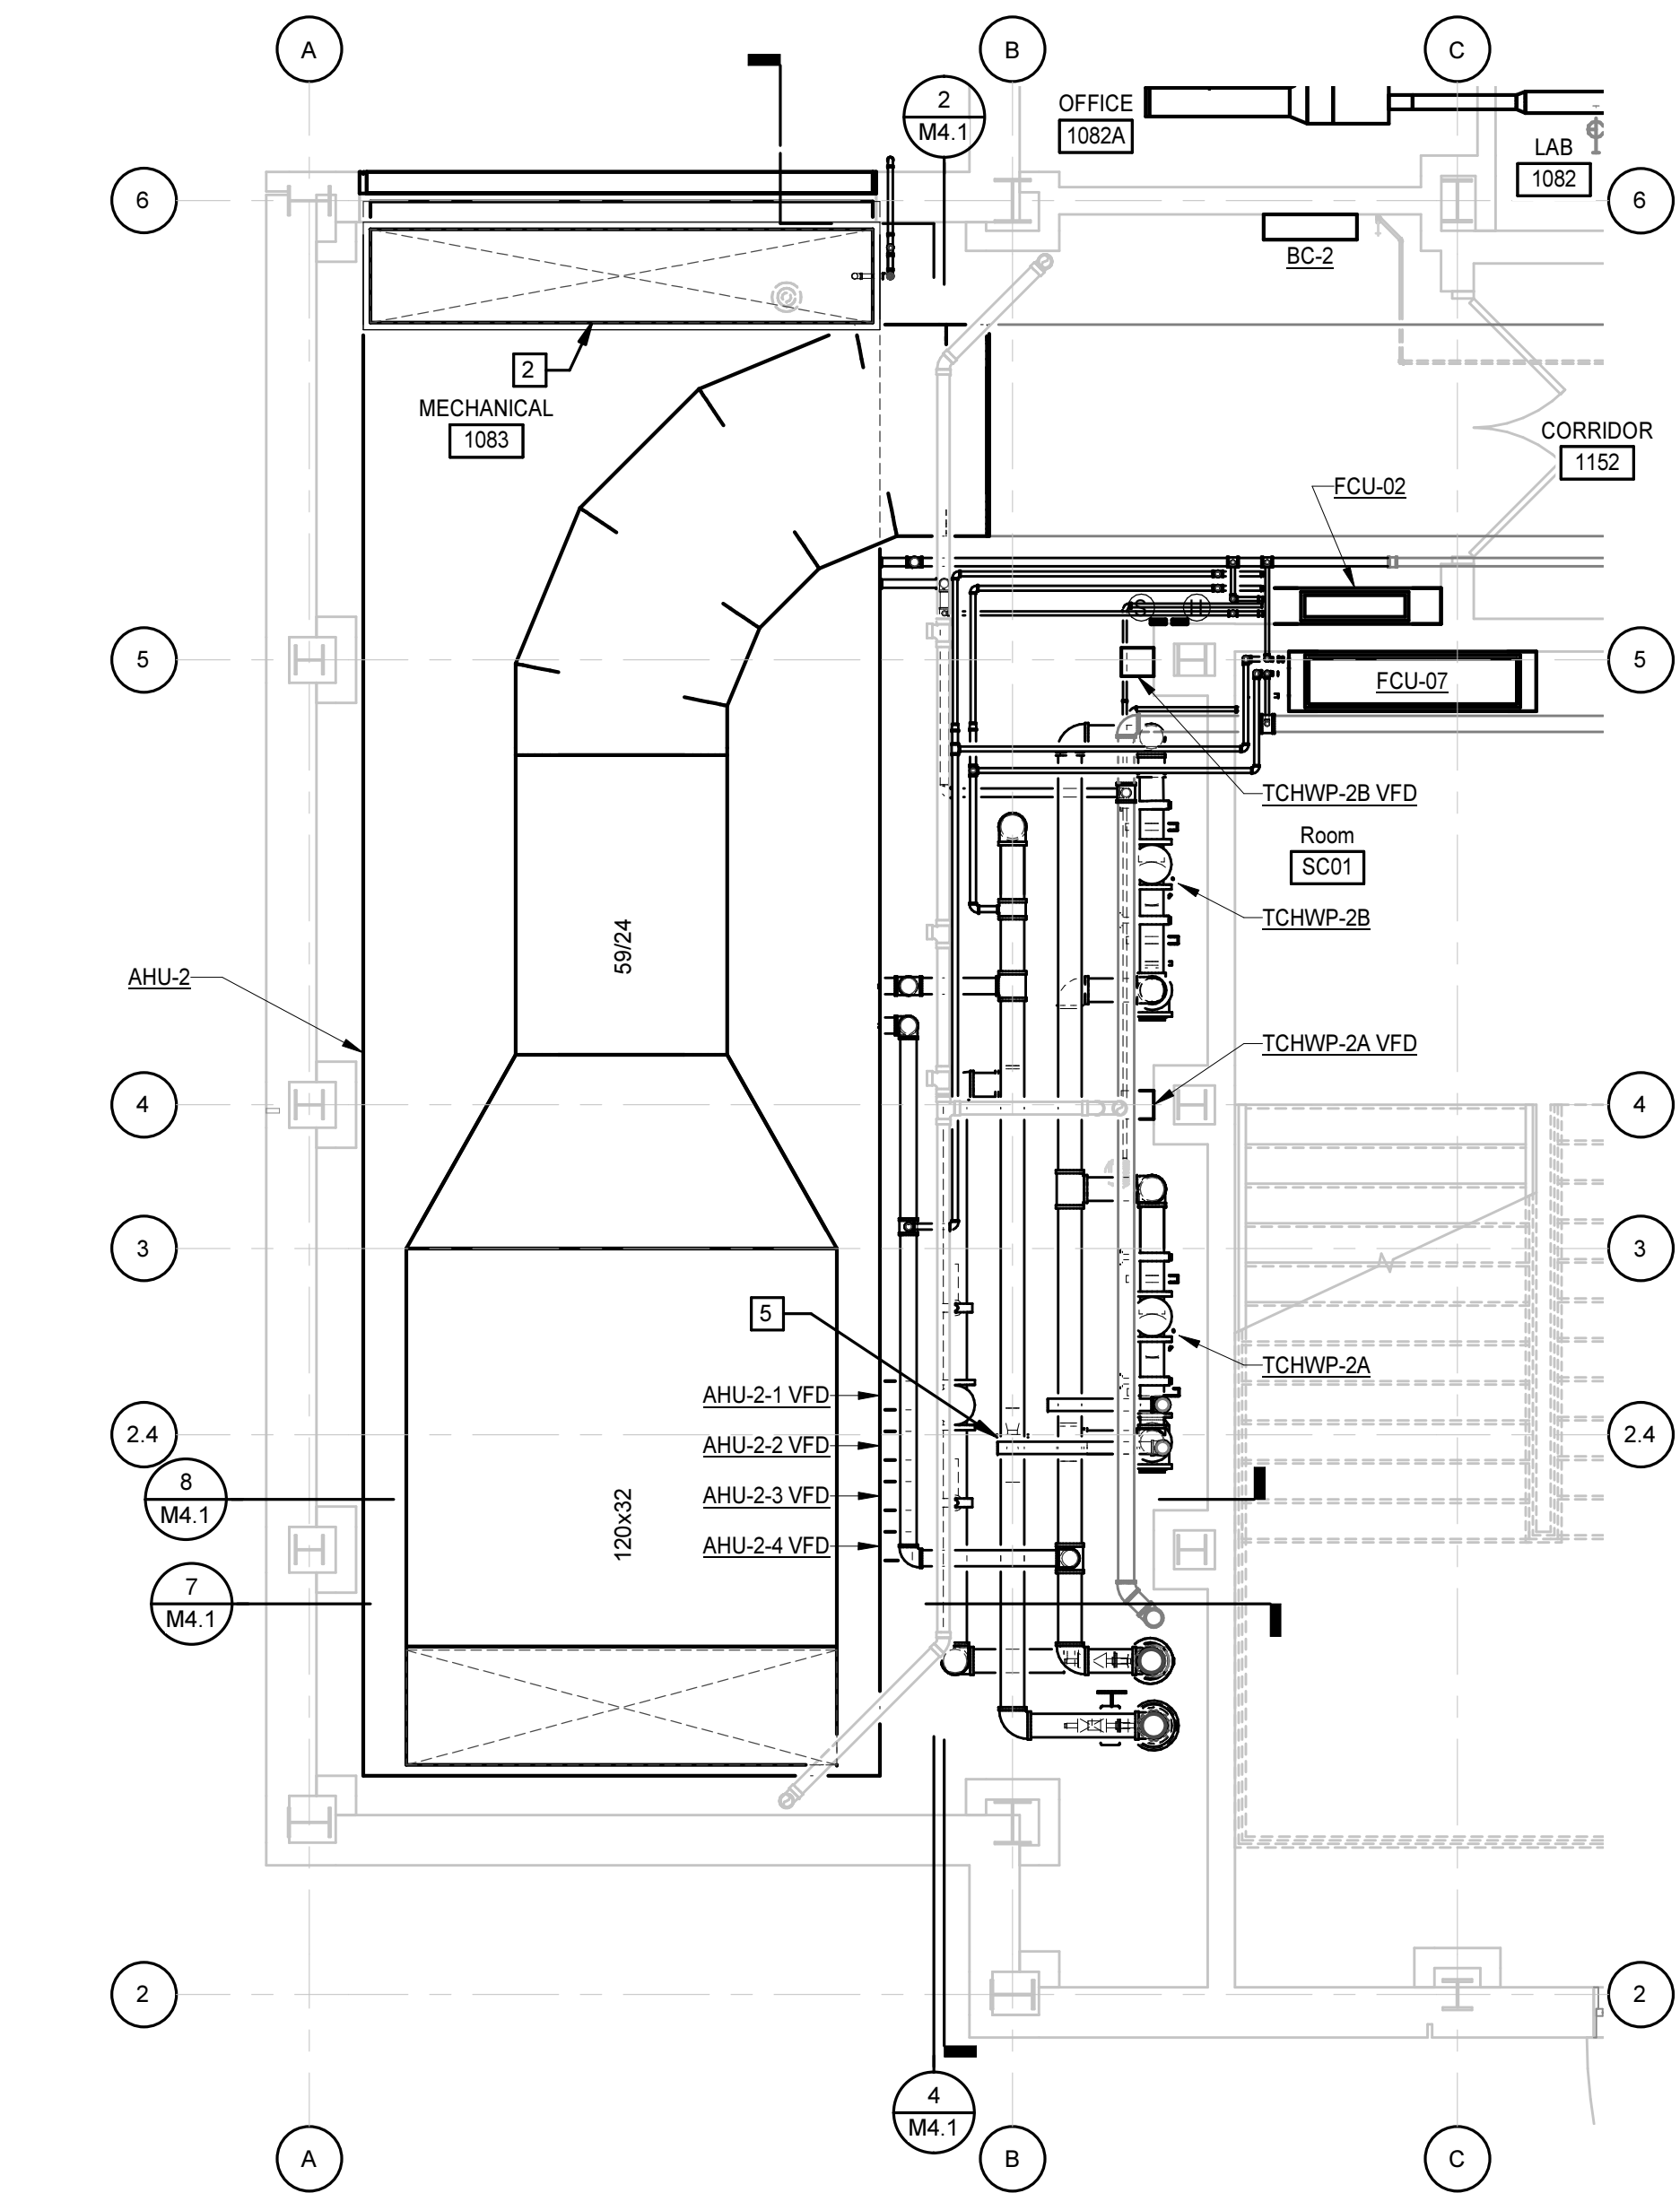

2 ENLARGED PLAN - 27-MECHANICAL - (AHU-2)

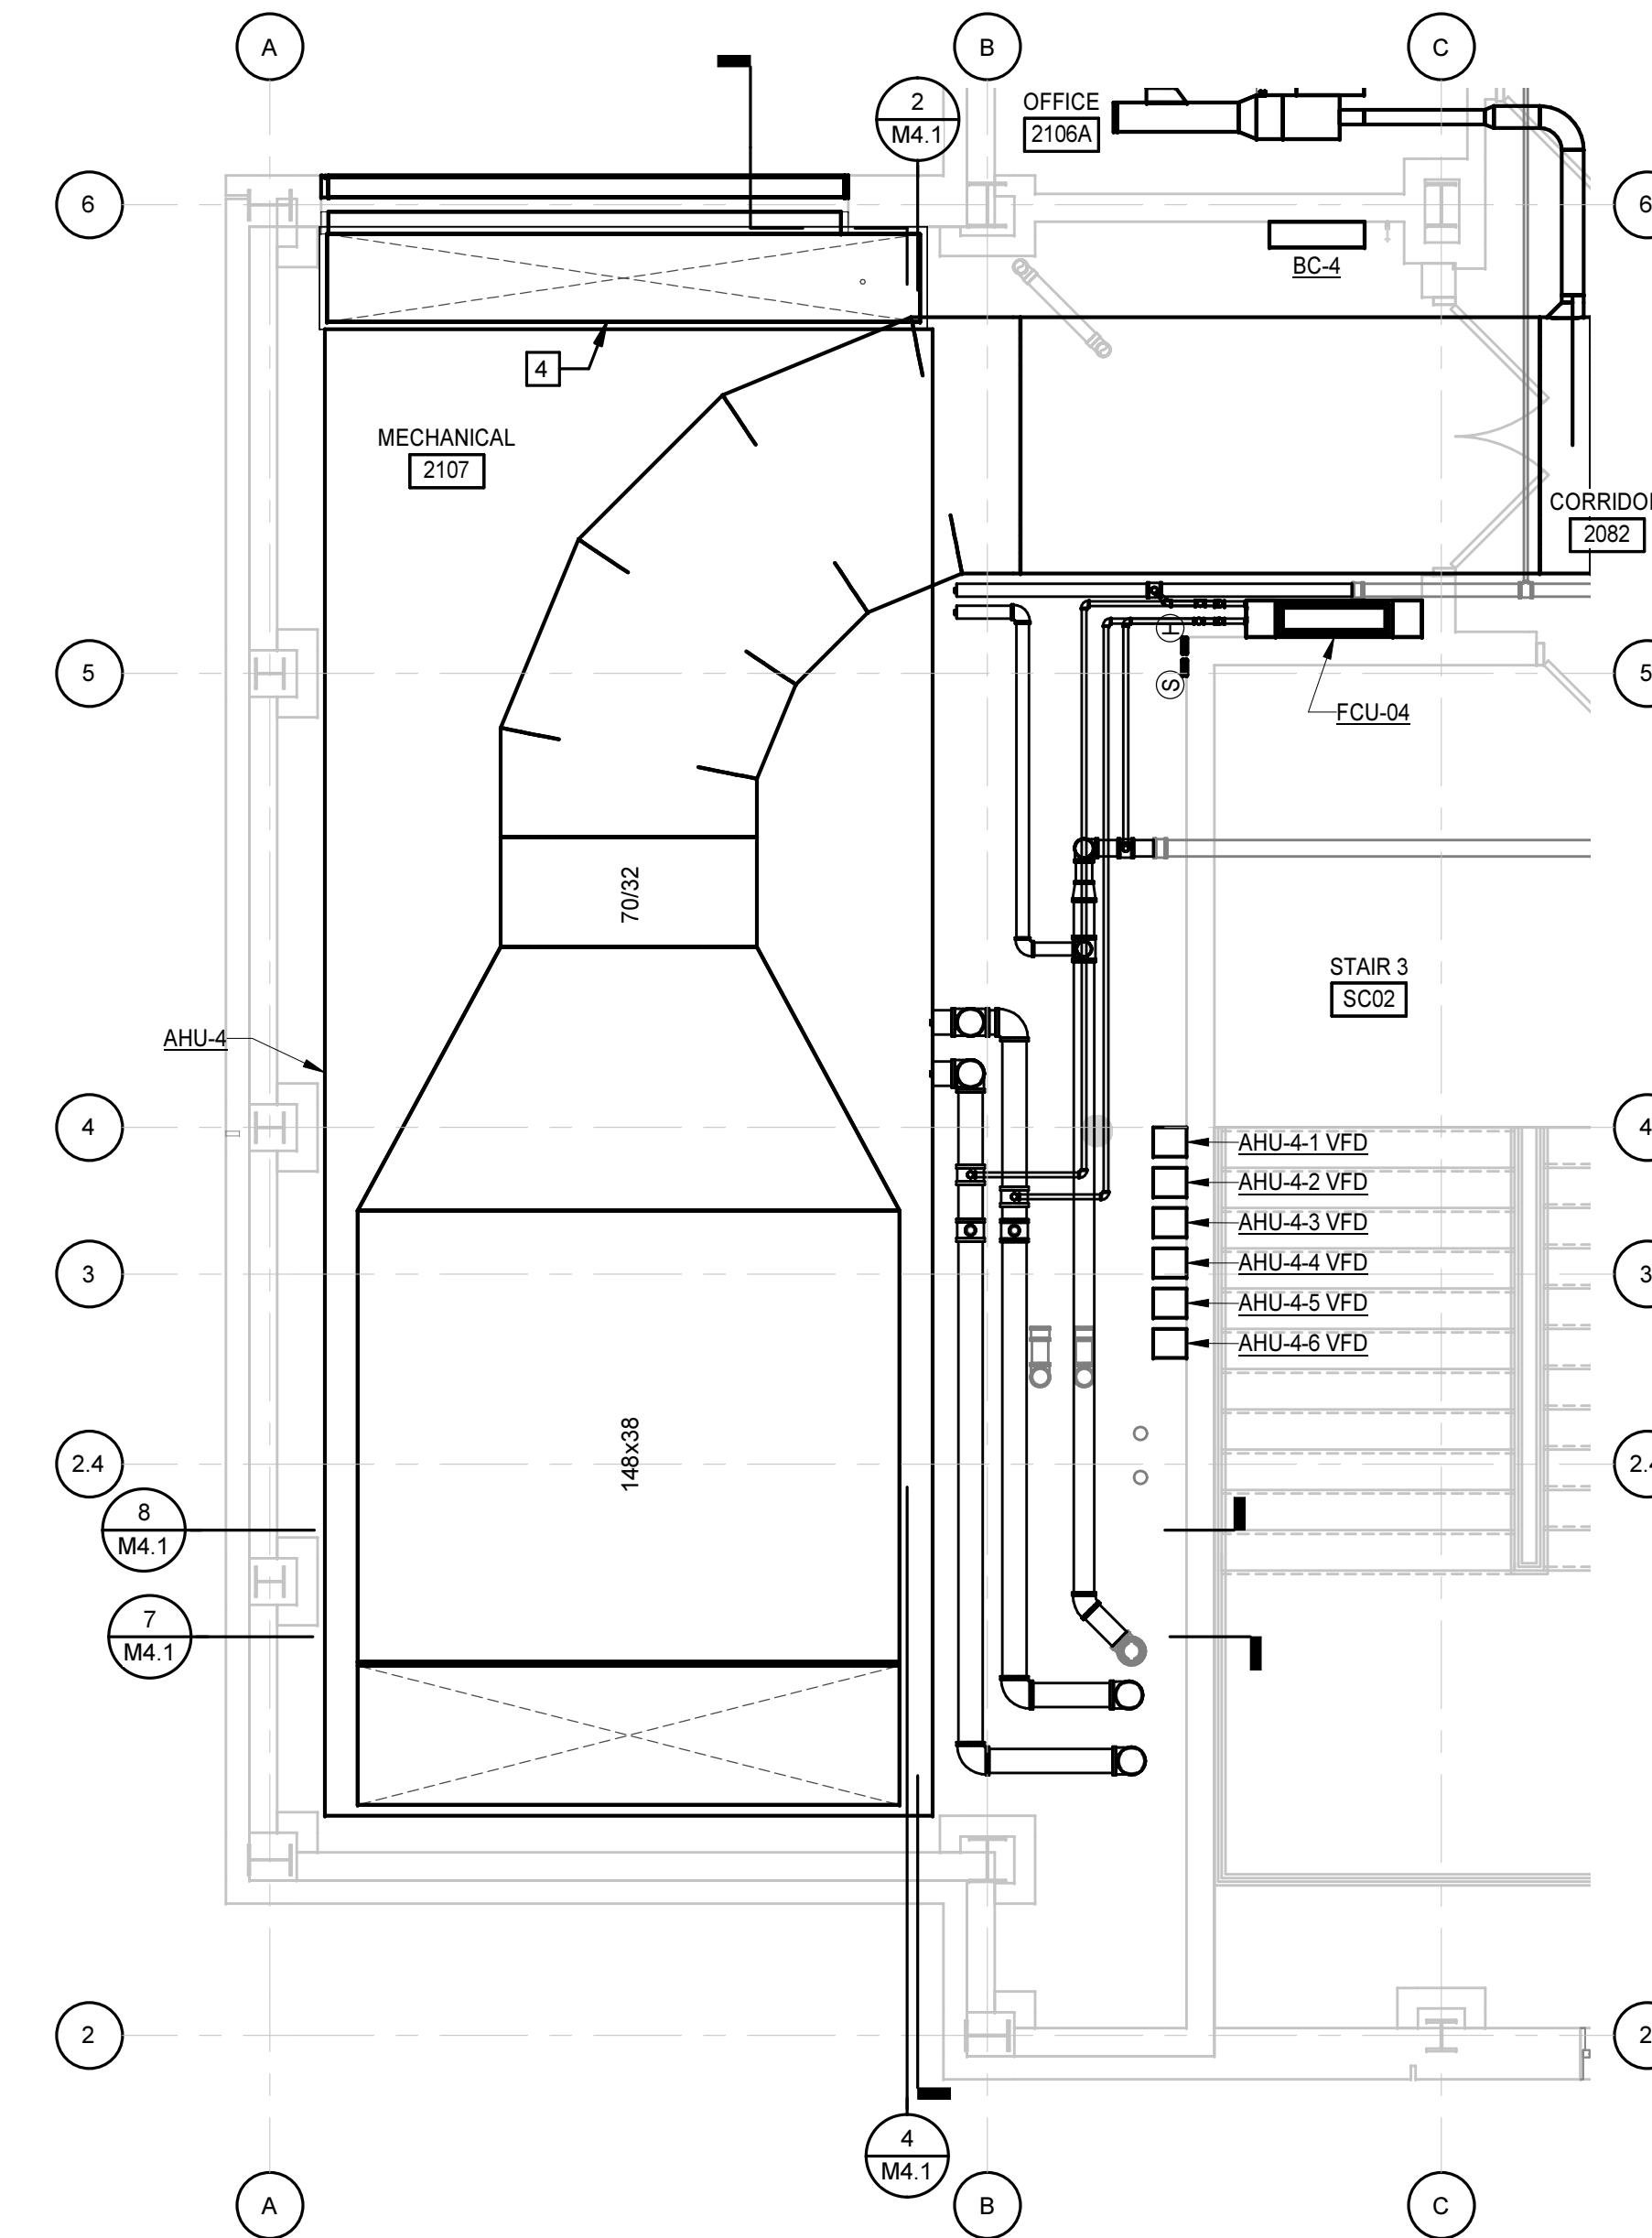

4 ENLARGED PLAN - 47-MECHANICAL - (AHU-4)

MOSELEYARCHITECTS

PROGRESS
PRINT, NOT FOR
CONSTRUCTION

Dobo Hall Renovation - Package A

SCO PROJECT NO. 18-19798-01A

UNC Wilmington

4978 CAHILL DR, WILMINGTON, NC 28403

PROJECT NO.	DATE
580999	MARCH 27, 2019
REVISIONS	
DATE	DESCRIPTION

ENLARGED PLANS

M3.2