
SWEENEY WATER TREATMENT PLANT BOILER REPLACEMENT

FOR CAPE FEAR PUBLIC UTILITY AUTHORITY

at 1833 N. 5th Avenue Wilmington, NC 28401







DRAWING INDEX

COVER SHEET
G001 DRAWING

G001 DRAWING INDEX

MECHANICAL

M-001 GENERAL NOTES, LEGEND, ABBREVIATIONS AND DEMOLITION NOTES MD101 PARTIAL FIRST FLOOR PLAN DEMOLITION

101 PARTIAL FIRST FLOOR PLAN DEMOLITI 01 PARTIAL FIRST FLOOR PLAN

M-501 DETAILS

M-601 SCHEDULES

ELECTRICAL EL

E-001 ELECTRICAL LEGEND, ABBREVIATIONS, PANEL SCHEDULES AND LOAD SUMMARIES

E-002 ELECTRICAL GENERAL NOTES
ED101 FIRST FLOOR PLAN DEMOLITION
EP101 FIRST FLOOR PLAN POWER

0 3/27/19 ISSUED FOR CONSTRUCTION


REVISION DATE REVISION DESCRIPTION


SWEENEY WTP
BOILER REPLACEMENT


CAPE FEAR PUBLIC UTILITY AUTHORITY


235 GOVERNMENT CENTER DRIVE
WILMINGTON, NC 28403
OFFICE: 910-332-6560


© Copyright 2019 CBHF Engineers, PLLC

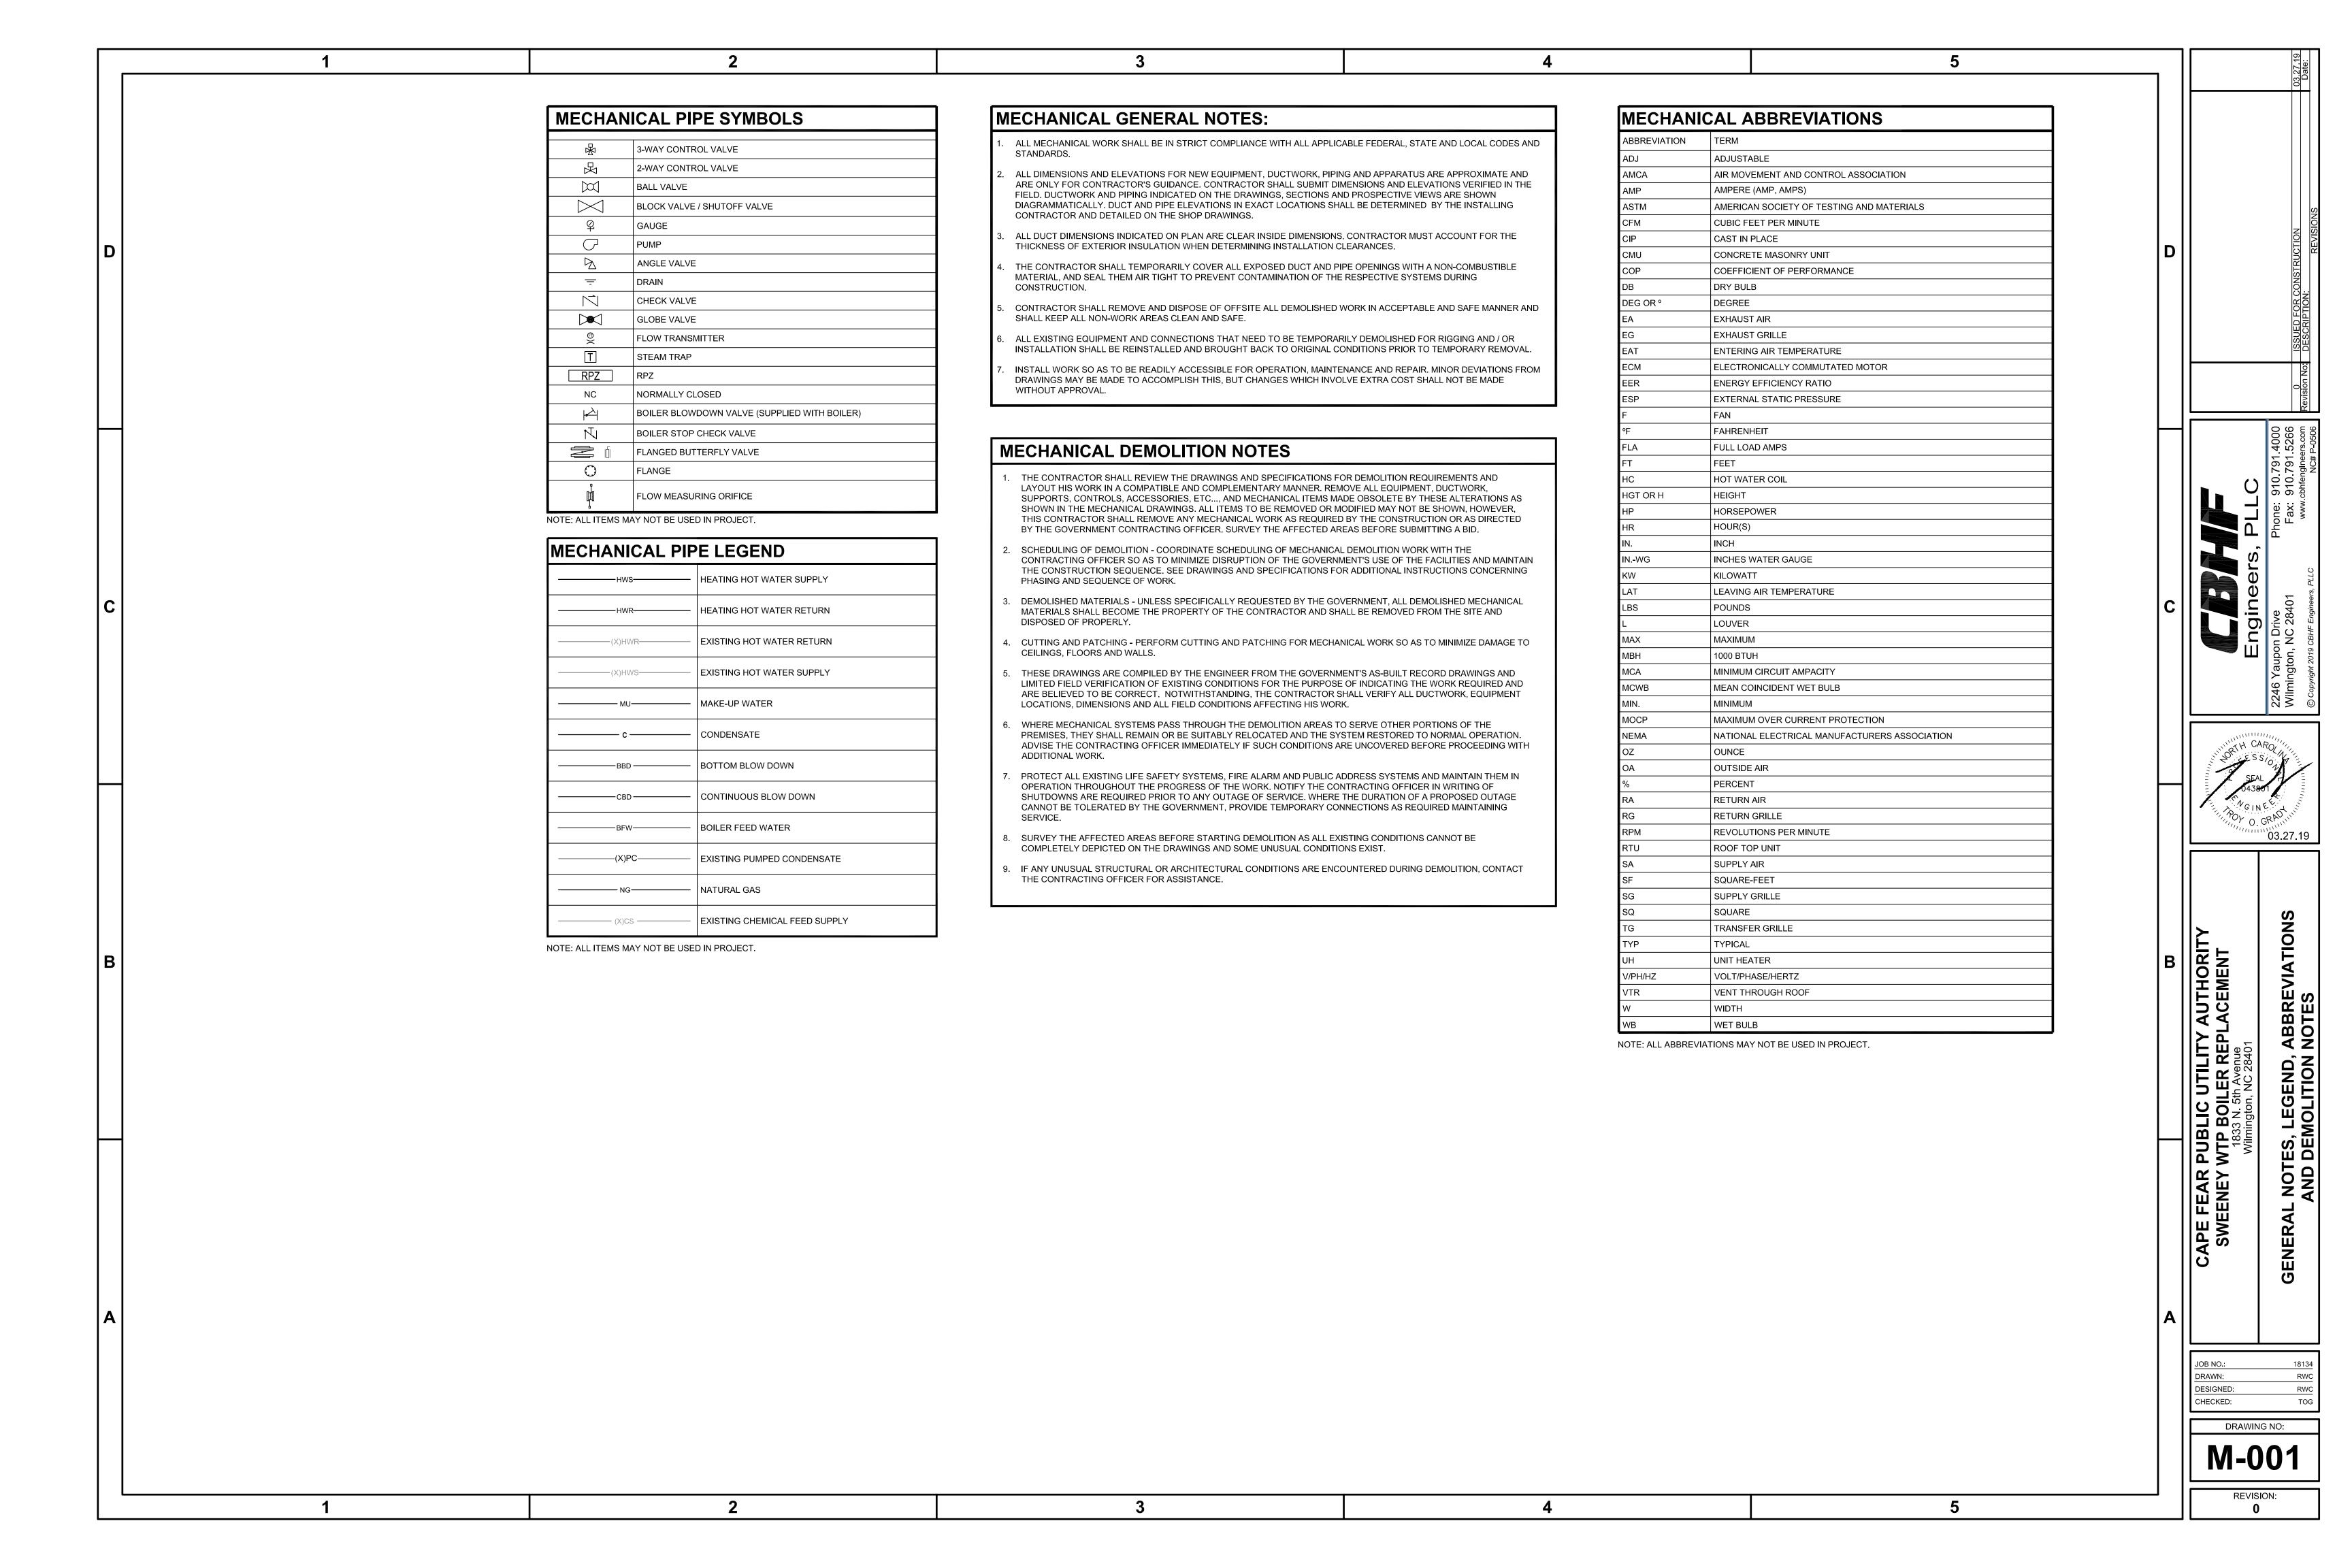


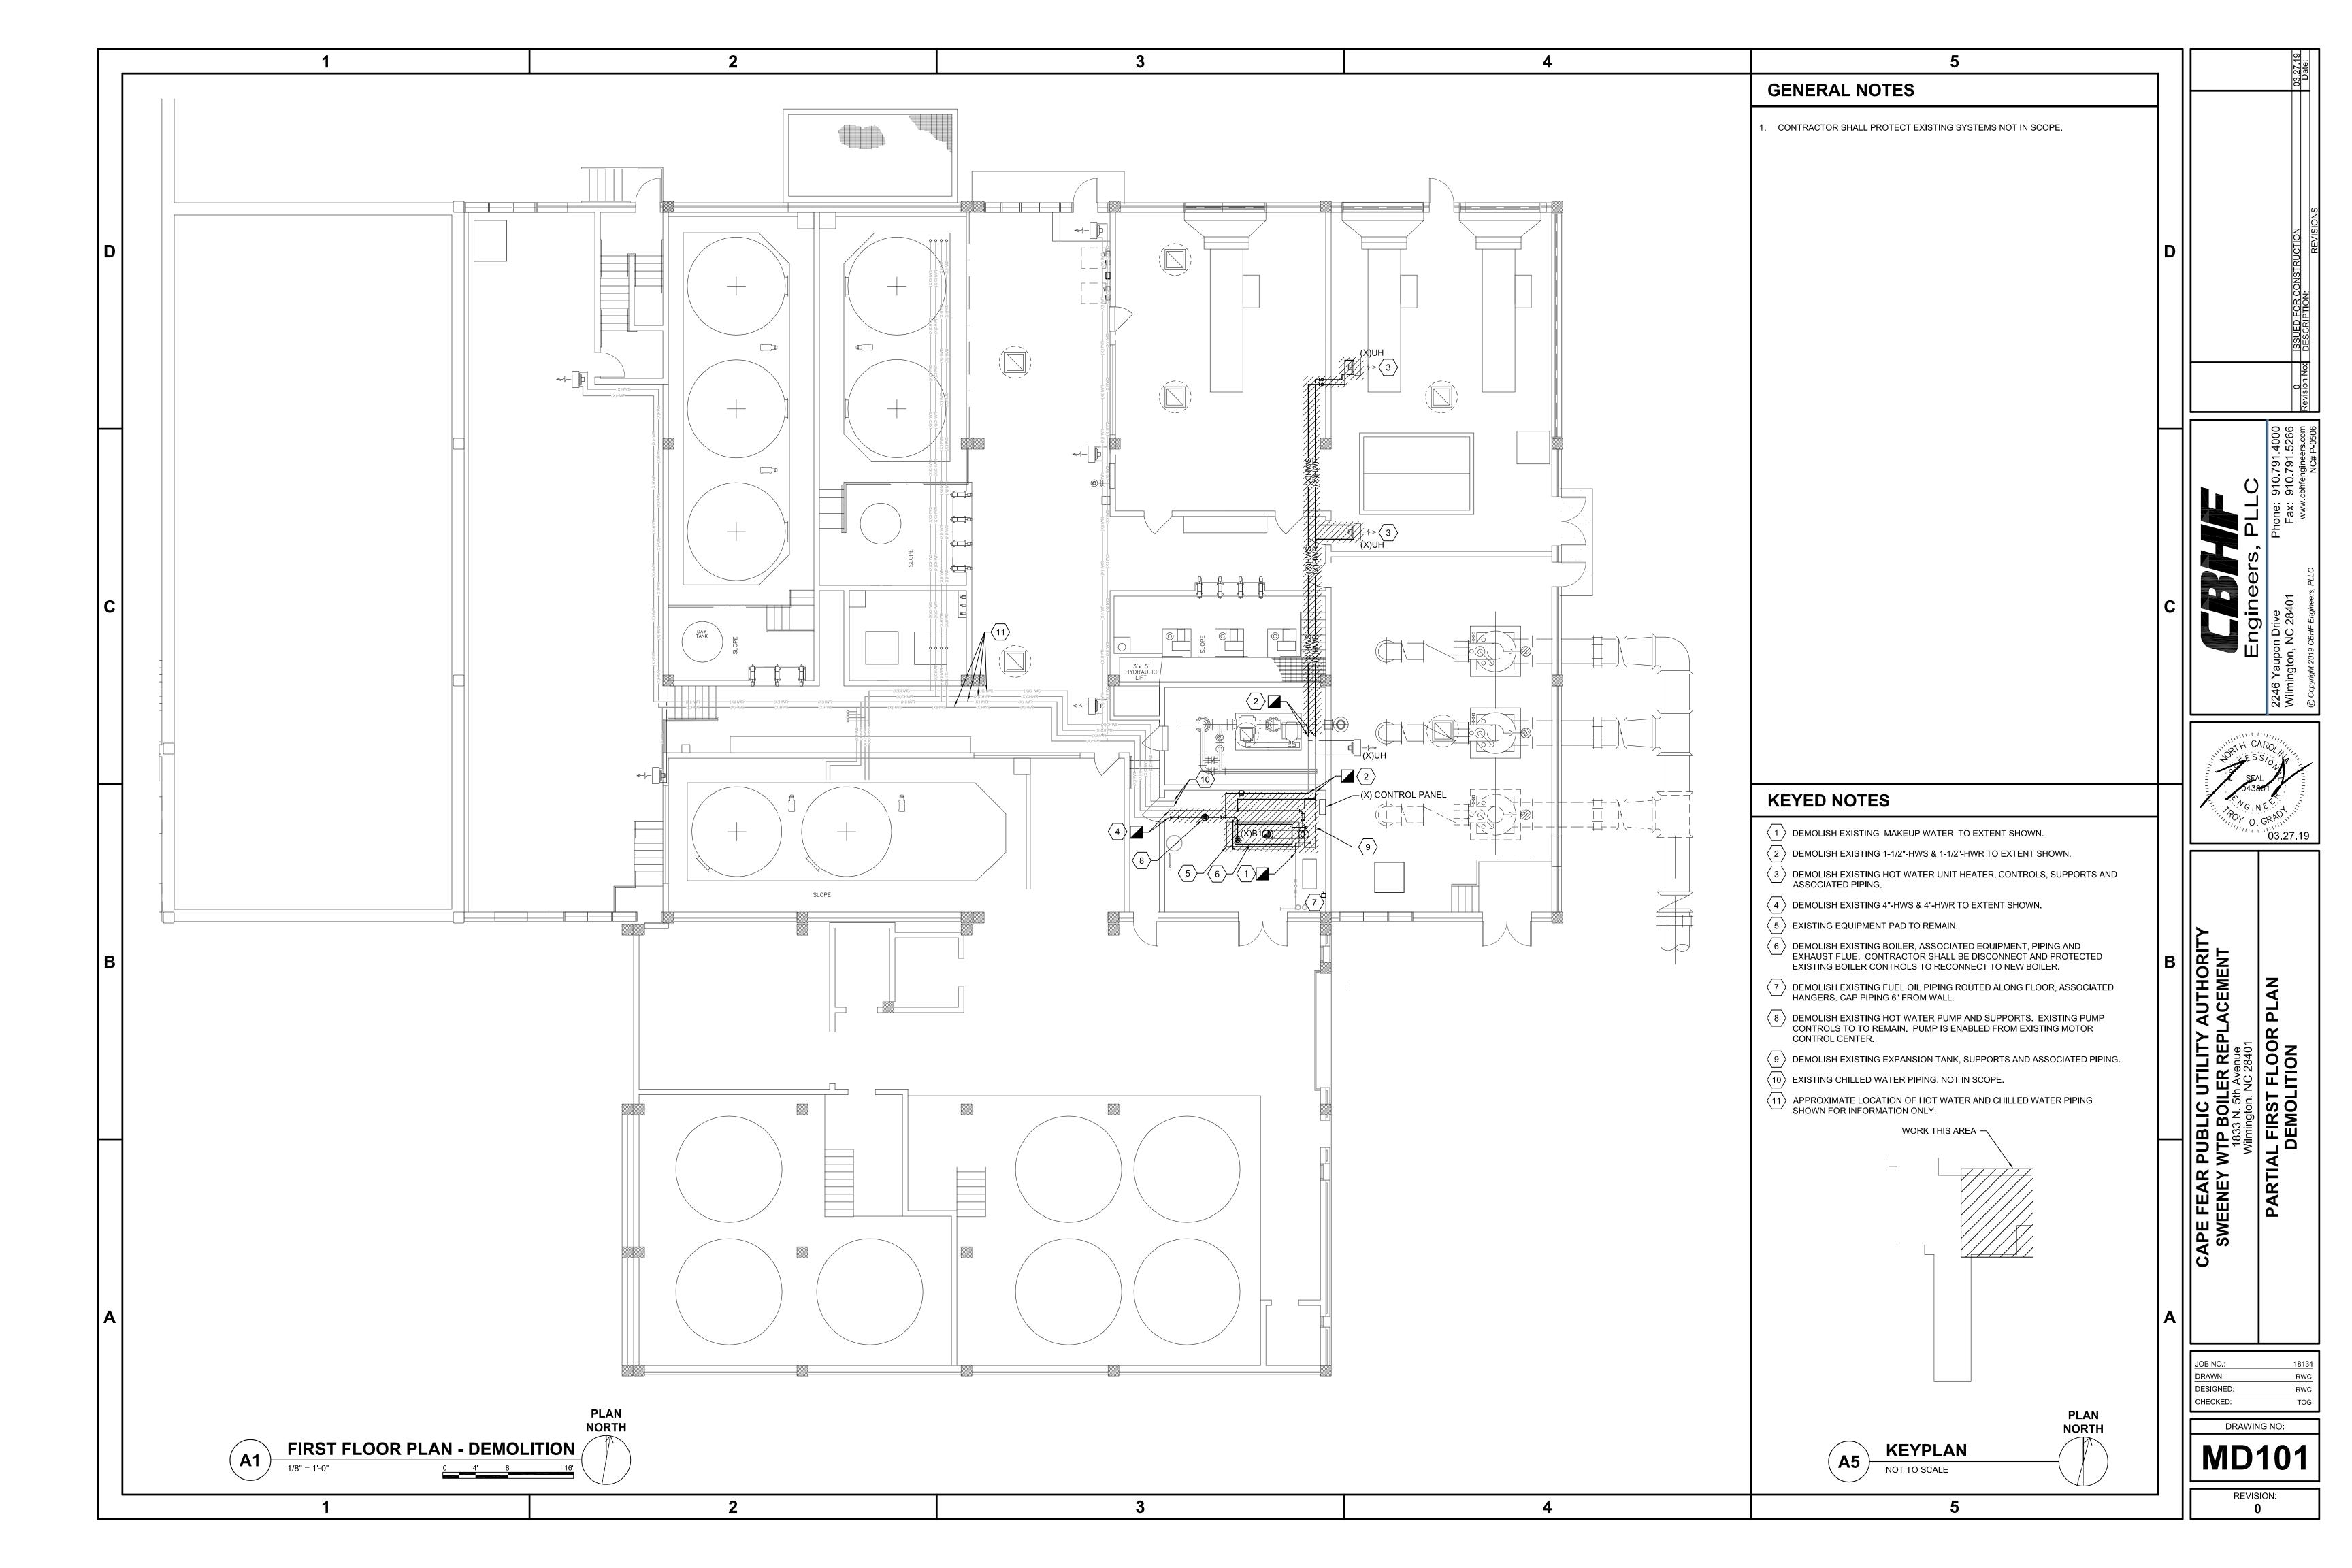

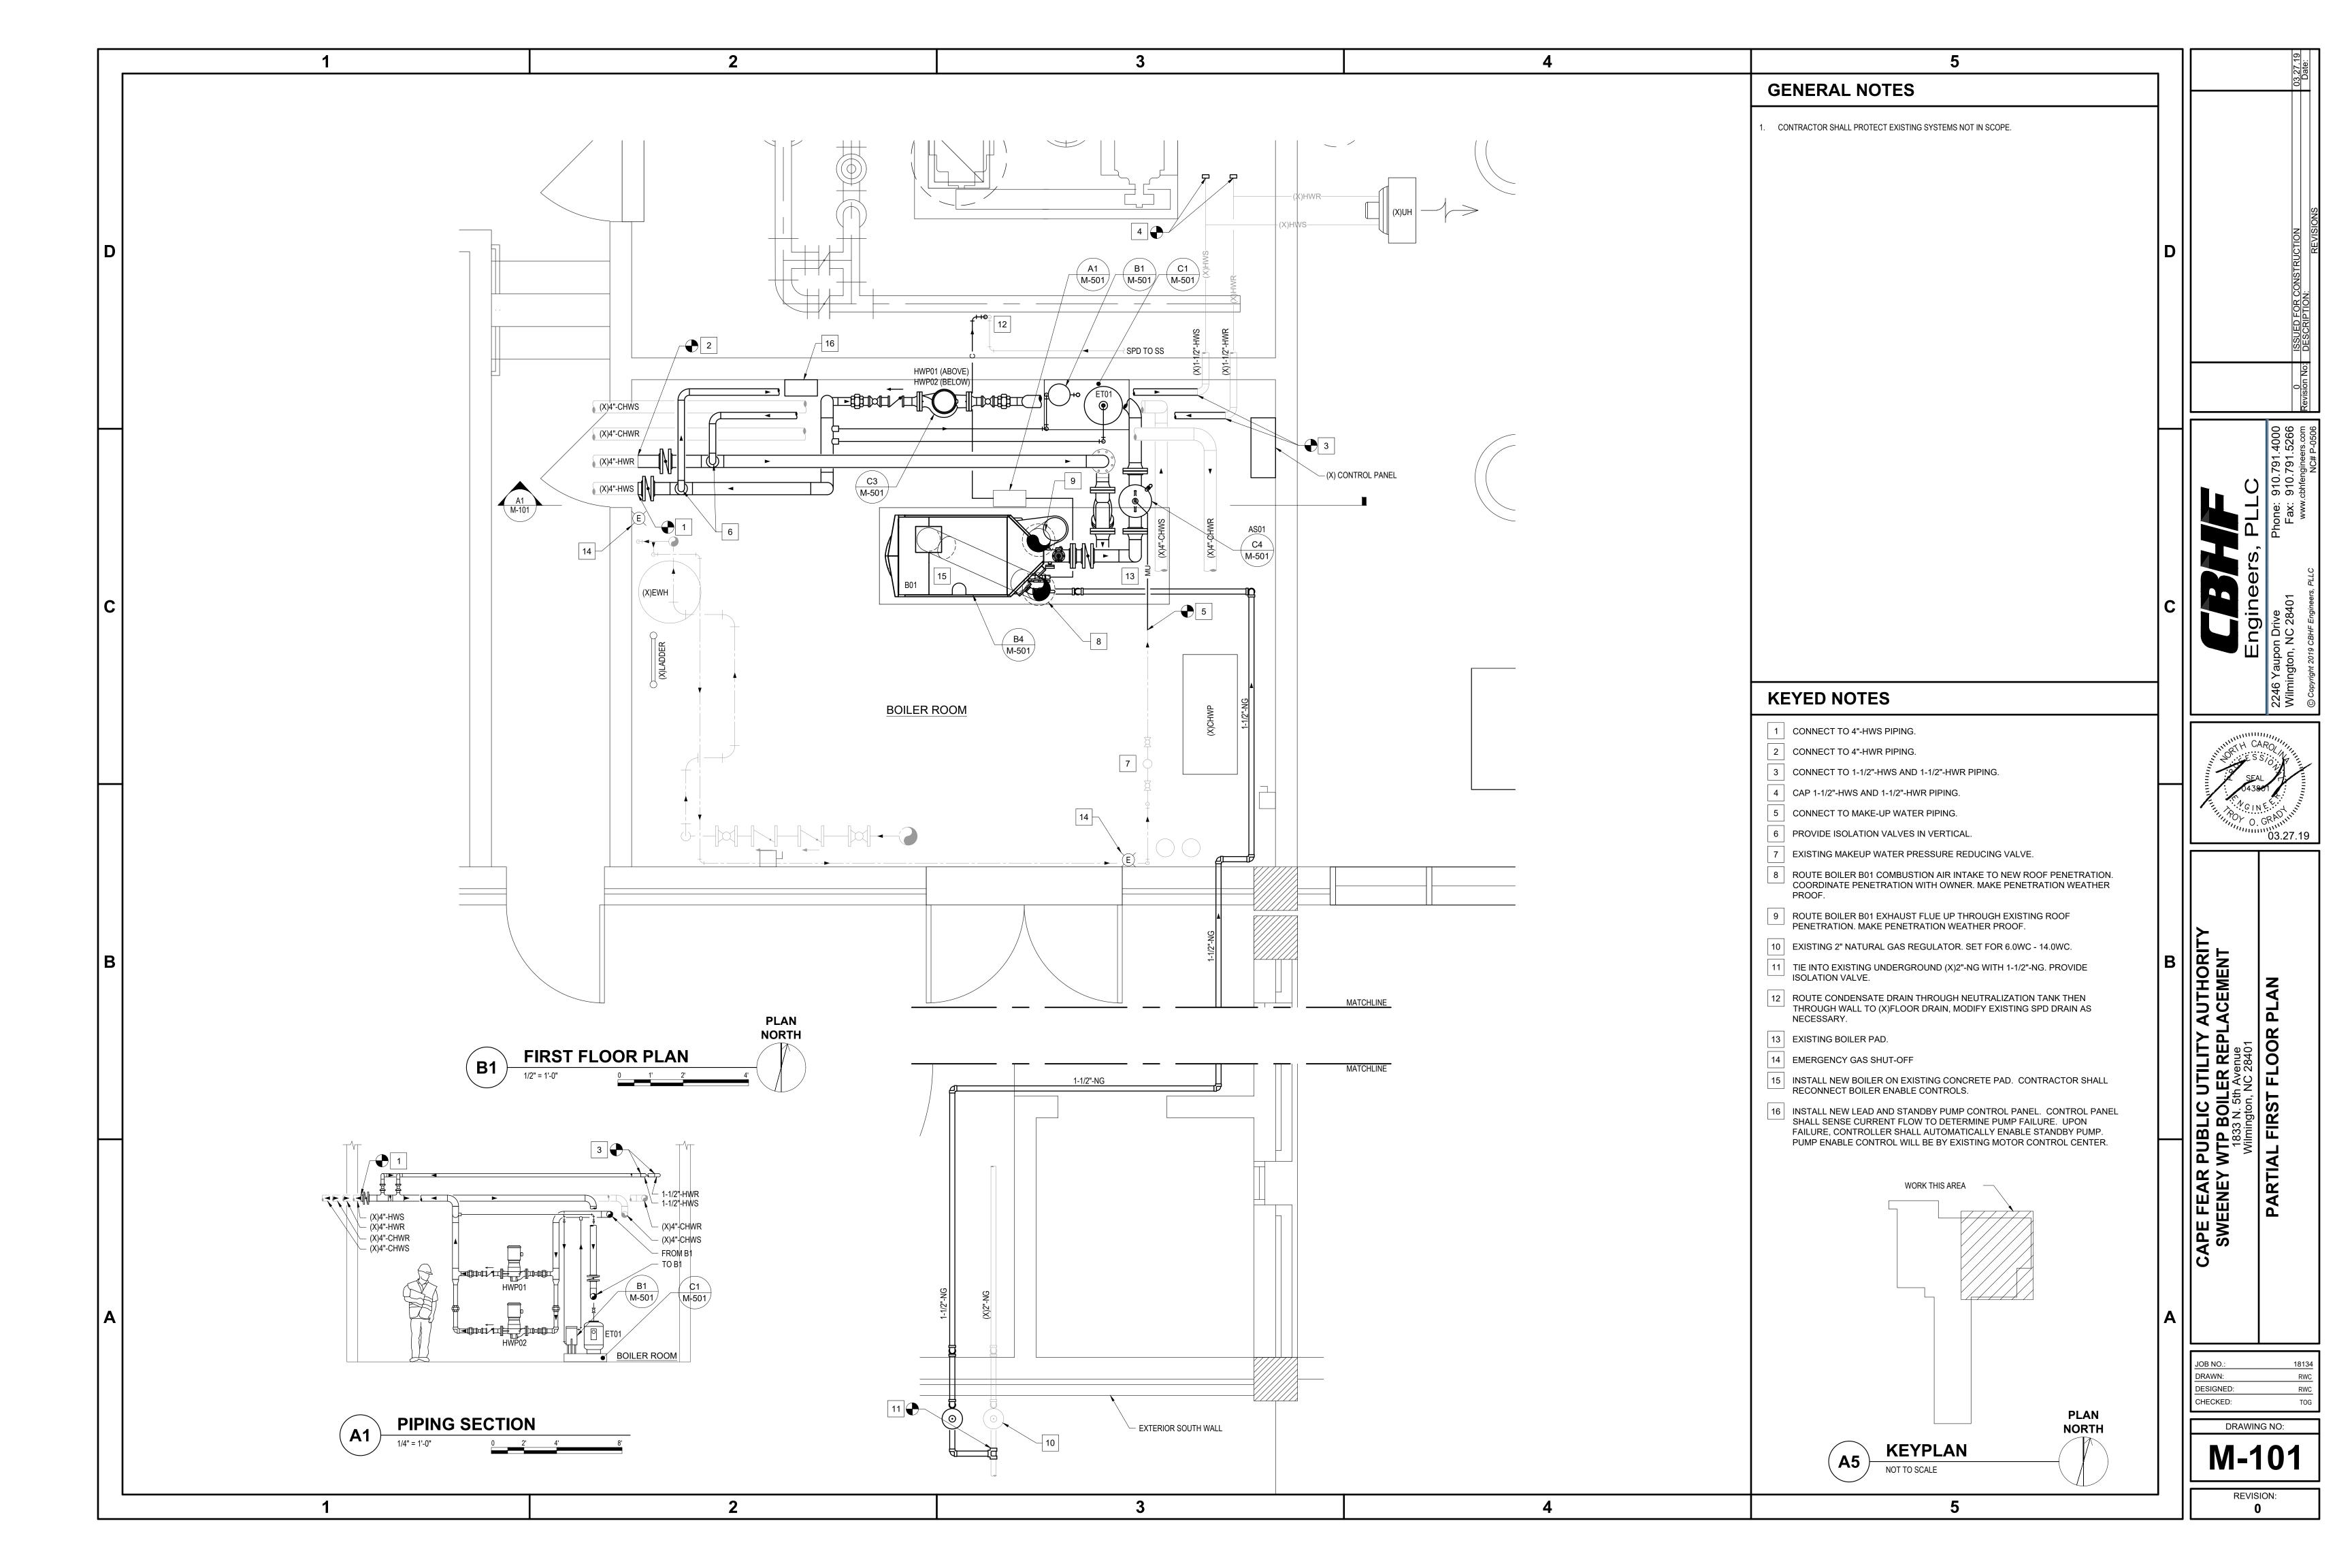

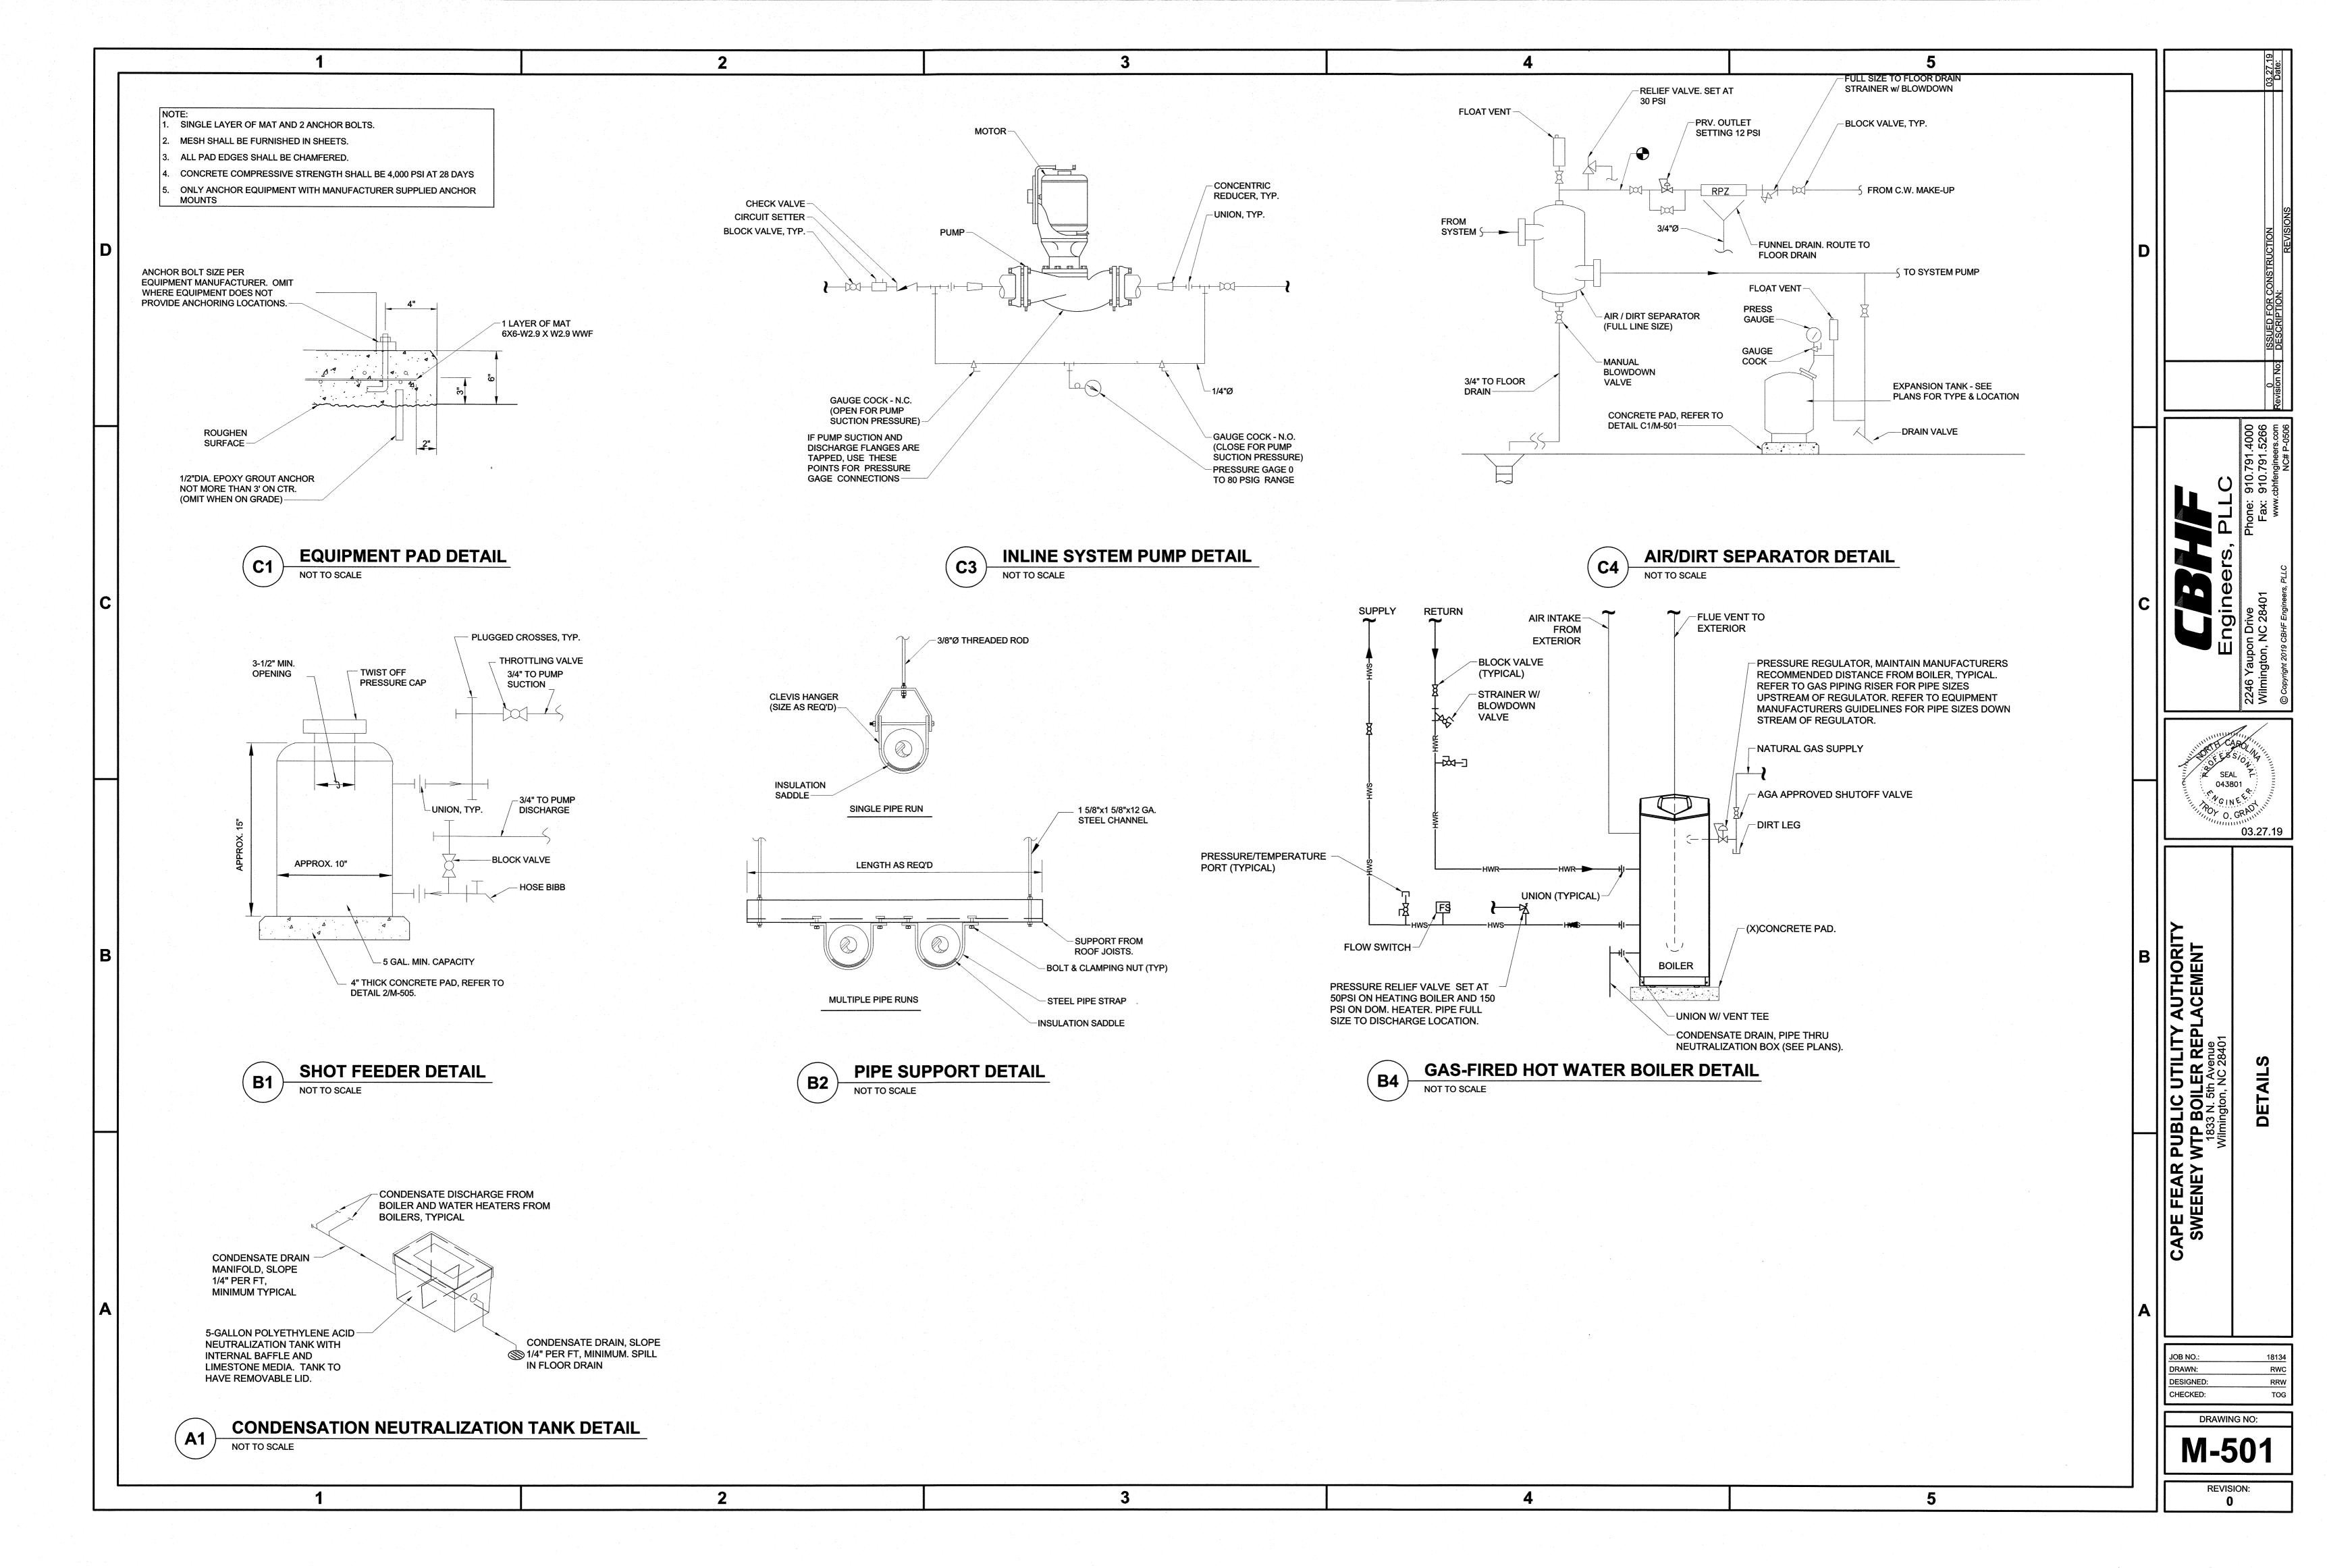

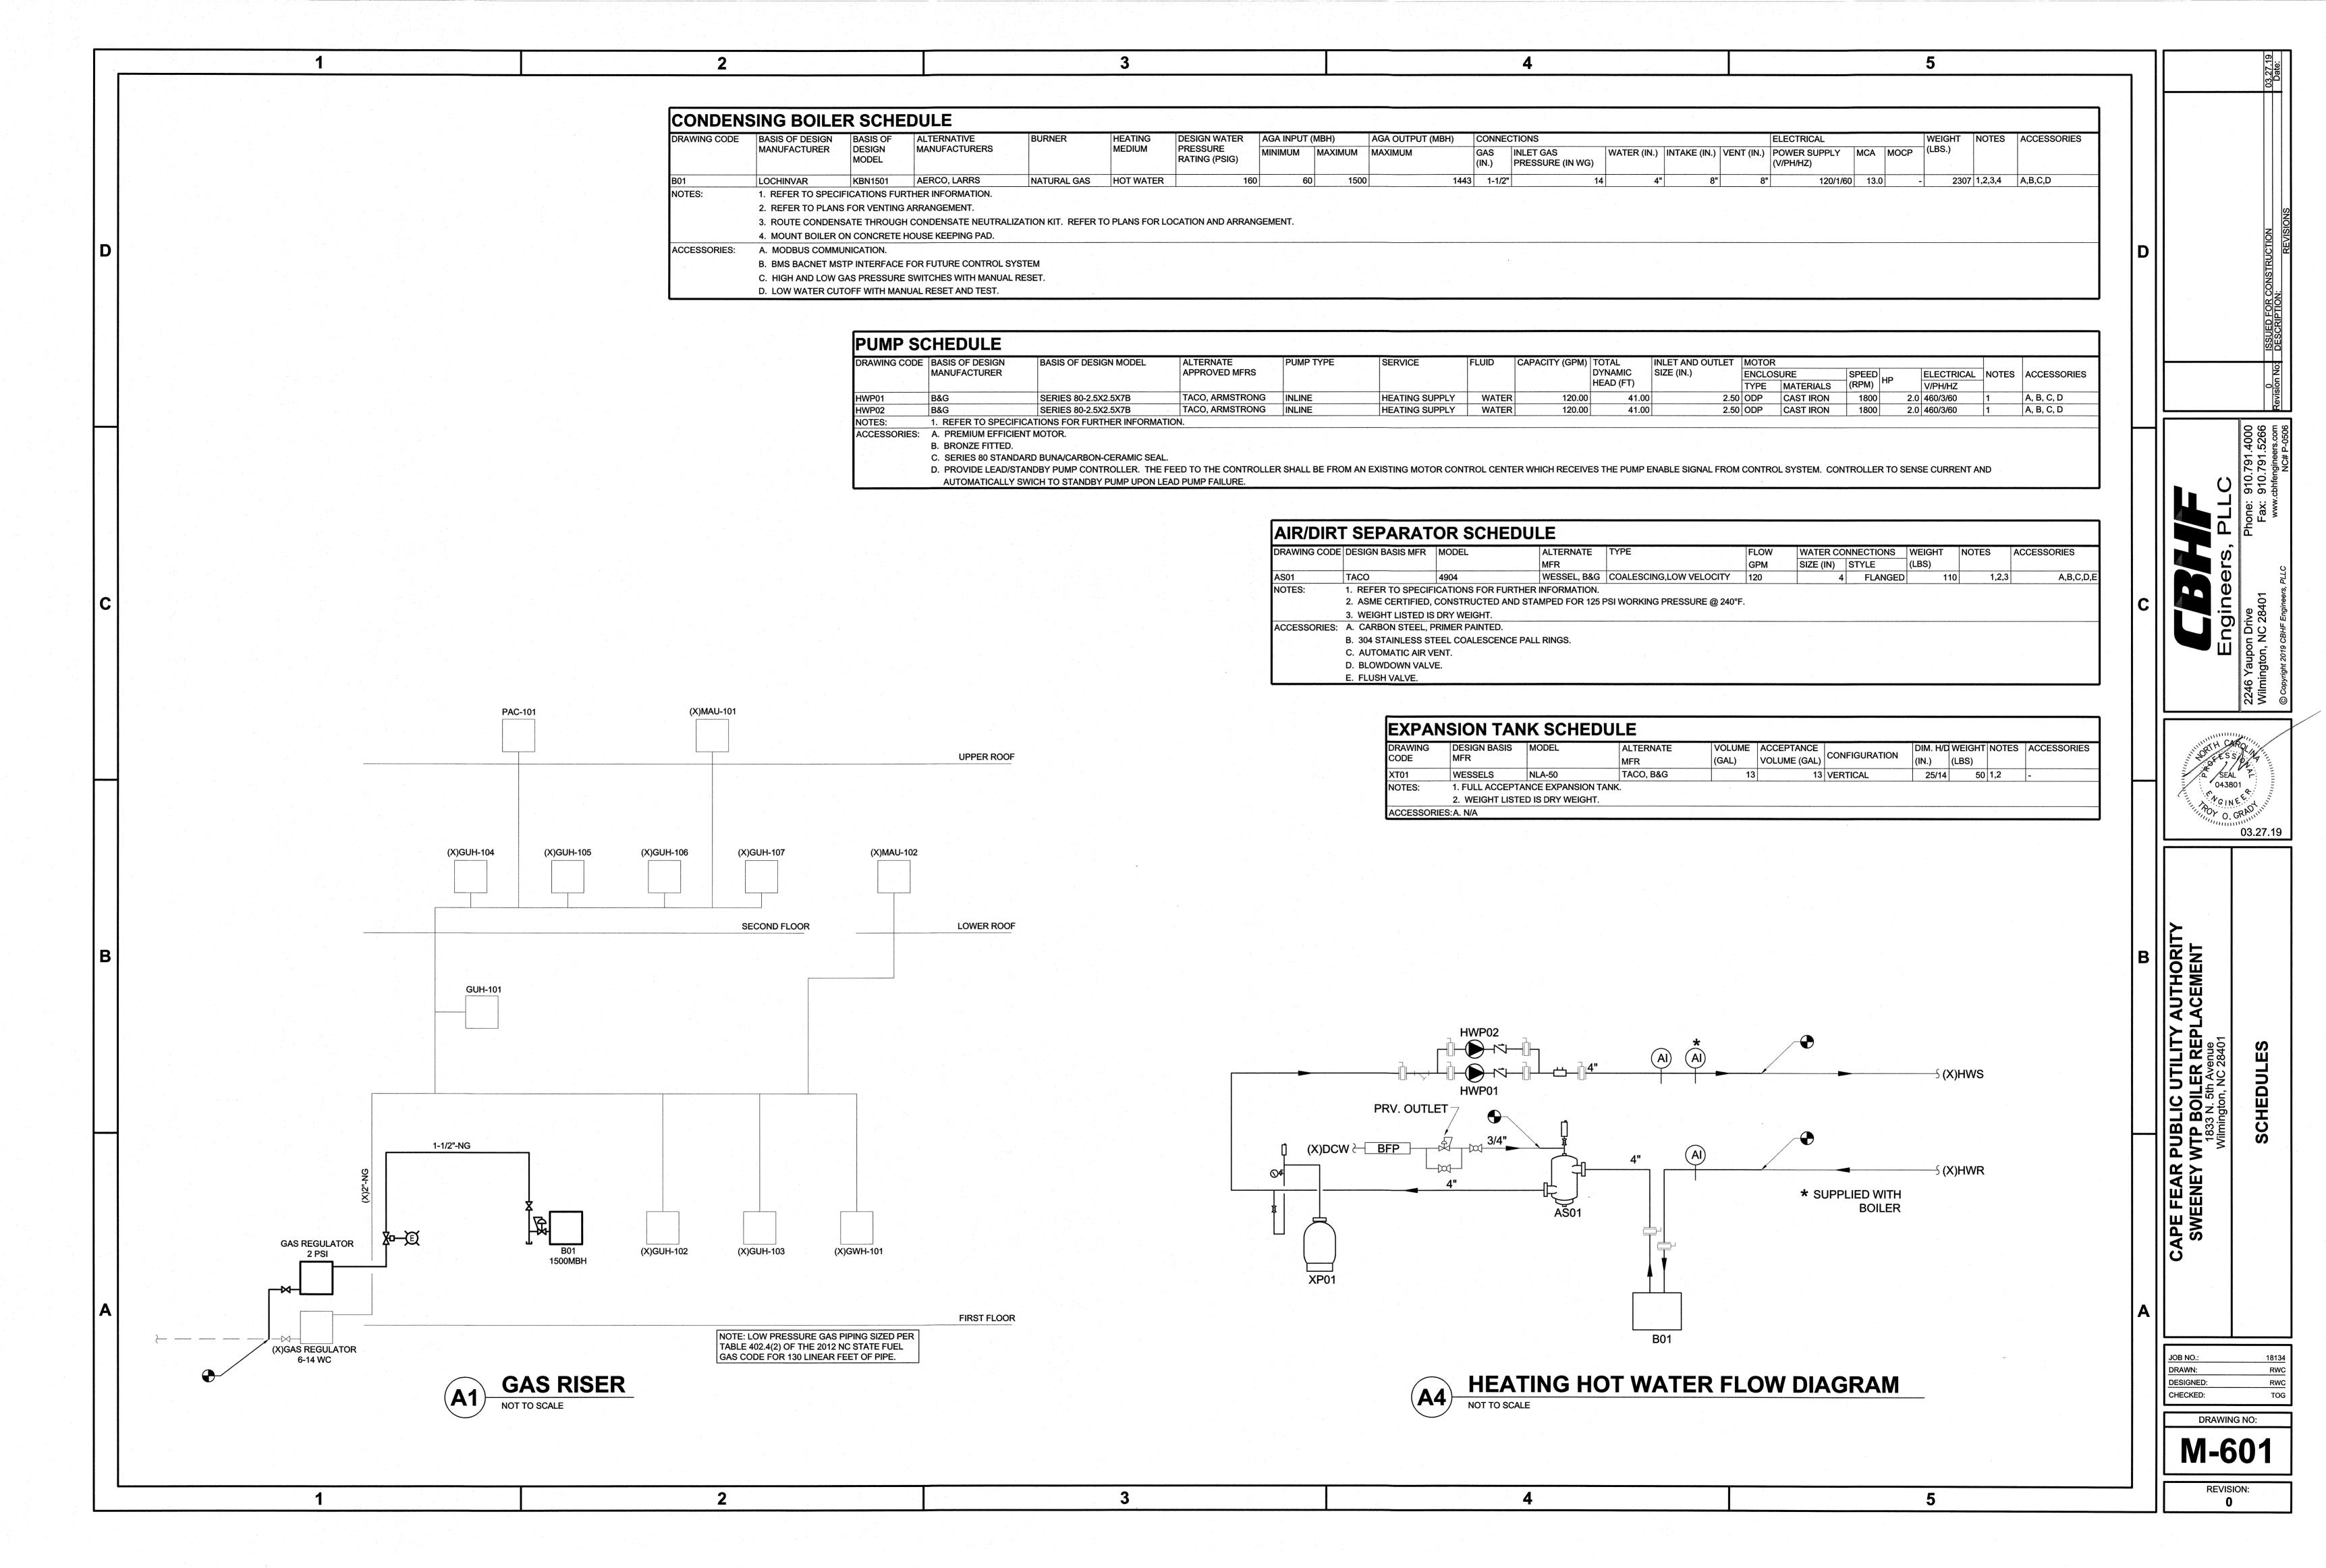

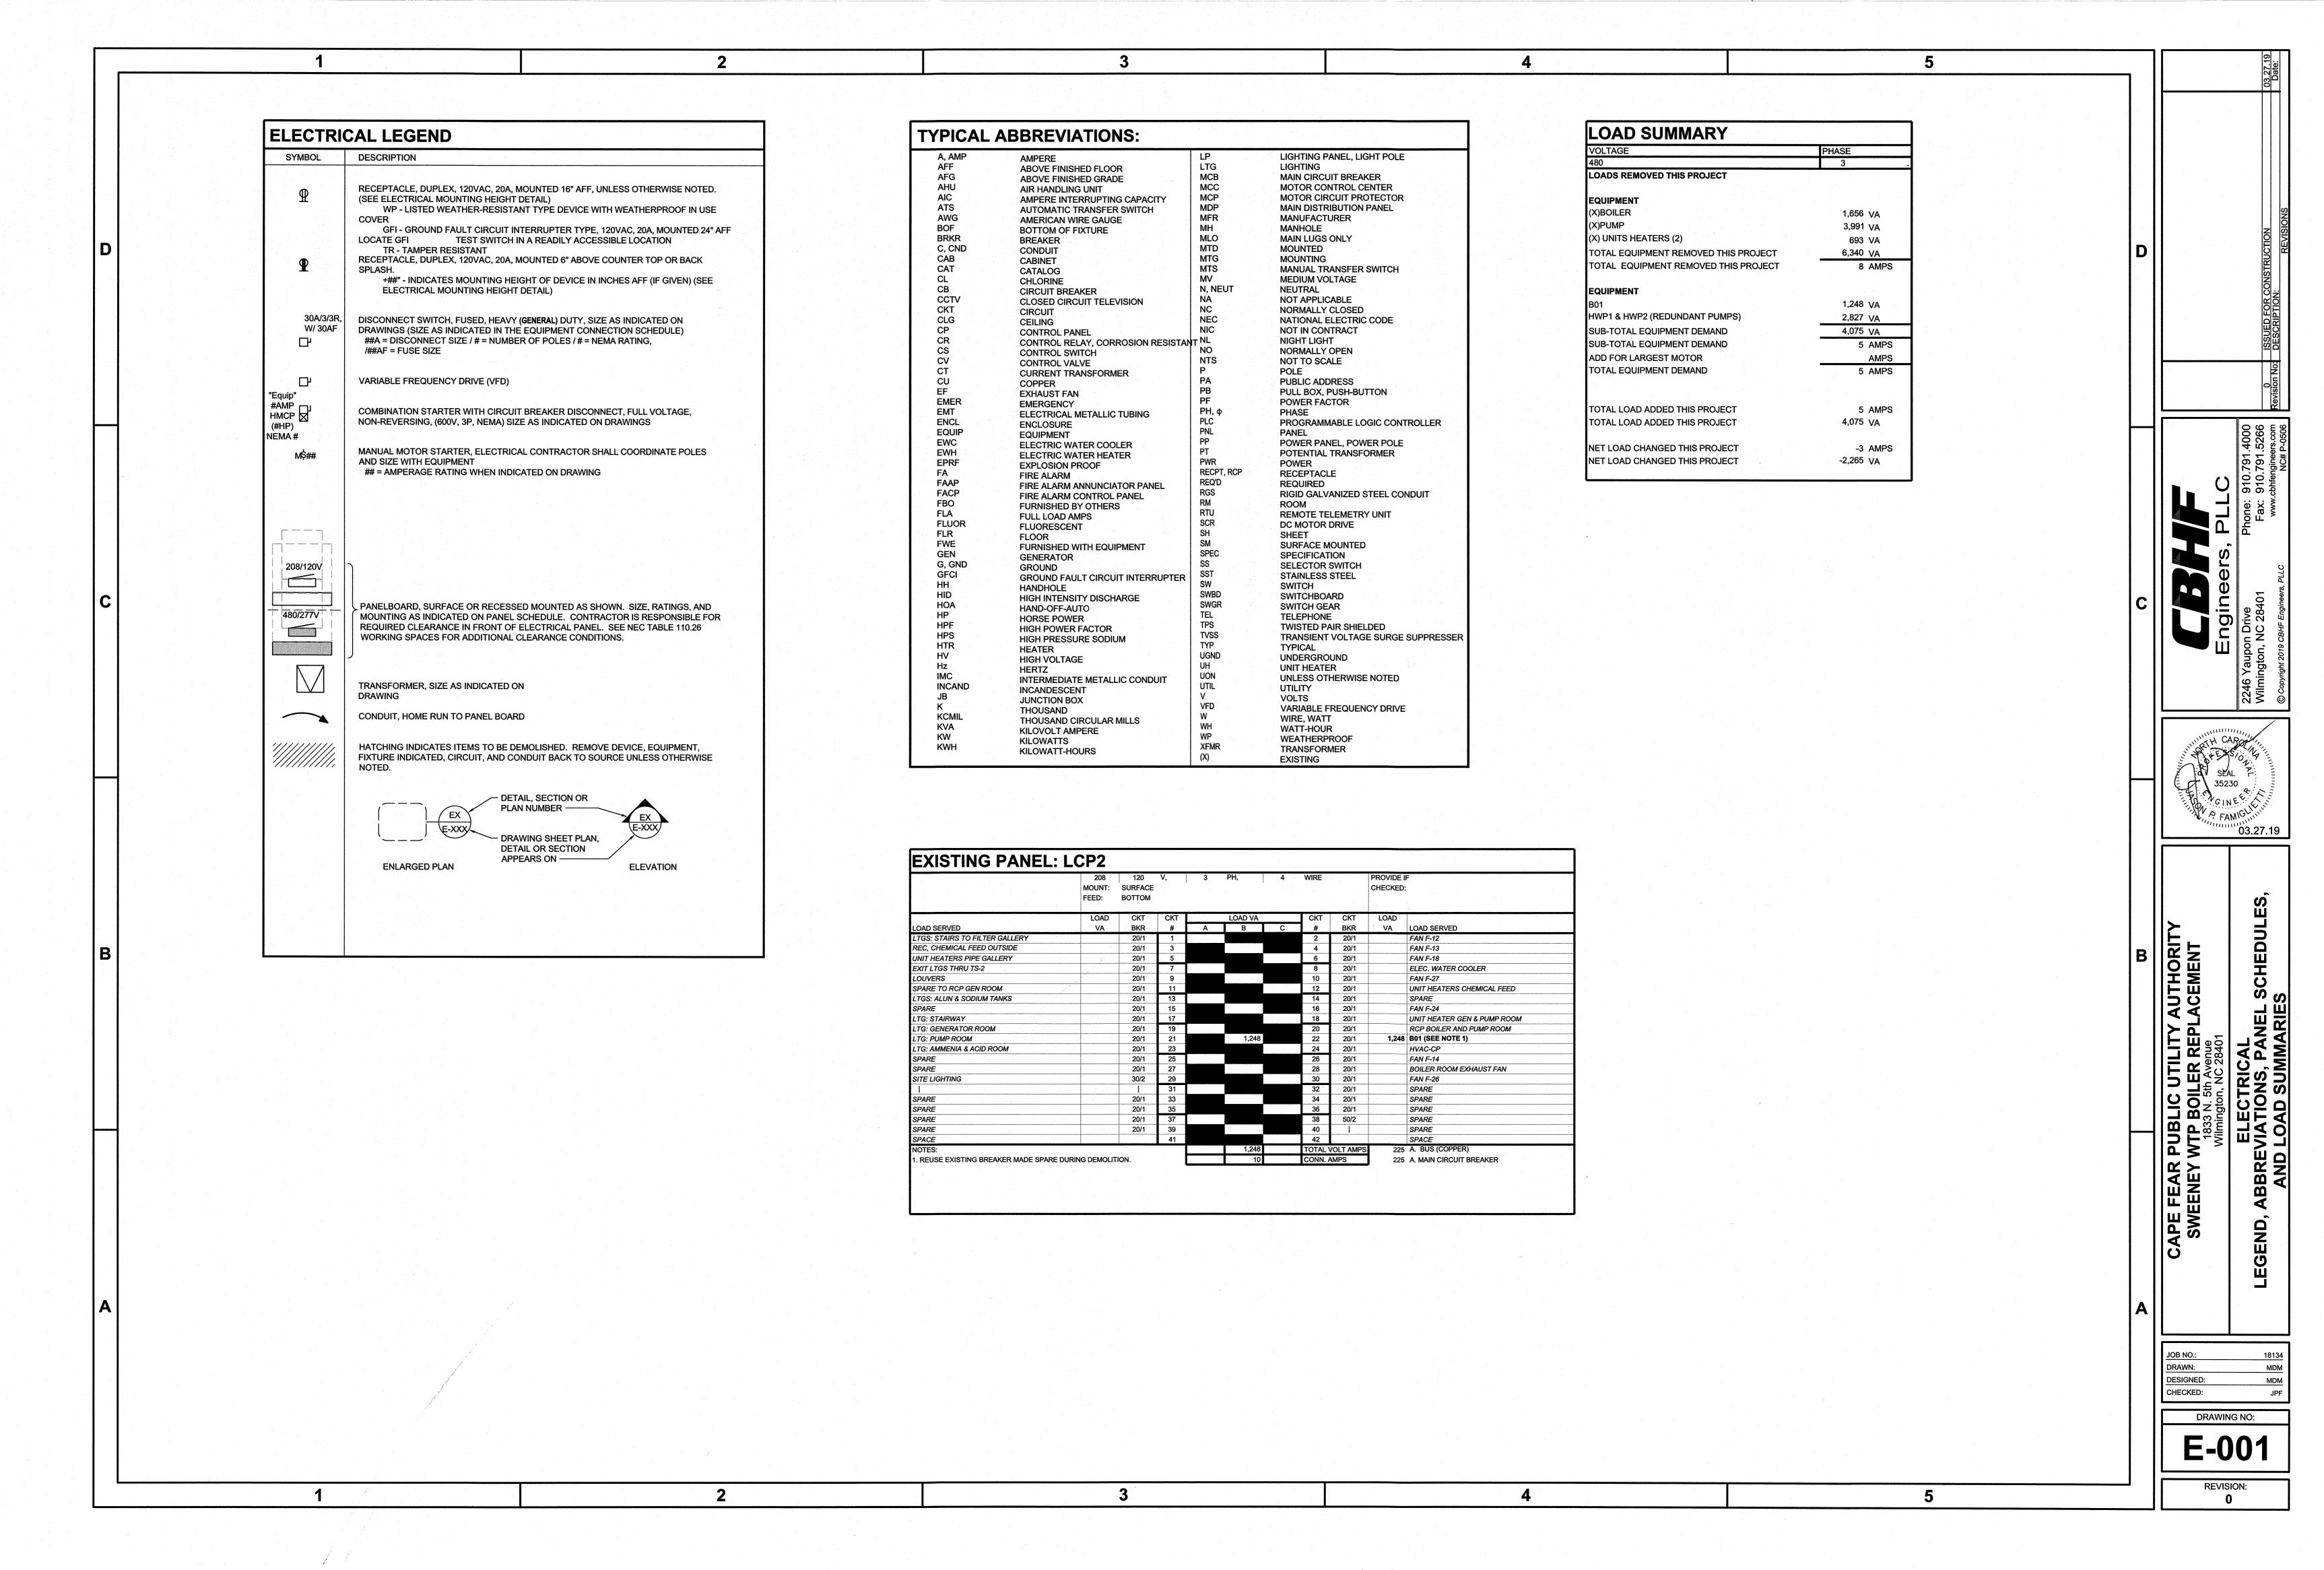

03.27.19

