

**NAVFAC
SPECIFICATION**

**WO 6778955
HVAC Systems @ MWD
Kennels B-4654**

MCAS Cherry Point, NC

AMENDMENT #02

IMPORTANT

This amendment should be acknowledged when your proposal is submitted. Failure to acknowledge the amendment may constitute grounds for rejection of the proposal.

If your proposal has been submitted prior to the receipt of this amendment, acknowledgement should be made by telegram, which should state whether the price contained in your proposal is to remain unchanged, is to be decreased by an amount, or is to be increased by an amount. The acknowledgement must be received prior to proposal opening time.

AMENDMENT OF SOLICITATION/MODIFICATION OF CONTRACT		1. CONTRACT ID CODE	PAGE 1	OF PAGES
2. AMENDMENT/MODIFICATION NO. 0002	3. EFFECTIVE DATE 07/10/2019	4. REQUISITION/PURCHASE REQ. NO.	5. PROJECT NO. (If applicable)	
6. ISSUED BY CG MCAS Cherry Point FACILITIES, ROICC B-163, CURTIS ROAD PSC BOX 8006 CHERRY POINT, NC 28533		7. ADMINISTERED BY (If other than item 6.)		Code
8. NAME AND ADDRESS OF CONTRACTOR (No., street, county, State and ZIP Code) AMENDMENT MUST BE ACKNOWLEDGED WITH YOUR PROPOSAL		<input checked="" type="checkbox"/>	9A. AMENDMENT OF SOLICITATION 6778955 HVAC Systems @ MWD Kennels, B-4654	
			9B. DATED (SEE ITEM 11)	
		<input type="checkbox"/>	10A. MODIFICATION OF CONTRACT/ORDER NO.	
			10B. DATED (SEE ITEM 13)	
CODE	FACILITY CODE			

11. THIS ITEM ONLY APPLIES TO AMENDMENTS OF SOLICITATIONS

The above numbered solicitation is amended as set forth in item 14. The hour and date specified for receipt of Offers is extended is not extended. Offers must acknowledge receipt of this amendment prior to the hour and date specified in the solicitation or as amended, by one of the following methods: (a) By completing items 8 and 15, and returning 1 copy of the amendment; (b) By acknowledging receipt of this amendment on each copy of the offer submitted; or (c) By separate letter or telegram which includes a reference to the solicitation and amendment numbers. FAILURE OF YOUR ACKNOWLEDGMENT TO BE RECEIVED AT THE PLACE DESIGNATED FOR THE RECEIPT OF OFFERS PRIOR TO THE HOUR AND DATE SPECIFIED MAY RESULT IN REJECTION OF YOUR OFFER. If by virtue of this amendment you desire to change an offer already submitted, such change may be made by telegram or letter, provided each telegram or letter makes reference to the solicitation and this amendment, and is received prior to the opening hour and date specified.

12. ACCOUNTING AND APPROPRIATION DATA (if required)

13. THIS ITEM APPLIES ONLY TO MODIFICATIONS OF CONTRACTS/ORDERS,
IT MODIFIES THE CONTRACT/ORDER NO. AS DESCRIBED IN ITEM 14.

<input type="checkbox"/>	A. THIS CHANGE ORDER IS ISSUED PURSUANT TO: (Specify authority) THE CHANGES SET FORTH IN ITEM 14. ARE MADE IN THE CONTRACT ORDER NO. IN ITEM 10A.
<input type="checkbox"/>	B. THE ABOVE NUMBERED CONTRACT/ORDER IS MODIFIED TO REFLECT THE ADMINISTRATION CHANGES (such as changes in paying office, appropriation date, etc.) SET FORTH IN ITEM 14, PURSUANT TO THE AUTHORITY OF FAR 43.103 (b).
<input type="checkbox"/>	C. THIS SUPPLEMENTAL AGREEMENT IS ENTERED INTO PURSUANT TO AUTHORITY OF:
<input type="checkbox"/>	D. OTHER: (specify type of modification and authority)

E. IMPORTANT: Contractor is not is required to sign this document and return **original** to the issuing office.

14. DESCRIPTION OF AMENDMENT/MODIFICATION (Organized by UCF section headings, including solicitation/contract subject matter where feasible.)
6778955, HVAC Systems @ MWD Kennel, B-4654, Marine Corps Air station, Cherry Point, North Carolina 28533

The purpose of this amendment is to provide the following:

1. Responses to RFI 3.
2. Revised drawing M-101

Proposal due date remains 29 July 2019

SEE ADDENDUM SHEET


15A. NAME AND TITLE OF SIGNER (Type or print)		16A. NAME AND TITLE OF CONTRACTING OFFICER (Type or print)	
15B. CONTRACTOR/OFFEROR (Same as Item 8)	15C. DATE SIGNED	16B. UNITED STATES OF AMERICA BY	16C. DATE SIGNED
(Signature of person authorized to sign)		(Signature of Contracting Officer)	

Amendment 02
WO 6778955, HVAC System @ MWD Kennel, B-4654
MCAS, Cherry Point, NC

RFI Responses:

RFI #3: Note #2 on Drawing M-101 indicates all supply ductwork above the ceiling in the Kennel is rectangle. The sizing for this duct is one dimensional, as if the duct is round. Please clarify the sizing of the rectangle supply ductwork above the ceiling in the kennel.

Response: Clarified the sizing of the rectangle supply ductwork above the ceiling in the kennel area on Drawing sheet M-101. Revised Drawing M-101 attached.

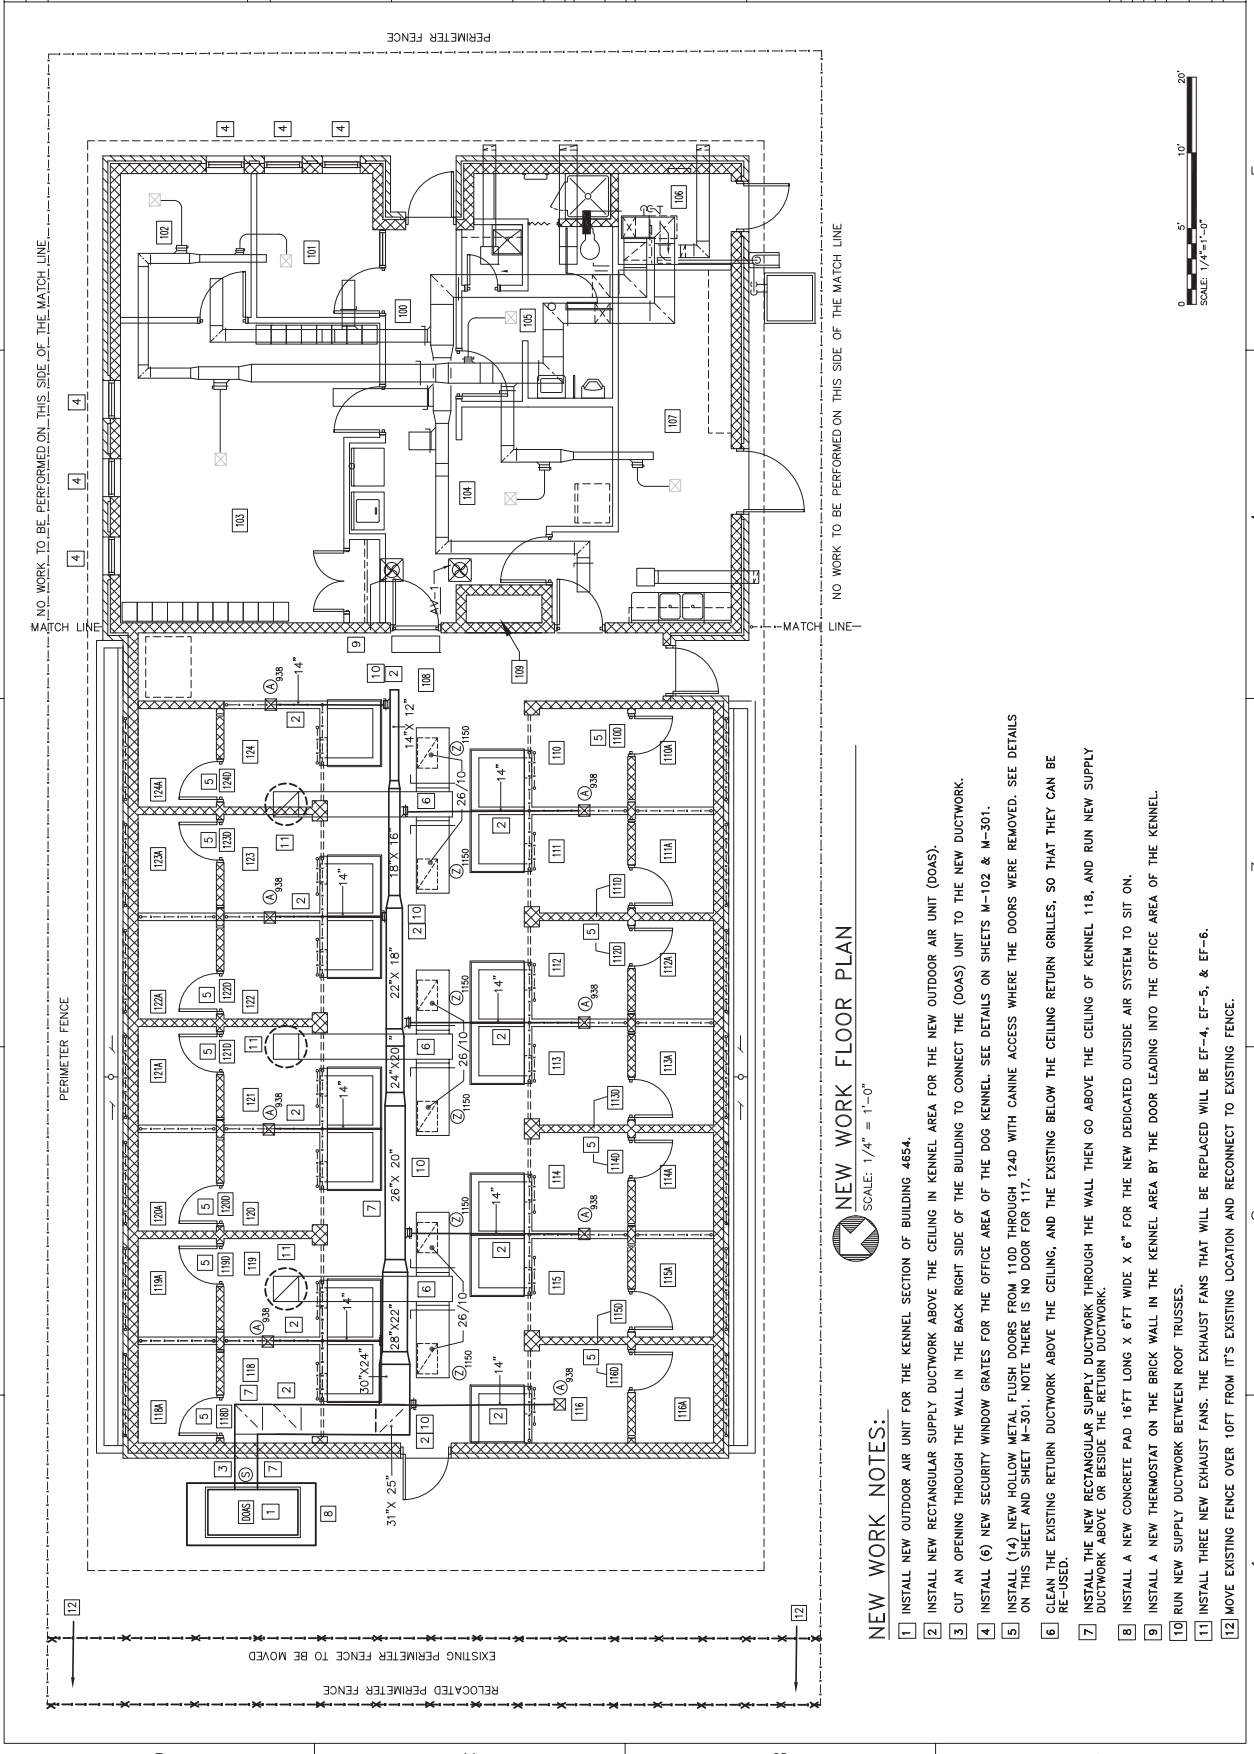

NEW WORK FLOOR PLAN
SCALE: 1/4" = 1'-0"

NEW WORK NOTES:

- 1 INSTALL NEW OUTDOOR AIR UNIT FOR THE KENNEL SECTION OF BUILDING 4654.
- 2 INSTALL NEW RECTANGULAR SUPPLY DUCTWORK ABOVE THE CEILING IN KENNEL AREA FOR THE NEW OUTDOOR AIR UNIT (DOAS).
- 3 CUT AN OPENING THROUGH THE WALL IN THE BACK RIGHT SIDE OF THE BUILDING TO CONNECT THE (DOAS) UNIT TO THE NEW DUCTWORK.
- 4 INSTALL (6) NEW SECURITY WINDOW GRATES FOR THE OFFICE AREA OF THE DOG KENNEL. SEE DETAILS ON SHEETS M-102 & M-301.
- 5 INSTALL (14) NEW HOLLOW METAL FLUSH DOORS FROM 110D THROUGH 124D WITH CANINE ACCESS WHERE THE DOORS WERE REMOVED. SEE DETAILS ON THIS SHEET AND SHEET M-301. NOTE THERE IS NO DOOR FOR 117.
- 6 CLEAN THE EXISTING RETURN DUCTWORK ABOVE THE CEILING, AND THE EXISTING BELOW THE CEILING RETURN GRILLES, SO THAT THEY CAN BE RE-USED.
- 7 INSTALL THE NEW RECTANGULAR SUPPLY DUCTWORK THROUGH THE WALL THEN GO ABOVE THE CEILING OF KENNEL 118, AND RUN NEW SUPPLY DUCTWORK ABOVE OR BESIDE THE RETURN DUCTWORK.
- 8 INSTALL A NEW CONCRETE PAD 16 FT LONG X 6 FT WIDE X 6" FOR THE NEW DEDICATED OUTSIDE AIR SYSTEM TO SIT ON.
- 9 INSTALL A NEW THERMOSTAT ON THE BRICK WALL IN THE KENNEL AREA BY THE DOOR LEADING INTO THE OFFICE AREA OF THE KENNEL.
- 10 RUN NEW SUPPLY DUCTWORK BETWEEN ROOF TRUSSES.
- 11 INSTALL THREE NEW EXHAUST FANS. THE EXHAUST FANS THAT WILL BE REPLACED WILL BE EF-4, EF-5, & EF-6.
- 12 MOVE EXISTING FENCE OVER 10 FT FROM IT'S EXISTING LOCATION AND RECONNECT TO EXISTING FENCE.