



1 CAFETERIA ADDITION FLOOR PLAN  
SCALE: 1/8" = 1'-0"

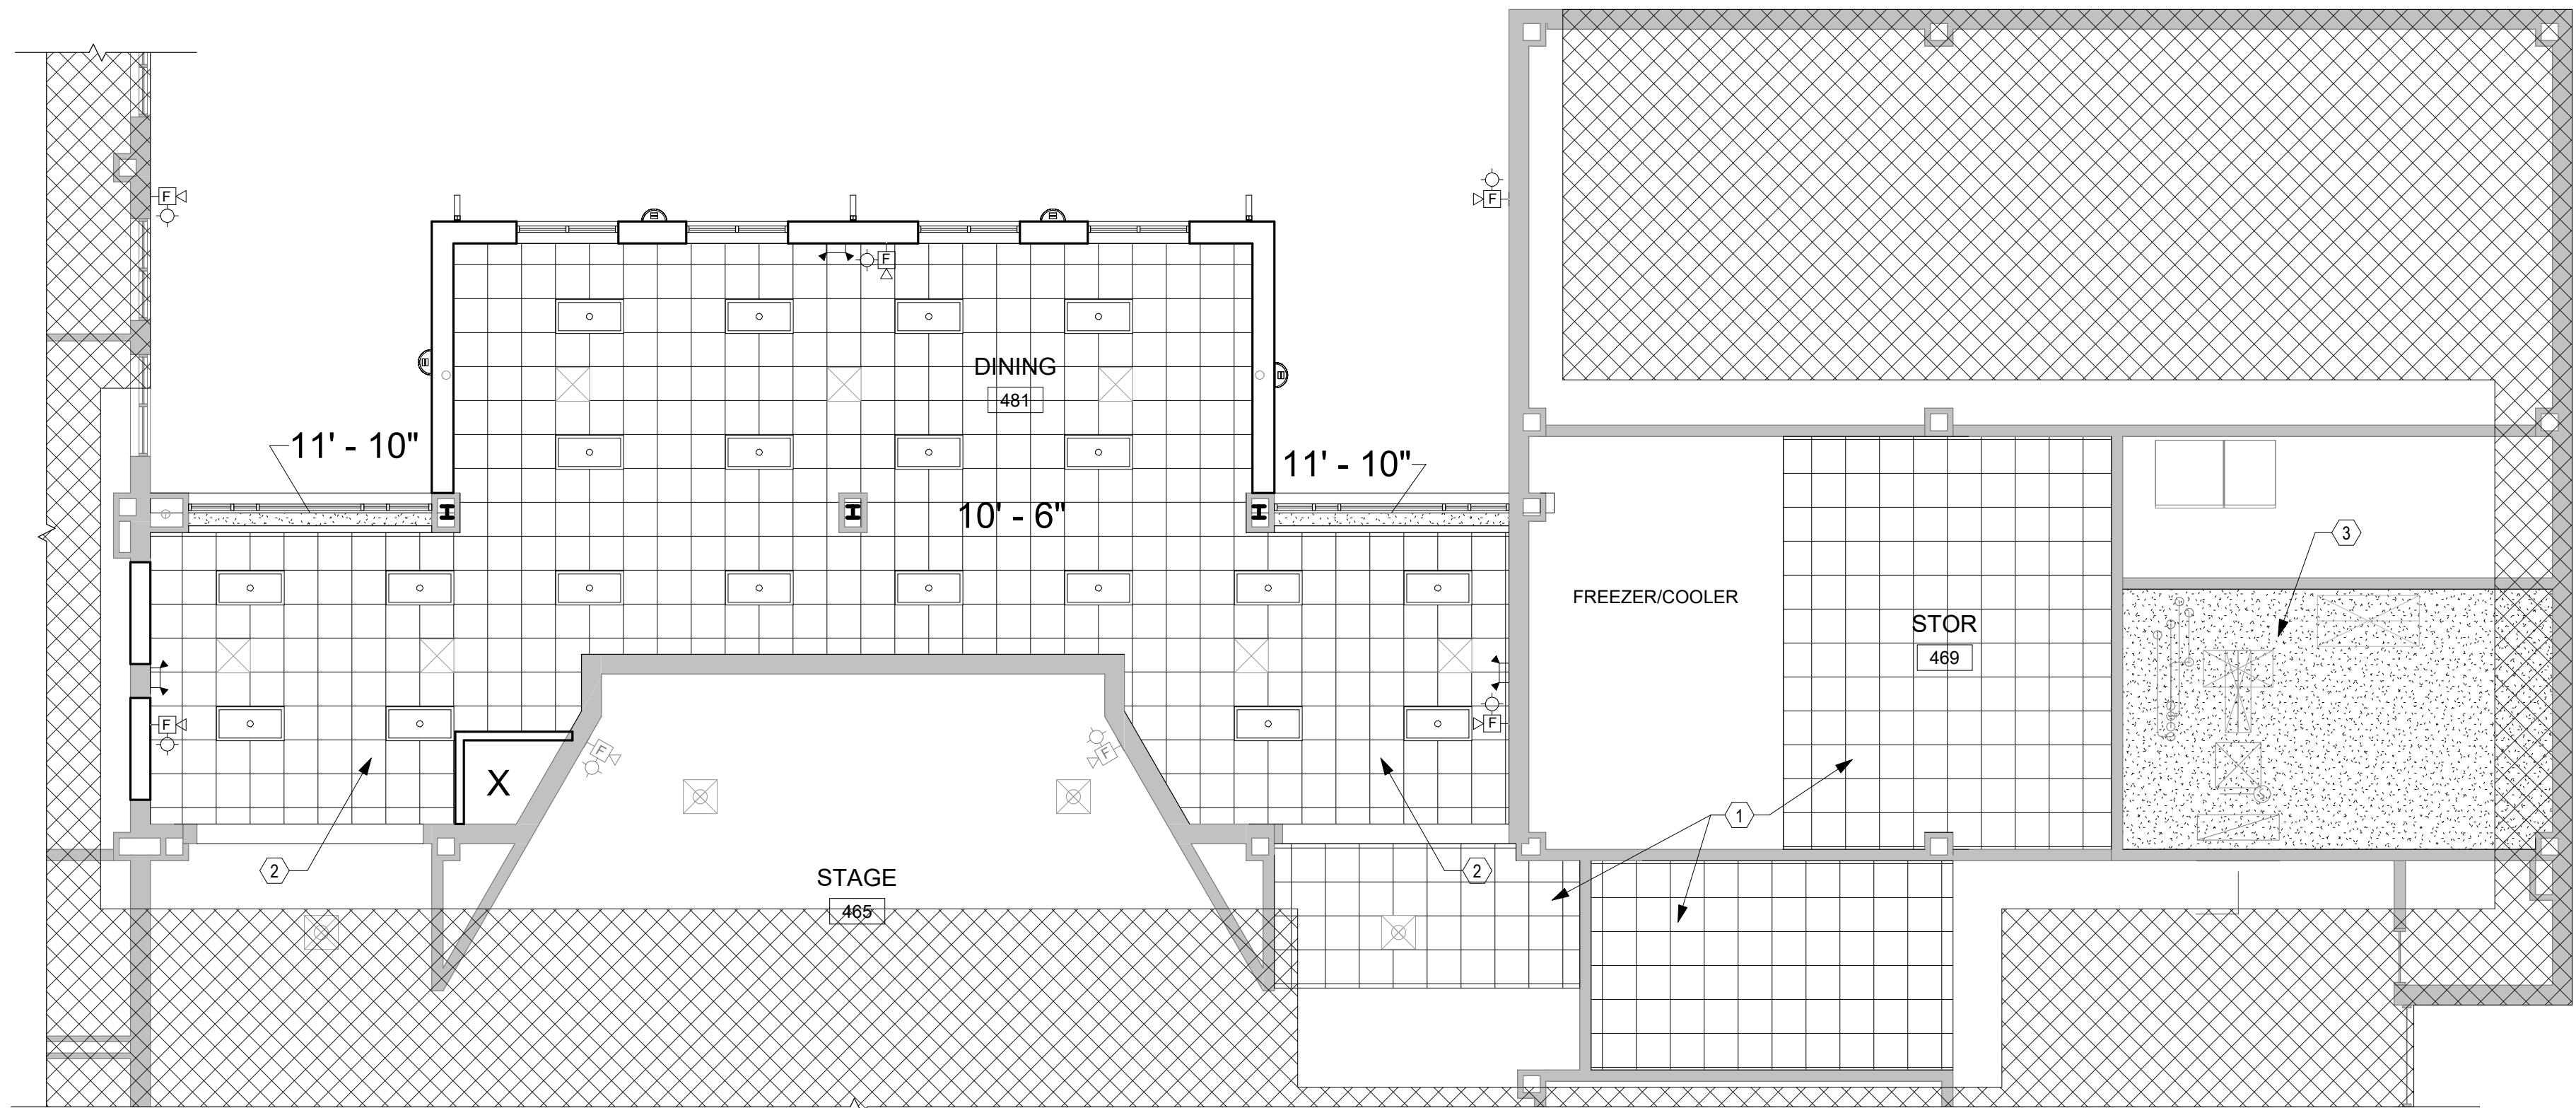

2 CAFETERIA REFLECTED CEILING PLAN  
SCALE: 1/8" = 1'-0"

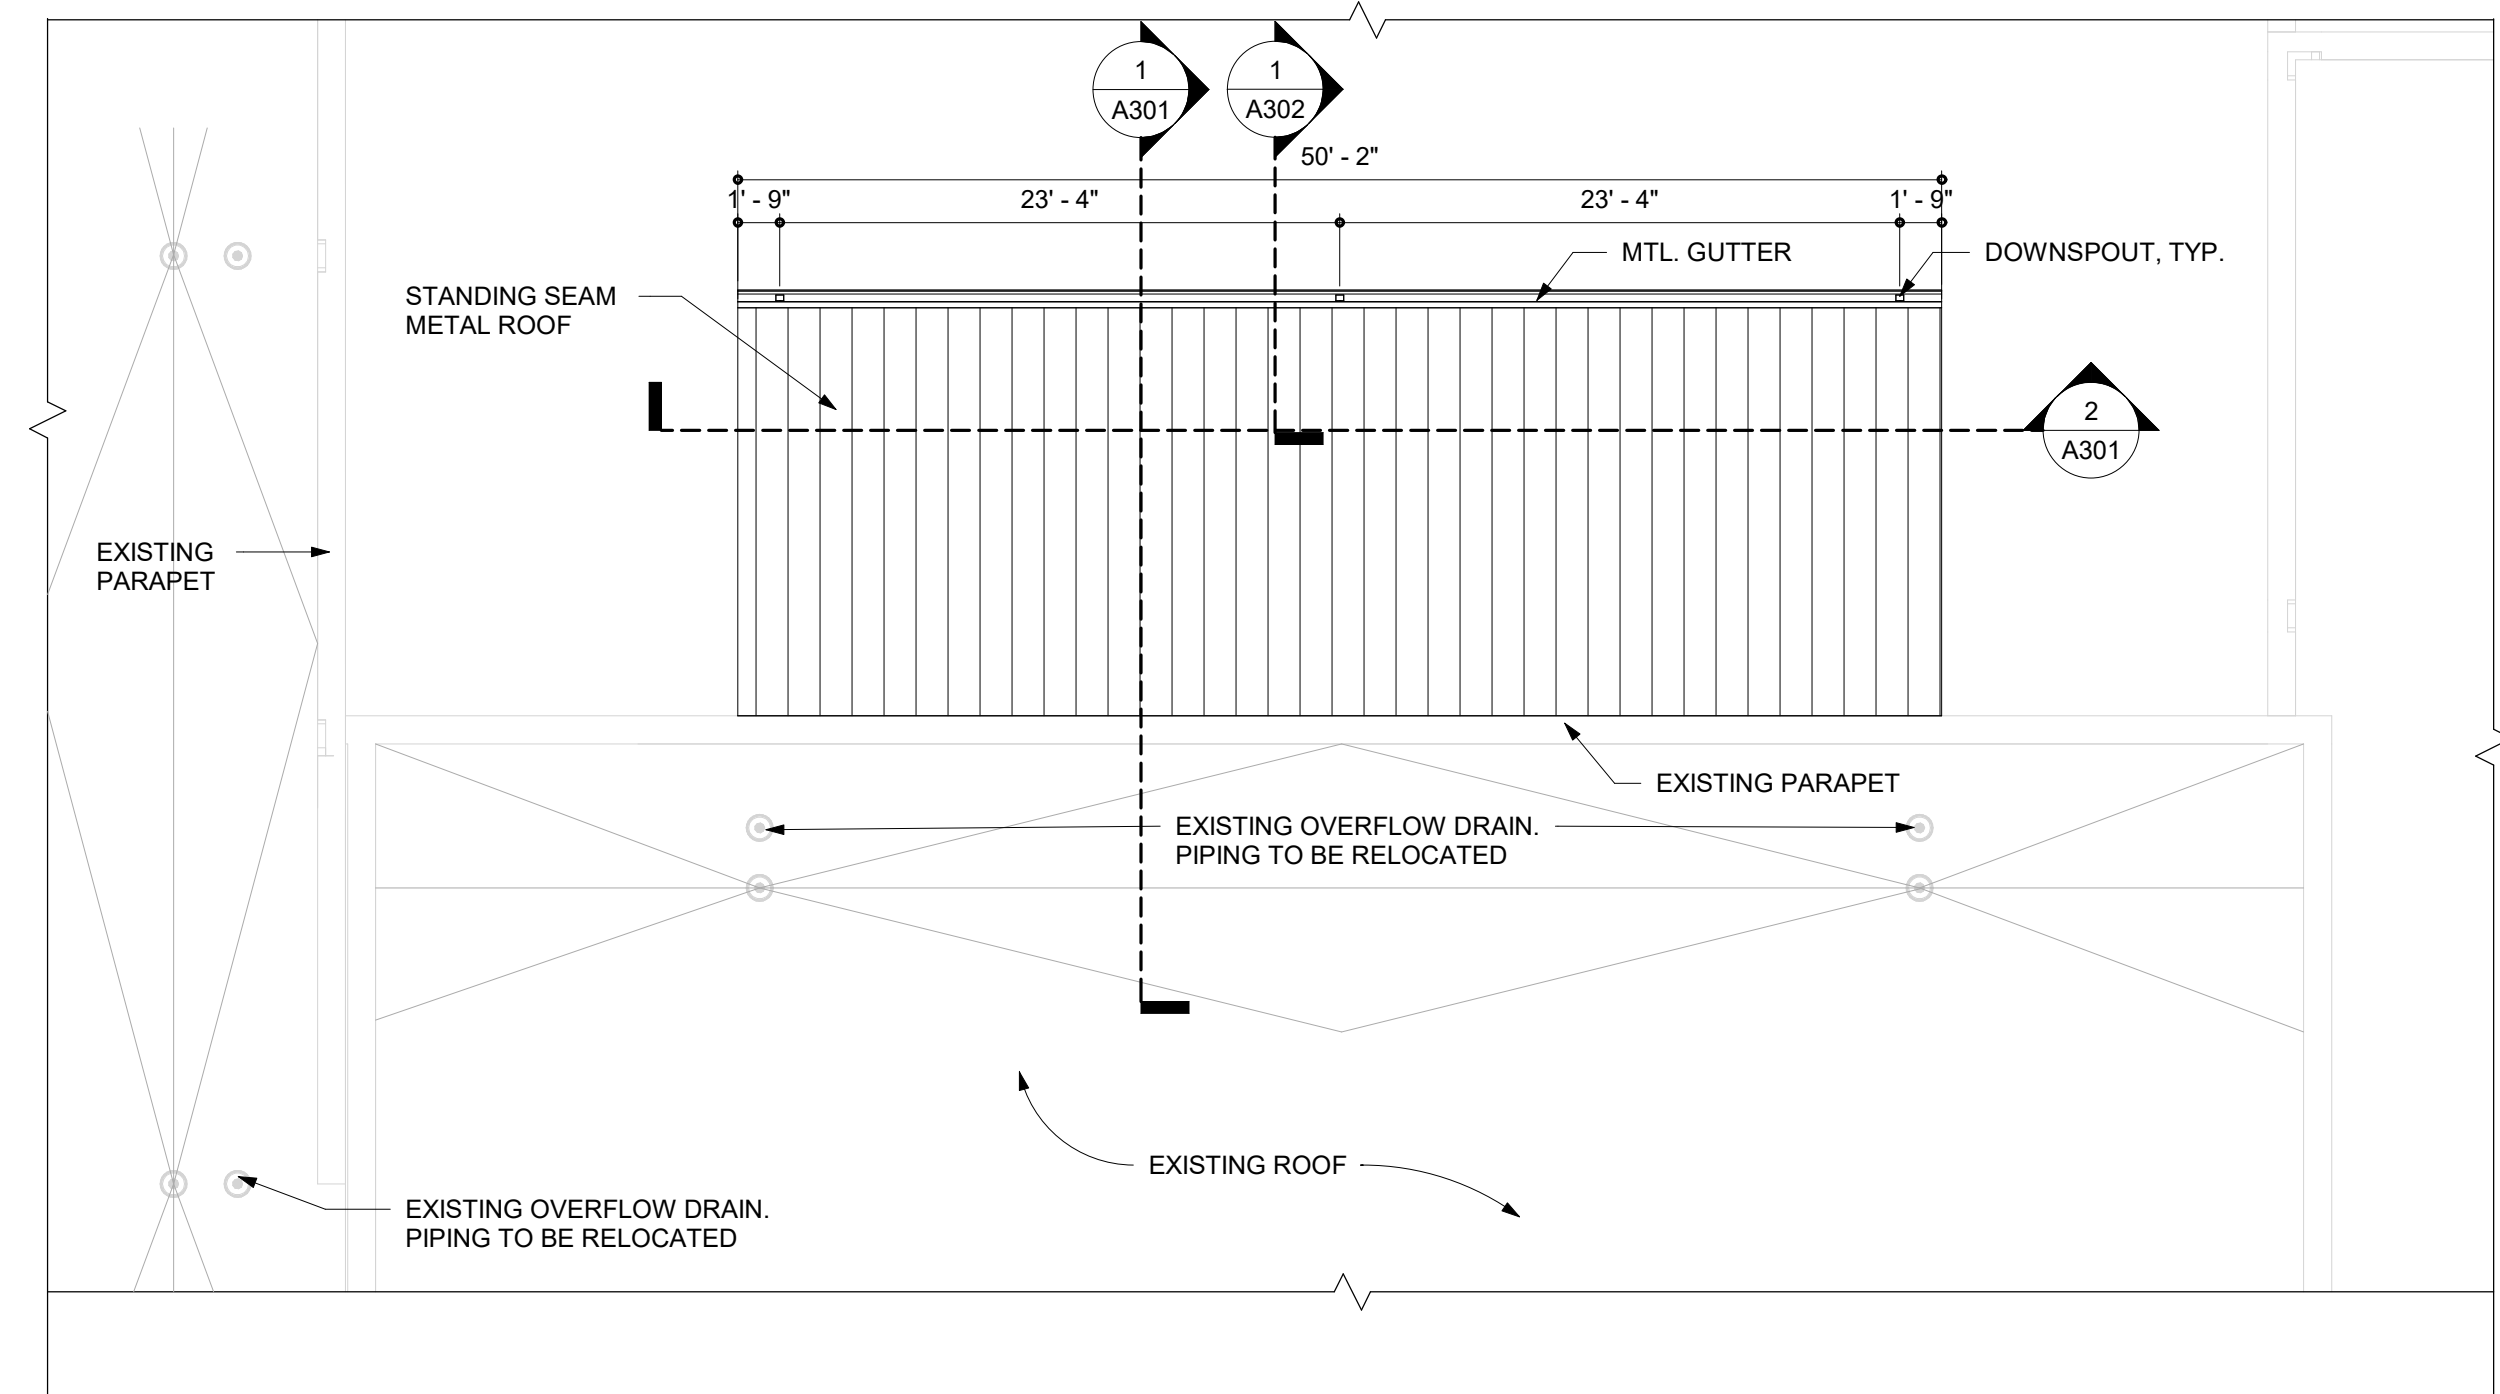

3 CAFETERIA ROOF PLAN  
SCALE: 1/8" = 1'-0"

CEILING LEGEND	CEILING NOTES
2x2 ACT CEILING ACT-1	1. SEE FINISH SCHEDULE FOR ACT TYPES.
INTERIOR - GWB CEILINGS/BULKHEADS	2. CEILING HEIGHTS INDICATED ARE FROM FINISH FLOOR. CEILINGS AT LANDINGS REFER TO NEAREST FLOOR LEVEL.
EXPOSED	3. ALL EXPOSED LINTELS SHALL BE PAINTED.
N.I.C.	4. ALIGN BULKHEADS TO FACE OF WALL / OPENING, U.O.N.
SUPPLY/RETURN/EXHAUST DIFFUSER OR REGISTER - SEE MECH.	
LIGHT FIXTURE - SEE ELEC.	

ROOF LEGEND	GENERAL ROOF NOTES
PVC ROOFING SYSTEM OVER RIGID INSULATION	1. DOWNSPOUTS SHALL BE 4"x3" PLAIN RECTANGULAR UNLESS OTHERWISE NOTED.
STANDING SEAM METAL ROOF	2. GUTTERS TO BE 6"x6" UNLESS OTHERWISE NOTED.
WALKPADS	
ROOFTOP VENTILATOR	
VTR VENT THROUGH ROOF - SEE PLUMB.	
D.S. DOWNSPOUT	
S.B. SPLASHBLOCK	

GENERAL NOTES
1. DIMENSIONS ARE TO EXTERIOR FACE OF CONCRETE, MASONRY, OR METAL STUD UNLESS OTHERWISE NOTED.
2. COORDINATE REQUIREMENTS OF WORK WITH ALL OTHER TRADES.
LEGEND
AREA N.I.C.

KEYNOTE LEGEND
1. RE-INSTALL SAVED 1-HOUR RATED CEILING TILE AND GRID. REPLACE ALL MATERIALS DAMAGED IN KIND. ALL REINSTALLATION WORK SHALL BE IN ACCORDANCE WITH UL DESIGN P225 FOR 1 HOUR CEILING/ROOF ASSEMBLY.
2. REPAIR/PATCH EXISTING 1-HOUR RATED SPRAY ON FIREPROOFING DAMAGED PRIOR TO OR DURING DEMOLITION OF THE EXISTING METAL SOFFIT. ALL WORK SHALL BE IN ACCORDANCE WITH UL DESIGN P701.
3. INSTALL NEW FIRE SEALANT AROUND PERIMETER OF EXISTING 2-HOUR RATED CEILING. WORK SHALL BE IN ACCORDANCE WITH UL DESIGN P519.



Mark	Date	Description
1	05.04.20	ADDENDUM 1
	04.16.20	ISSUED FOR BIDDING
	03.20.20	100% REV. SUBMISSION
	10.14.19	NCDPI DD SUBMISSION
	07.30.19	SD PROGRESS DWGS
	07.11.19	NCDPI SD SUBMISSION