

GENERAL MECHANICAL NOTES (ALL DRAWINGS):

1. MECHANICAL CONTRACTOR SHALL PROVIDE ALL MATERIALS AND EQUIPMENT AND PERFORM ALL LABOR REQUIRED TO INSTALL COMPLETE AND OPERABLE HVAC SYSTEMS AS INDICATED ON THE DRAWINGS, AS SPECIFIED AND REQUIRED BY CODE.
2. THE CONTRACT DOCUMENT DRAWINGS ARE DIAGRAMMATIC ONLY, AND ARE INTENDED TO CONVEY THE SCOPE AND GENERAL ARRANGEMENT OF WORK.
3. ALL DIMENSIONS AND EXISTING CONDITIONS SHALL BE VERIFIED BY THE CONTRACTOR BY FIELD INSPECTION PRIOR TO BIDDING. ANY INTERFERENCES TO INSTALLATION SHALL BE NOTED AND THE CONTRACTOR SHALL INCLUDE IN HIS BID PRICE THE COST TO AVOID OR RELOCATE ALL ITEMS, INCLUDING ITEMS OF OTHER TRADES, THAT INTERFERE. ALL WORK SHALL BE COORDINATED WITH ALL TRADES INVOLVED. ALL OFFSETS, RISES, TRANSITIONS AND DROPS IN DUCTS AND PIPING AROUND OBSTRUCTIONS SHALL BE PROVIDED AT NO ADDITIONAL COST TO THE OWNER.
4. VERIFY ALL EQUIPMENT CONNECTIONS WITH MANUFACTURERS' CERTIFIED DRAWINGS. VERIFY AND PROVIDE DUCT TRANSITIONS OR PIPE ADAPTERS TO FURNISHED EQUIPMENT. FIELD VERIFY AND COORDINATE ALL DIMENSIONS BEFORE FABRICATION.
5. PROVIDE ACCESS IN WALLS & CEILINGS TO ACCESS ALL EQUIPMENT, VALVES, CONTROL DEVICES, VOLUME DAMPERS, AND FIRE/SMOKE DAMPERS.
6. FOLLOW MANUFACTURE'S RECOMMENDATIONS FOR INSTALLATION OF EQUIPMENT. ALSO REFER TO TYPICAL DETAILS FOR INSTALLATION OF EQUIPMENT.
7. ALL MATERIALS FURNISHED, AND ALL WORK PERFORMED BY THE MECHANICAL CONTRACTOR SHALL BE IN ACCORDANCE WITH ALL APPLICABLE CODES AND REGULATIONS, INCLUDING BUT NOT LIMITED TO THE LATEST APPLICABLE EDITIONS OF NFPA, IEEE, OSHA, SMACNA, INTERNATIONAL MECHANICAL CODE, INTERNATIONAL BUILDING CODE, AND ANY STATE, COUNTY, AND LOCAL CODES.
8. ALL EQUIPMENT, DUCTWORK, ETC., SHALL BE SUPPORTED SUFFICIENTLY AND ANY ADDITIONAL SUPPORT SHALL BE PROVIDED AS REQUIRED TO PROVIDE VIBRATION FREE AND SAFE INSTALLATION. ALL MISCELLANEOUS STEEL REQUIRED AND/OR AS SHOWN IN DETAILS FOR DUCTWORK, AND EQUIPMENT (UNLESS OTHERWISE NOTED) SHALL BE FURNISHED AND INSTALLED BY THE MECHANICAL CONTRACTOR. SUPPORT ALL DUCTWORK, PIPING AND EQUIPMENT MOUNTED ABOVE THE CEILING DIRECTLY FROM THE STRUCTURE. ALL ATTACHMENTS TO BEAMS, TRUSSES, OR JOIST SHALL BE MADE AT PANEL POINTS WITH BEAM CLAMPS MEETING MSS STANDARDS.
9. ALL CONTROL WIRE AND CONDUIT SHALL COMPLY WITH NEC AND ELECTRICAL SPECIFICATIONS FOR THIS PROJECT.

DUCTWORK GENERAL NOTES (ALL DRAWINGS):

1. ALL DUCTWORK INDICATED IS SCHEMATIC AND SHOW ONLY RELATIVE POSITIONS. PROVIDE OFFSETS, RISES, TRANSITIONS AND ELBOWS AS NEEDED TO INSTALL PROPERLY.
2. PROVIDE ACCESS DOORS IN DUCTWORK FOR OPERATION, ADJUSTMENT, AND MAINTENANCE OF ALL HVAC DEVICES, FANS, DAMPERS, (FIRE, SMOKE, BALANCING) COILS, AND TERMINAL EQUIPMENT.
3. LOCATIONS OF TERMINAL DEVICES, AIR OUTLETS AND INLETS ARE APPROXIMATE. LOCATE PER THE ARCHITECTURAL DRAWINGS AND TO AVOID OTHER TRADE'S WORK. COORDINATE LOCATIONS WITH OTHER TRADES. CONSULT ARCHITECT/ENGINEER FOR CLARIFICATION IF CONFLICTS OCCUR.
4. DUCT DIMENSIONS SHOWN ARE CLEAR INSIDE FACE-TO-FACE DIMENSIONS AND DO NOT INCLUDE DUCT LINER WHERE SPECIFIED. INCREASE DIMENSIONS OF LINED DUCTWORK TO PROVIDE FREE INSIDE AREA EQUAL DIMENSIONS SHOWN. REFER TO THE SPECIFICATIONS FOR LOCATION OF LINED DUCTWORK.
5. FINAL CONNECTIONS FROM HIGH VELOCITY MAIN DUCTS TO AIR TERMINAL UNITS SHALL BE MADE WITH FLEXIBLE DUCTWORK NOT EXCEEDING 3 FEET IN LENGTH. CONNECTIONS BETWEEN LOW VELOCITY DUCTWORK AND/OR TERMINAL UNITS TO AIR INLETS AND OUTLETS SHALL BE MADE WITH FLEXIBLE DUCTWORK NOT EXCEEDING 6 FEET IN LENGTH. LONGER DUCT RUN OUTS SHALL BE CONSTRUCTED OF HARD DUCT OF THE SAME MATERIAL SPECIFIED FOR THE SYSTEM SERVED AND INSULATED AS SPECIFIED FOR THAT SYSTEM. FLEXIBLE DUCTWORK SHALL BE OF THE PRESSURE CLASS AND FACTORY INSULATED AS SPECIFIED FOR THE SYSTEM WHERE INSTALLED.
6. FLEXIBLE DUCTWORK SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS WITHOUT ANY SAGS, SHARP TURNS OR KINKS. AT THE MINIMUM, THE FLEXIBLE DUCTWORK SHALL BE FASTENED TO THE HARD DUCT BY A NYLON STRAP SECURED BY SHEETMETAL SCREWS TO PREVENT SLIPPING OFF FROM COLLAR.
7. PROVIDE VOLUME DAMPERS AT EACH AIR OUTLET, AIR INLET AND TERMINAL DEVICE AND AT EACH BRANCH TAKE-OFF CONNECTION FROM THE MAIN.

MECHANICAL LEGEND																																																																														
SYMBOL	ABRV.	DESCRIPTION	SYMBOL	ABRV.	DESCRIPTION	SYMBOL	ABRV.	DESCRIPTION																																																																						
	EX	EXISTING EQUIPMENT OR DUCTWORK TO REMAIN			CONNECTION POINT, NEW TO EXISTING		EX	EXISTING PIPING TO REMAIN - (X) DESIGNATES SERVICE																																																																						
	RX	EXISTING EQUIPMENT OR DUCTWORK TO BE REMOVED			DISCONNECTION POINT		RX	EXISTING PIPING TO BE REMOVED - (X) DESIGNATES SERVICE																																																																						
		NEW EQUIPMENT OR DUCTWORK			DRAWING KEYNOTE		HWS	HEATING WATER SUPPLY PIPING																																																																						
		LINED DUCTWORK			DEMOLITION DRAWING KEYNOTE		HWR	HEATING WATER RETURN PIPING																																																																						
		SUPPLY DUCT UP			REVISION NUMBER		CWS	CONDENSER WATER SUPPLY PIPING																																																																						
		SUPPLY DUCT DOWN			REVISION CLOUD		CWR	CONDENSER WATER RETURN PIPING																																																																						
		RETURN DUCT UP			PIPE UP		CHWS	CHILLED WATER SUPPLY PIPING																																																																						
		RETURN DUCT DOWN			PIPE DOWN		CHWR	CHILLED WATER RETURN PIPING																																																																						
		EXHAUST DUCT UP			PIPE TEE DOWN		LPS	LOW PRESSURE STEAM SUPPLY PIPING (0-15 PSIG)																																																																						
		EXHAUST DUCT DOWN			TOP PIPE CONNECTION		LPR	LOW PRESSURE STEAM CONDENSATE RETURN																																																																						
		ROUND DUCT ELBOW UP			BALL VALVE OR SHUTOFF VALVE IN RISE		MPS	MEDIUM PRESSURE STEAM SUPPLY PIPING (16-60 PSIG)																																																																						
		ROUND DUCT ELBOW DOWN			PIPE CAP		MPR	MEDIUM PRESSURE STEAM CONDENSATE RETURN																																																																						
		ELBOW WITH TURNING VANES			PIPE UNION		HPS	HIGH PRESSURE STEAM SUPPLY PIPING (61 TO 200 PSIG)																																																																						
		DUCT OFFSET - RISE			FLANGED CONNECTION		HPR	HIGH PRESSURE STEAM CONDENSATE RETURN																																																																						
		DUCT OFFSET - DROP			CONCENTRIC PIPE REDUCER		GWS	GLYCOL WATER SUPPLY																																																																						
		SQUARE / RECTANGULAR DUCT TRANSITION			ECCENTRIC PIPE REDUCER		GWR	GLYCOL WATER RETURN																																																																						
		SQUARE/RECTANGULAR TO ROUND DUCT TRANSITION			FLOW ARROW		RL	REFRIGERANT LIQUID PIPING																																																																						
	SD	SUPPLY DIFFUSER - MULTI-DIRECT.			PIPE ANCHOR		RS	REFRIGERANT SUCTION PIPING																																																																						
		SUPPLY DIFFUSER - DIRECT. (HATCH DENOTES BLANK OFF)			PIPE GUIDE		FOS	FUEL OIL SUPPLY PIPING																																																																						
	SG/EG	SIDEWALL SUPPLY or RETURN GRILLE - (R = REGISTER)		BV	BALL VALVE		FOR	FUEL OIL RETURN PIPING																																																																						
	LD	LINEAR DIFFUSER. SEE SCHEDULE FOR INFORMATION.		BVF	BUTTERFLY VALVE		CW	CITY (DOMESTIC) WATER																																																																						
	RG/EG	RETURN GRILLE - (R = REGISTER)		PV	PLUG VALVE		PC	PUMPED STEAM CONDENSATE																																																																						
	EG	EXHAUST GRILLE - (R = REGISTER)		GV	GATE VALVE		D	CONDENSATE DRAIN PIPING																																																																						
		FLEXIBLE DUCT		GBV	GLOBE VALVE		V	VENT PIPING																																																																						
	FLEX	FLEXIBLE DUCT CONNECTION (TO EQUIPMENT)		PRV	PRESSURE REDUCING VALVE		G	NATURAL GAS PIPING																																																																						
		SPIN TAP WITH VOLUME CONTROL DAMPER		CV	CHECK VALVE	<div>MECHANICAL ABBREVIATIONS</div> <table><tr><th>ABRV.</th><th>DESCRIPTION</th></tr><tr><td>HVAC</td><td>HEATING, VENTILATION AND AIR CONDITIONING</td></tr><tr><td>SA</td><td>SUPPLY AIR</td></tr><tr><td>RA</td><td>RETURN AIR</td></tr><tr><td>EA</td><td>EXHAUST AIR</td></tr><tr><td>OA</td><td>OUTSIDE AIR</td></tr><tr><td>TA</td><td>TRANSFER AIR</td></tr><tr><td>MA</td><td>MIXED AIR</td></tr><tr><td>MBH</td><td>1000 - BRITISH THERMAL UNITS</td></tr><tr><td>kW</td><td>1000-WATT (1 KW = 3,412 BTUH)</td></tr><tr><td>SENS.</td><td>SENSIBLE</td></tr><tr><td>LAT.</td><td>LATENT</td></tr><tr><td>E.A.T.</td><td>ENTERING AIR TEMPERATURE</td></tr><tr><td>L.A.T.</td><td>LEAVING AIR TEMPERATURE</td></tr><tr><td>E.W.T.</td><td>ENTERING WATER TEMPERATURE</td></tr><tr><td>L.W.T.</td><td>LEAVING WATER TEMPERATURE</td></tr><tr><td>DB/WB</td><td>DRY BULB / WET BULB</td></tr><tr><td>IN. W.G.</td><td>INCHES WATER GAUGE (AIR)</td></tr><tr><td>FT. W.G.</td><td>FEET WATER GAUGE (HYDRONIC)</td></tr><tr><td>E.S.P.</td><td>EXTERNAL STATIC PRESSURE</td></tr><tr><td>T.S.P.</td><td>TOTAL STATIC PRESSURE</td></tr><tr><td>TG</td><td>TRANSFER GRILLE</td></tr><tr><td>TR</td><td>TOP REGISTER</td></tr><tr><td>°F</td><td>FAHRENHEIT</td></tr><tr><td>R / R</td><td>REMOVE EXISTING ITEM & RELOCATE TO NEW LOCATION</td></tr><tr><td>EX</td><td>EXISTING</td></tr><tr><td>RL</td><td>RELOCATE EXISTING</td></tr><tr><td>UNO</td><td>UNLESS NOTED OTHERWISE</td></tr><tr><td>NTS</td><td>NOT TO SCALE</td></tr><tr><td>NIC</td><td>NOT IN CONTRACT</td></tr><tr><td>PH</td><td>PHASE</td></tr><tr><td>HZ</td><td>HERTZ</td></tr><tr><td>Ø</td><td>DIAMETER</td></tr><tr><td>AFF</td><td>ABOVE FINISHED FLOOR</td></tr><tr><td>ELEV.</td><td>ELEVATION FROM DATUM</td></tr></table>			ABRV.	DESCRIPTION	HVAC	HEATING, VENTILATION AND AIR CONDITIONING	SA	SUPPLY AIR	RA	RETURN AIR	EA	EXHAUST AIR	OA	OUTSIDE AIR	TA	TRANSFER AIR	MA	MIXED AIR	MBH	1000 - BRITISH THERMAL UNITS	kW	1000-WATT (1 KW = 3,412 BTUH)	SENS.	SENSIBLE	LAT.	LATENT	E.A.T.	ENTERING AIR TEMPERATURE	L.A.T.	LEAVING AIR TEMPERATURE	E.W.T.	ENTERING WATER TEMPERATURE	L.W.T.	LEAVING WATER TEMPERATURE	DB/WB	DRY BULB / WET BULB	IN. W.G.	INCHES WATER GAUGE (AIR)	FT. W.G.	FEET WATER GAUGE (HYDRONIC)	E.S.P.	EXTERNAL STATIC PRESSURE	T.S.P.	TOTAL STATIC PRESSURE	TG	TRANSFER GRILLE	TR	TOP REGISTER	°F	FAHRENHEIT	R / R	REMOVE EXISTING ITEM & RELOCATE TO NEW LOCATION	EX	EXISTING	RL	RELOCATE EXISTING	UNO	UNLESS NOTED OTHERWISE	NTS	NOT TO SCALE	NIC	NOT IN CONTRACT	PH	PHASE	HZ	HERTZ	Ø	DIAMETER	AFF	ABOVE FINISHED FLOOR	ELEV.	ELEVATION FROM DATUM
ABRV.	DESCRIPTION																																																																													
HVAC	HEATING, VENTILATION AND AIR CONDITIONING																																																																													
SA	SUPPLY AIR																																																																													
RA	RETURN AIR																																																																													
EA	EXHAUST AIR																																																																													
OA	OUTSIDE AIR																																																																													
TA	TRANSFER AIR																																																																													
MA	MIXED AIR																																																																													
MBH	1000 - BRITISH THERMAL UNITS																																																																													
kW	1000-WATT (1 KW = 3,412 BTUH)																																																																													
SENS.	SENSIBLE																																																																													
LAT.	LATENT																																																																													
E.A.T.	ENTERING AIR TEMPERATURE																																																																													
L.A.T.	LEAVING AIR TEMPERATURE																																																																													
E.W.T.	ENTERING WATER TEMPERATURE																																																																													
L.W.T.	LEAVING WATER TEMPERATURE																																																																													
DB/WB	DRY BULB / WET BULB																																																																													
IN. W.G.	INCHES WATER GAUGE (AIR)																																																																													
FT. W.G.	FEET WATER GAUGE (HYDRONIC)																																																																													
E.S.P.	EXTERNAL STATIC PRESSURE																																																																													
T.S.P.	TOTAL STATIC PRESSURE																																																																													
TG	TRANSFER GRILLE																																																																													
TR	TOP REGISTER																																																																													
°F	FAHRENHEIT																																																																													
R / R	REMOVE EXISTING ITEM & RELOCATE TO NEW LOCATION																																																																													
EX	EXISTING																																																																													
RL	RELOCATE EXISTING																																																																													
UNO	UNLESS NOTED OTHERWISE																																																																													
NTS	NOT TO SCALE																																																																													
NIC	NOT IN CONTRACT																																																																													
PH	PHASE																																																																													
HZ	HERTZ																																																																													
Ø	DIAMETER																																																																													
AFF	ABOVE FINISHED FLOOR																																																																													
ELEV.	ELEVATION FROM DATUM																																																																													
	AD	DUCT ACCESS DOOR		BFP	BACKFLOW PREVENTER																																																																									
	VD	VOLUME CONTROL DAMPER			PRESSURE RELIEF VALVE																																																																									
	BD	BACKDRAFT DAMPER			AUTOMATIC FLOW CONTROL VALVE																																																																									
	MD	MOTORIZED DAMPER			CALIBRATED BALANCING VALVE																																																																									
		ACCESS PANEL			AUTOMATIC AIR VENT																																																																									
	FD	VERTICAL FIRE DAMPER (WALL)			MANUAL AIR VENT																																																																									
	HFD	HORIZONTAL FIRE DAMPER (FLOOR)			P/T PLUG																																																																									
	SD	VERTICAL SMOKE DAMPER (WALL)			PRESSURE GAGE W/ SHUT-OFF																																																																									
	HSD	HORIZONTAL SMOKE DAMPER (FLOOR)			THERMOMETER																																																																									
	FD/SD	COMBINATION VERTICAL FIRE & SMOKE DAMPER			STRAINER (W/ BALL VALVE AND CAP)																																																																									
	HFD/SD	COMBINATION HORIZONTAL FIRE & SMOKE DAMPER			HOSE BIBB																																																																									
	RD	CEILING RADIATION FIRE DAMPER			FLEXIBLE CONNECTOR																																																																									
	DD	DUCT SMOKE DETECTOR			2-WAY CONTROL VALVE																																																																									
		THERMOSTAT			3-WAY CONTROL VALVE																																																																									
		HUMIDISTAT			TRIPLE DUTY VALVE WITH MEASURING CONNECTIONS																																																																									
		COMBINATION THERMOSTAT & HUMIDISTAT			INVERTED BUCKET STEAM TRAP																																																																									
		STATIC PRESSURE SENSOR			FLOAT & THERMOSTATIC STEAM TRAP																																																																									
		CARBON DIOXIDE SENSOR		UC	UNDER CUT DOOR - 1"																																																																									
		CARBON MONOXIDE SENSOR			LOUVERED DOOR																																																																									
		NITROUS OXIDE SENSOR		RA / EA	RETURN OR EXHAUST AIR																																																																									
		TEMPERATURE SENSOR		SA / OA	SUPPLY OR OUTSIDE AIR																																																																									
		STARTER			EQUIPMENT UNIT DESIGNATION																																																																									
		OCCUPANCY SENSOR			DIFFUSER, REGISTER & GRILLE UNIT DESIGNATION W/ CFM																																																																									
		REFRIGERANT DETECTOR																																																																												

NOTES:
1. NOT ALL SYMBOLS AND ABBREVIATIONS ARE IN USE FOR THIS PROJECT.


DRAWING SET: 90% Submission
RELEASE DATE: 12/29/2024

PRINTED OR ELECTRONIC DRAWINGS AND DOCUMENTATION MAY NOT BE REPRODUCED IN ANY FORM WITHOUT WRITTEN PERMISSION FROM KERSTING ARCHITECTURE, INC.
COPYRIGHT 2022. ALL RIGHTS RESERVED.

Allen + Shariff
MEP Engineering
Project Management
205 East Market Street
Salisbury, Maryland 21801
443.545.1300


CHABAD OF WILMINGTON - MIKVAH
JEWISH COMMUNITY CENTER
2317 Market Street
Wilmington, North Carolina 28403
PROJECT NO. 13-16

KERSTING ARCHITECTURE
4022 MARKET STREET SUITE 201 - WILMINGTON, NC 28403 - (910) 762-1348

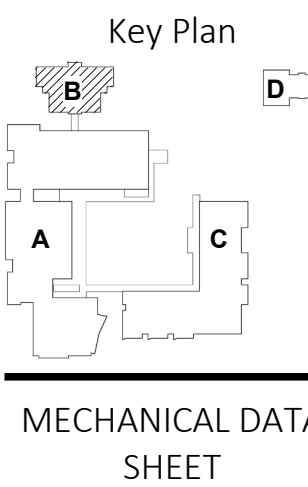

MECHANICAL DATA SHEET

M001-B

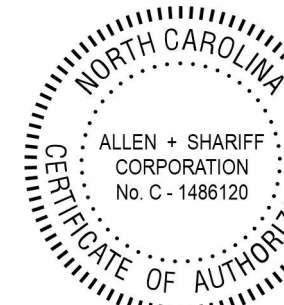

MECHANICAL SPECIFICATIONS	
MECHANICAL GENERAL CONDITIONS (230101)	
1. GENERAL	
a. CONFORM TO ALL GENERAL AND SPECIAL CONDITIONS OF CONTRACT AS SPECIFIED BY ARCHITECT AND/OR OWNER.	
b. PRODUCTS AND INSTALLATION SHALL COMPLY WITH ALL APPLICABLE LAWS, CODES, GOVERNMENT REGULATIONS, UTILITY COMPANY REQUIREMENTS, ETC. OF ALL AUTHORITIES HAVING JURISDICTION. WORK SHALL COMPLY WITH THE FOLLOWING CODES, STANDARDS AND ORGANIZATIONS:	
1. NORTH CAROLINA MECHANICAL CODE	
2. NORTH CAROLINA PLUMBING CODE	
3. NORTH CAROLINA ENERGY CODE	
4. NATIONAL ELECTRIC CODE	
5. NFPA	
6. UNDERWRITERS LABORATORY (UL), IRI, FM	
7. SMACNA "HVAC DUCT CONSTRUCTION STANDARDS" GUIDELINES, DETAILS, & MODEL SPECIFICATION,	
8. ASHRAE	
c. WHERE CONFLICTS EXIST BETWEEN CODES, STANDARDS OR THIS SPECIFICATION THE HIGHER REQUIREMENT SHALL APPLY. DEVIATIONS FROM THE CONTRACT DOCUMENTS REQUIRED BY THE ABOVE AUTHORITIES SHALL BE SUBMITTED TO THE ENGINEER FOR REVIEW, OBTAIN PERMITS AND PAY ALL FEES. ARRANGE FOR ALL REQUIRED INSPECTIONS AND APPROVALS. CONFIRM ALL UTILITY COMPANY REQUIREMENTS AND CONNECTION POINTS IN FIELD, PRIOR TO STARTING WORK.	
d. ALL SPECIFICATIONS AND DRAWINGS, I.E., ARCHITECTURAL, MECHANICAL, PLUMBING, AND ELECTRICAL ARE COMPLEMENTARY AND MUST BE USED IN COMBINATION TO OBTAIN COMPLETE CONSTRUCTION INFORMATION. ANY INFORMATION CONFLICTS WITHIN THE SPECIFICATIONS AND DRAWINGS SHALL BE BROUGHT TO THE ENGINEER'S ATTENTION. DRAWINGS ARE DIAGRAMMATIC. CONFIRM ALL DIMENSIONS BY FIELD MEASUREMENT. THE EXACT LOCATIONS FOR APPARATUS, FIXTURES, EQUIPMENT AND PIPING WHICH IS NOT COVERED BY DRAWINGS, SHALL BE OBTAINED FROM THE ARCHITECT OR HIS REPRESENTATIVE IN THE FIELD, AND THE WORK SHALL BE LAID OUT ACCORDINGLY.	
e. EACH CONTRACTOR SHALL PROVIDE FOR HIS OWN CLEAN-UP, REMOVAL AND LEGAL DISPOSAL OF ALL RUBBISH DAILY. CONTRACTOR SHALL PROTECT THEIR WORK AND EXISTING OR ADJACENT PROPERTY AGAINST WEATHER, TO MAINTAIN THEIR WORK, MATERIALS, APPARATUS AND FIXTURES FREE FROM INJURY OR DAMAGE. ANY WORK DAMAGED BY FAILURE TO PROVIDE PROTECTION REQUIRED, SHALL BE REMOVED AND REPLACED WITH NEW WORK AT THE CONTRACTOR'S EXPENSE.	
f. THE CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, SEQUENCES OF CONSTRUCTION AND THE SAFETY OF WORKMEN.	
g. NO MEP, IT, FP SYSTEMS OR COMPONENTS SHALL BE INSTALLED OR ROUTED ABOVE ELECTRICAL PANELS AND EQUIPMENT OR THROUGH ELEVATOR ROOMS, FIREPUMP ROOMS, OR STARTTOWERS UNLESS SERVING THE MACHINE ROOM, FIREPUMP ROOM OR STARTTOWER.	
h. THE CONTRACTOR SHALL COORDINATE AND OBTAIN A WRITTEN LISTING OF ELECTRICAL CHARACTERISTICS OF ALL MECHANICAL EQUIPMENT FROM ELECTRICAL CONTRACTOR PRIOR TO ORDERING OF EQUIPMENT. NO ADDITIONAL PAYMENT WILL BE MADE FOR LACK OF CONTRACTOR COORDINATION OF ELECTRICAL CHARACTERISTICS	
i. IN CASES OF DOUBT AS TO THE WORK INTENDED, OR IN THE EVENT OF NEED FOR EXPLANATION THEREOF, THE CONTRACTOR SHALL REQUEST SUPPLEMENTARY INSTRUCTIONS FROM THE ENGINEER. NO CHANGES ARE TO BE MADE TO THE WORK OF THIS CONTRACT WITHOUT PRIOR KNOWLEDGE AND APPROVAL OF THE ENGINEER. THE CONTRACTOR SHALL HOLD THE OWNER AND ITS CONSULTANTS HARMLESS AGAINST ALL CLAIMS AND JUDGMENTS ARISING OUT OF THE CONTRACTOR'S PERFORMANCE OF THE WORK OF THIS CONTRACT. THE CONTRACTOR SHALL NOT PROCEED WITH ANY WORK WHICH HE EXPECTS ADDITIONAL COMPENSATION BEYOND THE CONTRACT AMOUNT, WITHOUT WRITTEN AUTHORIZATION FROM THE APPROPRIATE AUTHORITY. FAILURE TO OBTAIN SUCH AUTHORIZATION SHALL INVALIDATE ANY CLAIM FOR EXTRA COMPENSATION.	
j. IT SHALL BE THE RESPONSIBILITY OF THIS CONTRACTOR TO INSTALL THE HEATING, VENTILATION AND AIR CONDITIONING SYSTEM SO AS TO INSURE QUIET OPERATION. NO VIBRATION OR SOUND SHALL BE TRANSMITTED TO THE BUILDING, STRUCTURE OR OCCUPIED AREAS. THE DECISION OF THE ENGINEER AS TO THE QUIETNESS OF THE SYSTEM AND EQUIPMENT SHALL BE FINAL. IT SHALL BE THIS CONTRACTORS RESPONSIBILITY TO CORRECT OR REPLACE ANY NOISY SYSTEM OR EQUIPMENT AS REQUIRED.	
k. OBTAIN PERMITS AND PAY ALL FEES. ARRANGE FOR ALL REQUIRED INSPECTIONS AND APPROVALS.	
2. BASIS OF DESIGN AND SUBSTITUTIONS	
a. WHEREVER THE WORDS "APPROVED ANY," "APPROVED EQUAL," "AS DIRECTED" OR SIMILAR PHRASES ARE USED IN THE FOLLOWING SPECIFICATIONS, THEY SHALL BE UNDERSTOOD TO REFER TO THE OWNER AS THE APPROVING AGENCY. THE NAME OR MAKE OF ANY EQUIPMENT OR MATERIALS NAMED IN THE SPECIFICATION (WHETHER OR NOT THE WORDS "OR APPROVED EQUAL" ARE USED) SHALL BE KNOWN AS THE "STANDARD".	
b. SUBMIT SHOP DRAWINGS FOR MECHANICAL EQUIPMENT, FIRE PROTECTION SYSTEMS, DUCTWORK AND PLUMBING FIXTURES AND EQUIPMENT WITH ADEQUATE DETAILS AND SCALES TO CLEARLY SHOW CONSTRUCTION. INDICATE THE OPERATING CHARACTERISTICS FOR EACH REQUIRED ITEM. CLEARLY IDENTIFY EACH ITEM ON THE SUBMITTAL AS TO MARK, LOCATION AND USE, USING SAME IDENTIFICATION AS PROVIDED ON DESIGN DRAWINGS. SHOP DRAWINGS TO BE SUBMITTED INCLUDE BUT NOT LIMITED TO:	
1. SHEETMETAL	
2. DIFFUSERS, GRILLES & REGISTERS	
3. FIRE DAMPERS	
4. VALVES & PIPING	
5. ALL EQUIPMENT	
DUCTWORK AND FIRE PROTECTION DRAWINGS SHALL BE FULLY DIMENSIONED BASED ON FIELD VERIFIED BUILDING CLEARANCES AND ARCHITECTURAL CEILING LAYOUTS, AND INDICATE STRUCTURAL, LIGHTING, DUCTWORK AND PIPING AT ALL CRITICAL LOCATIONS.	
c. CONTRACTOR SHALL REVIEW AND INDICATE HIS APPROVAL OF EACH SHOP DRAWING PRIOR TO SUBMITTAL FOR REVIEW. DO NOT START WORK OR FABRICATION UNTIL SHOP DRAWINGS HAVE BEEN REVIEWED BY THE ENGINEER AND RETURNED TO THE CONTRACTOR.	
d. SUBMITTALS WILL BE REVIEWED ONLY FOR GENERAL COMPLIANCE WITH THE CONTRACT DOCUMENTS AND NOT FOR DIMENSIONS OR QUANTITIES. THE SUBMITTAL REVIEW SHALL NOT RELIEVE THE CONTRACTOR OF RESPONSIBILITY FOR PURCHASE OF ANY ITEM IN FULL COMPLIANCE WITH THE CONTRACT DOCUMENTS OR ITS COMPLETE AND PROPER INSTALLATION.	
e. WHERE SUBMITTALS VARY FROM THE CONTRACT REQUIREMENTS, THE CONTRACTOR SHALL CLEARLY INDICATE ON SUBMITTAL OR ACCOMPANYING DOCUMENTS THE NATURE AND REASON FOR VARIATIONS.	
f. EACH MANUFACTURER OR HIS REPRESENTATIVE MUST CHECK THE APPLICATION OF HIS EQUIPMENT AND CERTIFY AT TIME OF SHOP DRAWING SUBMITTAL THAT EQUIPMENT HAS BEEN PROPERLY APPLIED AND CAN BE INSTALLED, SERVICED AND MAINTAINED WHERE INDICATED ON DRAWINGS. ADVISE ENGINEER IN WRITING WITH SUBMITTAL DRAWINGS OF ANY POTENTIAL PROBLEMS. THE MANUFACTURER SHALL BE RESPONSIBLE FOR ANY CHANGES THAT MIGHT BE NECESSARY BECAUSE OF PHYSICAL CHARACTERISTICS OF EQUIPMENT THAT HAVE NOT BEEN CALLED TO THE ENGINEER'S ATTENTION AT THE TIME OF SUBMITTAL.	
3. CUTTING, PATCHING AND DRILLING	
a. ALL CUTTING AND PATCHING OF THE BUILDING CONSTRUCTION REQUIRED FOR THIS WORK SHALL BE BY THIS CONTRACTOR UNLESS SHOWN ON ARCHITECTURAL DRAWINGS AND CONFIRMED AS TO SIZE AND LOCATION PRIOR TO NEW CONSTRUCTION. CUTTING SHALL BE IN A NEAT AND WORKMANLIKE MANNER. NEATLY SAW CUT ALL RECTANGULAR OPENINGS. SET SLEEVE THROUGH OPENINGS, AND FINISH PATCH OR PROVIDE TRIM FLANGE AROUND OPENING. CORE DRILL AND SLEEVE ALL ROUND OPENINGS. DO NOT CUT ANY STRUCTURAL COMPONENTS WITHOUT ARCHITECT'S APPROVAL.	
b. PATCH AND FINISH TO MATCH ADJACENT AREAS THAT HAVE BEEN CUT, DAMAGED OR MODIFIED AS A RESULT OF THE INSTALLATION OF THE MECHANICAL OR ELECTRICAL EQUIPMENT. FIRE STOP ALL PENETRATIONS OF FIRE RATED CONSTRUCTION IN A CODE APPROVED MANNER.	
c. ALL CONTRACTORS SHALL CONFIRM WITH OWNER, PRIOR TO BID, TIMES AVAILABLE FOR NOISE PRODUCING WORK SUCH AS CUTTING AND CORE DRILLING OF FLOORS, WALLS, ETC., AS WELL AS TIMES FOR WORK WHICH REQUIRE ACCESS INTO ADJOINING TENANT SPACES. INCLUDE ANY PREMIUM TIME IN BID.	
d. EXACT LOCATION OF ROOFTOP EQUIPMENT SHALL BE APPROVED BY OWNER'S STRUCTURAL ENGINEER.	
e. INFORMATION REGARDING REQUIRED PIPE OPENINGS IN WALLS, FLOORS, CHASES, ETC., AND CONCRETE EQUIPMENT PADS OR FOUNDATIONS SHALL BE GIVEN TO THE GENERAL CONTRACTOR BY THIS CONTRACTOR PRIOR TO THE CONSTRUCTION PERIOD. IF THIS CONTRACTOR FAILS TO COMPLY WITH THIS REQUEST, OR IF INCORRECT INFORMATION IS GIVEN, THE NECESSARY CUTTING AND PATCHING WILL BE PERFORMED BY THE GENERAL CONTRACTOR, AT THIS CONTRACTOR'S EXPENSE.	
4. FIRESTOPPING	
a. ALL SERVICES THAT PASS THRU FIRE OR SMOKE RATED PARTITIONS, WALLS, FLOORS, SHALL BE FIRESTOPPED. FIRE STOPPING RATING SHALL MATCH PARTITION RATING. ALL FIRE STOPPING SYSTEM SHALL MEET THE REQUIREMENTS OF ASTM E 814 UL 1478, AND BE FACTORY MUTUAL APPROVED.	
b. ALL FIRESTOPPING AND/OR SMOKE STOPPING MATERIAL AND INSTALLATION SHALL BE AS MANUFACTURED BY HILTI OR APPROVED EQUAL.	
5. ACCESS DOORS & PANELS	
a. ACCESS DOORS SHALL BE PROVIDED IN WALLS AND CEILINGS WHERE REQUIRED TO PERMIT PROPER ACCESS TO VALVES AND ANY OTHER SUCH DEVICES WHICH REQUIRE MAINTENANCE OR SERVICE. DOORS PLACED IN WALLS, PARTITIONS OR OTHER FIRE-RATED CONSTRUCTION SHALL HAVE A LABEL SIGNIFYING THAT THE DOOR HAS THE SAME FIRE RATING AS THE FIRE-RATED CONSTRUCTION.	
b. THIS CONTRACTOR SHALL FURNISH ACCESS PANELS TO THE GENERAL CONTRACTOR FOR INSTALLATION.	
c. ACCESS PANELS SHALL BE CONSTRUCTED OF 14 GAUGE STEEL, WITH 16 GAUGE STEEL FRAMES. DOORS SHALL FINISH FLUSH WITH THE SURROUNDING SURFACE. FRAMES SHALL HAVE 3 INCH WIDE EXPANDED METAL, FOR PLASTERED SURFACES AND PLAIN FLANGED TYPE FRAME FOR TILE, MASONRY OR GYPSUM BOARD SURFACES. DOORS AND FRAMES SHALL BE FURNISHED PRIME COATED. DOORS INSTALLED IN CERAMIC TILE OR OTHER NON-PAINTED SURFACES SHALL BE STAINLESS STEEL. HINGES SHALL BE CONCEALED SPRING TYPE, TO ALLOW DOORS TO BE OPENED 175 DEGREES. LOCKS SHALL BE FLUSH SCREWDRIVER TYPE WITH STEEL CAMS. ACCESS PANELS SHALL BE 24 INCHES BY 16 INCHES OR LARGER AS MAY BE REQUIRED FOR PROPER ACCESS TO THE DEVICE BEING SERVED.	
d. ACCESS PANELS ARE NOT REQUIRED IN COMPLETELY ACCESSIBLE LIFT OUT TILE CEILINGS. CONTRACTOR SHALL REVIEW THE ROOM FINISH SCHEDULE ON THE ARCHITECTURAL DRAWINGS IN ORDER TO VERIFY THE NEED FOR ACCESS PANEL.	
6. PAINTING	
a. IN FINISHED SPACES, PAINTING OF ALL MECHANICAL EQUIPMENT, APPARATUS, AND PIPING SHALL BE DONE BY THE PAINTING TRADE UNDER THE GENERAL CONTRACTOR SPECIFICATION, EXCEPT WHERE SPECIFIED TO BE DONE BY THE MECHANICAL CONTRACTOR.	
7. TEMPORARY HEAT	
a. THE COSTS OF TEMPORARY HEAT, INCLUDING UTILITY COSTS, SHALL BE AT THE EXPENSE OF THE HEATING TRADE (MECHANICAL CONTRACTOR). THE HEATING TRADE SHALL PROVIDE THE MEANS OF TEMPORARY HEAT, EXISTING HEATING EQUIPMENT AND SYSTEMS MAY NOT BE USED DURING CONSTRUCTION AS THE SYSTEMS SERVE OTHER OCCUPIED SPACES WITHIN THE BUILDING.	
b. THE PERMANENT MECHANICAL SYSTEM SHALL NOT BE USED UNDER ANY EXCEPTIONS TO PROVIDE TEMPORARY HEATING. VENTILATING EXHAUST OR AIR CONDITIONING UNTIL THE BUILDING IS CLEAN, WITHOUT ANY DUST OR DEBRIS THAT CAN ENTER THE MECHANICAL SYSTEM AND IS READY FOR OCCUPANCY, COVERING THE RETURN/EXHAUST AIR INLETS WITH FILTER MEDIA IS NOT AN ACCEPTABLE ALTERNATIVE TO HAVING AN ENCLOSED, DUST-FREE ENVIRONMENT FOR THE SYSTEMS TO OPERATE IN. IN NO EVENT SHALL THE MECHANICAL CONTRACTOR'S ONE-YEAR WARRANTY BE SHORTENED BY THE USE OF PERMANENT EQUIPMENT FOR TEMPORARY HEAT.	
8. RECORD DRAWINGS	
a. EACH CONTRACTOR OR SUBCONTRACTOR SHALL KEEP ONE (1) COMPLETE SET OF THE CONTRACT WORKING DRAWINGS ON THE JOB SITE ON WHICH HE SHALL REGULARLY RECORD ANY DEVIATIONS OR CHANGES FROM SUCH CONTRACT DRAWINGS MADE DURING CONSTRUCTION.	
b. THESE DRAWINGS SHALL RECORD THE LOCATION OF ALL CONCEALED EQUIPMENT, PIPING, ELECTRIC SERVICE, SEWERS, WASTES, VENTS, DUCTS, CONDUIT AND OTHER PIPING, BY MEASURED DIMENSIONS TO EACH SUCH ITEM FROM READILY IDENTIFIABLE AND ACCESSIBLE WALLS OR CORNERS OF THE BUILDING. PLANS ALSO SHALL SHOW INVERT ELEVATION OF SEWERS AND TOP ELEVATION OF ALL OTHER BELOW-GRADE LINES.	
c. RECORD DRAWINGS SHALL BE KEPT CLEAN AND UNDAMAGED AND SHALL NOT BE USED FOR ANY PURPOSE OTHER THAN RECORDING DEVIATIONS FROM WORKING DRAWINGS AND EXACT LOCATIONS OF CONCEALED WORK.	
d. AFTER THE PROJECT IS COMPLETED, THESE SETS OF DRAWINGS SHALL BE DELIVERED TO THE ARCHITECT IN GOOD CONDITION, AS A PERMANENT RECORD OF THE INSTALLATION AS ACTUALLY CONSTRUCTED.	
9. WARRANTY	
a. FULLY WARRANT ALL MATERIALS, EQUIPMENT AND WORKMANSHIP FOR ONE (1) YEAR FROM DATE OF ACCEPTANCE. EXTEND ALL MANUFACTURER'S WARRANTIES TO OWNER, INCLUDING ALL EXTENDED WARRANTIES ON HVAC EQUIPMENT.	
b. REPAIR OR REPLACE WITHOUT CHARGE TO THE OWNER ALL ITEMS FOUND DEFECTIVE DURING THE WARRANTY PERIOD. IN THE CASE OF REPLACEMENT OR REPAIR DUE TO FAILURE WITHIN THE WARRANTY PERIOD, THE WARRANTY ON THAT PORTION OF THE WORK SHALL BE EXTENDED FOR A MINIMUM PERIOD OF ONE (1) YEAR FROM THE DATE OF SUCH REPLACEMENT OR REPAIR.	
REFRIGERANT PIPING (232030)	
1. INSTALL REFRIGERANT PIPING BETWEEN CONDENSING UNIT AND DX COIL. PIPING SHALL BE REFRIGERANT GRADE TYPE "L" OR ACR COPPER WITH BRAZED JOINTS. PIPE PER MANUFACTURER'S PIPING DIAGRAMS AND RECOMMENDATIONS.	
2. ISOLATE PIPING FROM STRUCTURE WITH ONE (1) INCH INSULATION BETWEEN ALL PIPING AND SUPPORT POINTS.	
3. AFTER COMPLETION, PRESSURE TEST PIPING, PURGE AND EVACUATE SYSTEM TWICE AND CHARGE SYSTEM WITH REFRIGERANT AND OIL.	
4. INSTALL PIPING IN AS SHORT AND DIRECT ARRANGEMENT AS POSSIBLE TO MINIMIZE PRESSURE DROP. PROVIDE OIL TRAP AS RECOMMENDED BY THE EQUIPMENT MANUFACTURER.	
5. INSTALL UNIONS TO ALLOW REMOVAL OF SOLENOID VALVES, PRESSURE REDUCING VALVES, EXPANSION VALVES, AND AT CONNECTIONS TO COMPRESSORS AND EVAPORATORS.	
6. FILL THE PIPE AND FITTINGS DURING BRAZING, WITH NITROGEN TO PREVENT FORMATION OF SCALE.	
PIPE WALL SEALS (230517)	
1. WALL PIPE SEALS WITH RUBBER LINKS SHALL BE THUNDERLINE LINK SEAL, OR APPROVED EQUAL. WALL PIPE SEALS WITH INORGANIC MATERIAL LINKS THE PENETRATIONS OF FIRE RATED WALLS SHALL BE THUNDERLINE PYRO-PAC, OR APPROVED EQUAL.	
2. SEALS SHALL BE MODULAR MECHANICAL TYPE CONSISTING OF INTERLOCKING SYNTHETIC RUBBER OR INORGANIC MATERIAL LINKS SHAPED TO CONTINUOUSLY FILL THE ANNULAR SPACE BETWEEN THE PIPE AND WALL OPENING. LINKS SHALL BE LOOSELY ASSEMBLED WITH BOLTS TO FORM A CONTINUOUS BELT AROUND THE PIPE. A PRESSURE PLATE SHALL BE PROVIDED UNDER THE BOLT HEAD AND NUT OF EACH LINK. SEALS SHALL BE CONSTRUCTED TO PROVIDE ELECTRICAL INSULATION BETWEEN THE PIPE AND SLEEVE, THUS REDUCING CHANCES OF CATHODIC REACTION BETWEEN THESE TWO MEMBERS.	
3. AFTER THE SEAL ASSEMBLY IS POSITIONED IN THE SLEEVE, THE TIGHTENING OF THE BOLTS SHALL CAUSE THE SEALING ELEMENTS TO EXPAND AND PROVIDE AN ABSOLUTEY WATER-TIGHT SEAL BETWEEN THE PIPE AND SLEEVE.	
4. SLEEVES SHALL BE MANUFACTURED FROM HEAVY-WALL, WELDED OR SEAMLESS STEEL PIPE. A FULL CIRCLE CONTINUOUSLY WELDED WATER STOP PLATE SHALL BE PROVIDED TO ASSURE POSITIVE WATER SEALING OF THE SLEEVE. SLEEVE SHALL BE PROTECTED BY A COATING OF ENRICHED RED PRIMER.	
DUCTWORK (233113)	
1. FABRICATE AND ERECT ALL DUCTWORK TO ASHRAE & SMACNA STANDARDS FROM ALUMINIUM. COMPLY WITH NFPA BULLETN 90A REQUIREMENTS.	
2. GENERAL SUPPLY AND RETURN DUCTWORK HAVE A SMACNA 2" STATIC PRESSURE RATING WITH SEAL CLASS B SEAMS AND JOINTS.	
3. ALL RECTANGULAR TRANSFER DUCTWORK SHALL HAVE 1" THICK ACOUSTICAL LINER. LINER SHALL BE FLEXIBLE AND CONSTRUCTED OF GLASS FIBERS BONDED WITH A THIMOSSETTING RESIN. THE SURFACE OF THE LINER SHALL HAVE AN ANTIMICROBIAL EROSION RESISTANCE COATING TESTED BY NRTL AND REGISTERED BY THE EPA FOR USE IN HVAC SYSTEMS. MINIMUM R-VALUE SHALL BE 4.2.	
4. GENERAL EXHAUST DUCTWORK UNDER 45' IN LENGTH SHALL HAVE A SMACNA 1" STATIC PRESSURE RATING WITH SEAL CLASS B SEAM AND JOINTS. EXHAUST INSULATION OVER 45' IN LENGTH SHALL HAVE A SMACNA 2" STATIC PRESSURE RATINGS WITH SEAL CLASS A SEAM AND JOINTS.	
5. ALL FLEXIBLE DUCTWORK SHALL BEAR THE UL 181 LABEL (CLASS 1 AIR DUCT) AND SHALL BE FACTORY INSULATED (1-1/2" - 3/8 LB. FIBERGLASS) ATCO UPC #708 1/2 OR EQUAL. FLEXIBLE DUCTWORK SHALL COMPLY W/ NFPA 90A, AND NFPA 90B. ALL FLEXIBLE DUCTWORK CONNECTED TO DIFFUSERS SHALL NOT BE LESS THAN THE NECK SIZE OF THE DIFFUSER. MINIMUM FLEXIBLE DUCT BEND RADIUS OR EQUIVALENT SHALL BE 3 DUCT DIAMETERS, MAXIMUM LENGTH SHALL BE 6'-0", NO MORE THAN THE CURVATURE OF TWO (2) 90 DEGREE BENDS WILL BE ACCEPTABLE. FLEXIBLE DUCTS SHALL BE INDEPENDENTLY SUPPORTED FROM THE STRUCTURE AND CONNECTED WITH PLASTIC DRAIN BANDS TIGHTENED WITH MANUFACTURERS TOOL. FLEXIBLE DUCTS ARE NOT PERMITTED IN ROOMS WITHOUT CEILINGS.	
6. ALL FABRIC DUCTWORK SHALL BE COATED, 100% POLYESTER, WOVEN, FIRE RETARDANT MATERIAL, UL AND NFPA APPROVED, NON-POROUS AND MACHINE WASHABLE. DISPERSION ORIFICE SIZE, SPACING AND QUANTITY TO BE SELECTED BY THE MANUFACTURER FOR THE REQUIRED CFM AND DIFFUSER LENGTH OF EACH APPLICATION. COLOR TO BE SELECTED BY THE ARCHITECT. PROVIDE GALVANIZED SUSPENSION HARDWARE AND ACCESSORIES. SIMILAR TO DUCTOX DURATEX HIGH THROW MODEL.	
7. INCLUDE ALL ACOUSTIC, DOUBLE RADIUS AIRFOIL, SHAPED PERFORATED ALUMINIUM TURNING VANES, MANUAL DAMPERS, FLEXIBLE CONNECTORS, GRILLES AND DIFFUSERS, ACOUSTIC LINING, AND OTHER SHEET METAL ACCESSORIES FOR THE PROJECT. VOLUME DAMPERS TO BE OF OPPOSED BLADE TYPE CONSTRUCTED IN ACCORDANCE WITH "SMACNA" STANDARDS.	
8. ALL BRANCH CONNECTION FITTINGS IN RECTANGULAR DUCTWORK SHALL BE 45 DEGREE TRANSITION TYPE, CONICAL FINNINGS OR SPIN-IN FITTING. BUT FITTINGS ARE NOT ACCEPTABLE.	
9. DRYER VENT ROUND DUCTWORK SHALL BE 22 GAUGE (MINIMUM) ALUMINIUM CONSTRUCTION WITH DIE STAMPED OR FABRICATED FITTINGS. DUCTS SHALL BE CONSTRUCTED FOR LOW PRESSURE OPERATION WITH LONGITUDINAL SEAM UP. FABRICATED ELBOWS SHALL BE THE MULTI-PIECE TYPE WITH EACH SEGMENT NOT EXCEEDING 22-1/2 DEGREES. THROAT RADIUS OF ALL ELBOWS SHALL BE EQUAL TO THE DUCT DIAMETER. TEES SHALL BE THE CONCEALED TYPE. JOINTS SHALL BE THE SLIP OF FLANGED TYPE. DO NOT USE DRY TIE-UP COUPLING BANDS. MAKE-UP SLIP JOINTS WITH DUCT SEALER. DUCTS FOR EXHAUSTING CLOTHES DRYERS SHALL NOT BE ASSEMBLED WITH SCREWS OR OTHER FASTENING METHODS THAT EXTEND INTO THE DUCT AND THAT WOULD CATCH LINT. PROVIDE NFPA 90 A APPROVED FLEXIBLE DUCT SECTION AT CONNECTION OF DRYER TO DUCTWORK. PROVIDE AND INSTALL EXTRUDED ALUMINIUM DRYER FLAPPER VENT AT TERMINATION OF EACH DRYER VENT. WHERE CLOTHES DRYER VENT DUCTS PASS THROUGH WALLS, FLOORS, OR PARTITIONS, THAT SPACE AROUND THE DUCT SHALL BE SEALED WITH NON-COMBUSTIBLE MATERIAL AND FIRESTOPPED. SIGNAGE	
INDICATING EQUIVALENT LENGTH SHALL BE POSTED WITHIN 6" OF THE DRYER CONNECTION IN ACCORDANCE WITH IMC 504.6.5 2009.	
10. PROVIDE FIRE DAMPERS WITH ACCESS DOORS AT ALL FIRE RATED WALLS, PARTITIONS AND CEILINGS. DAMPERS SHALL HAVE RATING EQUIVALENT TO BARRIER. DAMPER SHALL BE THE DYNAMIC TYPE AND SHALL BE ABLE TO CLOSE AGAINST AN AIRSTREAM. DAMPERS SHALL MEET ALL NFPA AND IBC REQUIREMENTS.	
11. PROVIDE SMOKE DAMPERS WITH ACCESS DOORS AT ALL SMOKE BARRIERS/PARTITIONS. UNIT SHALL INCORPORATE BLADE END SWITCHES (OPEN AND CLOSED), AND OUTSIDE THE DUCT MOUNTED UL LISTED MOTOR. PROVIDE MANUFACTURER'S STANDARD UL LISTED OPEN-CLOSE - RESET SWITCH AND POSITION PILOT LIGHTS IN UNIT MOUNTED ENCLOSURE. ENCLOSURE TO BE CAPABLE OF BEING REMOVED FOR REMOTE MOUNTING TO ENSURE VISIBILITY AFTER SYSTEM INSTALLATION.	
12. PROVIDE COMBINATION FIRE/SMOKE DAMPERS AT ALL FIRE/SMOKE RATED SHAFT AND WALL LOCATIONS. EACH COMBINATION FIRE SMOKE DAMPER SHALL HAVE 16 GA. GALVANIZED BLADES STRENGTHENED WITH GROOVES MEETING REQUIREMENTS OF UL STANDARD 555 & 555S AND HAVE AN 1-1/2 HOUR RATING. BASIS OF DESIGN SHALL BE GREENHECK MODEL FSD 200 SERIES. DAMPERS SHALL BE EQUIPPED STANDARD WITH AN ELECTRIC HEAT-RESPONSIVE DEVICE THAT PERFORMS THE SAME FUNCTION AS A FUSE LINK TO CLOSE DAMPER AT 350 °F. PROVIDE POSITION INDICATING SWITCHES TO MEET REQUIREMENTS OF SMOKE PURGE CONTROL AND/OR BUILDING MANAGEMENT SYSTEM CONTROLS. THE DAMPER OPERATION AND CONSTRUCTION SHALL MEET UL REQUIREMENTS.	
13. PROVIDE CURBS FOR ALL ROOF EQUIPMENT. CURBS SHALL BE FURNISHED AS ACCESSORIES TO THE EQUIPMENT OR 8" HIGH PATE OR EQUAL EQUIPMENT SUPPORTS SPANNING STRUCTURE AND FLASHED INTO ROOFING. ALL CUTTING, FLASHING, AND PATCHING OF ROOF SHALL BE BY OWNER'S ROOFING CONTRACTOR AND PAID FOR BY MECHANICAL CONTRACTOR.	
14. PROVIDE BIG FOOT H FRAME SETS SUPPORT SYSTEM OR SIMILAR FOR ALL ROOFTOP DUCTWORK. SPACING SHALL BE PER SMACNA GUIDELINES.	
DUCTWORK EXTERNAL INSULATION & PIPE INSULATION (230713, 230719)	
1. INSULATE DUCTWORK AS DESCRIBED IN DUCTWORK INSULATION SCHEDULE. FIBERGLASS DUCT WRAP SHALL BE FULLY SECURED TO DUCT. LAP AND TAPE SEAMS AND SECURE TIGHTLY TO THE DUCTS WITH WIRE OR STICK PINS.	
2. DO NOT INSULATE:	
a. MAKE-UP AIR DUCTWORK OPERATING AT SURROUNDING AMBIENT CONDITIONS.	
b. RETURN AND EXHAUST AIR DUCTWORK LOCATED WITHIN THE BUILDING ENVELOPE (EXCEPT DUCTWORK WITHIN 10' OF BUILDING ENVELOPE PENETRATIONS).	
c. TRANSFER AIR DUCTWORK (ACOUSTICALLY LINE DUCT, CLEAR INSIDE DIMENSIONS SHOWN ON PLANS)	
d. EXPOSED SUPPLY DUCTWORK LOCATED IN CONDITIONED SPACE. (DOES NOT INCLUDE RETURN AIR PLENUM)	
e. PHENOLIC DUCTWORK	
3. INTERNAL DUCT INSULATION - DUCTWORK INDICATED TO HAVE INTERNAL INSULATION SHALL BE INTERNALLY COVERED WITH INSULATION SUITABLE TO MEET R-VALUES LISTED IN INSULATION SCHEDULE. INSULATION SHALL BE MANUFACTURED FROM A ROTARY PROCESS WITH A NON-WOVEN HYDROPHOBIC FACING. INSULATION SHALL HAVE FLAMESMOKE RATING OF 25/50. INSULATION SHALL WITHSTAND DUCT VELOCITIES OF 4000 FPM MINIMUM. DUCT SIZES SHOWN ON DRAWINGS ARE CLEAR INTERNAL DIMENSIONS. WHERE LINER IS USED, INCREASE OUTSIDE DIMENSIONS OF DUCT TO MAINTAIN INTERNAL DIMENSIONS. INSTALL LINER PER SMACNA OR NAIMA STANDARDS.	
4. INSULATE REFRIGERANT PIPING LINES AS DESCRIBED IN PIPING INSULATION SCHEDULE WITH ELASTOMERIC FOAM INSULATION WITH SELF-SEALING SEAM. ARIMACELL - AP ARMAFLEX XS INSULATION. PAINT COATED CELL INSULATION OUTDOORS WITH TWO COATS OF UV RESISTANT PAINT PER MANUFACTURER'S RECOMMENDATIONS. USE PRE-MOLDED COVERS OVER FITTINGS, VALVES, ELBOWS AND CONTROL DEVICES SEALED VAPOR TIGHT.	
5. ALL INSULATION TO BE APPLIED IN FULL ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS. ALL INSULATION SHALL COMPLY WITH 25/50 FLAME AND SMOKE HAZARD RATINGS PER ASTM E-84, NFPA 258 AND UL 723.	
6. PROVIDE REMOVABLE INSULATION SECTIONS TO COVER PARTS OF EQUIPMENT WHICH MUST BE OPENED PERIODICALLY FOR MAINTENANCE; INCLUDE METAL VESSEL COVERS, FASTENERS, FLANGES, CHILLED WATER PUMPS, FRAMES AND ACCESSORIES.	
7. REPLACE DAMAGED INSULATION WHICH CANNOT BE REPAIRED SATISFACTORILY, INCLUDING UNITS WITH VAPOR BARRIER DAMAGE AND MOISTURE SATURATED UNITS.	
HANGERS AND SUPPORTS (230529)	
1. SUPPORT ALL PIPING FROM STRUCTURE WITH UL LISTED HANGERS AND SUPPORTS SUITABLE FOR THE INTENDED INSTALLATION. DESIGN, SELECTION, SPACING, AND APPLICATION OF HANGERS AND SUPPORTS SHALL COMPLY WITH ANSI B31.1 AND MSS SP-69. HANGERS SHALL BE MANUFACTURED BY PENTAIR, OR APPROVED EQUAL. BLACK OR GALVANIZED STEEL PIPE = MODEL NO. 100, CAST IRON PIPE = MODEL NO. 400, COPPER TUBING = MODEL NO. 102-A.	
2. CONTRACTOR SHALL PROVIDE INSULATION HANGER WITH PROTECTIVE SHIELDS, SUCH AS PENTAIR, MODEL NO. 125, OR APPROVED EQUAL, FOR ALL INSULATED PIPING.	
3. CONTRACTOR SHALL PROVIDE RISER CLAMPS FOR VERTICAL PIPING AT EACH LEVEL. RISER CLAPS SHALL BE PENTAIR MODEL NO. 510 FOR STEEL PIPING AND MODEL NO. 511 FOR COPPER TUBING OR APPROVED EQUAL. USE "SHORT-END" RISER CLAMPS WHERE SPACE IS LIMITED.	
4. CONTRACTOR SHALL PROVIDE SIDE BEAM CLAMPS FOR SUPPORTING PIPING FROM STRUCTURAL STEEL MEMBERS. BEAM CLAMPS SHALL BE MANUFACTURED BY PENTAIR, MODEL 300 OR APPROVED EQUAL.	
5. WHERE OTHER MEANS OF SUPPORT PIPING ARE REQUIRED OR DESIRED, THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING THE ENGINEER'S APPROVAL PRIOR TO INSTALLING THOSE SUPPORTS.	
6. HANGERS AND SUPPORTS SHALL BE SPACED AT INTERVALS WHICH WILL PREVENT SAGGING AND REDUCE STRAIN ON VALVES AND SPECIALTIES. HANGER SPACING SHALL BE GREATER AND ROD SIZE SHALL BE NO SMALLER THAN THAT SHOWN IN THE FOLLOWING TABLE. HANGERS SHALL ALLOW FOR EXPANSION AND CONTRACTION. HANGER SHALL BE PROVIDED AT EACH CHANGE OF DIRECTION.	
7. RISER CLAMPS SHALL BE INSTALLED ABOVE THE FLOOR AT EACH LEVEL. RISER CLAMPS MAY BE SUSPENDED BELOW FLOOR LEVEL, WITH HANGER RODS AND INSERTS, WHERE THE INSTALLATION OF ESCUTCHEON PLATES IS REQUIRED.	
EQUIPMENT (235001)	
1. MAKE ALL FINAL EQUIPMENT CONNECTIONS AND PROVIDE THE NECESSARY ADAPTORS, FITTINGS, VALVES, DEVICES, ETC. FOR A COMPLETE AND OPERABLE SYSTEM. PROVIDE COMPLETE WITH BASES, ISOLATORS, SUPPORTS AND OTHER REQUIRED ACCESSORIES.	
2. EQUIPMENT SHALL BE INSTALLED IN FULL ACCORDANCE WITH THE MANUFACTURER'S DATA AND INSTALLATION INSTRUCTIONS, INCLUDING CLEARANCES, LUBRICATE AND ADJUST AS REQUIRED. THE CONTRACTOR'S RESPONSIBILITY TO CHECK AND CONFORM TO THESE REQUIREMENTS PRIOR TO STARTING WORK. FURNISH AND INSTALL CLEAN SET OF FILTERS PRIOR TO BALANCING.	
3. THE CONTRACTOR SHALL COORDINATE ELECTRICAL CHARACTERISTICS OF ALL MECHANICAL EQUIPMENT PRIOR TO ORDERING OF EQUIPMENT. COORDINATE REQUIREMENT FOR PROTECTIVE DEVICES. PROVIDE DISCONNECTS, CONTRACTORS, CONTROL WIRING, ETC. AS REQUIRED FOR PROPER FUNCTIONING SYSTEM WITH ELECTRICAL CONTRACTOR. NO ADDITIONAL PAYMENT WILL BE MADE FOR LACK OF CONTRACTOR COORDINATION OF ELECTRICAL CHARACTERISTICS.	
4. ALL FLOOR MOUNTED EQUIPMENT SHALL BE INSTALLED ON CONCRETE HOUSEKEEPING PADS. MINIMUM PAD THICKNESS SHALL BE NOMINAL 4". PAD SHALL EXTEND BEYOND THE EQUIPMENT A MINIMUM OF 4" ON EACH SIDE. CONCRETE PADS SHALL BE PROVIDED BY THIS CONTRACTOR. IT SHALL BE THE RESPONSIBILITY OF THE THIS CONTRACTOR TO COORDINATE THE SIZE AND LOCATION OF THE CONCRETE HOUSEKEEPING PADS WITH THE GENERAL CONTRACTOR.	
5. ALL EQUIPMENT SHALL BE MOUNTED ON VIBRATION ISOLATORS TO PREVENT THE TRANSMISSION OF VIBRATION AND MECHANICALLY TRANSMITTED SOUND TO THE BUILDING STRUCTURE.	
6. ISOLATION EQUIPMENT SHALL BE THE PRODUCT OF A SINGLE MANUFACTURER, AND SHALL BE DESIGNED SPECIFICALLY FOR THE APPLICATION REQUIRED. THIS INCLUDES, BUT IS NOT LIMITED TO, PUMP, DUCTWORK, PUMPS, VIBRATION ISOLATORS SHALL BE RATED FOR THE WEIGHT AND SPACING REQUIRED FOR THE EQUIPMENT REQUIRING ISOLATION.	
7. PROVIDE CURBS FOR ALL ROOF OPENINGS FOR DUCTS AND EQUIPMENT. CURBS SHALL BE FURNISHED AS ACCESSORIES TO THE EQUIPMENT OR 8" HIGH PATE OR EQUAL EQUIPMENT SUPPORTS SPANNING STRUCTURE AND FLASHED INTO ROOFING. ALL CUTTING, FLASHING, AND PATCHING OF ROOF SHALL BE BY OWNERS ROOFING CONTRACTOR AND PAID FOR BY MECHANICAL CONTRACTOR.	
CONTROLS (230910)	
1. PROVIDE COMPLETE TEMPERATURE CONTROLS FOR ALL HVAC SYSTEMS. PROVIDE NEW CONTROL DEVICES INCLUDING DAMPER OPERATORS, TEMPERATURE SENSORS AND OTHER REQUIRED DEVICES TO PROVIDE A COMPLETE OPERATIONAL SYSTEM PER THE FOLLOWING OPERATING SEQUENCE. MOUNT ALL CONTROLS FURNISHED AS ACCESSORIES TO EQUIPMENT AND PROVIDE ALL CONTROL WIRING REQUIRED FOR PROPER OPERATION WHERE NOT SPECIFICALLY SHOWN ON ELECTRICAL PLANS. ALL WIRING SHALL BE IN CONDUIT OR PER N.E.C. AND LOCAL CODE REQUIREMENTS. STANDARD MOUNTING HEIGHT TO TOP OF THERMOSTAT IS 48" ABOVE FINISHED FLOOR OR AS INDICATED ON THE ARCHITECTURAL DRAWINGS. DO NOT INSTALL THERMOSTATS NEAR DIMMER SWITCHES. WIRING OF ALL MOTORIZED OPERATORS AND THERMOSTATS (REGARDLESS OF VOLTAGE) ARE THE RESPONSIBILITY OF THE MECHANICAL CONTRACTOR.	
2. THE CONTRACTOR SHALL FURNISH AND INSTALL A COMPLETE, WEB-BASED, NATURE BACNET-INTEGRATED BUILDING AUTOMATION SYSTEM (BAS) INCLUDING ALL NECESSARY HARDWARE, ALL OPERATING AND APPLICATIONS SOFTWARE NECESSARY TO PERFORM THE HVAC CONTROL SEQUENCES OF OPERATION AS CALLED FOR IN THIS SPECIFICATION OR AS SHOWN ON THE DRAWINGS. BAS CONTRACTOR SHALL FURNISH AND INSTALL ALL RELATED SOFTWARE AND HVAC-DDC CONTROLS AS SPECIFIED WITHIN THIS SPECIFICATION. IT SHALL BE THE RESPONSIBILITY OF THE BAS CONTRACTOR TO COORDINATE THIS WORK WITH THE GENERAL	
CONTRACTOR, MECHANICAL CONTRACTOR, AND THE ELECTRICAL CONTRACTOR AS IT RELATES TO THE INSTALLATION AND WIRING OF ALL RELATED HVAC SYSTEMS.	
3. IT SHALL BE THE RESPONSIBILITY OF THE BAS CONTRACTOR TO PROVIDE ALL THE REQUIRED LABOR AND PROGRAMMING TO SEAMLESSLY INTEGRATE THE NEW BAS BACNET SYSTEM AND ITS DDC POINTS, GRAPHICS, ALARMS, ETC. INTO AN EXISTING BAS IF PRESENT.	
4. THE CONTROLS CONTRACTOR SHALL WARRANT THE SYSTEM FOR 24 MONTHS AFTER SUBSTANTIAL COMPLETION. DURING THE WARRANTY PERIOD, THE BUILDING SYSTEM CONTRACTOR SHALL BE RESPONSIBLE FOR ALL NECESSARY REVISIONS TO THE SOFTWARE AS REQUIRED TO PROVIDE A COMPLETE AND WORKABLE SYSTEM CONSISTENT WITH THE LETTER AND INTENT OF THE SEQUENCE OF OPERATION SECTION OF THE SPECIFICATION.	
5. THE FOLLOWING ARE THE APPROVED BAS MANUFACTURERS:	
• AUTOMATED LOGIC, INC.	
• CARRIER CONTROLS	
• DISTECH CONTROLS BY TRINITY AUTOMATED SOLUTIONS	
• HONEYWELL CONTROLS BY CHESAPEAKE CONTROLS, INC	
• JOHNSON CONTROLS, PITTSBURGH BRANCH OFFICE	
• KMC CONTROLS BY BUILDING CONTROL SYSTEMS	
• SIEMENS CONTROLS	
• TRANE CONTROLS	
• OR PRE-APPROVED EQUAL.	
6. THE CONTROL SYSTEM SHALL BE PROGRAMMED WITH THE FOLLOWING SEQUENCES AND FEATURES:	
a. UNOCCUPIED HEAT: THE SYSTEM SHALL USE VRF AND RTU AS THE PRIMARY SOURCE OF HEAT DURING UNOCCUPIED PERIODS.	
b. MORNING WARM UP: BEFORE THE OCCUPIED PERIOD BEGINS, THE SYSTEM SHALL USE VRF AND RTU HEAT TO BRING THE CONNECTED SPACES UP TO OCCUPIED TEMPERATURE.	
c. SUPPLY FAN PRESSURE RESET: THE CONTROL SYSTEM SHALL MONITOR ALL DAMPER POSITIONS THAT ARE CONNECTED TO THE RTU SUPPLY FAN. THE SUPPLY AIR PRESSURE SETPOINT SHALL BE REDUCED IF NONE OF THE DAMPERS ARE OPEN 95% OR GREATER.	
d. SUPPLY TEMPERATURE RESET: THE CONTROL SYSTEM SHALL MONITOR ALL DAMPER POSITIONS THAT ARE CONNECTED TO A PARTICULAR UNITS SUPPLY FAN. THE SUPPLY AIR TEMPERATURE SHALL BE RESET HIGHER IF THE RETURN AIR RELATIVE HUMIDITY IS BELOW 40% AND NONE OF THE DAMPER POSITIONS ARE OPEN 95% OR GREATER.	
e. ECONOMIZER: THE CONTROL SYSTEM SHALL MONITOR THE ECONOMIZER OPERATION AND THE RELEVANT SENSORS FOR THE RTU. THE RTU SHALL CONTROL THE DAMPER POSITION AS DESIGNED FROM THE FACTORY. THE CONTROL SYSTEM SHALL MONITOR THE DAMPER POSITION AND THE OTHER SENSORS THAT ARE INTEGRATED INTO ECONOMIZER OPERATION.	
IDENTIFICATION (230593)	
1. CONTRACTOR SHALL PROVIDE IDENTIFICATION LABELS, TAGS, ETC. AS INDICATED ON THE DRAWINGS AND AS SPECIFIED HEREIN. THE IDENTIFICATION SHALL BE IN ACCORDANCE WITH ANSI STANDARD A13.1. PRESSURE SENSITIVE MARKERS SHALL BE MANUFACTURED BY THE BRADY CO., OR APPROVED EQUAL. MARKERS SHALL BE MANUFACTURERS STANDARD PRODUCT. PRESSURE SENSITIVE PIPE MARKERS SHALL BE MANUFACTURED BY THE BRADY CO., OR APPROVED EQUAL. PIPE MARKERS SHALL BE MANUFACTURERS STANDARD PRODUCT.	
1. MAGNETIC MOTOR CONTROLLERS:	
a. MAGNETIC MOTOR CONTROLLERS SHALL BE PROVIDED AS INDICATED. THEY SHALL NOT BE SMALLER THAN NEMA SIZE 1.	
b. NON-REVERSING MAGNETIC CONTROLLER SHALL BE UTILIZED TO START FULL VOLTAGE, NON-REVERSING, AC SINGLE SPEED MOTORS. THE CONTROLLERS SHALL BE SIZED FOR THE LOAD UNLESS OTHERWISE INDICATED.	
c. REVERSING MAGNETIC CONTROLLER SHALL BE UTILIZED TO START FULL VOLTAGE REVERSING, AC SINGLE SPEED MOTORS. THE CONTROLLER SHALL BE SIZED FOR THE LOAD UNLESS OTHERWISE INDICATED. LOCATION OF REVERSING MAGNETIC CONTROLLERS IS INDICATED ON THE DRAWINGS.	
d. WHERE MULTI-SPEED MOTORS ARE SCHEDULED ON THE DRAWINGS, THE MOTOR CONTROLS SHALL BE COMPATIBLE WITH THE TYPE MOTOR SHOWN.	
e. OVERLOAD RELAYS SHALL BE SOLID STATE AND BE SUPPLIED IN EACH LEG. OVERLOAD RELAYS SHALL BE MATCHED TO LOAD AND SHALL BE ADJUSTABLE FROM 90% TO 110%. A SINGLE RESET BUTTON SHALL BE MOUNTED ON THE STARTER DOOR TO PERMIT EXTERNAL RESET. RELAYS SHALL BE CONVERTIBLE FROM MANUAL TO AUTOMATIC RESET BY A SIMPLE ADJUSTMENT.	
f. CONTROL TRANSFORMERS SHALL BE PROVIDED, WHERE REQUIRED. BOTH LEGS OF THE PRIMARY AND ONE LEG OF THE SECONDARY OF THE CONTROL TRANSFORMER SHALL BE PROTECTED BY NEMA CLASS J FUSES. THE OTHER LEGS OF THE SECONDARY SHALL BE GROUNDING. CONTROL TRANSFORMER CAPACITY SHALL BE ADEQUATE TO OPERATE ALL CONTROL DEVICES IN THE CIRCUIT. CONTROL VOLTAGE SHALL BE 120V AC UNLESS OTHERWISE SPECIFIED.	
g. UNLESS OTHERWISE INDICATED, ALL MOTOR STARTERS SHALL BE PROVIDED WITH HAND-OFF-AUTOMATIC (H.O.A) SWITCH IN THE DOOR. ENCLOSURES FOR MAGNETIC STARTERS SHALL BE NEMA TYPE 1 FOR INDOOR USE, NEMA TYPE 4X FOR OUTDOOR USE AND NEMA TYPE 7 FOR EXPLOSION PROOF USE.	
h. MOTOR CONTROLLERS SHALL BE PROVIDED WITH ALL CONTROL DEVICES, INCLUDING AUXILIARY CONTACTS, REQUIRED FOR EQUIPMENT TO OPERATE AS SPECIFIED.	
2. COMBINATION MOTOR CONTROLLERS:	
a. COMBINATION MOTOR CONTROLLERS SHALL BE PROVIDED WITH MOLDED CASE MOTOR CIRCUIT PROTECTORS OR MOLDED CASE CIRCUIT BREAKERS AS INDICATED. MOTOR CIRCUIT PROTECTIVE DEVICES SHALL HAVE SHORT CIRCUIT CAPACITY AS REQUIRED. UNIT CONTROL CIRCUIT FUSING SHALL BE PROVIDED. THE MOTOR CIRCUIT PROTECTIVE DEVICE SHALL BE MOUNTED IN THE SAME ENCLOSURE AS THE MAGNETIC CONTROLLER AND SHALL BE OPERABLE BY HAND FROM OUTSIDE THE ENCLOSURE. THE HANDLE SHALL BE SO INTERLOCKED WITH THE DOOR THAT IT MUST BE RETURNED TO THE "OFF" POSITION BEFORE THE DOOR CAN BE OPENED, BUT A CON-PROOF DEFEAT MECHANISM SHALL BE PROVIDED TO ALLOW AUTHORIZED PERSONNEL TO OPEN THE ENCLOSURE DOOR WITHOUT OPENING THE DISCONNECTING DEVICE. PROVISIONS FOR PADLOCKING THE DISCONNECT HANDLE IN THE "OFF" POSITION SHALL BE MADE. THE ENCLOSURE FOR COMBINATION STARTERS SHALL BE NEMA TYPE 1 FOR INDOOR USE AND NEMA TYPE 4X FOR OUTDOOR USE, AND NEMA TYPE 7 FOR EXPLOSION PROOF USE.	
b. MOTOR CIRCUIT PROTECTORS SHALL BE THE CONTINUOUSLY ADJUSTABLE, INSTANTANEOUS MAGNETIC TRIP TYPE CIRCUIT BREAKER AND SHALL BE SO CONSTRUCTED THAT ALL POLES OPEN, CLOSE AND TRIP SIMULTANEOUSLY.	
3. OVERLOAD AND SHORT CIRCUIT PROTECTION:	
a. HEATER ELEMENTS SHALL BE PROVIDED FOR OVERLOAD PROTECTION. MOTOR CIRCUIT PROTECTOR SHALL BE PROVIDED FOR MOTOR SHORT CIRCUIT PROTECTION.	
DISCONNECT SWITCHES (230514)	
1. THIS CONTRACTOR SHALL FURNISH ALL SAFETY DISCONNECT SWITCHES (FUSED AND NON-FUSED) REQUIRED FOR EQUIPMENT FURNISHED UNDER THIS CONTRACT. IN ADDITION, THIS CONTRACTOR SHALL FURNISH A SAFETY DISCONNECT SWITCH FOR ALL MOTORS AND EQUIPMENT WHICH DO NOT HAVE COMBINATION STARTERS OR INTEGRAL DISCONNECTING MEANS. FUSIBLE DISCONNECT SWITCHES SHALL BE PROVIDED FOR ALL EQUIPMENT RATED FOR USE ONLY WITH FUSES (SUCH AS CONDENSING UNITS, COMPRESSORS, ETC.). SUCH SWITCHES SHALL BE ONE, TWO OR THREE POLE TYPE, WITH SLOD NEUTRAL FOR 4 WIRE SERVICE, AND SHALL HAVE THE PROPER CURRENT RATING AND VOLTAGE RATING AS REQUIRED. INSTALLATION OF ALL DISCONNECT SWITCHES SHALL BE BY THE ELECTRICAL CONTRACTOR.	
2. ALL SAFETY SWITCHES SHALL BE NEMA HEAVY DUTY TYPE AND SHALL CARRY THE UNDERWRITERS' LABORATORIES LABEL. FUSIBLE SWITCHES SHALL INCORPORATE CLASS "R" FUSE REJECTION FEATURE AND SHALL BE BRACED TO WITHSTAND 200,000 AMPERE RMS SYMMETRICAL FAULT CURRENT. SAFETY SWITCHES SHALL CONFORM TO FEDERAL SPECIFICATION W-S-865.	
3. PROVIDE HEAVY-DUTY TYPE, SHEET ENCLOSED, SAFETY SWITCHES, THE TYPE, SIZE, AND RATING SHALL BE AS INDICATED ON THE DRAWINGS OR AS REQUIRED BY THE MOTOR OR EQUIPMENT SERVED. THE ENCLOSURE FOR DISCONNECT SWITCHES SHALL BE NEMA TYPE 1 FOR INDOOR USE, NEMA TYPE 4X FOR OUTDOOR USE AND NEMA TYPE 7 FOR EXPLOSION PROOF USE. DISCONNECTS SHALL BE MANUFACTURED BY ALLEN-BRADLEY, GENERAL ELECTRIC, CUTLER-HAMMER APPROVED EQUAL.	
4. SWITCHES SHALL INCORPORATE QUICK-MAKE, QUICK-BREAK OPERATING HANDLES. THE MECHANISM SHALL BE AN INTEGRAL PART OF THE BOX, NOT THE COVER, AND SWITCHES SHALL HAVE A COVER INTERLOCK TO PREVENT UNAUTHORIZED OPENING OF THE SWITCH DOOR IN THE ON POSITION OR CLOSING OF THE SWITCH MECHANISM WITH THE DOOR OPEN. CURRENT CARRYING PARTS SHALL BE CONSTRUCTED OF HIGH-CONDUCTIVITY COPPER WITH SILVER-TUNGSTEN TYPE SWITCH CONTACT.	
5. FUSE CLIPS SHALL BE POSITIVE PRESSURE TYPE REINFORCED FUSE CLIPS.	
6. THE ELECTRICAL CONTRACTOR SHALL FURNISH, INSTALL AND CONNECT ALL POWER WIRING TO ALL MECHANICAL CONTRACTOR FURNISHED EQUIPMENT. THE MECHANICAL CONTRACTOR SHALL FURNISH, INSTALL AND CONNECT ALL CONTROL WIRING TO ALL FURNISHED EQUIPMENT, INCLUDING CONTROL DEVICES, STARTERS AND INTEGRAL DISCONNECT SWITCHES OF CONTRACTOR FURNISHED EQUIPMENT.	


DRAWING SET: 90% Submission
RELEASE DATE: 12/29/2024

PRINTED ON ELECTRONIC DRAWINGS AND DOCUMENTATION MAY NOT BE USED WITHOUT WRITTEN PERMISSION FROM ALLEN + SHARRIFF CORPORATION. ALL RIGHTS RESERVED.

Allen + Shariff
MEP Engineering
Project Management
205 East Main Street
Salisbury, Maryland 21801
443.545.1300

CHABAD OF WILMINGTON - MIKVAH
JEWISH COMMUNITY CENTER
2317 Market Street
Wilmington, North Carolina 28403
PROJECT NO. 23-15

KERSTING
ARCHITECTURE
4022 MARKET STREET SUITE 201 - WILMINGTON, NC 28403 - (910) 762-1348

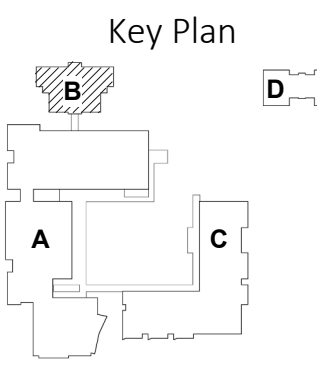

VARIABLE FREQUENCY DRIVES (230515)

1. PROVIDE VARIABLE FREQUENCY DRIVES (VFD) AS SPECIFIED HEREIN AND AS SHOWN ON THE CONTRACT DRAWINGS. BASIS OF DESIGN IS ABB MODEL ACH-450. THE ENCLOSURE FOR VFD SHALL BE NEMA TYPE 12 FOR INDOOR USE AND NEMA TYPE 3R FOR OUTDOOR USE. VFD SHALL PROVIDE MICROPROCESSOR-BASED CONTROL FOR THREE-PHASE INDUCTION MOTORS USING PULSE WIDTH MODULATED (PWM) DESIGN, WHICH CONVERTS THE UTILITY INPUT VOLTAGE AND FREQUENCY TO A VARIABLE VOLTAGE AND FREQUENCY OUTPUT VIA A TWO-STEP OPERATION. VFD SHALL HAVE AN EFFICIENCY AT FULL LOAD AND SPEED THAT EXCEEDS 97%. THE EFFICIENCY SHALL EXCEED 99% AT 50% SPEED.
2. VFD SHALL MAINTAIN A MINIMUM LINE SIDE DISPLACEMENT POWER FACTOR OF 0.96, REGARDLESS OF SPEED AND LOAD FOR VFD'S LESS THAN 75 HP. VFD SHALL MAINTAIN A MINIMUM LINE SIDE DISPLACEMENT POWER FACTOR OF .99, REGARDLESS OF SPEED AND LOAD FOR MOTORS GREATER THAN 75 HP. THE VFD'S SHALL HAVE A ONE (1) MINUTE OVERLOAD CURRENT RATING OF 110% FOR LOW OVERLOAD APPLICATIONS. VFD SHALL HAVE AN INTEGRAL EMI/RFI FILTER AND CIRCUIT BREAKER AS STANDARD. THE CURRENT WITHSTAND RATING OF THE OPEN VFD SHALL BE 65,000 AIC.
3. COMMUNICATION CAPABILITY OPTIONS SHALL INCLUDE MODBUS RTU, JOHNSON CONTROLS METASYS N2, BACNET MSTP, BACNET/IP, MODBUS/TCP AND EXPANSION CARD COMMUNICATIONS SHALL INCLUDE LONWORKS. THE EXACT PROTOCOL NEEDED IS THAT WHICH WILL COMMUNICATE WITH THE BAS COMMUNICATION SYSTEM PROVIDED.
4. VFD SHALL HAVE A COOLING FAN(S) THAT IS FIELD REPLACEABLE.
5. VFD SHALL INCLUDE THE FOLLOWING PROTECTIVE FEATURES: OVERCURRENT, OVERVOLTAGE, SYSTEM FAULT, UNDER VOLTAGE, INPUT LINE SUPERVISION, OUTPUT PHASE SUPERVISION, UNDER TEMPERATURE, OVER TEMPERATURE, MOTOR STALLED, MOTOR OVER TEMPERATURE AND MOTOR UNDER LOAD. VFD SHALL PROVIDE GROUND FAULT PROTECTION DURING POWER-UP, STARTING, AND RUNNING.
6. WARRANTY SHALL BE TWENTY-FOUR (24) MONTHS FROM CERTIFIED START-UP DATE. THIS WARRANTY DURATION INCLUDES START-UP BY AN AUTHORIZED SERVICE REPRESENTATIVE AND PARTS, LABOR AND TRAVEL TIME.

CHECK, TEST, START, ADJUST, BALANCE AND INSTRUCTIONS (230583)

1. AFTER INSTALLATION, CHECK ALL EQUIPMENT, AND PERFORM START UP IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.
2. ALL PIPING SHALL BE TESTED AND FREE OF LEAKS.
3. CONCEALED OR INSULATED WORK SHALL REMAIN UNCOVERED UNTIL REQUIRED TESTS HAVE BEEN COMPLETED, BUT IF CONSTRUCTION SCHEDULE REQUIRES IT, ARRANGE FOR PRIOR TESTS ON PARTS OF SYSTEM AS APPROVED BY THE TENANT.
4. BALANCE ALL SYSTEMS, CALIBRATE CONTROLS, CHECK FOR PROPER OPERATION AND SEQUENCE UNDER ALL CONDITIONS AND MAKE ALL NECESSARY ADJUSTMENTS.
5. AFTER INSTALLATION AND EQUIPMENT IS PLACED IN OPERATION, HVAC CONTRACTOR IS RESPONSIBLE FOR BALANCING SYSTEMS. BALANCING SHALL BE PERFORMED BY AN INDEPENDENT AABC CERTIFIED CONTRACTOR.
6. ADJUST AND BALANCE THE AIR SYSTEMS BEFORE HYDRONIC, AND REFRIGERANT SYSTEMS. TESTING AND BALANCING SHALL BE DONE IN ACCORDANCE WITH THE MOST RECENT AABC NATIONAL STANDARDS FOR TOTAL SYSTEM BALANCE. GPMS SHALL BE BALANCED WITHIN 10% OF DESIGN. AFTER ALL AIR SYSTEMS ARE INSTALLED, EACH SUPPLY AIR OUTLET SHALL BE AIR BALANCED TO WITHIN 10% OF THE CFM SHOWN WITH AIR PATTERNS SET AS INDICATED ON DRAWINGS (OR WITHIN 10 CFM WHEN BELOW 100 CFM). FAN RPM'S AND ZONE DAMPERS SHALL BE ADJUSTED AND SHEAVES SHALL BE REPLACED AS REQUIRED TO ACHIEVE AIR BALANCE. ALL ZONES OR PORTIONS THEREOF SERVING OTHER SPACES AND WHICH MAY BE AFFECTED BY THE PROJECT SHALL BE TRAVERSED PRIOR TO CONSTRUCTION. THE FINAL AIR BALANCE SHALL RESTORE THESE AIR QUANTITIES. BEFORE AND AFTER AIR QUANTITIES SHALL BE LISTED IN THE AIR BALANCE REPORT
7. SHOULD THE AIR BALANCE REPORT INDICATE UNACCEPTABLE DUCT LEAKAGE, AS DETERMINED BY THE ENGINEER, THEN DUCT LEAKAGE TEST SHALL BE PERFORMED IN ACCORDANCE WITH AABC STANDARDS. DUCT SHALL BE RESEALED AND/OR REPAIRED AS REQUIRED TO MEET DESIGN REQUIREMENTS. ALL, OR PORTIONS OF THE SYSTEM SHALL BE REBALANCED AS REQUIRED UNTIL ALL SYSTEMS ARE WITHIN THE PERFORMANCE STANDARDS LISTED ABOVE.
8. CLEAN ALL MECHANICAL EQUIPMENT AND DUCTWORK OF ALL CONSTRUCTION DUST AT PROJECT COMPLETION. REPLACE ALL FILTERS PRIOR TO AIR BALANCING. PROVIDE ONE SPARE SET OF FILTERS FOR EACH PIECE OF EQUIPMENT TO THE OWNER.
9. START UP AND PLACE ALL SYSTEMS IN OPERATION AND TAG ALL SWITCHES AND CONTROLS WITH PERMANENT LABELS.
10. PROVIDE OWNER TRAINING AND DEMONSTRATION OF ALL MECHANICAL SYSTEMS AND EQUIPMENT. INSTRUCT OWNER ON PROPER OPERATION AND PREVENTATIVE MAINTENANCE OF SYSTEM. SUBMIT OPERATING AND MAINTENANCE MANUAL ON ALL EQUIPMENT AND SYSTEMS.
11. AIR QUALITY TESTING SHALL BE PERFORMED BY AN AABC CERTIFIED CONTRACTOR, THIS CONTRACTOR SHALL BE ACCEPTABLE UPON APPROVAL OF THE ENGINEER. CONDUCT BASELINE INDOOR AIR QUALITY TESTING AFTER CONSTRUCTION ENDS AND BEFORE OCCUPANCY. TESTING PROCEDURES SHALL BE PER THE U.S. E.P.A. COMPENDIUM OF METHODS FOR THE DETERMINATION OF AIR POLLUTANTS IN INDOOR AIR AND AS DETAILED BY THE U.S.G.B.C. IN THE LEED-NC VERSION 3.0 REFERENCE GUIDE. CONTRACTOR SHALL DEMONSTRATE THAT THE CONTAMINANT MAXIMUM CONCENTRATIONS LISTED UNDER EQ CREDIT 3.2 IN THE LEED REFERENCE GUIDE ARE NOT EXCEEDED. CONTRACTOR SHALL INCLUDE ONE ADDITIONAL SAMPLING / RE-TESTING OF EACH BUILDING AREA IN HIS BID


DRAWING SET: 90% Submission
RELEASE DATE: 12/29/2024

PRINTED OR ELECTRONIC DRAWINGS AND DOCUMENTATION MAY NOT BE REPRODUCED IN ANY FORM WITHOUT WRITTEN PERMISSION FROM KERSTING ARCHITECTURE, INC.
COPYRIGHT 2024. ALL RIGHTS RESERVED.


Allen + Shariff
MEP Engineering
Project Management
205 East Market Street
Salisbury, Maryland 21801
443.545.1300


CHABAD OF WILMINGTON - MIKVAH
JEWISH COMMUNITY CENTER
2317 Market Street
Wilmington, North Carolina 28403
PROJECT NO. 31-26



KERSTING
ARCHITECTURE
4022 MARKET STREET SUITE 201 - WILMINGTON, NC 28403 - (910) 762-1348

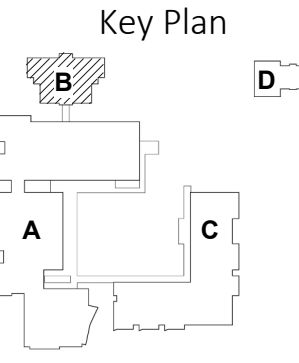

MECHANICAL
SPECIFICATIONS


M003-B

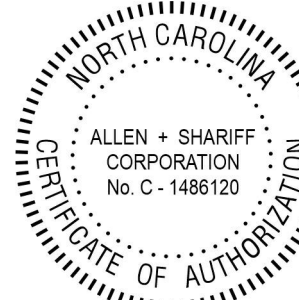

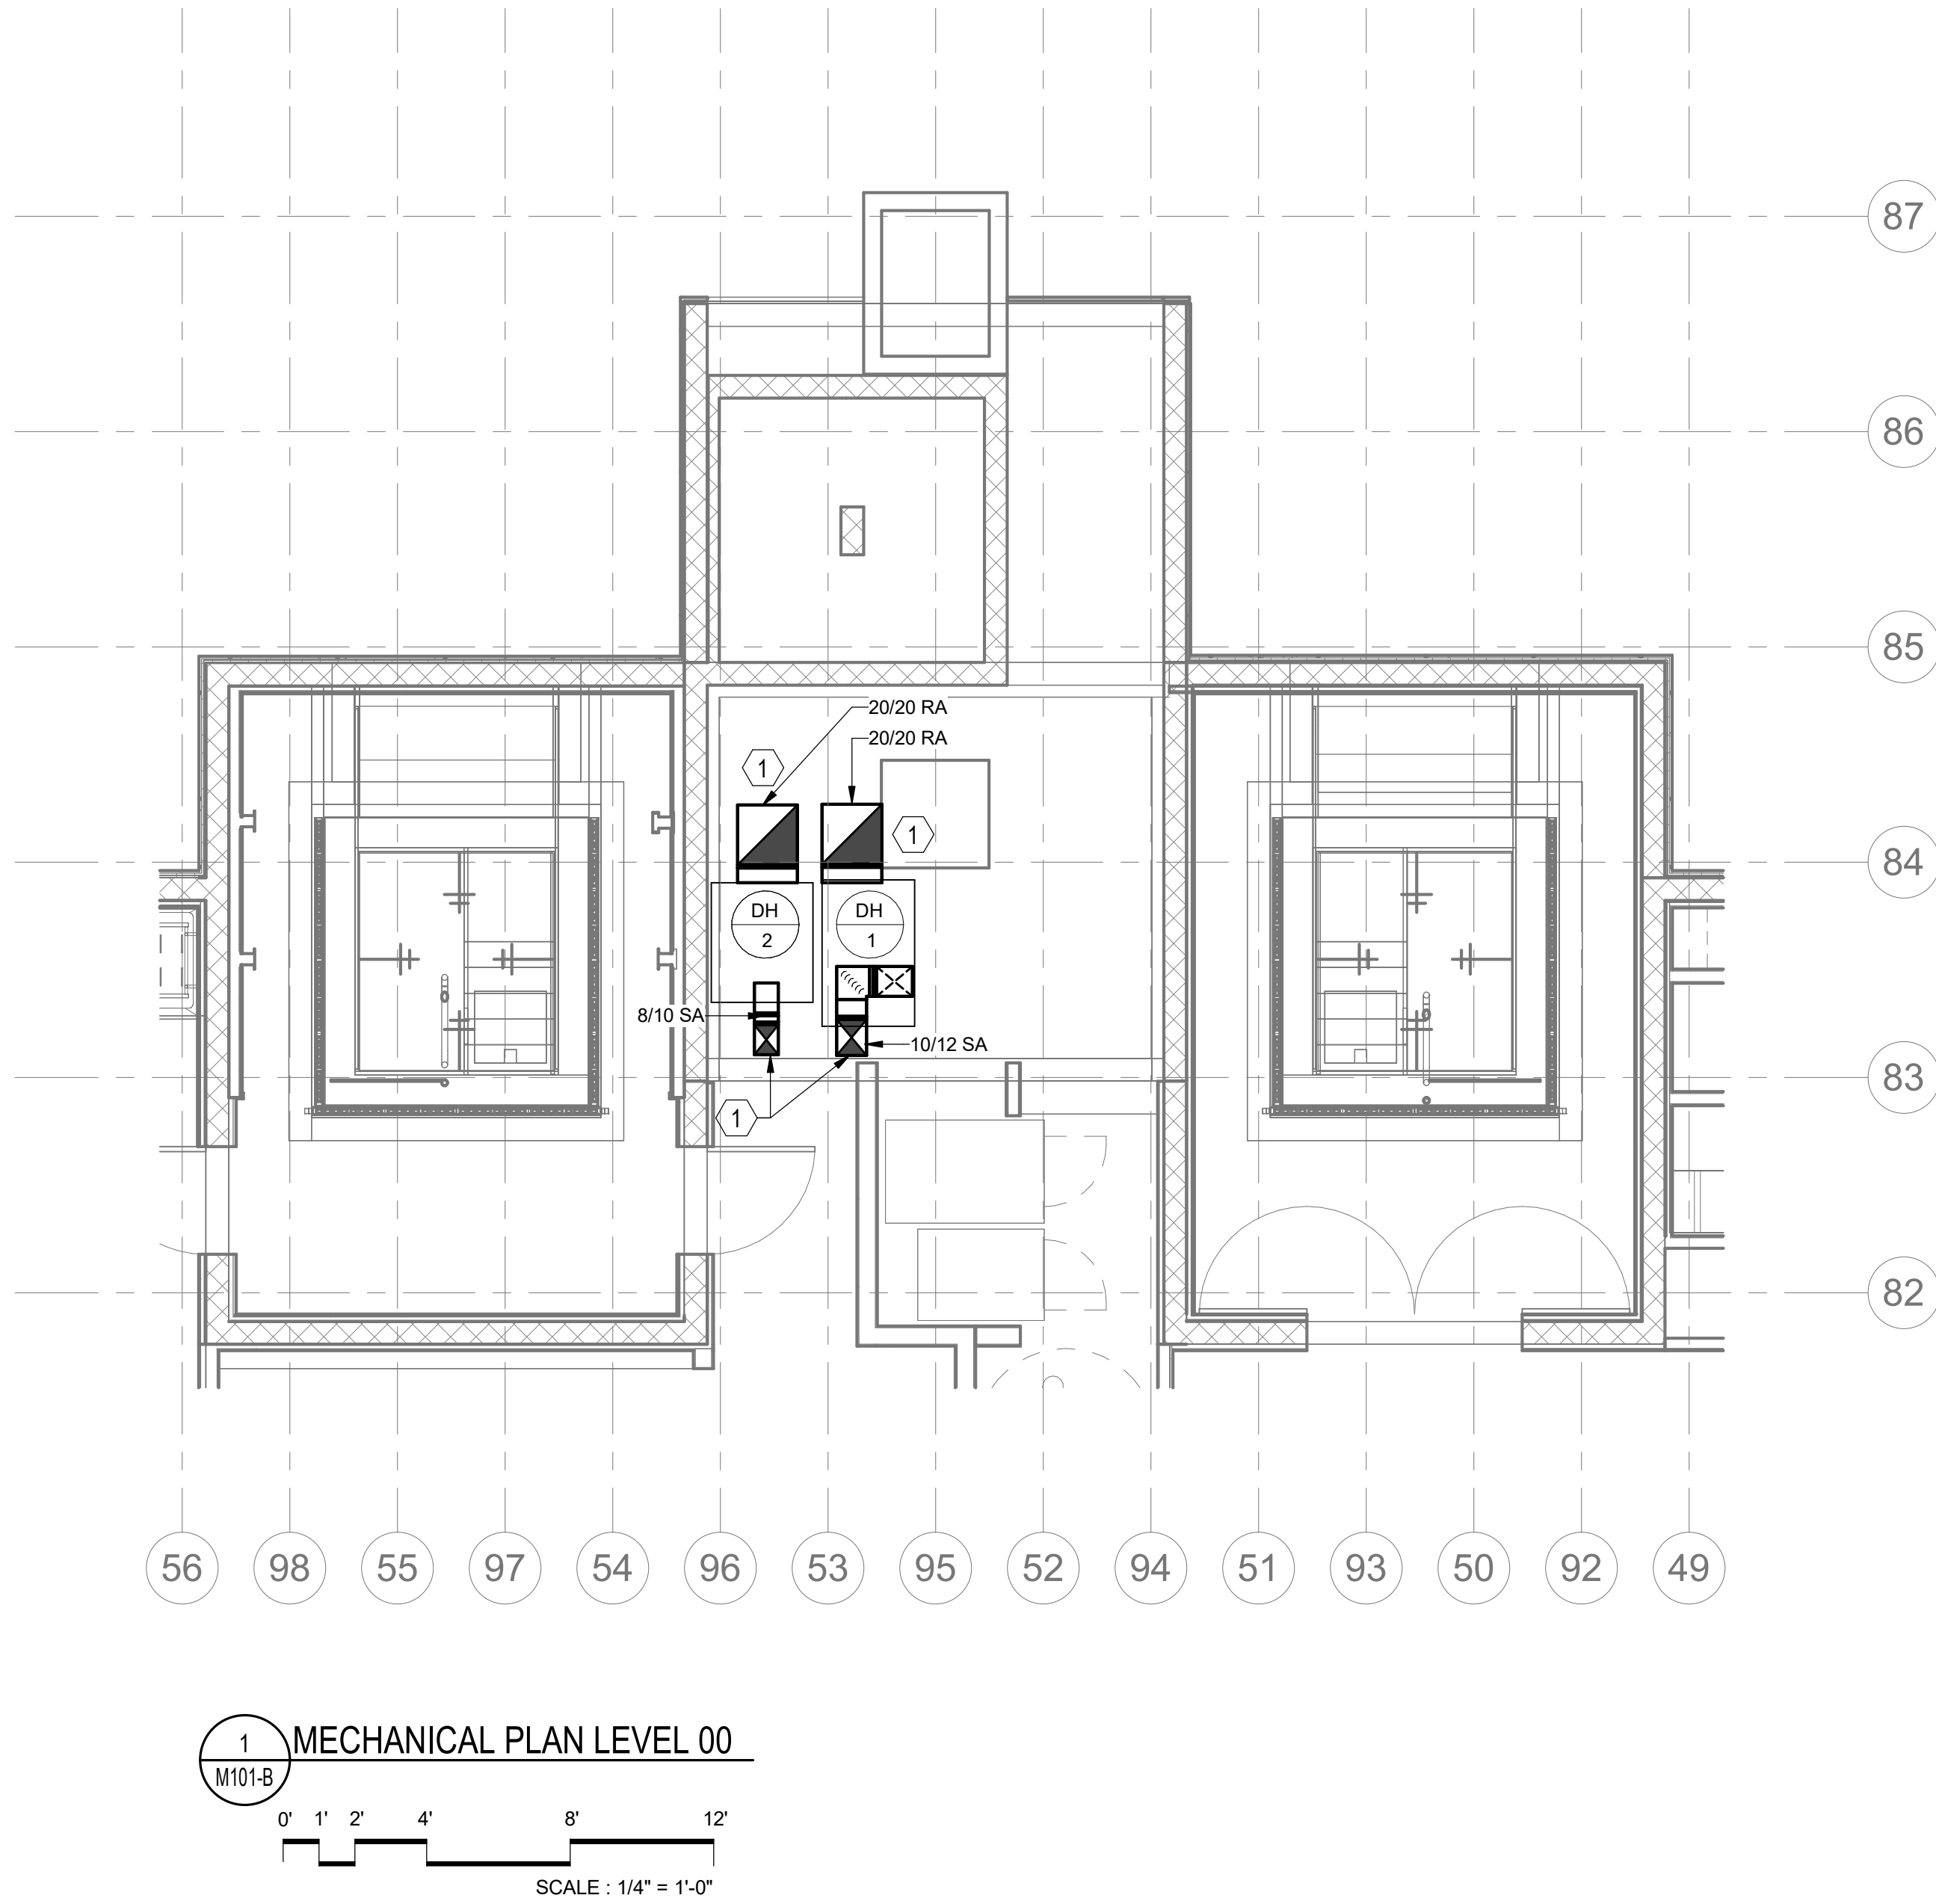

- MECHANICAL GENERAL NOTES:**
1. CONTRACTOR TO COORDINATE WITH OTHER TRADES PRIOR TO ROUGH IN. CONTRACTOR SHALL ENSURE THAT PROPER CONSTRUCTION SEQUENCING IS ACCOMPLISHED TO AVOID REWORK THAT WOULD OCCUR TO INSTALL MECHANICAL SYSTEMS.
 2. INSTALL ALL MECHANICAL EQUIPMENT ACCORDING TO MANUFACTURER INSTRUCTIONS.
- MECHANICAL KEY NOTES:** #
1. REFER TO M102-B SHEET FOR CONTINUATION.



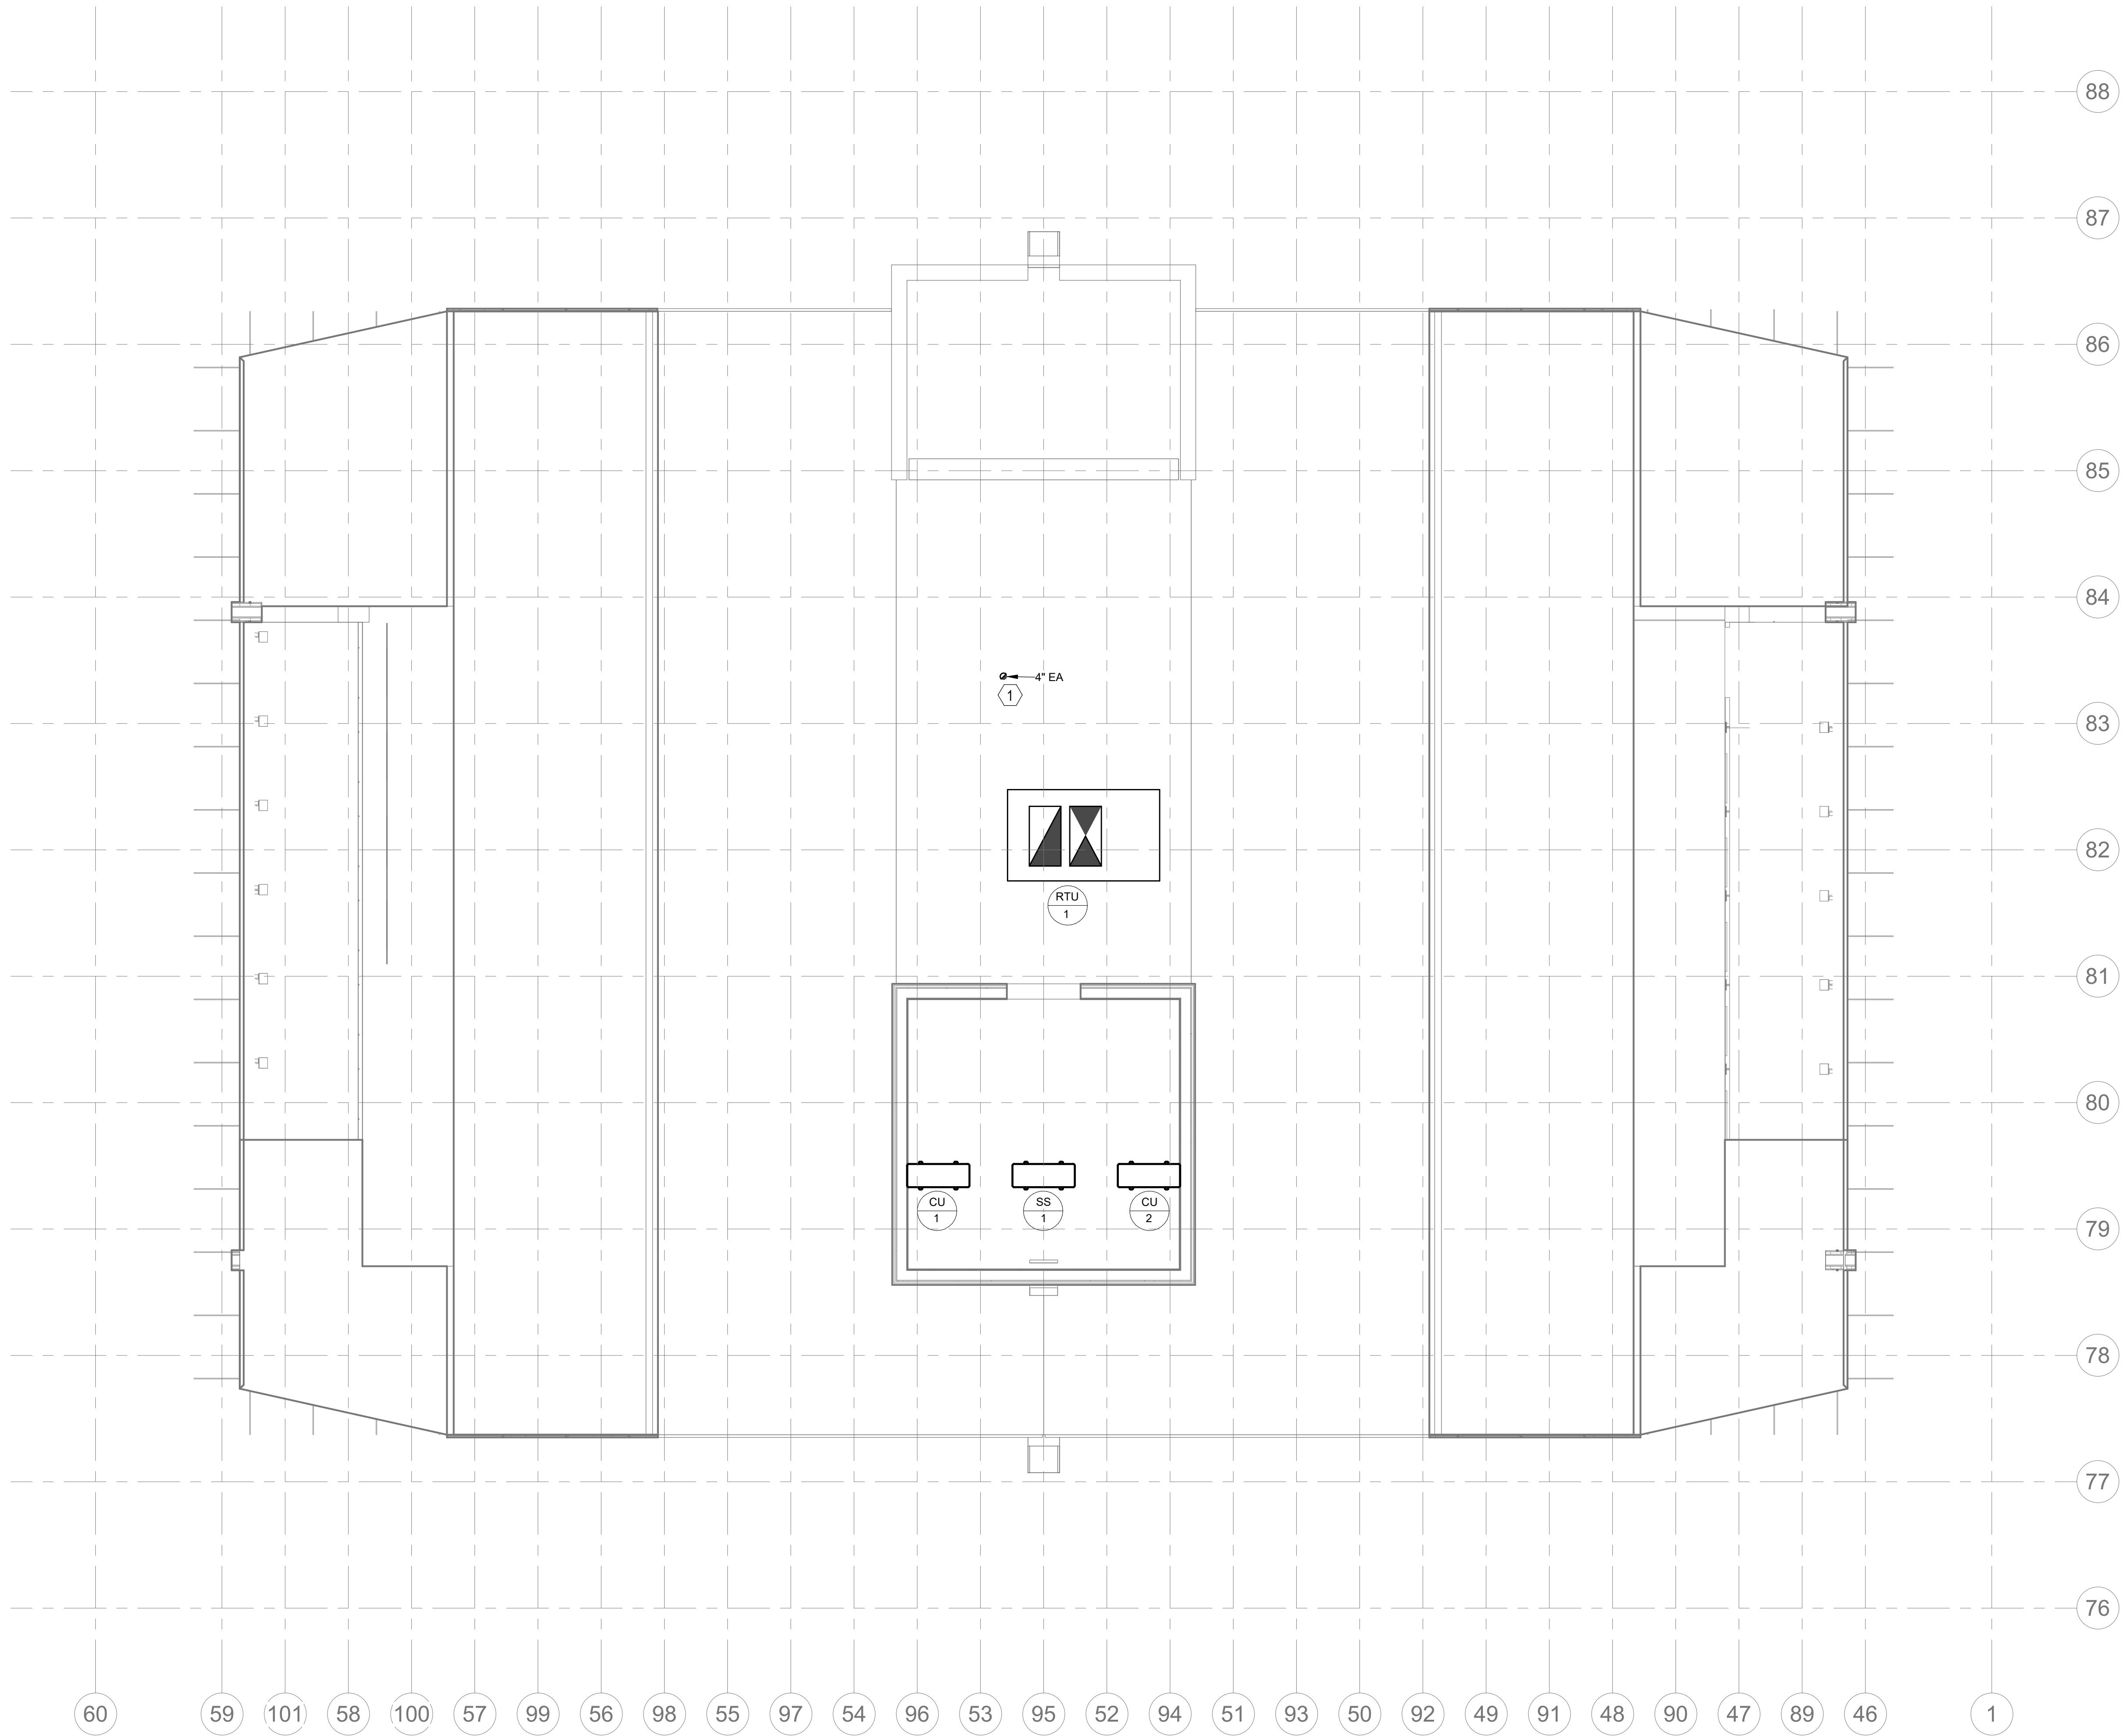

1 MECHANINCAL PLAN - ROOF
M103-B 1/4" = 1'-0"

0' 1' 2' 4' 8' 12'

SCALE : 1/4" = 1'-0"

MECHANICAL GENERAL NOTES:

1. CONTRACTOR TO COORDINATE WITH OTHER TRADES PRIOR TO ROUGH IN. CONTRACTOR SHALL ENSURE THAT PROPER CONSTRUCTION SEQUENCING IS ACCOMPLISHED TO AVOID REWORK THAT WOULD OCCUR TO INSTALL MECHANICAL SYSTEMS.

MECHANICAL KEY NOTES: (B)

1. PROVIDE 4" EXHAUST AIR DUCT FROM DRYER. REFER TO DRYER EXHAUST DUCT DETAILS #5 ON SHEET M201-B.

DRAWING SET: 90% Submission
RELEASE DATE: 12/29/2024

PRINTED ON ELECTRONIC DRAWINGS AND DOCUMENTATION MAY NOT BE REPRODUCED IN ANY FORM WITHOUT WRITTEN PERMISSION FROM KERSTING ARCHITECTURE, INC.
COPYRIGHT 2022. ALL RIGHTS RESERVED.

Allen + Shariff
MEP Engineering
Project Management
205 East Market Street
Salisbury, Maryland 21801
443.545.1300

CHABAD OF WILMINGTON - MIKVAH
JEWISH COMMUNITY CENTER
2317 Market Street
Wilmington, North Carolina 28403
PROJECT NO. 31-26


KERSTING
ARCHITECTURE
4022 MARKET STREET SUITE 201 - WILMINGTON, NC 28403 - (910) 762-1348

Key Plan
A B C D






MECHANICAL PLAN - ROOF

M103-B




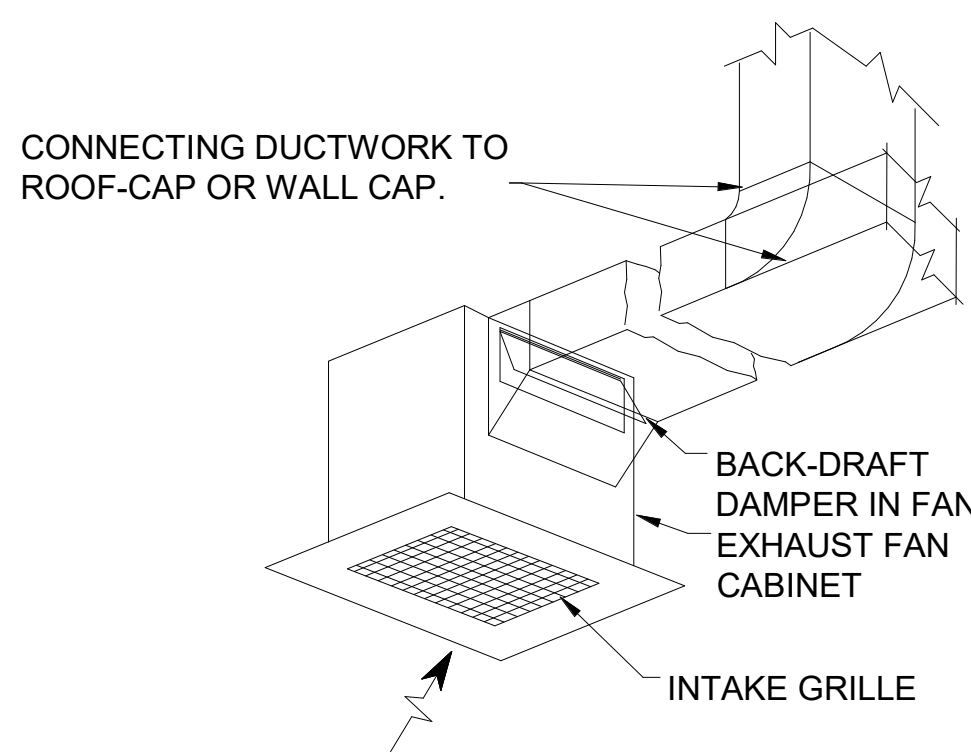


1 M - CELING FAN EXHAUST
M201-B

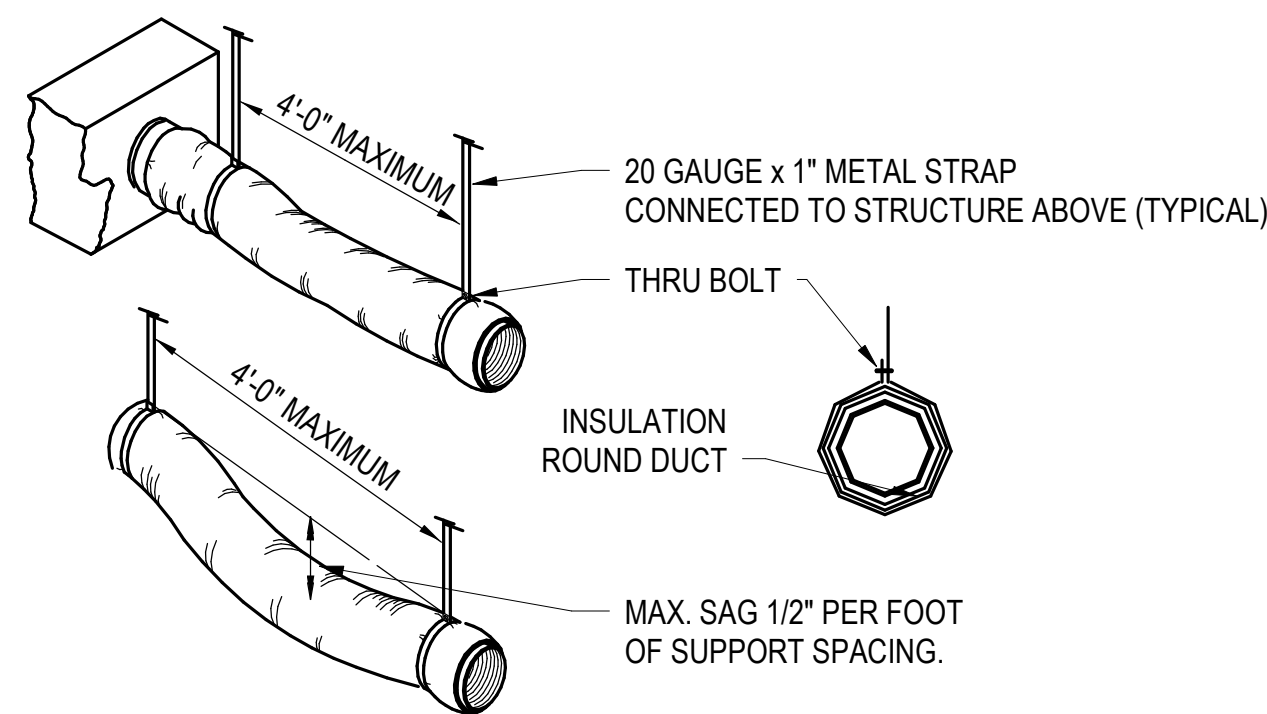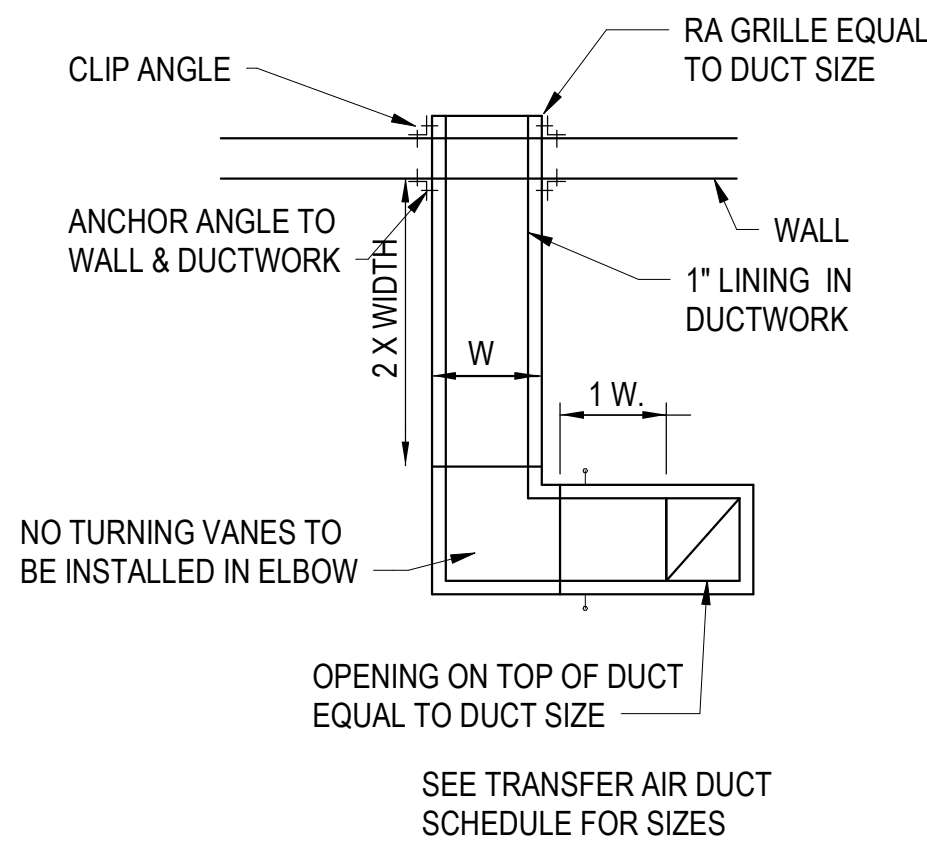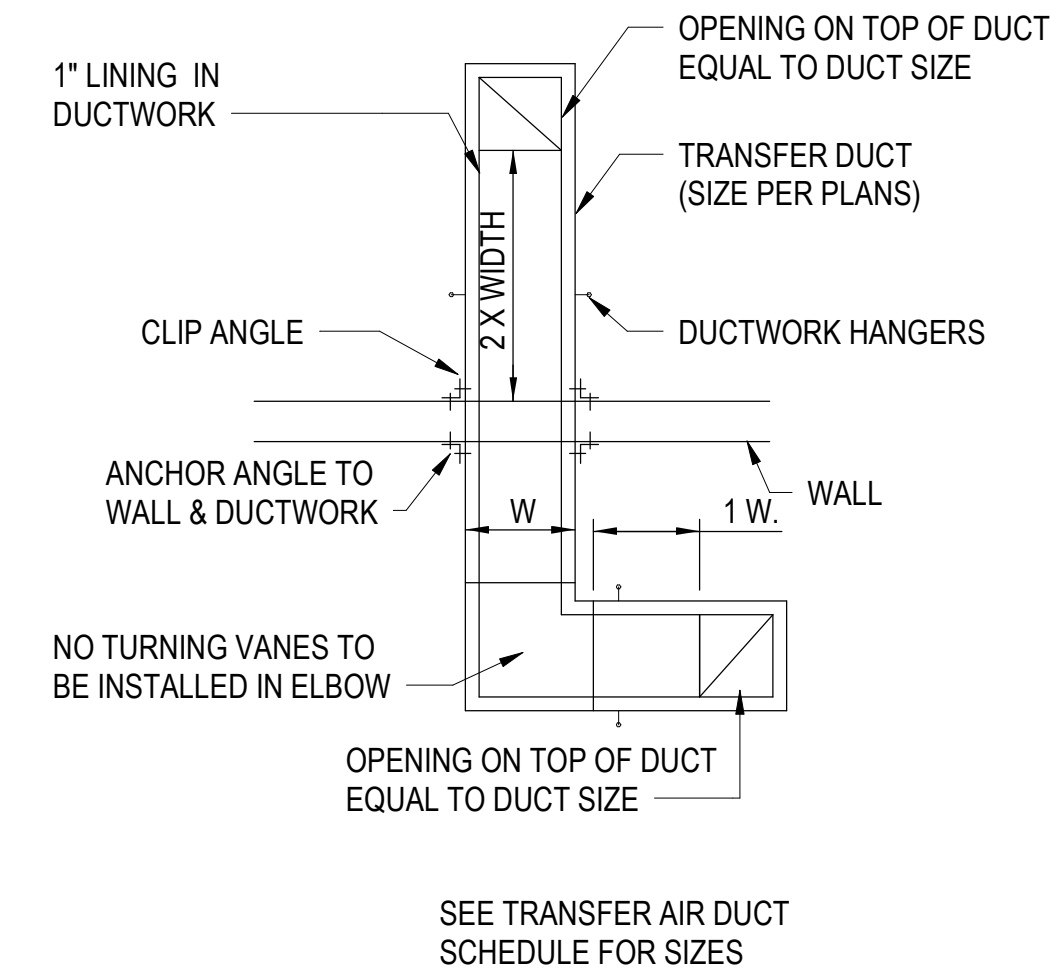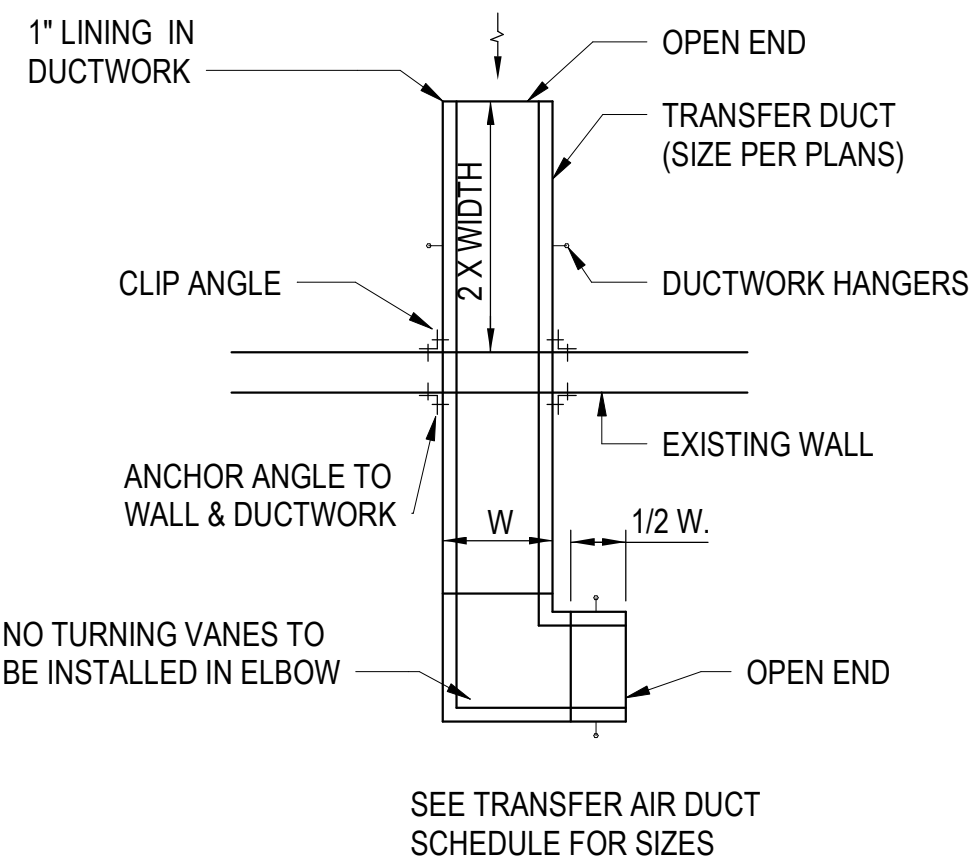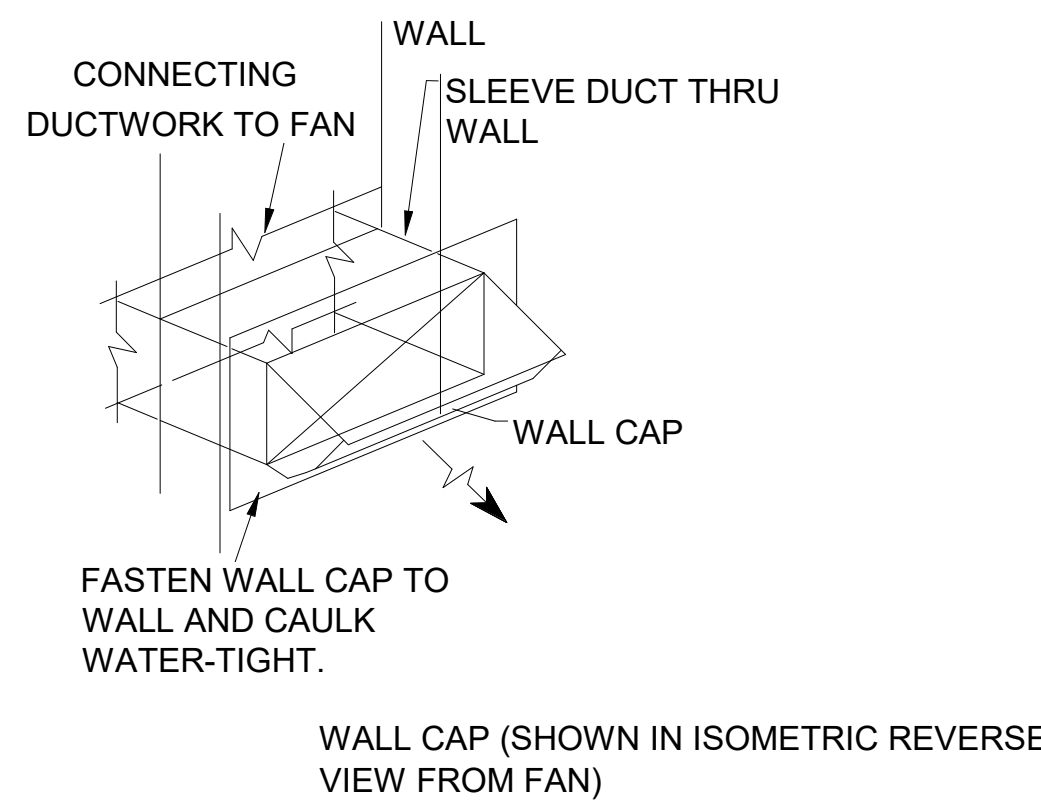

NOTES:

1. FLEXIBLE DUCT SHOULD EXTEND STRAIGHT FOR SEVERAL INCHES FROM RECTANGULAR DUCT CONNECTION BEFORE BENDING.
2. FLEXIBLE DUCT SHOULD NOT EXCEED 6'-0" IN LENGTH. USE RIGID ROUND DUCTWORK WHEN RUNOUTS EXCEED 6'-0".

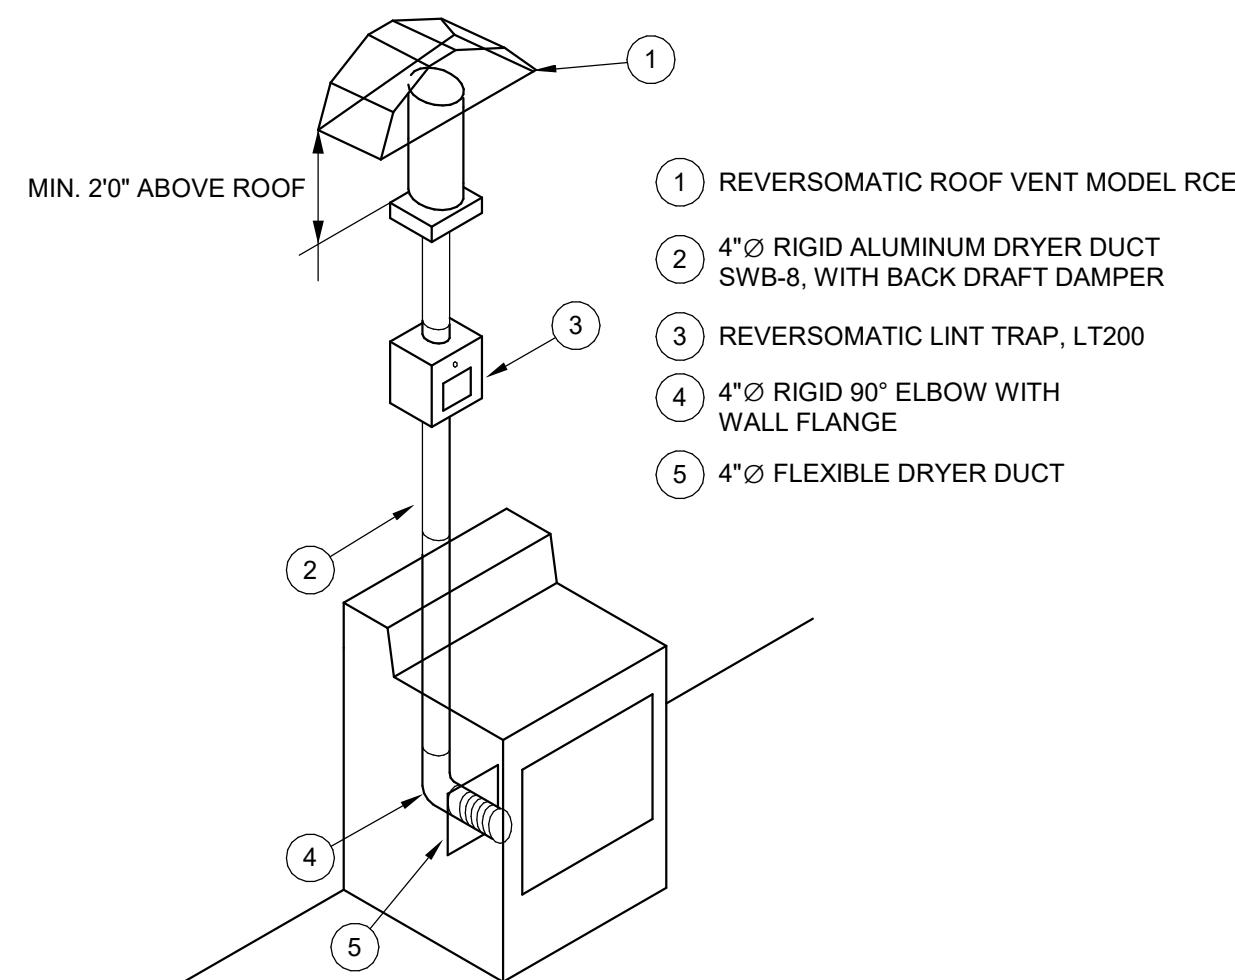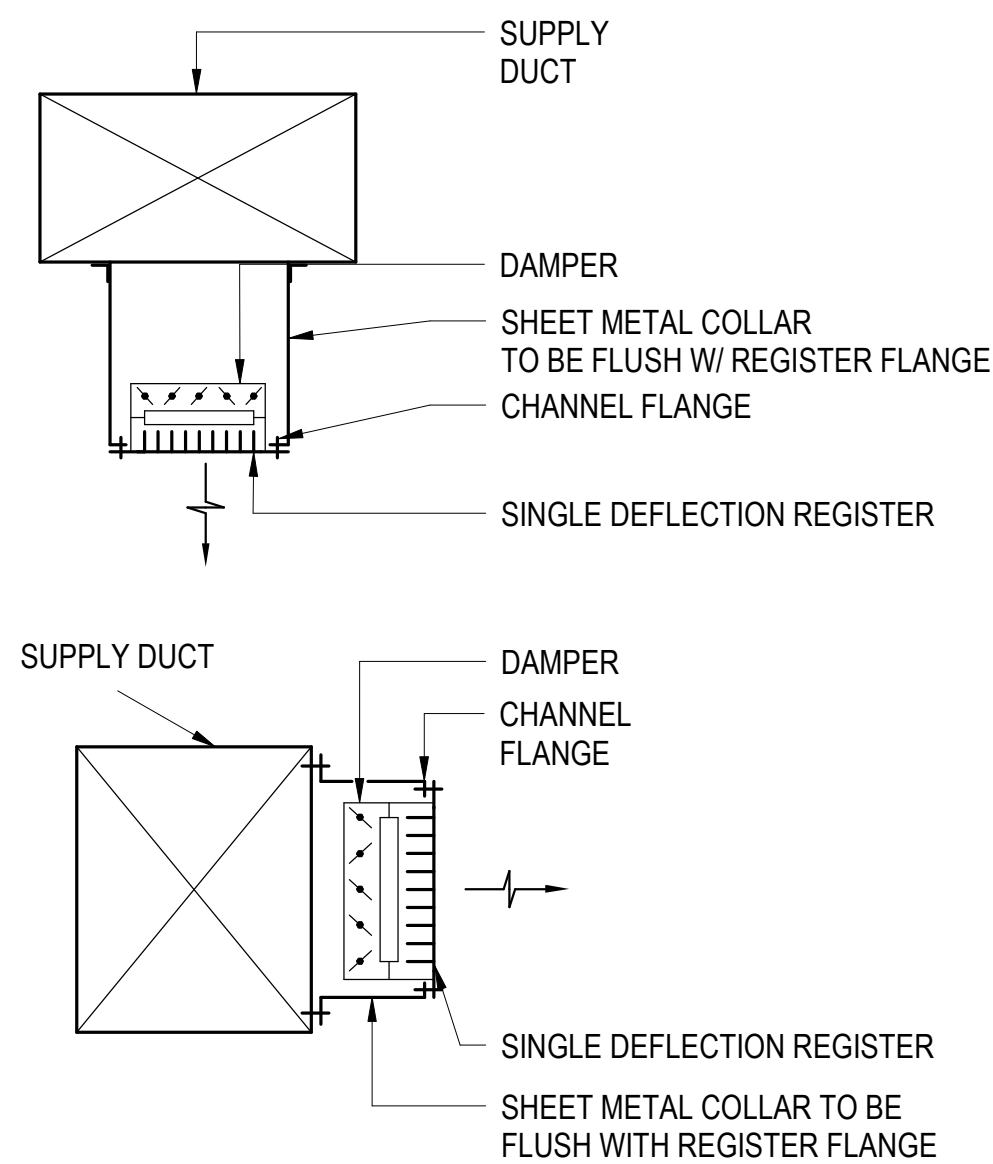

SPLIT SYSTEM SCHEDULE																												
INDOOR UNIT INFORMATION																	OUTDOOR UNIT INFORMATION											
TAG	LOCATION	QUANTITY	BASIS OF DESIGN	MARK	NOM. TONS	TYPE	FAN			COOLING MODE			HEATING MODE		AUX. HEATER (kW)	ELEC. INFO.		TAG	UNIT LOCATION	MARK	AHRI STANDARD 1230					PHYSICAL DATA	ELEC. INFO.	
							CFM (HL)	E.S.P. IN.W.G.	OA (CFM)	E.A.T DB/WB	TOTAL (MBH)	SENS. (MBH)	E.A.T DB	CAPACITY (MBH) AT 17 DEGREES F		V/PH	MCA / MOP				EER	SEER	HSPF	COP (17 DEG F)	COP (47 DEG F)	WEIGHT (LBS.)	V/PH	MCA / MOP
DH-1	MEN'S MIKVAH	1	DCA	DCA 650A	1.5	TOP DISCHARGE	650	0.5	-	82/67	18.0	9.4	70	10.1	4.0	208/1	21.7/26.1	CU-1	ROOF	LORC-1	12.5	15.0	8.9	2.4	3.8	77.0	208/1	15/15
DH-2	WOMEN'S MIKVAH	1	DCA	DCA650A-RA-07-003	1.5	TOP DISCHARGE	650	0.5	-	82/67	18.0	9.4	70	10.1	4.0	208/1	21.7/26.1	CU-2	ROOF	LORC-1	12.5	15.0	8.9	2.4	3.8	77.0	208/1	15/15
SS	AMENITIES	6	SAMSUNG	AM005NNNDCH/AA	0.4	CASSETTE	230	-	-	80/67	5.0	2.5	70	10.9	-	208/1	0.2/15	SS-1	ROOF	AM048TXMDCH/AA	11.5	21.0	10.7	2.6	3.9	216.1	208-230/1	29/29

FAN SCHEDULE							
TAG	DESCRIPTION	SERVES	CFM	E.S.P. (IN W.G.)	AMPS	MODEL NUMBER	NOTES
EF-1	CEILING FAN	WOMEN'S SM PREP ROOM #2	80	0.25	0.30	BROAN AE80K	
EF-2	CEILING FAN	WOMEN'S MIKVAH	150	0.1	0.21	PANASONIC FV-1115VQ1	
EF-3	CEILING FAN	MEN'S MIKVAH	150	0.1	0.21	PANASONIC FV-1115VQ1	
EF-4	CEILING FAN	MEN'S TOILET	80	0.25	0.3	BROAN AE80K	
EF-5	CEILING FAN	MEN'S SHOWER	150	0.1	0.21	PANASONIC FV-1115VQ1	
EF-6	CEILING FAN	WOMEN'S SM PREP ROOM #1	80	0.25	0.30	BROAN AE80K	
EF-7	CEILING FAN	WOMEN'S TOILET	80	0.25	0.30	BROAN AE80K	

DIFFUSER NECK SIZE & RUNOUT LENGTH SCHEDULE		
CFM RANGE	NECK SIZE	MAX LENGTH
0-125	6"Ø	4'-0"
126-230	8"Ø	5'-0"
231-420	10"Ø	5'-0"
421-650	12"Ø	6'-0"
651 - 900	14"Ø	6'-0"

NOTE: DIAMETER OF DIFFUSER FLEXIBLE DUCT CONNECTOR IS EQUAL DIFFUSER NECK SIZE. SEE PLANS AND SPECIFICATIONS FOR FACE TYPE AND MODEL NUMBERS.

SYSTEM	SYSTEM- LOCATION	OPERATING TEMPERATURE	MATERIAL	SMACNA CLASS					REMARKS
				TYPE	THICKNESS IN.S	DENSITY LB/CU. FT.	INSTALLED "R" VALUE/ CONDUCTIVITY	JACKET	
DUCT	SUPPLY AIR DUCT - INDOOR CONCEALED, ACCESSIBLE	40-120	MINERAL-FIBER	BLANKET	2.0"	0.75	6.0	FSK	1, 4
DUCT	SUPPLY AIR DUCT - INDOOR CONCEALED, INACCESSIBLE	40-120	MINERAL-FIBER	BOARD	1.5"	2.25	6.5	FSK	2
DUCT	SUPPLY / RETURN AIR DUCT - ACOUSTICAL LINER	40-120	MINERAL-FIBER	LINER	1.5"	2.25	6.0	N/A	4
DUCT	SUPPLY AIR DUCT - INDOOR EXPOSED	40-120	MINERAL-FIBER	LINER	1.5"	2.25	6.0	N/A	1, 4
DUCT	SUPPLY, RETURN, RELIEF, EXHAUST DUCT - OUTDOORS AND UNCONDITIONED	40-120	*	*	*	*	12	FSK	4
DUCT	EXHAUST DUCT WITHIN 10 FEET OF EXTERIOR OPENING - INDOOR	40-120	MINERAL-FIBER	BOARD	1.0"	2.25	4.3	FSK	

- NOTES:
- GENERAL:
1. ALL DUCTWORK SHALL BE ACOUSTICALLY LINED UPSTREAM OF THE CONCERT VENUE. THE DUCTWORK SHALL ALSO BE SUBJECT TO THE PROPER INSULATION VALUES AS DICTATED IN THE THERMAL INSULATION SCHEDULE. ALL BRANCH DUCTWORK THAT SERVES ACOUSTICALLY SENSITIVE AREAS SHALL BE ACOUSTICALLY LINED. ALL DUCTWORK BRANCH LINES THAT SHARE A MAIN WITH A BRANCH LINE SERVING AN ACOUSTICALLY SENSITIVE AREA SHALL BE ACOUSTICALLY LINED FOR 25' O.D.'S IN THE DIRECTION OF THE ACOUSTICALLY SENSITIVE AREA TO PREVENT SOUND TRANSFER FROM ONE SPACE TO THE OTHER.
1. CONCEALED, ACCESSIBLE LOCATIONS - ABOVE LAY-IN OR ACCESSIBLE CEILINGS, ACCESSIBLE MECHANICAL SHAFTS.
2. CONCEALED, INACCESSIBLE LOCATIONS - ABOVE HARD CEILINGS, (DRY WALL, PLASTER), MECHANICAL SHAFTS, BEHIND WALLS.
3. DO NOT INSULATE:
- MAKE-UP AIR DUCTWORK OPERATING AT SURROUNDING AMBIENT CONDITIONS
- RETURN AND EXHAUST AIR DUCTWORK LOCATED INDOORS.
- TRANSFER AIR DUCTWORK (ACOUSTICALLY LINE DUCT)
- EXPOSED SUPPLY DUCTWORK LOCATED IN CONDITIONED SPACE. (DOES NOT INCLUDE RETURN AIR PLENUM)
4. MULTIPLE INSULATION METHODS MAY BE USED TO ACHIEVE THE TOTAL REQUIRED R-VALUE.

SYSTEM	LOCATION IN DUCT SYSTEM	MATERIAL	SMACNA CLASS				DUCT TEST PRESS. INs W.C.	REMARKS
			STATIC PRESSURE IN.S W.C.	SEAL CLASS	LEAKAGE CLASS (RECT./ROUND)	POS. or NEG.		
DH-	SUPPLY AIR DUCT	ALUMINIUM	1"	B	24/12	POS.	1	1
DH-	RETURN AIR DUCT	ALUMINIUM	1"	B	24/12	NEG.	1	1
EF-	GENERAL EXHAUST DUCT OVER 46" RUN	ALUMINIUM	2"	A	12/6	NEG.	2	1
EF-	GENERAL EXHAUST DUCT RUNS UNDER 45" RUN	ALUMINIUM	1"	B	24/12	NEG.	1	1
EF-	GENERAL EXHAUST DUCT RUNS UNDER 10" RUN	ALUMINIUM	1/2"	C	24/12	NEG.	1	1

- NOTES:
1. CONSTRUCT WITH CHEMICAL RESISTANT JOINTS SEALED WITH EITHER SILICONE SEALER OR USE FLANGED JOINTS WITH NEOPRENE GASKETS WITH LONGITUDINAL JOINTS SEALED WITH SILICONE SEALER. SEAL JOINTS LIQUID TIGHT.

PACKAGED ROOFTOP UNIT SCHEDULE																									
TAG	NOM. TONS	MIN. O/A CFM	SUPPLY FAN DATA					EER	DX COOLING COIL DATA					HEATING CAPACITY				AIR FILTER		ELECTRICAL DATA			W. T. (LBS)	BASIS OF DESIGN /MODEL	REMARKS
			CFM	E.S.P. IN. WG	RPM	HP	E.A.T. DB/WB		L.A.T. DB/WB	TOTAL MBH	SENS. MBH	REFGT. TYPE	HEAT TYPE	STG.S	INPUT MBH	OUTPUT MBH	MERV RATING	DEPTH	VOLTS/ PH	MCA	MOP				
RTU-1	5.0	1300	1300	1.5	1236	3	11	78.9/67.0	55.0/54.6	74.3	50.7	R-454B	GAS	2	120	97.2	13	2"	208/3	43	50	1294	TRANE/YHC067 E3RLA005D	1	

- REMARKS NOTES:
1. ADDITIONAL EQUIPMENT - LOW LEAK ECONOMIZER, 14" CURB, GAS HEAT, HOT GAS REHEAT, POWER EXHAUST, CONVENIENCE OUTLET.

GRILLE, REGISTER & DIFFUSER SCHEDULE												
TAG	FACE SIZE (SLOT WIDTH)	# SLOTS/ BAR, GRID SPACE	DEFLECTION/ THROW	CONNECTION SIZE	MAX CFM	P.D. IN. W.C.	THROW @ 50 FPM	MAX. NC	BASIS OF DESIGN	MODEL	REMARKS	
S-1	24/24	N/A	4W	PER SCH.	300	0.05	11	<15	TITUS	OMNI	1,2	
S-2	22/22	3/4"	ADJ.	16"Ø W/ BOOT	1600	0.05	73	25	TITUS	301FL	1,2	
S-3	12/12	N/A	4W	PER SCH.	419	0.05	6	<15	TITUS	OMNI	1,2	
R-1	24/24	1/2 GRID	N/A	N/A	1000	-0.05	N/A	20	TITUS	45F	1,2	
R-2	36/12	3/4"	35°	36/12	1500	-0.02	N/A	20	TITUS	350RL	1,2	
R-3	36/24	3/4"	35°	36/24	2830	-0.05	N/A	20	TITUS	350RL	1,2	
E-1	12/12	N/A	N/A	PER SCH.	150	-0.05	N/A	<15	TITUS	8R	1,2	

- REMARKS:
1. SEE ARCHITECTURAL REFLECTED CEILING PLAN FOR CEILING TYPES AND MOUNTING REQUIREMENTS.
2. DIFFUSER FINISH AND COLOR BY ARCHITECT.

HEATED FLOOR EQUIPMENT SCHEDULE												
DESIGNATION	MANUFACTURER	MODEL	DESCRIPTION	KW	VOLT AGE	PHASE	AMPS	SURFACE AREA	THERMOSTAT	SERVES	NOTES	
HEATED CABLE MAT	PERSIA	SFM2W0960D120096	HEATING CABLE MAT	1.0	208	1	4.0	160	WALL MOUNTED	WOMEN'S SM PREP. ROOM #2	FLOOR SENSOR WITH THERMOSTAT. TWO (2) FLOOR MATS (80FT2/EACH) FOR WOMEN'S SM PREP RM#2.	
HEATED CABLE MAT	PERSIA	SFM2W0840D120084	HEATING CABLE MAT	0.9	208	1	3.5	128	WALL MOUNTED	WOMEN'S SM PREP. ROOM #1	FLOOR SENSOR WITH THERMOSTAT. TWO (2) FLOOR MATS (70FT2/EACH) FOR WOMEN'S SM PREP RM#2.	


DRAWING SET: 90% Submission
RELEASE DATE: 12/29/2024

PRINTED OR ELECTRONIC DRAWINGS AND DOCUMENTATION MAY NOT BE REPRODUCED IN ANY FORM WITHOUT WRITTEN PERMISSION FROM KERSTING ARCHITECTURE, PC.
COPYRIGHT 2022. ALL RIGHTS RESERVED.


Allen + Shariff
MEP Engineering
Project Management
205 East Market Street
Salisbury, Maryland 21801
443.545.1300

CHABAD OF WILMINGTON - MIKVAH
JEWISH COMMUNITY CENTER
2317 Market Street
Wilmington, North Carolina 28403
PROJECT NO. 31-16

KERSTING ARCHITECTURE
4022 MARKET STREET SUITE 201 - WILMINGTON, NC 28403 - (910) 762-1348

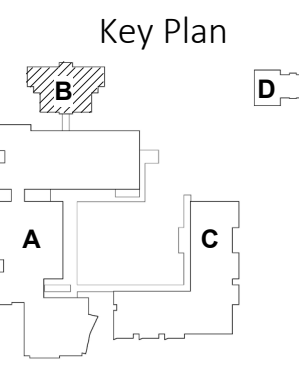

MECHANICAL SCHEDULES

M301-B

