

**GENERAL MECHANICAL NOTES (ALL DRAWINGS):**

- MECHANICAL CONTRACTOR SHALL PROVIDE ALL MATERIALS AND EQUIPMENT AND PERFORM ALL LABOR REQUIRED TO INSTALL COMPLETE AND OPERABLE HVAC SYSTEMS AS INDICATED ON THE DRAWINGS, AS SPECIFIED AND REQUIRED BY CODE.
- THE CONTRACT DOCUMENT DRAWINGS ARE DIAGRAMMATIC ONLY, AND ARE INTENDED TO CONVEY THE SCOPE AND GENERAL ARRANGEMENT OF WORK.
- ALL DIMENSIONS AND EXISTING CONDITIONS SHALL BE VERIFIED BY THE CONTRACTOR BY FIELD INSPECTION PRIOR TO BIDDING. ANY INTERFERENCES TO INSTALLATION SHALL BE NOTED AND THE CONTRACTOR SHALL INCLUDE IN HIS BID PRICE THE COST TO AVOID OR RELOCATE ALL ITEMS, INCLUDING ITEMS OF OTHER TRADES, THAT INTERFERE. ALL WORK SHALL BE COORDINATED WITH ALL TRADES INVOLVED. ALL OFFSETS, RISES, TRANSITIONS AND DROPS IN DUCTS AND PIPING AROUND OBSTRUCTIONS SHALL BE PROVIDED AT NO ADDITIONAL COST TO THE OWNER.
- VERIFY ALL EQUIPMENT CONNECTIONS WITH MANUFACTURERS' CERTIFIED DRAWINGS. VERIFY AND PROVIDE DUCT TRANSITIONS OR PIPE ADAPTERS TO FURNISHED EQUIPMENT. FIELD VERIFY AND COORDINATE ALL DIMENSIONS BEFORE FABRICATION.
- PROVIDE ACCESS IN WALLS & CEILINGS TO ACCESS ALL EQUIPMENT, VALVES, CONTROL DEVICES, VOLUME DAMPERS, AND FIRE/SMOKE DAMPERS.
- FOLLOW MANUFACTURE'S RECOMMENDATIONS FOR INSTALLATION OF EQUIPMENT. ALSO REFER TO TYPICAL DETAILS FOR INSTALLATION OF EQUIPMENT.
- ALL MATERIALS FURNISHED, AND ALL WORK PERFORMED BY THE MECHANICAL CONTRACTOR SHALL BE IN ACCORDANCE WITH ALL APPLICABLE CODES AND REGULATIONS, INCLUDING BUT NOT LIMITED TO THE LATEST APPLICABLE EDITIONS OF NFPA, IEEE, OSHA, SMACNA, INTERNATIONAL MECHANICAL CODE, INTERNATIONAL BUILDING CODE, AND ANY STATE, COUNTY, AND LOCAL CODES.
- ALL EQUIPMENT, DUCTWORK, ETC. SHALL BE SUPPORTED SUFFICIENTLY AND ANY ADDITIONAL SUPPORT SHALL BE PROVIDED AS REQUIRED TO PROVIDE VIBRATION FREE AND SAFE INSTALLATION. ALL MISCELLANEOUS STEEL REQUIRED AND/OR AS SHOWN IN DETAILS FOR DUCTWORK, AND EQUIPMENT (UNLESS OTHERWISE NOTED) SHALL BE FURNISHED AND INSTALLED BY THE MECHANICAL CONTRACTOR. SUPPORT ALL DUCTWORK, PIPING AND EQUIPMENT MOUNTED ABOVE THE CEILING DIRECTLY FROM THE STRUCTURE. ALL ATTACHMENTS TO BEAMS, TRUSSES, OR JOIST SHALL BE MADE AT PANEL POINTS WITH BEAM CLAMPS MEETING MSS STANDARDS.
- ALL CONTROL WIRE AND CONDUIT SHALL COMPLY WITH NEC AND ELECTRICAL SPECIFICATIONS FOR THIS PROJECT.

**DUCTWORK GENERAL NOTES (ALL DRAWINGS):**

- ALL DUCTWORK INDICATED IS SCHEMATIC AND SHOW ONLY RELATIVE POSITIONS. PROVIDE OFFSETS, RISES, TRANSITIONS AND ELBOWS AS NEEDED TO INSTALL PROPERLY.
- PROVIDE ACCESS DOORS IN DUCTWORK FOR OPERATION, ADJUSTMENT, AND MAINTENANCE OF ALL HVAC DEVICES, FANS, DAMPERS, (FIRE, SMOKE, BALANCING) COILS, AND TERMINAL EQUIPMENT.
- LOCATIONS OF TERMINAL DEVICES, AIR OUTLETS AND INLETS ARE APPROXIMATE. LOCATE PER THE ARCHITECTURAL DRAWINGS AND TO AVOID OTHER TRADES WORK. COORDINATE LOCATIONS WITH OTHER TRADES. CONSULT ARCHITECT/ENGINEER FOR CLARIFICATION IF CONFLICTS OCCUR.
- DUCT DIMENSIONS SHOWN ARE CLEAR INSIDE FACE-TO-FACE DIMENSIONS AND DO NOT INCLUDE DUCT LINER WHERE SPECIFIED. INCREASE DIMENSIONS OF LINED DUCTWORK TO PROVIDE FREE INSIDE AREA EQUAL DIMENSIONS SHOWN. REFER TO THE SPECIFICATIONS FOR LOCATION OF LINED DUCTWORK.
- FINAL CONNECTIONS FROM HIGH VELOCITY MAIN DUCTS TO AIR TERMINAL UNITS SHALL BE MADE WITH FLEXIBLE DUCTWORK NOT EXCEEDING 3 FEET IN LENGTH. CONNECTIONS BETWEEN LOW VELOCITY DUCTWORK AND/OR TERMINAL UNITS TO AIR INLETS AND OUTLETS SHALL BE MADE WITH FLEXIBLE DUCTWORK NOT EXCEEDING 6 FEET IN LENGTH. LONGER DUCT RUN OUTS SHALL BE CONSTRUCTED OF HARD DUCT OF THE SAME MATERIAL SPECIFIED FOR THE SYSTEM SERVED AND INSULATED AS SPECIFIED FOR THAT SYSTEM. FLEXIBLE DUCTWORK SHALL BE OF THE PRESSURE CLASS AND FACTORY INSULATED AS SPECIFIED FOR THE SYSTEM WHERE INSTALLED.
- FLEXIBLE DUCTWORK SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS WITHOUT ANY SAGS, SHARP TURNS OR KINKS. AT THE MINIMUM, THE FLEXIBLE DUCTWORK SHALL BE FASTENED TO THE HARD DUCT BY A NYLON STRAP SECURED BY SHEETMETAL SCREWS TO PREVENT SLIPPING OFF FROM COLLAR.
- PROVIDE VOLUME DAMPERS AT EACH AIR OUTLET, AIR INLET AND TERMINAL DEVICE AND AT EACH BRANCH TAKE-OFF CONNECTION FROM THE MAIN.

**MECHANICAL LEGEND**

SYMBOL	ABRV.	DESCRIPTION	SYMBOL	ABRV.	DESCRIPTION	SYMBOL	ABRV.	DESCRIPTION
	EX	EXISTING EQUIPMENT OR DUCTWORK TO REMAIN			CONNECTION POINT, NEW TO EXISTING		EX	EXISTING PIPING TO REMAIN - (X) DESIGNATES SERVICE
	RX	EXISTING EQUIPMENT OR DUCTWORK TO BE REMOVED			DISCONNECTION POINT		RX	EXISTING PIPING TO BE REMOVED - (X) DESIGNATES SERVICE
		NEW EQUIPMENT OR DUCTWORK			DRAWING KEYNOTE		HWS	HEATING WATER SUPPLY PIPING
		LINED DUCTWORK			DEMOLITION DRAWING KEYNOTE		HWR	HEATING WATER RETURN PIPING
		SUPPLY DUCT UP			REVISION NUMBER		CWS	CONDENSER WATER SUPPLY PIPING
		SUPPLY DUCT DOWN			REVISION CLOUD		CWR	CONDENSER WATER RETURN PIPING
		RETURN DUCT UP			PIPE UP		CHWS	CHILLED WATER SUPPLY PIPING
		RETURN DUCT DOWN			PIPE DOWN		CHWR	CHILLED WATER RETURN PIPING
		EXHAUST DUCT UP			PIPE TEE DOWN		LPS	LOW PRESSURE STEAM SUPPLY PIPING (0-15 PSIG)
		EXHAUST DUCT DOWN			TOP PIPE CONNECTION		LPR	LOW PRESSURE STEAM CONDENSATE RETURN
		ROUND DUCT ELBOW UP			BALL VALVE OR SHUTOFF VALVE IN RISE		MPS	MEDIUM PRESSURE STEAM SUPPLY PIPING (16-60 PSIG)
		ROUND DUCT ELBOW DOWN			PIPE CAP		MPR	MEDIUM PRESSURE STEAM CONDENSATE RETURN
		ELBOW WITH TURNING VANES			PIPE UNION		HPS	HIGH PRESSURE STEAM SUPPLY PIPING (61 TO 200 PSIG)
		DUCT OFFSET - RISE			FLANGED CONNECTION		HPR	HIGH PRESSURE STEAM CONDENSATE RETURN
		DUCT OFFSET - DROP			CONCENTRIC PIPE REDUCER		GWS	GLYCOL WATER SUPPLY
		SQUARE / RECTANGULAR DUCT TRANSITION			ECCENTRIC PIPE REDUCER		GWR	GLYCOL WATER RETURN
		SQUARE/RECTANGULAR TO ROUND DUCT TRANSITION			FLOW ARROW		RL	REFRIGERANT LIQUID PIPING
	SD	SUPPLY DIFFUSER - MULTI-DIRECT.			PIPE ANCHOR		RS	REFRIGERANT SUCTION PIPING
		SUPPLY DIFFUSER - DIRECT. (HATCH DENOTES BLANK OFF)			PIPE GUIDE		FOS	FUEL OIL SUPPLY PIPING
	SG/EG	SIDEWALL SUPPLY or RETURN GRILLE - (R = REGISTER)		BV	BALL VALVE		FOR	FUEL OIL RETURN PIPING
	LD	LINEAR DIFFUSER. SEE SCHEDULE FOR INFORMATION.		BFV	BUTTERFLY VALVE		CW	CITY (DOMESTIC) WATER
	RG/EG	RETURN GRILLE - (R = REGISTER)		PV	PLUG VALVE		PC	PUMPED STEAM CONDENSATE
	EG	EXHAUST GRILLE - (R = REGISTER)		GV	GATE VALVE		D	CONDENSATE DRAIN PIPING
		FLEXIBLE DUCT		GBV	GLOBE VALVE		V	VENT PIPING
	FLEX	FLEXIBLE DUCT CONNECTION (TO EQUIPMENT)		PRV	PRESSURE REDUCING VALVE		G	NATURAL GAS PIPING
		SPIN TAP WITH VOLUME CONTROL DAMPER		CV	CHECK VALVE			
	AD	DUCT ACCESS DOOR		BFP	BACKFLOW PREVENTER			
	VD	VOLUME CONTROL DAMPER			PRESSURE RELIEF VALVE			
	BD	BACKDRAFT DAMPER			AUTOMATIC FLOW CONTROL VALVE			
	MD	MOTORIZED DAMPER			CALIBRATED BALANCING VALVE			
	AP	ACCESS PANEL			AUTOMATIC AIR VENT			
	FD	VERTICAL FIRE DAMPER (WALL)			MANUAL AIR VENT			
	HFD	HORIZONTAL FIRE DAMPER (FLOOR)			P/T PLUG			
	SD	VERTICAL SMOKE DAMPER (WALL)			PRESSURE GAGE W/ SHUT-OFF			
	HSD	HORIZONTAL SMOKE DAMPER (FLOOR)			THERMOMETER			
	FD/SD	COMBINATION VERTICAL FIRE & SMOKE DAMPER			STRAINER (W/ BALL VALVE AND CAP)			
	HFD/SD	COMBINATION HORIZONTAL FIRE & SMOKE DAMPER			HOSE BIBB			
	RD	CEILING RADIATION FIRE DAMPER			FLEXIBLE CONNECTOR			
	DD	DUCT SMOKE DETECTOR			2-WAY CONTROL VALVE			
	T	THERMOSTAT			3-WAY CONTROL VALVE			
	H	HUMIDISTAT			TRIPLE DUTY VALVE WITH MEASURING CONNECTIONS			
	TH	COMBINATION THERMOSTAT & HUMIDISTAT			INVERTED BUCKET STEAM TRAP			
	SP	STATIC PRESSURE SENSOR			FLOAT & THERMOSTATIC STEAM TRAP			
	CO2	CARBON DIOXIDE SENSOR		UC	UNDER CUT DOOR - 1"			
	CO	CARBON MONOXIDE SENSOR			LOUVERED DOOR			
	NO	NITROUS OXIDE SENSOR		RA / EA	RETURN OR EXHAUST AIR			
	S	TEMPERATURE SENSOR		SA / OA	SUPPLY OR OUTSIDE AIR			
	S	STARTER			EQUIPMENT UNIT DESIGNATION			
	OS	OCCUPANCY SENSOR			TAG #			
	R	REFRIGERANT DETECTOR			DIFFUSER, REGISTER & GRILLE UNIT DESIGNATION W/ CFM			

**MECHANICAL ABBREVIATIONS**

ABRV.	DESCRIPTION
HVAC	HEATING, VENTILATION AND AIR CONDITIONING
SA	SUPPLY AIR
RA	RETURN AIR
EA	EXHAUST AIR
OA	OUTSIDE AIR
TA	TRANSFER AIR
MA	MIXED AIR
MBH	1000 - BRITISH THERMAL UNITS
KW	1000-WATT (1 KW = 3,412 BTUH)
SENS.	SENSIBLE
LAT.	LATENT
E.A.T.	ENTERING AIR TEMPERATURE
L.A.T.	LEAVING AIR TEMPERATURE
E.W.T.	ENTERING WATER TEMPERATURE
L.W.T.	LEAVING WATER TEMPERATURE
DB/WB	DRY BULB / WET BULB
IN. W.G.	INCHES WATER GAUGE (AIR)
FT. W.G.	FEET WATER GAUGE (HYDRONIC)
E.S.P.	EXTERNAL STATIC PRESSURE
T.S.P.	TOTAL STATIC PRESSURE
TG	TRANSFER GRILLE
TR	TOP REGISTER
*F	FAHRENHEIT
R / R	REMOVE EXISTING ITEM & RELOCATE TO NEW LOCATION
EX	EXISTING
RL	RELOCATE EXISTING
UNO	UNLESS NOTED OTHERWISE
NTS	NOT TO SCALE
NIC	NOT IN CONTRACT
PH	PHASE
HZ	HERTZ
Ø	DIAMETER
AFF	ABOVE FINISHED FLOOR
ELEV.	ELEVATION FROM DATUM

NOTES:  
1. NOT ALL SYMBOLS AND ABBREVIATIONS ARE IN USE FOR THIS PROJECT.


DRAWING SET: 90% Submission  
RELEASE DATE: 12/29/2024

PRINTED OR ELECTRONIC DRAWINGS AND DOCUMENTATION MAY NOT BE REPRODUCED IN ANY FORM WITHOUT WRITTEN PERMISSION FROM HERSTING ARCHITECTURE, INC.  
COPYRIGHT 2022. ALL RIGHTS RESERVED.

**Allen + Shariff**  
MEP Engineering  
Project Management  
205 East Market Street  
Salisbury, Maryland 21801  
443.545.1300

**CHABAD OF WILMINGTON - SHUL**  
JEWISH COMMUNITY CENTER  
2317 Market Street  
Wilmington, North Carolina 28403  
PROJECT NO. 13-18

**KERSTING ARCHITECTURE**  
4022 MARKET STREET SUITE 201 - WILMINGTON, NC 28403 - (910) 762-1348

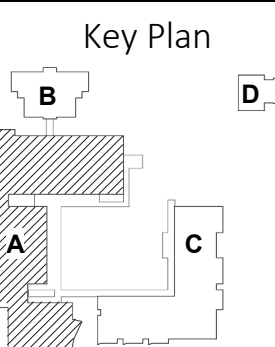

MECHANICAL DATA SHEET

M-001-A



**MECHANICAL SPECIFICATIONS**

**MECHANICAL GENERAL CONDITIONS (23010)**

- GENERAL
    - CONFORM TO ALL GENERAL AND SPECIAL CONDITIONS OF CONTRACT AS SPECIFIED BY ARCHITECT AND/OR OWNER.
    - PRODUCTS AND INSTALLATION SHALL COMPLY WITH ALL APPLICABLE LAWS, CODES, GOVERNMENT REGULATIONS, UTILITY COMPANY REQUIREMENTS, ETC. OF ALL AUTHORITIES HAVING JURISDICTION. WORK SHALL COMPLY WITH THE FOLLOWING CODES, STANDARDS AND ORGANIZATIONS:
      - NORTH CAROLINA MECHANICAL CODE
      - NORTH CAROLINA PLUMBING CODE
      - NORTH CAROLINA ENERGY CODE
      - NATIONAL ELECTRIC CODE
      - NFPA
      - UNDERWRITERS LABORATORY (UL), IRI, FM
      - SMACNA HVAC DUCT CONSTRUCTION STANDARDS' GUIDELINES, DETAILS, & MODEL SPECIFICATION,
      - ASHRAE
    - WHERE CONFLICTS EXIST BETWEEN CODES, STANDARDS OR THIS SPECIFICATION THE HIGHER REQUIREMENT SHALL APPLY. DEVIATIONS FROM THE CONTRACT DOCUMENTS REQUIRED BY THE ABOVE AUTHORITIES SHALL BE SUBMITTED TO THE ENGINEER FOR REVIEW, OBTAIN PERMITS AND PAY ALL FEES. ARRANGE FOR ALL REQUIRED INSPECTIONS AND APPROVALS. CONFIRM ALL UTILITY COMPANY REQUIREMENTS AND CONNECTION POINTS IN FIELD, PRIOR TO STARTING WORK.
    - ALL SPECIFICATIONS AND DRAWINGS, I.E., ARCHITECTURAL, MECHANICAL, PLUMBING, AND ELECTRICAL ARE COMPLIMENTARY AND MUST BE USED IN COMBINATION TO OBTAIN COMPLETE CONSTRUCTION INFORMATION. ANY INFORMATION CONFLICTS WITHIN THE SPECIFICATIONS AND DRAWINGS SHALL BE BROUGHT TO THE ENGINEER'S ATTENTION. DRAWINGS ARE DIAGNOSTIC. CONFIRM ALL DIMENSIONS BY FIELD MEASUREMENT. THE EXACT LOCATIONS FOR APPARATUS, FIXTURES, EQUIPMENT AND PIPING WHICH IS NOT COVERED BY DRAWINGS, SHALL BE OBTAINED FROM THE ARCHITECT OR HIS REPRESENTATIVE IN THE FIELD, AND THE WORK SHALL BE LAID OUT ACCORDINGLY.
    - EACH CONTRACTOR SHALL PROVIDE FOR HIS OWN CLEAN-UP, REMOVAL AND LEGAL DISPOSAL OF ALL RUBBISH DAILY. CONTRACTOR SHALL PROTECT THEIR WORK AND EXISTING OR ADJACENT PROPERTY AGAINST WEATHER. TO MAINTAIN THEIR WORK, MATERIALS, APPARATUS AND FIXTURES FREE FROM INJURY OR DAMAGE. ANY WORK DAMAGED BY FAILURE TO PROVIDE PROTECTION REQUIRED, SHALL BE REMOVED AND REPLACED WITH NEW WORK AT THE CONTRACTOR'S EXPENSE.
    - THE CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, SEQUENCES OF CONSTRUCTION AND THE SAFETY OF WORKMEN.
    - NO MEP, IT, FP SYSTEMS OR COMPONENTS SHALL BE INSTALLED OR ROUTED ABOVE ELECTRICAL PANELS AND EQUIPMENT OR THROUGH ELEVATOR ROOMS, FIREPUMP ROOMS, OR STAIRTOWERS UNLESS SERVING THE MACHINE ROOM, FIREPUMP ROOM OR STAIRTOWER.
    - THE CONTRACTOR SHALL COORDINATE AND OBTAIN A WRITTEN LISTING OF ELECTRICAL CHARACTERISTICS OF ALL MECHANICAL EQUIPMENT FROM ELECTRICAL CONTRACTOR PRIOR TO ORDERING OF EQUIPMENT. NO ADDITIONAL PAYMENT WILL BE MADE FOR LACK OF CONTRACTOR COORDINATION OF ELECTRICAL CHARACTERISTICS.
    - IN CASES OF DOUBT AS TO THE WORK INTENDED, OR IN THE EVENT OF NEED FOR EXPLANATION THEREOF, THE CONTRACTOR SHALL REQUEST SUPPLEMENTARY INSTRUCTIONS FROM THE ENGINEER. NO CHANGES ARE TO BE MADE TO THE WORK OF THIS CONTRACT WITHOUT PRIOR KNOWLEDGE AND APPROVAL OF THE ENGINEER. THE CONTRACTOR SHALL HOLD THE OWNER AND HIS CONSULTANTS HARMLESS AGAINST ALL CLAIMS AND JUDGMENTS ARISING OUT OF THE CONTRACTOR'S PERFORMANCE OF THE WORK OF THIS CONTRACT. THE CONTRACTOR SHALL NOT PROCEED WITH ANY WORK, WHICH HE EXPECTS ADDITIONAL COMPENSATION BEYOND THE CONTRACT AMOUNT, WITHOUT WRITTEN AUTHORIZATION FROM THE APPROPRIATE AUTHORITY. FAILURE TO OBTAIN SUCH AUTHORIZATION SHALL INVALIDATE ANY CLAIM FOR EXTRA COMPENSATION.
  - IT SHALL BE THE RESPONSIBILITY OF THIS CONTRACTOR TO INSTALL THE HEATING, VENTILATION AND AIR CONDITIONING SYSTEM SO AS TO INSURE QUIET OPERATION. NO VIBRATION OR SOUND SHALL BE TRANSMITTED TO THE BUILDING, STRUCTURE OR OCCUPIED AREAS. THE DECISION OF THE ENGINEER AS TO THE QUIETNESS OF THE SYSTEM AND EQUIPMENT SHALL BE FINAL. IT SHALL BE THIS CONTRACTORS RESPONSIBILITY TO CORRECT OR REPLACE ANY NOISY SYSTEM OR EQUIPMENT AS REQUIRED.
  - OBTAIN PERMITS AND PAY ALL FEES. ARRANGE FOR ALL REQUIRED INSPECTIONS AND APPROVALS.
  - BASIS OF DESIGN AND SUBSTITUTIONS
    - WHEREVER THE WORDS "APPROVED BY", "APPROVED EQUAL," "AS DIRECTED" OR SIMILAR PHRASES ARE USED IN THE FOLLOWING SPECIFICATIONS, THEY SHALL BE UNDERSTOOD TO REFER TO THE OWNER AS THE APPROVING AGENCY. THE NAME OR MAKE OF ANY EQUIPMENT OR MATERIALS NAMED IN THE SPECIFICATION (WHETHER OR NOT THE WORDS "OR APPROVED EQUAL" ARE USED) SHALL BE KNOWN AS THE "STANDARD".
    - SUBMIT SHOP DRAWINGS FOR MECHANICAL EQUIPMENT, FIRE PROTECTION SYSTEMS, DUCTWORK, AND PLUMBING FIXTURES AND EQUIPMENT WITH ADEQUATE DETAILS AND SCALES TO CLEARLY SHOW CONSTRUCTION. INDICATE THE OPERATING CHARACTERISTICS FOR EACH REQUIRED ITEM. CLEARLY IDENTIFY EACH ITEM ON THE SUBMITTAL AS TO MARK, LOCATION AND USE. USING SAME IDENTIFICATION AS PROVIDED ON DESIGN DRAWINGS. SHOP DRAWINGS TO BE SUBMITTED INCLUDE BUT NOT LIMITED TO:
      - SHEET METAL
      - DIFFUSERS, GRILLES & REGISTERS
      - FIRE DAMPERS
      - VALVES & PIPING
      - ALL EQUIPMENTDUCTWORK AND FIRE PROTECTION DRAWINGS SHALL BE FULLY DIMENSIONED BASED ON FIELD VERIFIED BUILDING CLEARANCES AND ARCHITECTURAL CEILING LAYOUTS, AND INDICATE STRUCTURAL, LIGHTING, DUCTWORK AND PIPING AT ALL CRITICAL LOCATIONS.
  - CONTRACTOR SHALL REVIEW AND INDICATE HIS APPROVAL OF EACH SHOP DRAWING PRIOR TO SUBMITTAL FOR REVIEW. DO NOT START WORK OR FABRICATION UNTIL SHOP DRAWINGS HAVE BEEN REVIEWED BY THE ENGINEER AND RETURNED TO THE CONTRACTOR.
  - SUBMITTALS WILL BE REVIEWED ONLY FOR GENERAL COMPLIANCE WITH THE CONTRACT DOCUMENTS AND NOT FOR DIMENSIONS OR QUANTITIES. THE SUBMITTAL REVIEW SHALL NOT RELIEVE THE CONTRACTOR OF RESPONSIBILITY FOR THE USE OF ANY ITEM IN FULL COMPLIANCE WITH THE CONTRACT DOCUMENTS OR ITS COMPLETE AND PROPER INSTALLATION.
  - WHERE SUBMITTALS VARY FROM THE CONTRACT REQUIREMENTS, THE CONTRACTOR SHALL CLEARLY INDICATE ON SUBMITTAL OR ACCOMPANYING DOCUMENTS THE NATURE AND REASON FOR VARIATIONS.
  - EACH MANUFACTURER OR HIS REPRESENTATIVE MUST CHECK THE APPLICATION OF HIS EQUIPMENT AND CERTIFY AT TIME OF SHOP DRAWING SUBMITTAL THAT EQUIPMENT HAS BEEN PROPERLY APPLIED AND CAN BE INSTALLED, SERVICED AND MAINTAINED WHERE INDICATED ON DRAWINGS. ADVISE ENGINEER IN WRITING WITH SUBMITTAL DRAWINGS OF ANY POTENTIAL PROBLEMS. THE MANUFACTURER SHALL BE RESPONSIBLE FOR ANY CHANGES THAT MIGHT BE NECESSARY BECAUSE OF PHYSICAL CHARACTERISTICS OF EQUIPMENT THAT HAVE NOT BEEN CALLED TO THE ENGINEER'S ATTENTION AT THE TIME OF SUBMITTAL.
- CUTTING, PATCHING AND DRILLING
  - ALL CUTTING AND PATCHING OF THE BUILDING CONSTRUCTION REQUIRED FOR THIS WORK SHALL BE BY THIS CONTRACTOR UNLESS SHOWN ON ARCHITECTURAL DRAWINGS AND CONFIRMED AS TO SIZE AND LOCATION PRIOR TO NEW CONSTRUCTION. CUTTING SHALL BE IN A NEAT AND WORKMANLIKE MANNER. NEATLY SAW CUT ALL RECTANGULAR OPENINGS, SET SLEEVE THROUGH OPENING, AND FINISH PATCH OR PROVIDE TRIM FLANGE AROUND OPENING. CORE DRILL AND SLEEVE ALL ROUND OPENINGS. DO NOT CUT ANY STRUCTURAL COMPONENTS WITHOUT ARCHITECT'S APPROVAL.
  - PATCH AND FINISH TO MATCH ADJACENT AREAS THAT HAVE BEEN CUT, DAMAGED OR MODIFIED AS A RESULT OF THE INSTALLATION OF THE MECHANICAL OR ELECTRICAL EQUIPMENT. FIRE STOP ALL PENETRATIONS OF FIRE RATED CONSTRUCTION IN A CODE APPROVED MANNER.
  - ALL CONTRACTORS SHALL CONFIRM WITH OWNER, PRIOR TO BID, TIMES AVAILABLE FOR NOISE PRODUCING WORK SUCH AS CUTTING AND CORE DRILLING OF FLOORS, WALLS, ETC., AS WELL AS TIMES FOR WORK WHICH REQUIRE ACCESS INTO ADJOINING TENANT SPACES. INCLUDE ANY PREMIUM TIME IN BID.
  - EXACT LOCATION OF ROOFTOP EQUIPMENT SHALL BE APPROVED BY OWNER'S STRUCTURAL ENGINEER.
- INFORMATION REGARDING REQUIRING PIPE OPENINGS IN WALLS, FLOORS, CHASES, ETC., AND CONCRETE EQUIPMENT PADS OR FOUNDATIONS SHALL BE GIVEN TO THE GENERAL CONTRACTOR BY THIS CONTRACTOR PRIOR TO THE CONSTRUCTION PERIOD. IF THIS CONTRACTOR FAILS TO COMPLY WITH THIS REQUEST, OR IF INCORRECT INFORMATION IS GIVEN, THE NECESSARY CUTTING AND PATCHING WILL BE PERFORMED BY THE GENERAL CONTRACTOR, AT THIS CONTRACTOR'S EXPENSE.
- FIRESTOPPING
  - ALL SERVICES THAT PASS THRU FIRE OR SMOKE RATED PARTITIONS, WALLS, FLOORS, SHALL BE FIRESTOPPED. FIRE STOPPING RATING SHALL MATCH PARTITION RATING. ALL FIRE STOPPING SYSTEM SHALL MEET THE REQUIREMENTS OF ASTM E 814, UL 1479, AND BE FACTORY MUTUAL APPROVED.
  - ALL FIRESTOPPING AND/OR SMOKE STOPPING MATERIAL AND INSTALLATION SHALL BE AS MANUFACTURED BY HILLI OR APPROVED EQUAL.
- ACCESS DOORS & PANELS
  - ACCESS DOORS SHALL BE PROVIDED IN WALLS AND CEILING WHERE REQUIRED TO PERMIT PROPER ACCESS TO VALVES AND ANY OTHER SERVICE DEVICES WHICH REQUIRE MAINTENANCE OR SERVICE. DOORS PLACED IN WALLS, PARTITIONS OR OTHER FIRE-RATED CONSTRUCTION SHALL HAVE A LABEL SIGNIFYING THAT THE DOOR HAS THE SAME FIRE RATING AS THE FIRE-RATED CONSTRUCTION.
  - THIS CONTRACTOR SHALL FURNISH ACCESS PANELS TO THE GENERAL CONTRACTOR FOR INSTALLATION.

- ACCESS PANELS SHALL BE CONSTRUCTED OF 14 GAUGE STEEL WITH 16 GAUGE STEEL FRAMES. DOORS SHALL FINISH FLUSH WITH THE SURROUNDING SURFACE. FRAMES SHALL HAVE 3 INCH WIDE EXPANDED METAL FOR PLASTERED SURFACES AND FLAT FLANGED TYPE FRAME FOR TILE, MASONRY OR GYPSUM BOARD SURFACES. DOORS AND FRAMES SHALL BE FINISHED PRIME COATED. DOORS INSTALLED IN CERAMIC TILE OR OTHER NON-PAINTED SURFACES SHALL BE STAINLESS STEEL. HINGES SHALL BE CONCEALED SPRING TYPE, TO ALLOW DOORS TO BE OPENED 175 DEGREES. LOCKS SHALL BE FLUSH SCREWDRIVER TYPE WITH STEEL CAMS. ACCESS PANELS SHALL BE 16 INCHES BY 16 INCHES OR LARGER AS MAY BE REQUIRED FOR PROPER ACCESS TO THE DEVICE BEING SERVED.
- ACCESS PANELS ARE NOT REQUIRED IN COMPLETELY ACCESSIBLE LIFT OUT TILE CEILINGS. CONTRACTOR SHALL REVIEW THE ROOM FINISH SCHEDULE ON THE ARCHITECTURAL DRAWINGS IN ORDER TO VERIFY THE NEED FOR ACCESS PANEL.
- PAINTING
  - IN FINISHED SPACES, PAINTING OF ALL MECHANICAL EQUIPMENT, APPARATUS, AND PIPING SHALL BE DONE BY THE PAINTING TRADE UNDER THE GENERAL CONTRACTOR SPECIFICATION, EXCEPT WHERE SPECIFIED TO BE DONE BY THE MECHANICAL CONTRACTOR.
- TEMPORARY HEAT
  - THE COSTS OF TEMPORARY HEAT, INCLUDING UTILITY COSTS, SHALL BE AT THE EXPENSE OF THE HEATING TRADE (MECHANICAL CONTRACTOR). THE HEATING TRADE SHALL PROVIDE THE MEANS OF TEMPORARY HEAT. EXISTING HEATING EQUIPMENT AND SYSTEMS MAY NOT BE USED DURING CONSTRUCTION AS THE SYSTEMS SERVE OTHER OCCUPIED SPACES WITHIN THE BUILDING.
  - THE PERMANENT MECHANICAL SYSTEM SHALL NOT BE USED UNDER ANY EXCEPTIONS TO PROVIDE TEMPORARY HEATING, VENTILATING, EXHAUST OR AIR CONDITIONING UNTIL THE BUILDING IS CLEAN, WITHOUT ANY DUST OR DEBRIS THAT CAN ENTER THE MECHANICAL SYSTEM AND IS READY FOR OCCUPANCY. COVERING THE RETURN EXHAUST AIR INLETS WITH FILTER MEDIA IS NOT AN ACCEPTABLE ALTERNATIVE TO HAVING AN ENCLOSED, DUST-FREE ENVIRONMENT FOR THE SYSTEMS TO OPERATE IN. IN NO EVENT SHALL THE MECHANICAL CONTRACTOR'S ONE-YEAR WARRANTY BE SHORTENED BY THE USE OF PERMANENT EQUIPMENT FOR TEMPORARY HEAT.
- RECORD DRAWINGS
  - EACH CONTRACTOR OR SUBCONTRACTOR SHALL KEEP ONE (1) COMPLETE SET OF THE CONTRACT WORKING DRAWINGS ON THE JOB SITE ON WHICH HE SHALL REGULARLY RECORD ANY DEVIATIONS OR CHANGES FROM SUCH CONTRACT DRAWINGS MADE DURING CONSTRUCTION.
  - THESE DRAWINGS SHALL RECORD THE LOCATION OF ALL CONCEALED EQUIPMENT, PIPING, ELECTRIC SERVICE, SEWERS, WASTES, VENTS, DUCTS, CONDUIT AND OTHER PIPING, BY MEASURED DIMENSIONS TO EACH SUCH ITEM FROM READILY IDENTIFIABLE AND ACCESSIBLE WALLS OR CORNERS OF THE BUILDING. PLANS ALSO SHALL SHOW INVERT ELEVATION OF SEWERS AND TOP ELEVATION OF ALL OTHER BELOW-GRADE LINES.
  - RECORD DRAWINGS SHALL BE KEPT CLEAN AND UNMARGED AND SHALL NOT BE USED FOR ANY PURPOSE OTHER THAN RECORDING DEVIATIONS FROM WORKING DRAWINGS AND EXACT LOCATIONS OF CONCEALED WORK.
  - AFTER THE PROJECT IS COMPLETED, THESE SETS OF DRAWINGS SHALL BE DELIVERED TO THE ARCHITECT IN GOOD CONDITION, AS A PERMANENT RECORD OF THE INSTALLATION AS ACTUALLY CONSTRUCTED.
- WARRANTY
  - FULLY WARRANT ALL MATERIALS, EQUIPMENT AND WORKMANSHIP FOR ONE (1) YEAR FROM DATE OF ACCEPTANCE. EXTEND ALL MANUFACTURER'S WARRANTIES TO OWNER, INCLUDING ALL EXTENDED WARRANTIES ON HVAC EQUIPMENT.
  - REPAIR OR REPLACE WITHOUT CHARGE TO THE OWNER ALL ITEMS FOUND DEFECTIVE DURING THE WARRANTY PERIOD. IN THE EVENT OF REPLACEMENT OR REPAIR DUE TO FAILURE WITHIN THE WARRANTY PERIOD, THE WARRANTY ON THAT PORTION OF THE WORK SHALL BE EXTENDED FOR A MINIMUM PERIOD OF ONE (1) YEAR FROM THE DATE OF SUCH REPLACEMENT OR REPAIR.

**DUCTWORK (23313)**

- FABRICATE AND ERECT ALL DUCTWORK FOR ASHRAE AND SMACNA STANDARDS FROM ALUMINUM. COMPLY WITH NFPA BULLETIN 90A REQUIREMENTS.
- GENERAL SUPPLY AND RETURN DUCTWORK HAVE A SMACNA 2" STATIC PRESSURE RATING WITH SEAL CLASS B SEAMS AND JOINTS.
- ALL RECTANGULAR TRANSFER DUCTWORK SHALL HAVE 1" THICK ACOUSTICAL LINER. LINER SHALL BE FLEXIBLE AND CONSTRUCTED OF GLASS FIBERS BONDED WITH A THERMOSETTING RESIN. THE SURFACE OF THE LINER SHALL HAVE AN ANTIMICROBIAL EROSION RESISTANCE TESTED BY NRTL AND REGISTERED BY THE EPA FOR USE IN HVAC SYSTEMS. MINIMUM R-VALUE SHALL BE 4.2.
- GENERAL EXHAUST DUCTWORK UNDER 45' IN LENGTH SHALL HAVE A SMACNA 1" STATIC PRESSURE RATING WITH SEAL CLASS B SEAM AND JOINTS. EXHAUST DUCTWORK OVER 45' IN LENGTH SHALL HAVE A SMACNA 2" STATIC PRESSURE RATING WITH SEAL CLASS A SEAM AND JOINTS.
- ALL FLEXIBLE DUCTWORK SHALL BEAR THE UL 181 LABEL (CLASS 1 AIR DUCT) AND SHALL BE FACTORY INSULATED (1-1/2", 0.6 LB., FIBERGLASS) ATCO UPC #0761 OR EQUAL. FLEXIBLE DUCTWORK SHALL COMPLY W/ NFPA 90A, AND NFPA 90B. ALL FLEXIBLE DUCTWORK CONNECTED TO DIFFUSERS SHALL NOT BE LESS THAN THE SMOKE SIZE OF THE DIFFUSER. MINIMUM FLEXIBLE DUCT BEND RADIUS OF CURVATURE SHALL BE 3 DUCT DIAMETERS. MAXIMUM LENGTH SHALL BE R/40, NO MORE THAN THE EQUIVALENT OF TWO (2) 90 DEGREE BENDS WILL BE ACCEPTABLE. FLEXIBLE DUCTS SHALL BE INDEPENDENTLY SUPPORTED FROM THE STRUCTURE AND CONNECTED WITH PLASTIC DRAW BANDS TIGHTENED WITH MANUFACTURER'S TOOL. FLEXIBLE DUCTS ARE NOT PERMITTED IN ROOMS WITHOUT CEILINGS.
- ALL FABRIC DUCTWORK SHALL BE COATED, 100% POLYESTER, WOVEN, FIRE RETARDANT MATERIAL, UL AND NFPA APPROVED, NON-POROUS AND MACHINE WASHABLE. DISPERSION ORIFICE SIZE, SPACING AND QUANTITY TO BE SELECTED BY THE MANUFACTURER FOR THE REQUIRED CFM AND DIFFUSER LENGTH OF EACH APPLICATION. COLOR TO BE SELECTED BY THE ARCHITECT. PROVIDE GALVANIZED SUSPENSION HARDWARE AND ACCESSORIES. SIMILAR TO DUCTSOX DURATEX HIGH TROW MODEL.
- INCLUDE ALL ACOUSTIC, DOUBLE RADIUS AIRFOIL SHAPED PERFORATED ALUMINUM TURNING VANES, MANUAL DAMPERS, FLEXIBLE CONNECTORS, GRILLES AND DIFFUSERS, ACOUSTIC LINING, AND OTHER SHEET METAL ACCESSORIES FOR THE PROJECT. VOLUME DAMPERS TO BE OF OPPOSED BLADE TYPE CONSTRUCTED IN ACCORDANCE WITH "SMACNA" STANDARDS.
- ALL BRANCH CONNECTION FITTINGS IN RECTANGULAR DUCTWORK SHALL BE 45 DEGREE TRANSITION TYPE, CONICAL FITTINGS OR SPIN-IN FITTINGS. BUTT FITTINGS ARE NOT ACCEPTABLE.
- PROVIDE FIRE DAMPERS WITH ACCESS DOORS AT ALL FIRE RATED WALLS, PARTITIONS AND CEILINGS. DAMPERS SHALL HAVE RATING EQUIVALENT TO BARRIER. DAMPER SHALL BE THE DYNAMIC TYPE AND SHALL BE ABLE TO CLOSE AGAINST AN AIRSTREAM. DAMPERS SHALL MEET ALL NFPA AND IBC REQUIREMENTS.
- PROVIDE SMOKE DAMPERS WITH ACCESS DOORS AT ALL SMOKE BARRIERS/PARTITIONS. UNIT SHALL INCORPORATE BLADE END SWITCHES (OPEN AND CLOSED), AND OUTSIDE THE DUCT MOUNTED UL LISTED MOTOR. PROVIDE MANUFACTURER'S STANDARD U.L. LISTED OPEN-CLOSE - RESET SWITCH AND POSITION PILOT LIGHTS IN UNIT MOUNTED ENCLOSURE. ENCLOSURE TO BE CAPABLE OF BEING REMOVED FOR REMOTE MOUNTING TO ENSURE VISIBILITY AFTER SYSTEM INSTALLATION.
- PROVIDE COMBINATION FIRE/SMOKE DAMPERS AT ALL FIRE/SMOKE RATED SHAFT AND WALL LOCATIONS. EACH COMBINATION FIRE SMOKE DAMPER SHALL HAVE 16 GA. GALVANIZED BLADES STRENGTHENED WITH GROOVES MEETING REQUIREMENTS OF UL STANDARD 555 & 555S AND HAVE AN 1-1/2 HOUR RATING. BASIS OF DESIGN SHALL BE GREENHEX MODEL FSD 200 SERIES. DAMPERS SHALL BE EQUIPPED STANDARD WITH AN ELECTRIC HEAT RESPONSIVE DEVICE THAT PERFORMS THE SAME FUNCTION AS A FUSIBLE LINK TO CLOSE DAMPER AT 350 °F. PROVIDE POSITION INDICATING SWITCHES TO MEET REQUIREMENTS OF SMOKE PURGE CONTROL AND/OR BUILDING MANAGEMENT SYSTEM CONTROLS. THE DAMPER OPERATION AND CONSTRUCTION SHALL MEET UL REQUIREMENTS.
- PROVIDE CURBS FOR ALL ROOF EQUIPMENT. CURBS SHALL BE FURNISHED AS ACCESSORIES TO THE EQUIPMENT OR R" HIGH PATE OR EQUAL EQUIPMENT SUPPORTS SPANNING STRUCTURE AND FLASHED INTO ROOFING. ALL CUTTING, FLASHING, AND PATCHING OF ROOF SHALL BE BY OWNER'S ROOFING CONTRACTOR AND PAID FOR BY MECHANICAL CONTRACTOR.
- PROVIDE BIG FOOT H FRAME SETS SUPPORT SYSTEM OR SIMILAR FOR ALL ROOFTOP DUCTWORK. SPACING SHALL BE PER SMACNA GUIDELINES.

**HANGERS AND SUPPORTS (23052)**

- SUPPORT ALL PIPING FROM STRUCTURE WITH UL LISTED HANGERS AND SUPPORTS SUITABLE FOR THE INTENDED INSTALLATION. DESIGN, SELECTION, SPACING, AND APPLICATION OF HANGERS AND SUPPORTS SHALL COMPLY WITH ANSI B31.1 AND MSS SP-69. HANGERS SHALL BE MANUFACTURED BY PENTAIR, OR APPROVED EQUAL. BLACK OR GALVANIZED STEEL PIPE = MODEL NO. 100, CAST IRON PIPE = MODEL NO. 400, COPPER TUBING = MODEL NO. 102-A.
- CONTRACTOR SHALL PROVIDE INSULATION HANGER WITH PROTECTIVE SHIELDS, SUCH AS PENTAIR, MODEL NO. 125, OR APPROVED EQUAL FOR ALL INSULATED PIPING.
- CONTRACTOR SHALL PROVIDE RISER CLAMPS FOR VERTICAL PIPING AT EACH LEVEL. RISER CLAPS SHALL BE PENTAIR MODEL NO. 510 FOR STEEL PIPING AND MODEL NO. 511 FOR COPPER TUBING OR APPROVED EQUAL. USE "SHORT-END" RISER CLAMPS WHERE SPACE IS LIMITED.
- CONTRACTOR SHALL PROVIDE SIDE BEAM CLAMPS FOR SUPPORTING PIPING FROM STRUCTURAL STEEL MEMBERS. BEAM CLAMPS SHALL BE MANUFACTURED BY PENTAIR, MODEL 300 OR APPROVED EQUAL.
- WHERE OTHER MEANS OF SUPPORT PIPING ARE REQUIRED OR DESIRED, THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING THE ENGINEER'S APPROVAL PRIOR TO INSTALLING THOSE SUPPORTS.
- HANGERS AND SUPPORTS SHALL BE SPACED AT INTERVALS WHICH WILL PREVENT SAGGING AND REDUCE STRAIN ON VALVES AND SPECIALTIES. HANGER SPACING SHALL BE NO GREATER AND ROD SIZE SHALL BE NO SMALLER THAN THAT SHOWN IN THE FOLLOWING TABLE. HANGERS SHALL ALLOW FOR EXPANSION AND CONTRACTION. HANGER SHALL BE PROVIDED AT EACH CHANGE OF DIRECTION.

**RISER CLAMPS SHALL BE INSTALLED ABOVE THE FLOOR AT EACH LEVEL. RISER CLAMPS MAY BE SUSPENDED BELOW FLOOR LEVEL, WITH HANGER RODS AND INSERTS, WHERE THE INSTALLATION OF ESCUTCHEON PLATES IS REQUIRED.**

**EQUIPMENT (23500)**

- MAKE ALL FINAL EQUIPMENT CONNECTIONS AND PROVIDE THE NECESSARY ADAPTORS, FITTINGS, VALVES, DEVICES, ETC. FOR A COMPLETE AND OPERABLE SYSTEM. PROVIDE COMPLETE WITH BASES, ISOLATORS, SUPPORTS AND OTHER REQUIRED ACCESSORIES.
- EQUIPMENT SHALL BE INSTALLED IN FULL ACCORDANCE WITH THE MANUFACTURER'S DATA AND INSTALLATION INSTRUCTIONS, INCLUDING CLEARANCES, LUBRICATE AND ADJUST AS REQUIRED. THIS IS CONTRACTORS RESPONSIBILITY TO CHECK AND CONFORM TO THESE REQUIREMENTS PRIOR TO STARTING WORK. FURNISH AND INSTALL CLEAN SET OF FILTERS PRIOR TO BALANCING.
- THE CONTRACTOR SHALL COORDINATE ELECTRICAL CHARACTERISTICS OF ALL MECHANICAL EQUIPMENT PRIOR TO ORDERING OF EQUIPMENT. COORDINATE REQUIREMENT FOR PROVISION OF MOTOR STARTERS, DISCONNECTS, CONTACTORS, CONTROL WIRING, ETC. AS REQUIRED FOR PROPER FUNCTIONING SYSTEM WITH ELECTRICAL CONTRACTOR. NO ADDITIONAL PAYMENT WILL BE MADE FOR LACK OF CONTRACTOR COORDINATION OF ELECTRICAL CHARACTERISTICS.
- ALL FLOOR MOUNTED EQUIPMENT SHALL BE INSTALLED ON CONCRETE HOUSEKEEPING PADS. MINIMUM PAD THICKNESS SHALL BE NOMINAL 4". PAD SHALL EXTEND BEYOND THE EQUIPMENT A MINIMUM OF 4" ON EACH SIDE. CONCRETE PADS SHALL BE PROVIDED BY THIS CONTRACTOR. IT SHALL BE THE RESPONSIBILITY OF THIS CONTRACTOR TO COORDINATE THE SIZE AND LOCATION OF THE CONCRETE HOUSEKEEPING PADS WITH THE GENERAL CONTRACTOR.
- ALL EQUIPMENT SHALL BE MOUNTED ON VIBRATION ISOLATORS TO PREVENT THE TRANSMISSION OF VIBRATION AND MECHANICALLY TRANSMITTED SOUND TO THE BUILDING STRUCTURE.
- ISOLATION EQUIPMENT SHALL BE THE PRODUCT OF A SINGLE MANUFACTURER, AND SHALL BE DESIGNED SPECIFICALLY FOR THE APPLICATION REQUIRED. THIS INCLUDES, BUT IS NOT LIMITED TO, PIPING DUCTWORK, PUMPS, VIBRATION ISOLATORS SHALL BE RATED FOR THE WEIGHT AND SPACING REQUIRED FOR THE EQUIPMENT REQUIRING ISOLATION.
- PROVIDE CURBS FOR ALL ROOF OPENINGS FOR DUCTS AND EQUIPMENT. CURBS SHALL BE FURNISHED AS ACCESSORIES TO THE EQUIPMENT OR R" HIGH PATE OR EQUAL EQUIPMENT SUPPORTS SPANNING STRUCTURE AND FLASHED INTO ROOFING. ALL CUTTING, FLASHING, AND PATCHING OF ROOF SHALL BE BY OWNERS ROOFING CONTRACTOR AND PAID FOR BY MECHANICAL CONTRACTOR.

**CONTROLS (23010)**

- PROVIDE COMPLETE TEMPERATURE CONTROLS FOR ALL HVAC SYSTEMS. PROVIDE NEW CONTROL DEVICES INCLUDING DAMPER OPERATORS, TEMPERATURE SENSORS AND OTHER REQUIRED DEVICES TO PROVIDE A COMPLETE OPERATIONAL SYSTEM PER THE FOLLOWING OPERATING SEQUENCE. MOUNT ALL CONTROLS FURNISHED AS ACCESSORIES TO EQUIPMENT AND PROVIDE ALL CONTROL WIRING REQUIRED FOR PROPER OPERATION WHERE NOT SPECIFICALLY SHOWN ON ELECTRICAL PLANS. ALL WIRING SHALL BE IN CONDUIT OR PER N.E.C. AND LOCAL CODE REQUIREMENTS. STANDARD MOUNTING HEIGHT TO TOP OF THERMOSTAT IS 48" ABOVE FINISHED FLOOR OR AS INDICATED ON THE ARCHITECTURAL DRAWINGS. DO NOT INSTALL THERMOSTATS NEAR DIMMER SWITCHES. WIRING OF ALL MOTORIZED OPERATORS AND THERMOSTATS (REGARDLESS OF VOLTAGE) ARE THE RESPONSIBILITY OF THE MECHANICAL CONTRACTOR.
- THE CONTRACTOR SHALL FURNISH AND INSTALL A COMPLETE, WEB-BASED, NATIVE BACNET-INTEGRATED BUILDING AUTOMATION SYSTEM (BAS) INCLUDING ALL NECESSARY HARDWARE, ALL OPERATING AND APPLICATIONS SOFTWARE NECESSARY TO PERFORM THE HVAC CONTROL SEQUENCES OF OPERATION AS CALLED FOR IN THIS SPECIFICATION OR AS SHOWN ON THE DRAWINGS. BAS CONTRACTOR SHALL FURNISH AND INSTALL ALL RELATED SOFTWARE AND HVAC-DCD CONTROLS AS SPECIFIED WITHIN THIS SPECIFICATION. IT SHALL BE THE RESPONSIBILITY OF THE BAS CONTRACTOR TO COORDINATE THIS WORK WITH THE GENERAL CONTRACTOR, MECHANICAL CONTRACTOR, AND THE ELECTRICAL CONTRACTOR AS IT RELATES TO THE INSTALLATION AND WIRING OF ALL RELATED HVAC SYSTEMS.
- IT SHALL BE THE RESPONSIBILITY OF THE BAS CONTRACTOR TO PROVIDE ALL THE REQUIRED LABOR AND PROGRAMMING TO SEAMLESSLY INTEGRATE THE NEW BAS BACNET SYSTEM AND ITS DCD POINTS, GRAPHICS, ALARMS, ETC. INTO AN EXISTING BAS IF PRESENT.
- THE CONTROLS CONTRACTOR SHALL WARRANT THE SYSTEM FOR 24 MONTHS AFTER SUBSTANTIAL COMPLETION. DURING THE WARRANTY PERIOD, THE BUILDING SYSTEM CONTRACTOR SHALL BE RESPONSIBLE FOR ALL NECESSARY REVISIONS TO THE SOFTWARE AS REQUIRED TO PROVIDE A COMPLETE AND WORKABLE SYSTEM CONSISTENT WITH THE LETTER AND INTENT OF THE SEQUENCE OF OPERATION SECTION OF THE SPECIFICATION.
  - THE FOLLOWING ARE THE APPROVED BAS MANUFACTURERS:
    - AUTOMATED LOGIC, INC.
    - CARRIER CONTROLS
    - DIESTECH CONTROLS BY TRINITY AUTOMATED SOLUTIONS
    - HONEYWELL CONTROLS BY CHESAPEAKE CONTROLS, INC
    - JOHNSON CONTROLS, PITTSBURGH BRANCH OFFICE
    - KMC CONTROLS BY BUILDING CONTROL SYSTEMS
    - SIEMENS CONTROLS
    - TRANE CONTROLS
    - OR PRE-APPROVED EQUAL.
- THE CONTROL SYSTEM SHALL BE PROGRAMMED WITH THE FOLLOWING SEQUENCES AND FEATURES:
  - UNOCCUPIED HEAT: THE SYSTEM SHALL USE VRF AND RTU AS THE PRIMARY SOURCE OF HEAT DURING UNOCCUPIED PERIODS.
  - MORNING WARM UP: BEFORE THE OCCUPIED PERIOD BEGINS, THE SYSTEM SHALL USE VRF AND RTU HEAT TO BRING THE CONNECTED SPACES UP TO OCCUPIED TEMPERATURE.
  - SUPPLY FAN PRESSURE RESET: THE CONTROL SYSTEM SHALL MONITOR ALL DAMPER POSITIONS THAT ARE CONNECTED TO THE RTU SUPPLY FAN. THE SUPPLY AIR PRESSURE SETPOINT SHALL BE REDUCED IF NONE OF THE DAMPERS ARE OPEN 95% OR GREATER.
  - SUPPLY TEMPERATURE RESET: THE CONTROL SYSTEM SHALL MONITOR ALL DAMPER POSITIONS THAT ARE CONNECTED TO A PARTICULAR UNITS SUPPLY FAN. THE SUPPLY AIR TEMPERATURE SHALL BE RESET HIGHER IF THE RETURN AIR RELATIVE HUMIDITY IS BELOW 40% AND NONE OF THE DAMPER POSITIONS ARE OPEN 95% OR GREATER.
  - ECONOMIZER: THE CONTROL SYSTEM SHALL MONITOR THE ECONOMIZER OPERATION AND THE RELEVANT SENSORS FOR THE RTU. THE RTU SHALL CONTROL THE DAMPER POSITION AS DESIGNED FROM THE FACTORY. THE CONTROL SYSTEM SHALL MONITOR THE DAMPER POSITION AND THE OTHER SENSORS THAT ARE INTEGRATED INTO ECONOMIZER OPERATION.

**IDENTIFICATION (23053)**

- CONTRACTOR SHALL PROVIDE IDENTIFICATION LABELS, TAGS, ETC. AS INDICATED ON THE DRAWINGS AND AS SPECIFIED HEREIN. THE IDENTIFICATION SHALL BE IN ACCORDANCE WITH ANSI STANDARD A13.1. PRESSURE SENSITIVE MARKERS SHALL BE MANUFACTURED BY THE BRADY CO., OR APPROVED EQUAL. MARKERS SHALL BE MANUFACTURER'S STANDARD PRODUCT. PRESSURE SENSITIVE PIPE MARKERS SHALL BE MANUFACTURED BY THE BRADY CO., OR APPROVED EQUAL. PIPE MARKERS SHALL BE MANUFACTURER'S STANDARD PRODUCT.
- MAGNETIC MOTOR CONTROLLERS:
  - MAGNETIC MOTOR CONTROLLERS SHALL BE PROVIDED AS INDICATED. THEY SHALL NOT BE SMALLER THAN NEMA SIZE 1.
  - NON-REVERSING MAGNETIC CONTROLLER SHALL BE UTILIZED TO START FULL VOLTAGE, NON-REVERSING, AC SINGLE SPEED MOTORS. THE CONTROLLERS SHALL BE SIZED FOR THE LOAD UNLESS OTHERWISE INDICATED.
  - REVERSING MAGNETIC CONTROLLER SHALL BE UTILIZED TO START FULL VOLTAGE REVERSING, AC SINGLE SPEED MOTORS. THE CONTROLLER SHALL BE SIZED FOR THE LOAD UNLESS OTHERWISE INDICATED. LOCATION OF REVERSING MAGNETIC CONTROLLERS IS INDICATED ON THE DRAWINGS.
  - WHERE MULTI-SPEED MOTORS ARE SCHEDULED ON THE DRAWINGS, THE MOTOR CONTROLS SHALL BE COMPATIBLE WITH THE TYPE MOTOR SHOWN.
  - OVERLOAD RELAYS SHALL BE SOLID STATE AND BE SUPPLIED IN EACH LEG. OVERLOAD RELAYS SHALL BE MATCHED TO LOAD AND SHALL BE ADJUSTABLE FROM 90% TO 110%. A SINGLE RESET BUTTON SHALL BE MOUNTED ON THE STARTER DOOR TO PERMIT EXTERNAL RESET. RELAYS SHALL BE CONVERTIBLE FROM MANUAL TO AUTOMATIC RESET BY A SIMPLE ADJUSTMENT.
  - CONTROL TRANSFORMERS SHALL BE PROVIDED, WHERE REQUIRED. BOTH LEGS OF THE PRIMARY AND ONE LEG OF THE SECONDARY OF THE CONTROL TRANSFORMER SHALL BE PROTECTED BY NEMA CLASS 3 FUSES. THE OTHER LEG OF THE SECONDARY SHALL BE GROUNDING. CONTROL TRANSFORMER CAPACITY SHALL BE ADEQUATE TO OPERATE ALL CONTROL DEVICES IN THE CIRCUIT. CONTROL VOLTAGE SHALL BE 120V AC UNLESS OTHERWISE SPECIFIED.
  - UNLESS OTHERWISE INDICATED, ALL MOTOR STARTERS SHALL BE PROVIDED WITH HAND-OFF-AUTOMATIC (H.O.A) SWITCH IN THE DOOR. ENCLOSURES FOR MAGNETIC STARTERS SHALL BE NEMA TYPE 1 FOR INDOOR USE NEMA TYPE 4X FOR OUTDOOR USE AND NEMA TYPE 7 FOR EXPLOSION PROOF USE.
  - MOTOR CONTROLLERS SHALL BE PROVIDED WITH ALL CONTROL DEVICES, INCLUDING AUXILIARY CONTACTS, REQUIRED FOR EQUIPMENT TO OPERATE AS SPECIFIED.

**COMBINATION MOTOR CONTROLLERS:**

- COMBINATION MOTOR CONTROLLERS SHALL BE PROVIDED WITH MOLDED CASE MOTOR CIRCUIT PROTECTORS OR MOLDED CASE CIRCUIT BREAKERS AS INDICATED. MOTOR CIRCUIT PROTECTIVE DEVICES SHALL HAVE SHORT CIRCUIT CAPACITY AS REQUIRED. UNIT CONTROL CIRCUIT FUSING SHALL BE PROVIDED. THE MOTOR CIRCUIT PROTECTIVE DEVICE SHALL BE MOUNTED IN THE SAME ENCLOSURE AS THE MAGNETIC CONTROLLER AND SHALL BE OPERABLE BY HAND FROM OUTSIDE THE ENCLOSURE. THE HANDLE SHALL BE SO INTERLOCKED WITH THE DOOR THAT IT MUST BE RETURNED TO THE "OFF" POSITION BEFORE THE DOOR CAN BE OPENED, BUT A COIN-PROOF DEFEAT MECHANISM SHALL BE PROVIDED TO ALLOW AUTHORIZED PERSONNEL TO OPEN THE ENCLOSURE DOOR WITHOUT OPENING THE DISCONNECTING DEVICE. PROVISIONS FOR PATCHING THE DISCONNECT HANDLE IN THE "OFF" POSITION SHALL BE MADE. THE ENCLOSURE FOR COMBINATION STARTERS SHALL BE NEMA TYPE 1 FOR INDOOR USE AND NEMA TYPE 4X FOR OUTDOOR USE, AND NEMA TYPE 7 FOR EXPLOSION PROOF USE.
- MOTOR CIRCUIT PROTECTORS SHALL BE THE CONTINUOUSLY ADJUSTABLE, INSTANTANEOUS MAGNETIC TRIP TYPE CIRCUIT BREAKER AND SHALL BE SO CONSTRUCTED THAT ALL POLES OPEN, CLOSE AND TRIP SIMULTANEOUSLY.
- OVERLOAD AND SHORT CIRCUIT PROTECTION:
  - HEATER ELEMENTS SHALL BE PROVIDED FOR OVERLOAD PROTECTION. MOTOR CIRCUIT PROTECTOR SHALL BE PROVIDED FOR MOTOR SHORT CIRCUIT PROTECTION.

**DISCONNECT SWITCHES (23054)**

- THIS CONTRACTOR SHALL FURNISH ALL SAFETY DISCONNECT SWITCHES (FUSED AND NON-FUSED) REQUIRED FOR EQUIPMENT. THIS CONTRACTOR SHALL FURNISH AND INSTALL THIS CONTRACTOR SHALL FURNISH A SAFETY DISCONNECT SWITCH FOR ALL MOTORS AND EQUIPMENT WHICH DO NOT HAVE COMBINATION STARTERS OR INTEGRAL DISCONNECTING MEANS. FUSIBLE DISCONNECT SWITCH SHALL BE PROVIDED FOR ALL EQUIPMENT RATED FOR USE ONLY WITH FUSES (SUCH AS CONDENSING UNITS, COMPRESSORS, ETC.). SUCH SWITCHES SHALL BE ONE, TWO OR THREE POLE TYPE, WITH SOLID NEUTRAL FOR 4 WIRE SERVICE, AND SHALL HAVE THE PROPER CURRENT AND VOLTAGE RATINGS AS REQUIRED. INSTALLATION OF ALL DISCONNECT SWITCHES SHALL BE BY THE ELECTRICAL CONTRACTOR.
- ALL SAFETY SWITCHES SHALL BE NEMA HEAVY DUTY TYPE AND SHALL CARRY THE UNDERWRITERS' LABORATORIES LABEL. FUSIBLE SWITCHES SHALL INCORPORATE CLASS "R" FUSE REJECTION FEATURE AND SHALL BE BRACED TO WITHSTAND 200,000 AMPERE RMS SYMMETRICAL FAULT CURRENT. SAFETY SWITCHES SHALL CONFORM TO FEDERAL SPECIFICATION W-8-865.
- PROVIDE HEAVY DUTY TYPE, SHEET ENCLOSED, SAFETY SWITCHES. THE TYPE, SIZE, AND RATING SHALL BE AS INDICATED ON THE DRAWINGS OR AS REQUIRED BY THE MOTOR OR EQUIPMENT SERVED. THE ENCLOSURE FOR DISCONNECT SWITCHES SHALL BE NEMA TYPE 1 FOR INDOOR USE, NEMA TYPE 4X FOR OUTDOOR USE AND NEMA TYPE 7 FOR EXPLOSION PROOF USE. DISCONNECTS SHALL BE MANUFACTURED BY ALLEN-BRADLEY, GENERAL ELECTRIC, CUTLER-HAMMER APPROVED EQUAL.
- SWITCHES SHALL INCORPORATE QUICK-MAKE, QUICK-BREAK OPERATING HANDLES. THE MECHANISM SHALL BE AN INTEGRAL PART OF THE BOX, NOT THE COVER, AND SWITCHES SHALL HAVE A COVER INTERLOCK TO PREVENT UNAUTHORIZED OPENING OF THE SWITCH DOOR IN THE ON POSITION OR CLOSING OF THE SWITCH MECHANISM WITH THE DOOR OPEN. CURRENT CARRYING PARTS SHALL BE CONSTRUCTED OF HIGH-CONDUCTIVITY COPPER WITH SILVER-TUNGSTEN TYPE SWITCH CONTACT.
- FUSE CLIPS SHALL BE POSITIVE PRESSURE TYPE REINFORCED FUSE CLIPS.
- THE ELECTRICAL CONTRACTOR SHALL FURNISH, INSTALL AND CONNECT ALL POWER WIRING TO ALL MECHANICAL CONTRACTOR FURNISHED EQUIPMENT. THE MECHANICAL CONTRACTOR SHALL FURNISH, INSTALL AND CONNECT ALL CONTROL WIRING TO ALL FURNISHED EQUIPMENT, INCLUDING CONTROL DEVICES, STARTERS AND INTEGRAL DISCONNECT SWITCHES OF CONTRACTOR FURNISHED EQUIPMENT.

**VARIABLE FREQUENCY DRIVES (230515)**

- PROVIDE VARIABLE FREQUENCY DRIVES (VFD) AS SPECIFIED HEREIN AND AS SHOWN ON THE CONTRACT DRAWINGS. BASIS OF DESIGN IS ABB MODEL ACH-550. THE ENCLOSURE FOR VFD SHALL BE NEMA TYPE 12 FOR INDOOR USE AND NEMA TYPE 3R FOR OUTDOOR USE. VFD SHALL PROVIDE MICROPROCESSOR-BASED CONTROL FOR THREE-PHASE INDUCTION MOTORS USING PULSE WIDTH MODULATED (PWM) DESIGN, WHICH CONVERTS THE UTILITY INPUT VOLTAGE AND FREQUENCY TO A VARIABLE VOLTAGE AND FREQUENCY OUTPUT VIA A TWO-STEP OPERATION. VFD SHALL HAVE AN EFFICIENCY AT FULL LOAD AND SPEED THAT EXCEEDS 97%. THE EFFICIENCY SHALL EXCEED 90% AT 50% SPEED.
  - VFD SHALL MAINTAIN A MINIMUM LINE SIDE DISPLACEMENT POWER FACTOR OF 0.96, REGARDLESS OF SPEED AND LOAD FOR VFD'S LESS THAN 75 HP. VFD SHALL MAINTAIN A MINIMUM LINE SIDE DISPLACEMENT POWER FACTOR OF .98, REGARDLESS OF SPEED AND LOAD FOR MOTORS GREATER THAN 75 HP. THE VFD'S SHALL HAVE A ONE (1) MINUTE OVERLOAD CURRENT RATING OF 110% FOR LOW OVERLOAD APPLICATIONS. VFD SHALL HAVE AN INTEGRAL EMERGENCY FILTER AND CIRCUIT BREAKER AS STANDARD. THE CURRENT WITHSTAND RATING OF THE OPEN VFD SHALL BE 65,000 ACI.
- COMMUNICATION CAPABILITY OPTIONS SHALL INCLUDE MODBUS RTU, JOHNSON CONTROLS METASYS N2, BACNET MS/TP, BACNET/IP, MODBUS/TCP AND EXPANSION CARD COMMUNICATIONS SHALL INCLUDE LONWORKS. THE EXACT PROTOCOL, NEEDS IS THAT WHICH WILL COMMUNICATE WITH THE BAS COMMUNICATION SYSTEM PROVIDED.
- VFD SHALL HAVE A COOLING FAN(S) THAT IS FIELD REPLACEABLE.
- VFD SHALL INCLUDE THE FOLLOWING PROTECTIVE FEATURES: OVERCURRENT, OVERVOLTAGE, SYSTEM FAULT, UNDER VOLTAGE, INPUT LINE SUPERVISION, OUTPUT PHASE SUPERVISION, UNDER TEMPERATURE, OVER TEMPERATURE, MOTOR STALLED, MOTOR OVER TEMPERATURE AND MOTOR UNDER LOAD. VFD SHALL PROVIDE GROUND FAULT PROTECTION DURING POWER-UP, STARTING, AND RUNNING.
- WARRANTY SHALL BE TWENTY-FOUR (24) MONTHS FROM CERTIFIED START-UP DATE. THIS WARRANTY DURATION INCLUDES START-UP BY AN AUTHORIZED SERVICE REPRESENTATIVE AND PARTS, LABOR AND TRAVEL TIME.

**CHECK, TEST, START, ADJUST, BALANCE AND INSTRUCTIONS (230593)**

- AFTER INSTALLATION, CHECK ALL EQUIPMENT, AND PERFORM START UP IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.
- ALL PIPING SHALL BE TESTED AND FREE OF LEAKS.
- CONCEALED OR INSULATED WORK SHALL REMAIN UNCOVERED UNTIL REQUIRED TESTS HAVE BEEN COMPLETED, BUT IF CONSTRUCTION SCHEDULE REQUIRES IT, ARRANGE FOR PRIOR TESTS ON PARTS OF SYSTEM AS APPROVED BY THE TENANT.
- BALANCE ALL SYSTEMS, CALIBRATE CONTROLS, CHECK FOR PROPER OPERATION AND SEQUENCE UNDER ALL CONDITIONS AND MAKE ALL NECESSARY ADJUSTMENTS.
- AFTER INSTALLATION AND EQUIPMENT IS PLACED IN OPERATION, HVAC CONTRACTOR IS RESPONSIBLE FOR BALANCING SYSTEMS. BALANCING SHALL BE PERFORMED BY AN INDEPENDENT AABC CERTIFIED CONTRACTOR.
- ADJUST AND BALANCE THE AIR SYSTEMS BEFORE HYDRONIC, AND REFRIGERANT SYSTEMS. TESTING AND BALANCING SHALL BE DONE IN ACCORDANCE WITH THE MOST RECENT AABC NATIONAL STANDARDS FOR TOTAL SYSTEM BALANCE. GPM'S SHALL BE BALANCED WITHIN 10% OF DESIGN. AFTER ALL AIR SYSTEMS ARE INSTALLED, EACH SUPPLY AIR OUTLET SHALL BE AIR BALANCED TO WITHIN 10% OF THE CFM SHOWN WITH AIR PATTERNS SET AS INDICATED ON DRAWINGS (OR WITHIN 10 CFM WHEN BELOW 100 CFM). FAN RPM'S AND ZONE DAMPERS SHALL BE ADJUSTED AND SHEAVES SHALL BE REPLACED AS REQUIRED TO ACHIEVE AIR BALANCE. ALL ZONES OR PORTIONS THEREOF SERVING OTHER SPACES AND WHICH MAY BE AFFECTED BY THE PROJECT SHALL BE TRAVERSED PRIOR TO CONSTRUCTION. THE FINAL AIR BALANCE SHALL RESTORE THESE AIR QUANTITIES. BEFORE AND AFTER AIR QUANTITIES SHALL BE LISTED IN THE AIR BALANCE REPORT.
- SHOULD THE AIR BALANCE REPORT INDICATE UNACCEPTABLE DUCT LEAKAGE, AS DETERMINED BY THE ENGINEER, THEN DUCT LEAKAGE TEST SHALL BE PERFORMED IN ACCORDANCE WITH AABC STANDARDS. DUCT SHALL BE RESEALED AND/OR REPAIRED AS REQUIRED TO MEET DESIGN REQUIREMENTS. ALL, OR PORTIONS OF THE SYSTEM SHALL BE REBALANCED AS REQUIRED UNTIL ALL SYSTEMS ARE WITHIN THE PERFORMANCE STANDARDS LISTED ABOVE.
- CLEAN ALL MECHANICAL EQUIPMENT AND DUCTWORK OF ALL CONSTRUCTION DUST AT PROJECT COMPLETION. REPLACE ALL FILTERS PRIOR TO AIR BALANCING. PROVIDE ONE SPARE SET OF FILTERS FOR EACH PIECE OF EQUIPMENT TO THE OWNER.
- START UP AND PLACE ALL SYSTEMS IN OPERATION AND TAG ALL SWITCHES AND CONTROLS WITH PERMANENT LABELS.
- PROVIDE OWNER TRAINING AND DEMONSTRATION OF ALL MECHANICAL SYSTEMS AND EQUIPMENT. INSTRUCT OWNER ON PROPER OPERATION AND PREVENTATIVE MAINTENANCE OF SYSTEM. SUBMIT OPERATING AND MAINTENANCE MANUAL ON ALL EQUIPMENT AND SYSTEMS.
- AIR QUALITY TESTING SHALL BE PERFORMED BY AN AABC CERTIFIED CONTRACTOR, THIS CONTRACTOR SHALL BE ACCEPTABLE UPON APPROVAL OF THE ENGINEER. CONDUCT BASELINE INDOOR AIR QUALITY TESTING AFTER CONSTRUCTION ENDS AND BEFORE OCCUPANCY. TESTING PROCEDURES SHALL BE PER THE U.S. E.P.A. COMPENDIUM OF METHODS FOR THE DETERMINATION OF AIR POLLUTANTS IN INDOOR AIR AND AS DETAILED BY THE U.S.E.P.A. IN THE LEADING REFERENCE GUIDE. CONTRACTOR SHALL DEMONSTRATE THAT THE CONTAMINANT MAXIMUM CONCENTRATIONS LISTED UNDER EQ CREDIT 3.2 IN THE LEED REFERENCE GUIDE ARE NOT EXCEEDED. CONTRACTOR SHALL INCLUDE ONE ADDITIONAL SAMPLING / RE-TESTING OF EACH BUILDING AREA IN HIS BID


DRAWING SET: 90% Submission  
RELEASE DATE: 12/29/2024

PRINTED OR ELECTRONIC DRAWINGS AND DOCUMENTATION MAY NOT BE REPRODUCED IN ANY MANNER WITHOUT WRITTEN PERMISSION FROM FIRST AMERICAN. ALL RIGHTS RESERVED.



CHABAD OF WILMINGTON - SHUL JEWISH COMMUNITY CENTER  
2317 Market Street  
Wilmington, North Carolina 28403  
PROJECT NO. 23-14


KERSTING ARCHITECTURE  
4022 MARKET STREET SUITE 201 - WILMINGTON, NC 28403 - (910) 762-1348

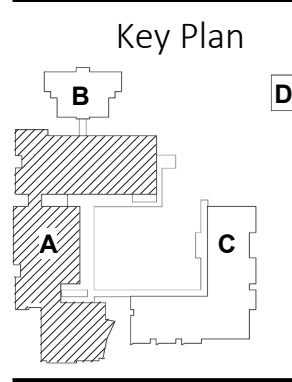

MECHANICAL SPECIFICATIONS

M-002-A



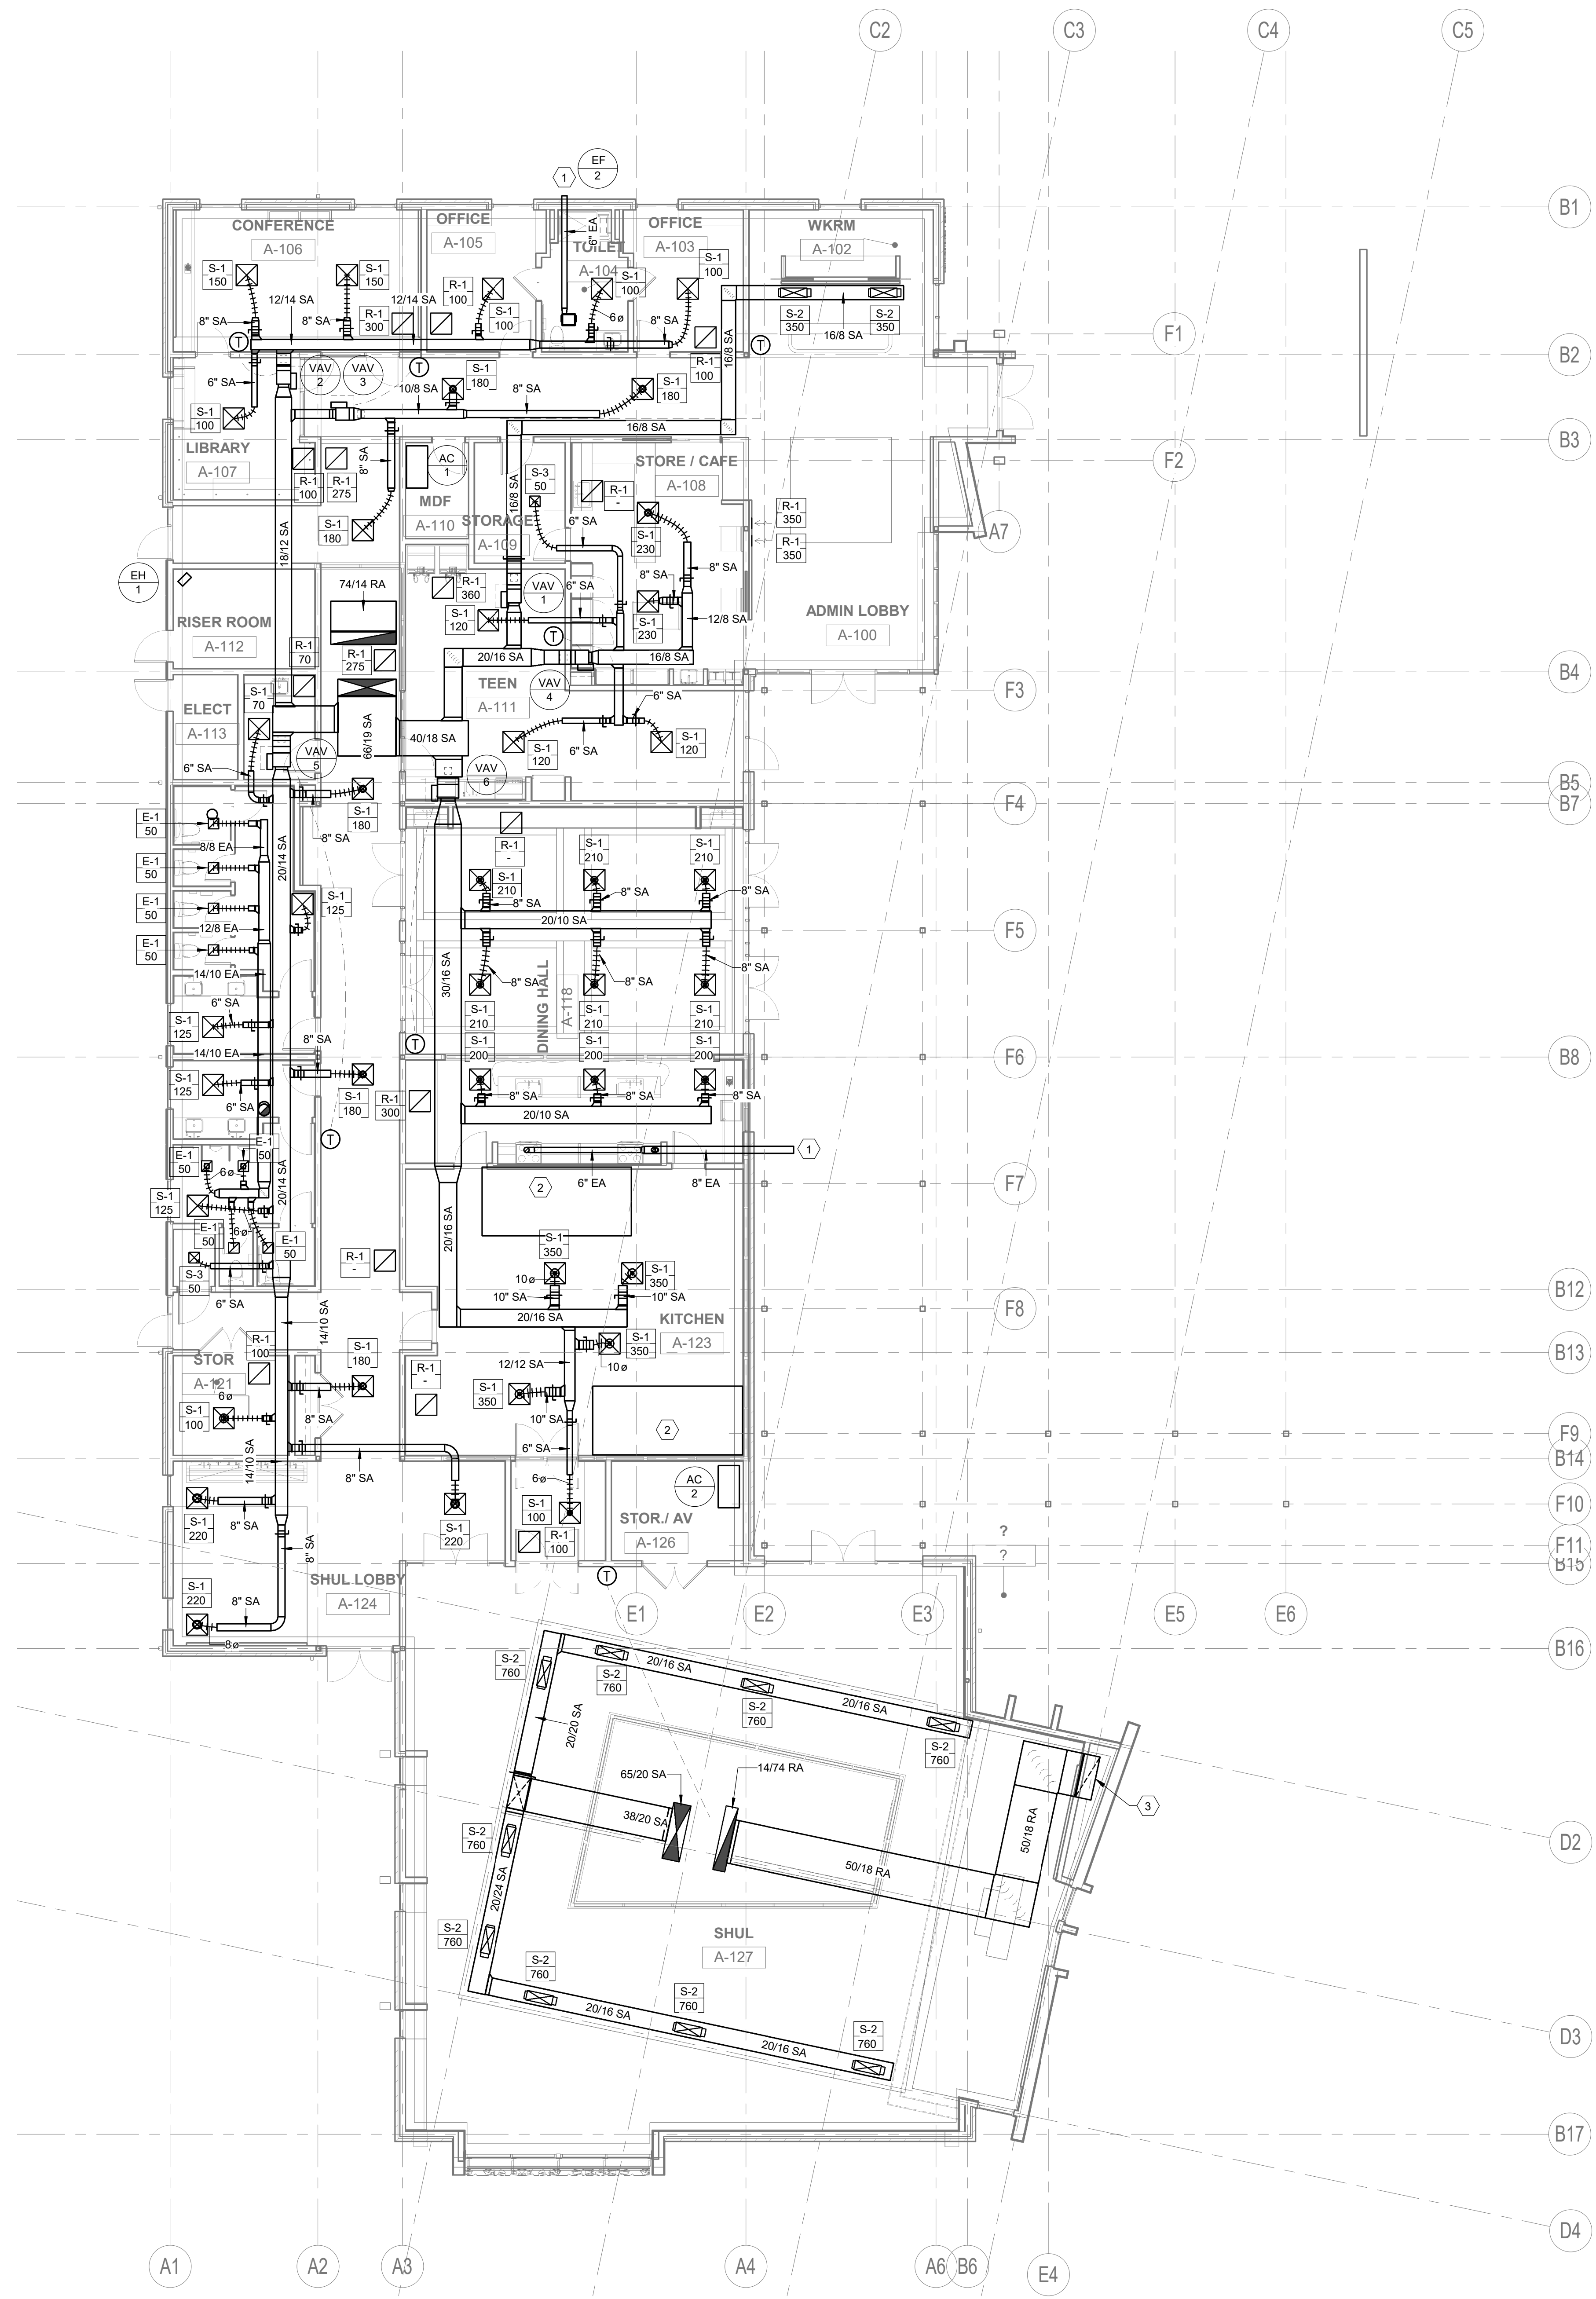


- MECHANICAL GENERAL NOTES:**
- CONTRACTOR TO COORDINATE WITH OTHER TRADES PRIOR TO ROUGH IN. CONTRACTOR SHALL ENSURE THAT PROPER CONSTRUCTION SEQUENCING IS ACCOMPLISHED TO AVOID REWORK THAT WOULD OCCUR TO INSTALL MECHANICAL SYSTEMS.
- MECHANICAL KEY NOTES:**
- PROVIDE ALUMINUM WALL CAP (W-1) WITH BACKDRAFT DAMPER FOR EXHAUST DUCT.
  - KITCHEN EQUIPMENT AND EXHAUST HOODS BY OTHERS.
  - PROVIDE 50"x18" OPENING IN DECORATION WALL FOR RETURN AIR.

DRAWING SET: 90% Submission  
 RELEASE DATE: 12/20/2024

PRINTED OR ELECTRONIC DRAWINGS AND DOCUMENTATION MAY NOT BE REPRODUCED IN ANY FORM WITHOUT WRITTEN PERMISSION FROM KERSTING ARCHITECTURE, INC.  
 COPYRIGHT 2022. ALL RIGHTS RESERVED.




**CHABAD OF WILMINGTON - SHUL**  
 JEWISH COMMUNITY CENTER  
 2317 Market Street  
 Wilmington, North Carolina 28403  
 PROJECT NO. 13-14

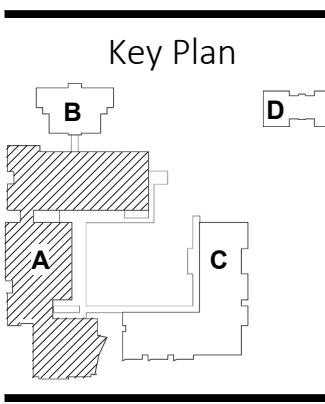

LEVEL 1 MECHANICAL PLAN

M-101-A

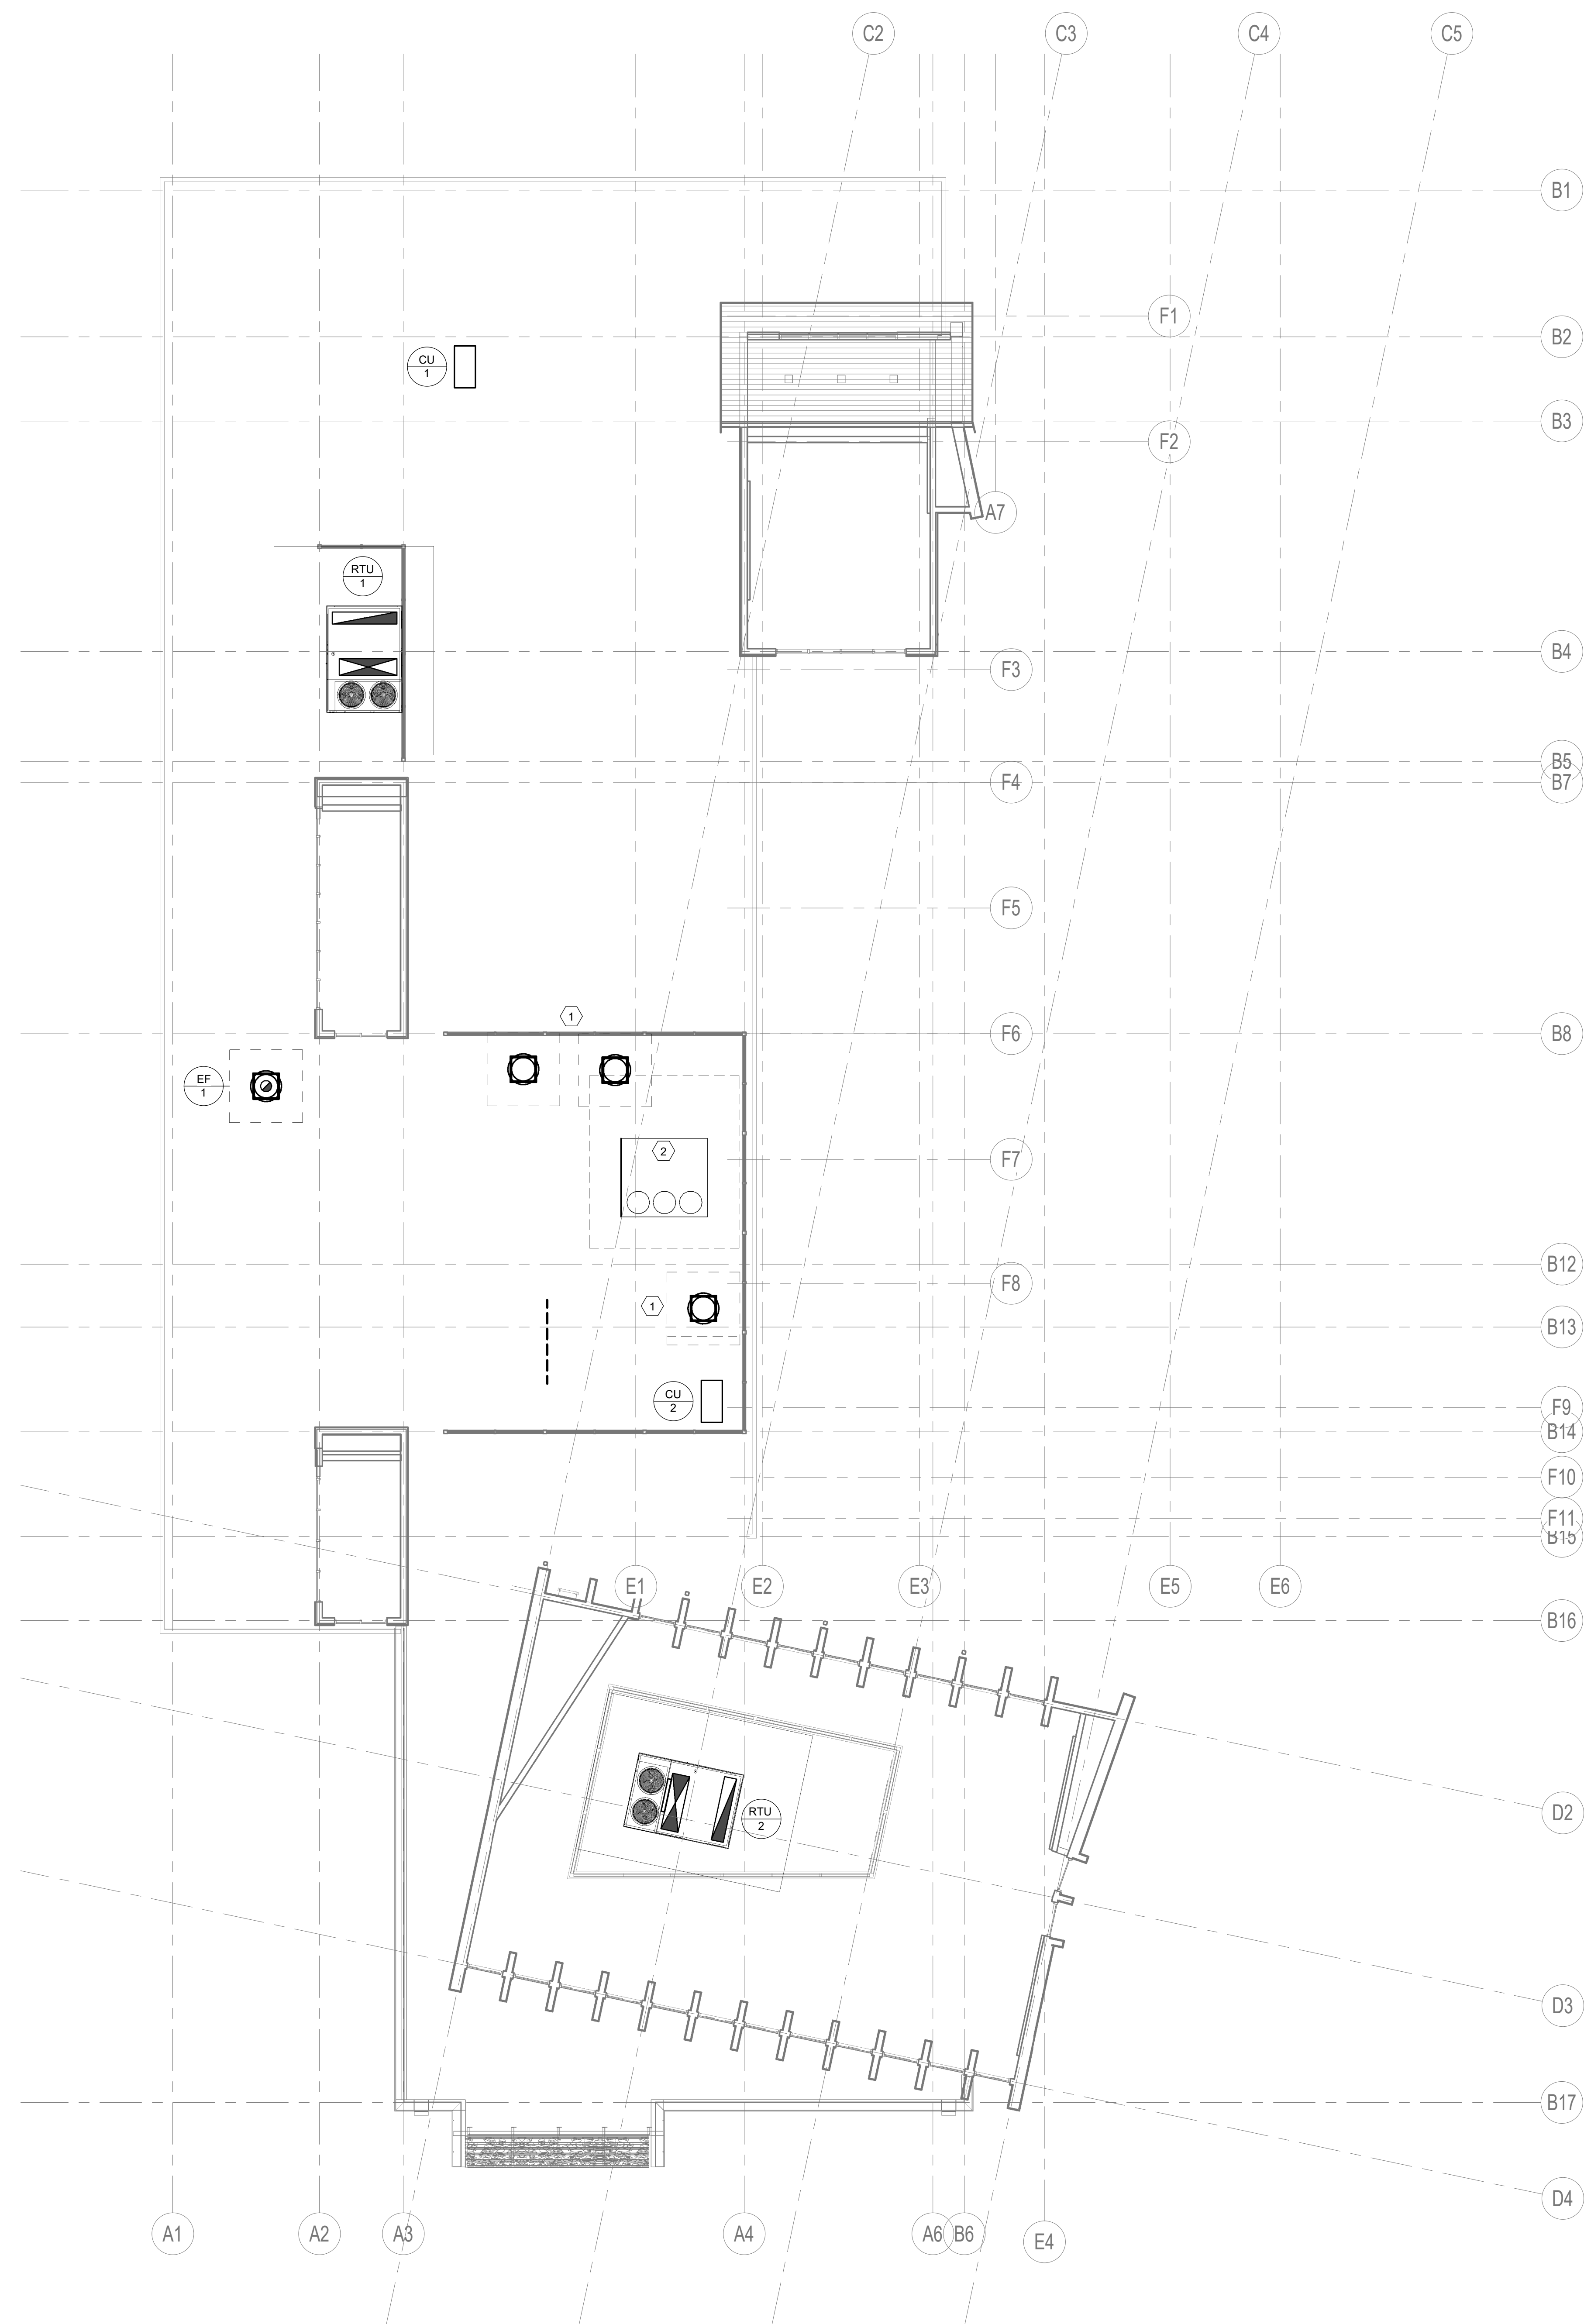

**MECHANICAL GENERAL NOTES:**

1. CONTRACTOR TO COORDINATE WITH OTHER TRADES PRIOR TO ROUGH IN. CONTRACTOR SHALL ENSURE THAT PROPER CONSTRUCTION SEQUENCING IS ACCOMPLISHED TO AVOID REWORK THAT WOULD OCCUR TO INSTALL MECHANICAL SYSTEMS.

**MECHANICAL KEY NOTES: (#)**

1. KITCHEN EQUIPMENT AND EXHAUST FAN BY OTHERS.
2. KITCHEN EQUIPMENT AND DOAS UNIT BY OTHERS.


DRAWING SET: 90% Submission  
 RELEASE DATE: 12/29/2024

PRINTED OR ELECTRONIC DRAWINGS AND DOCUMENTATION MAY NOT BE REPRODUCED IN ANY FORM WITHOUT WRITTEN PERMISSION FROM KERSTING ARCHITECTURE, INC.  
 COPYRIGHT 2022. ALL RIGHTS RESERVED.

**Allen + Shariff**  
 MEP Engineering  
 Project Management  
 205 East Market Street  
 Salisbury, Maryland 21801  
 443.545.1300


**CHABAD OF WILMINGTON - SHUL**  
 JEWISH COMMUNITY CENTER  
 2317 Market Street  
 Wilmington, North Carolina 28403  
 PROJECT NO. 21-14

**KERSTING ARCHITECTURE**  
 4022 MARKET STREET SUITE 201 - WILMINGTON, NC 28403 - (910) 763-1348

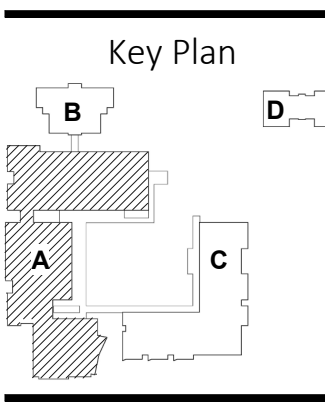


ROOF MECHANICAL PLAN


M-102-A

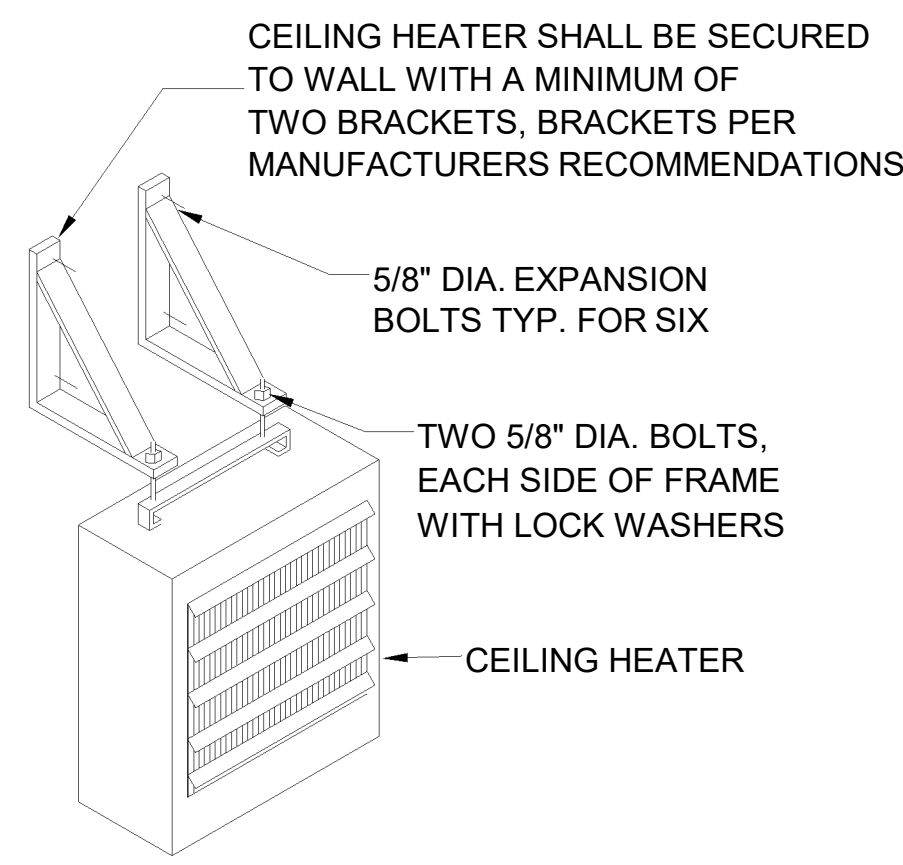





1 M-ELECTRIC CEILING HEATER DETAIL  
M-201-A

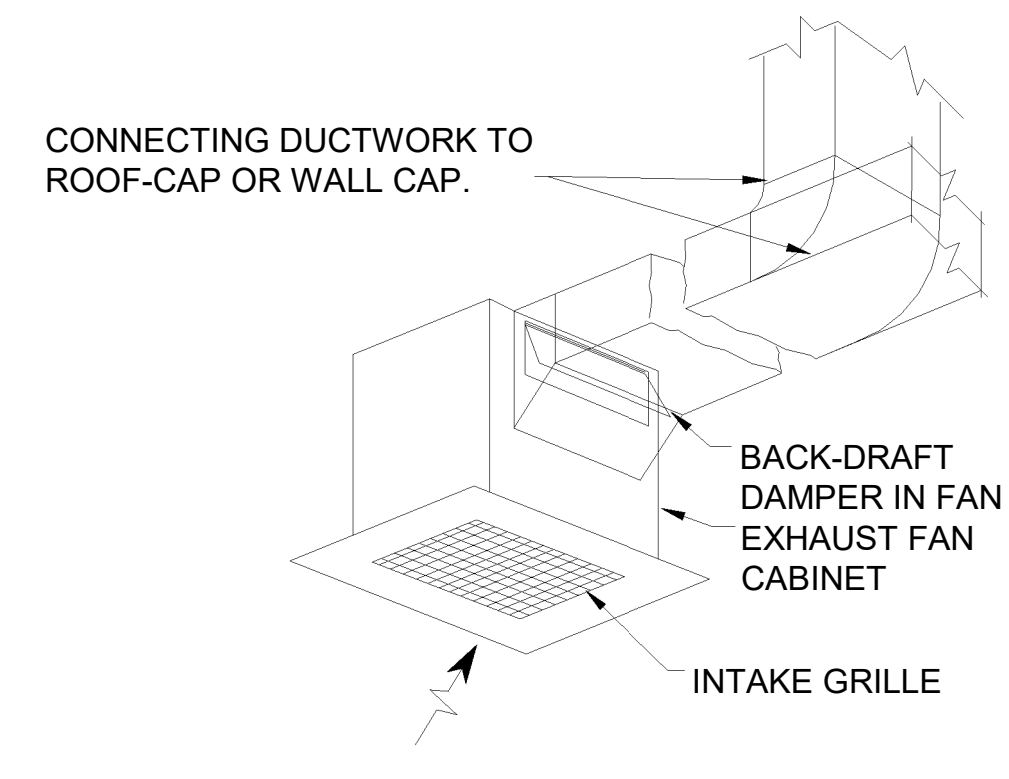


2 M - CEILING FAN EXHAUST  
M-201-A

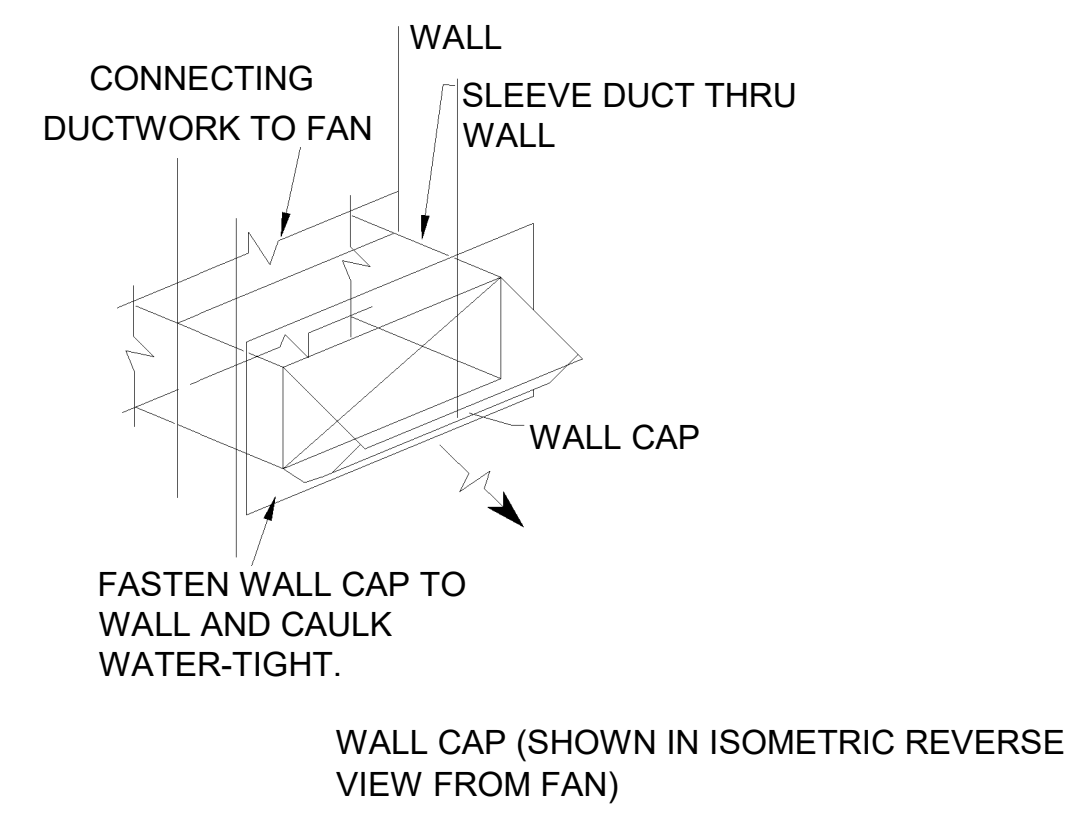


3 TRANSFER DUCT DETAIL  
M-201-A

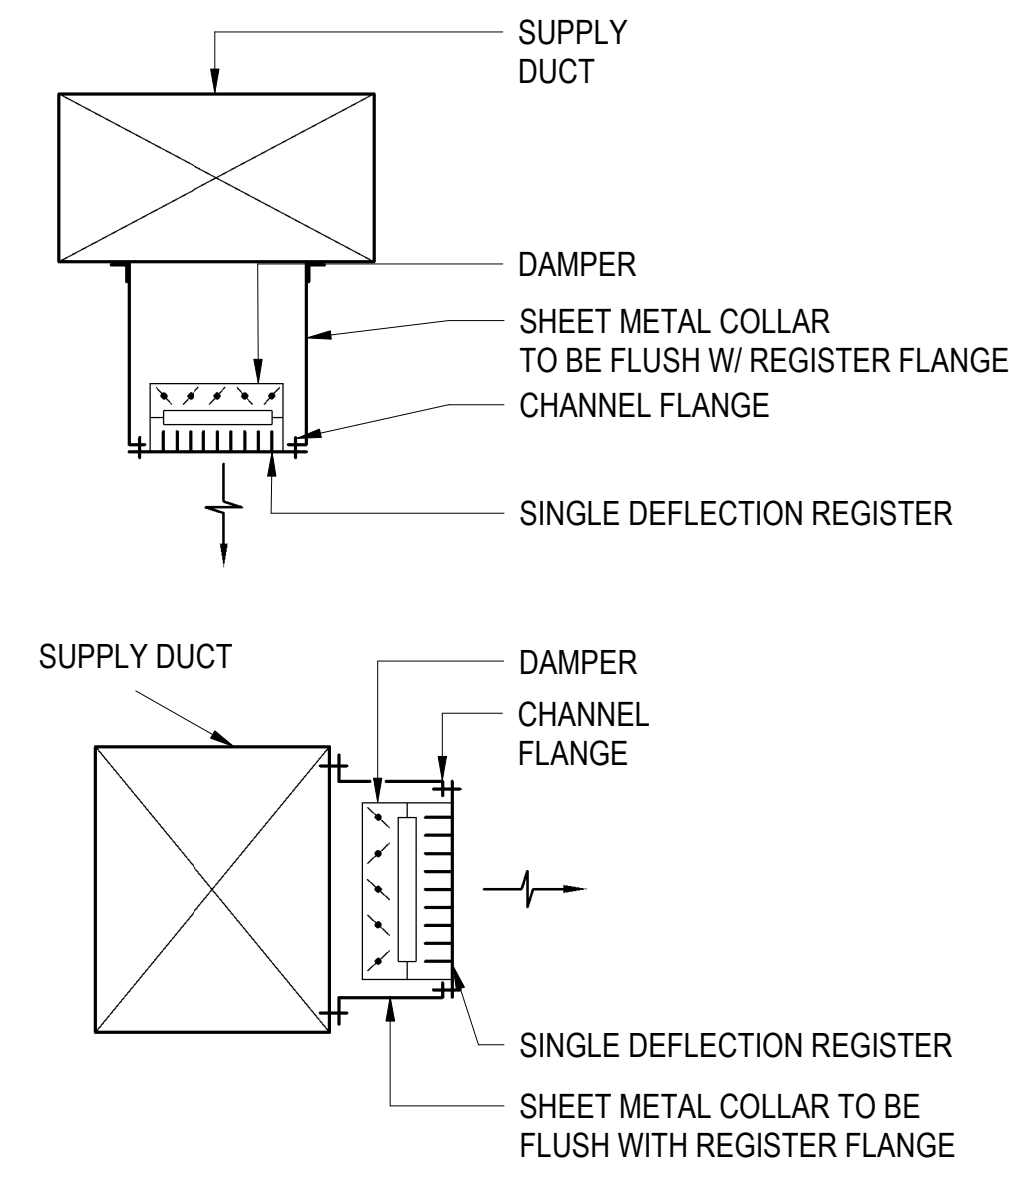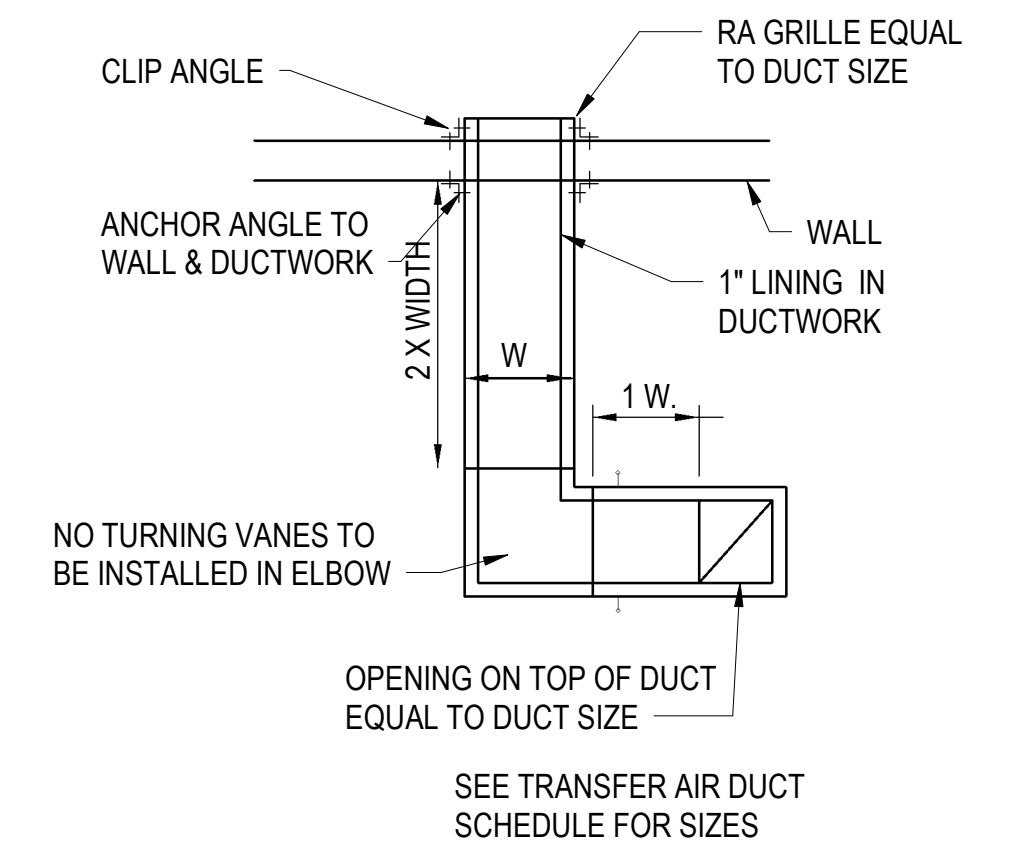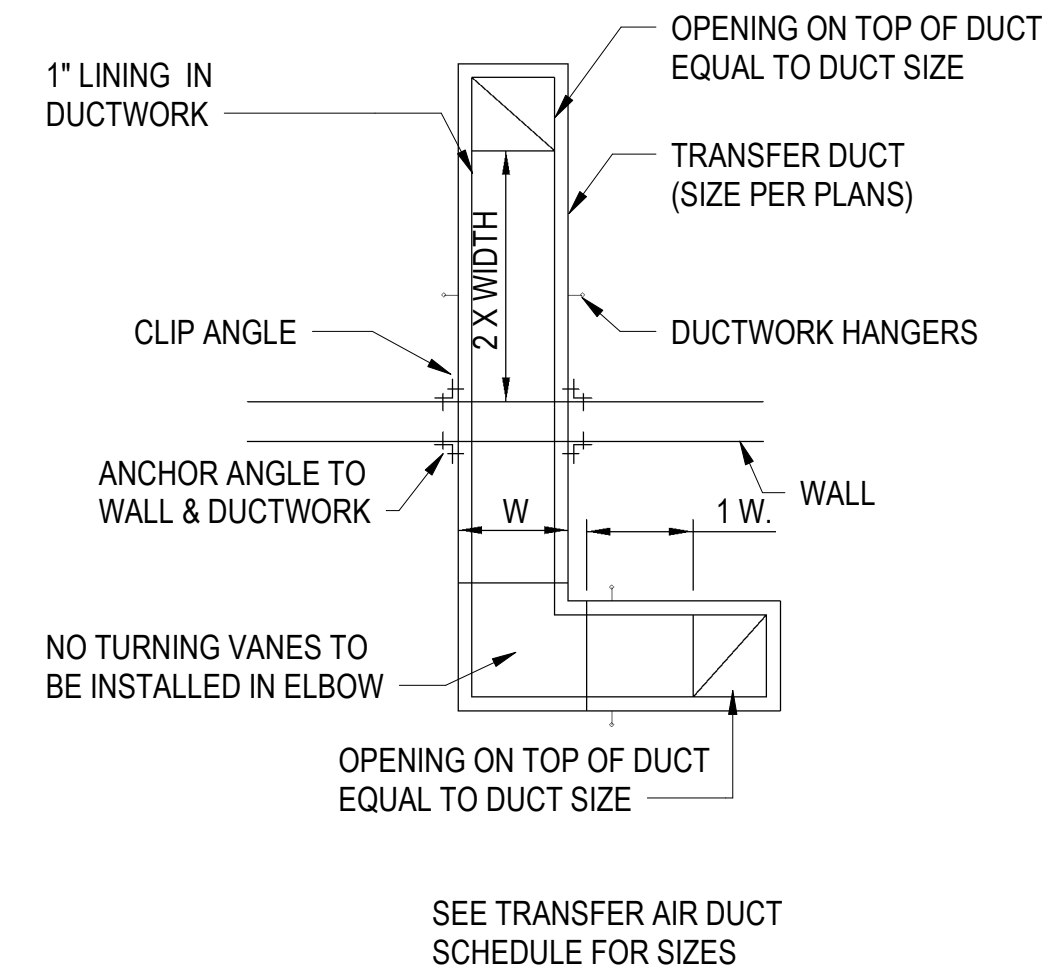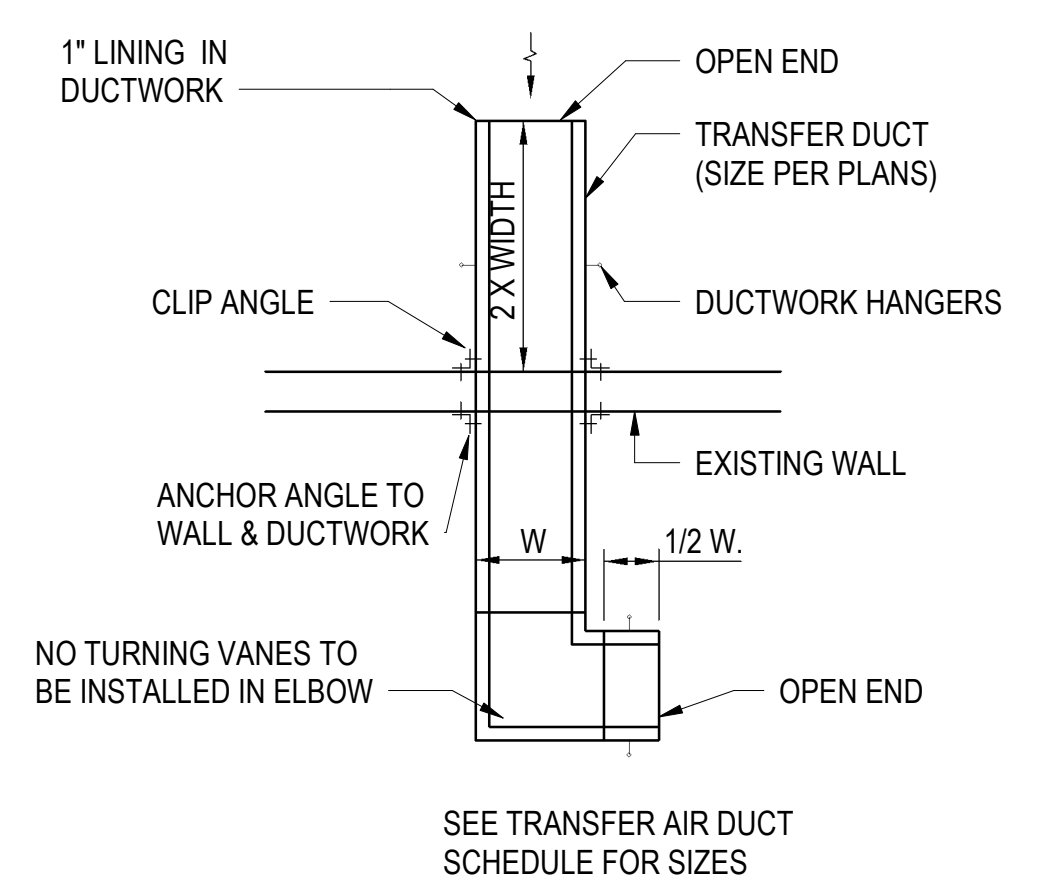

4 SUPPLY REGISTER DETAIL  
M-201-A

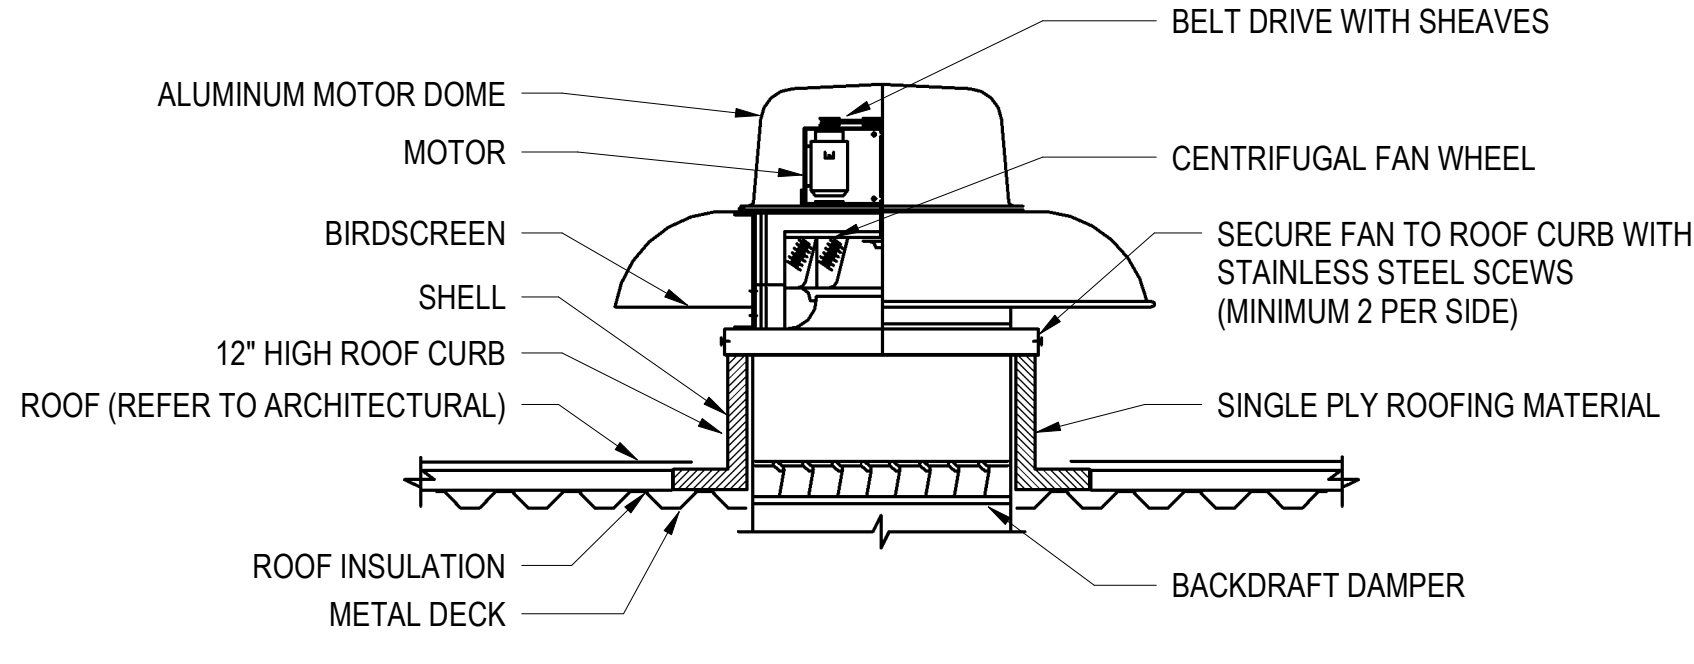


5 ROOF MOUNTED EXHAUST FAN DETAIL  
M-201-A

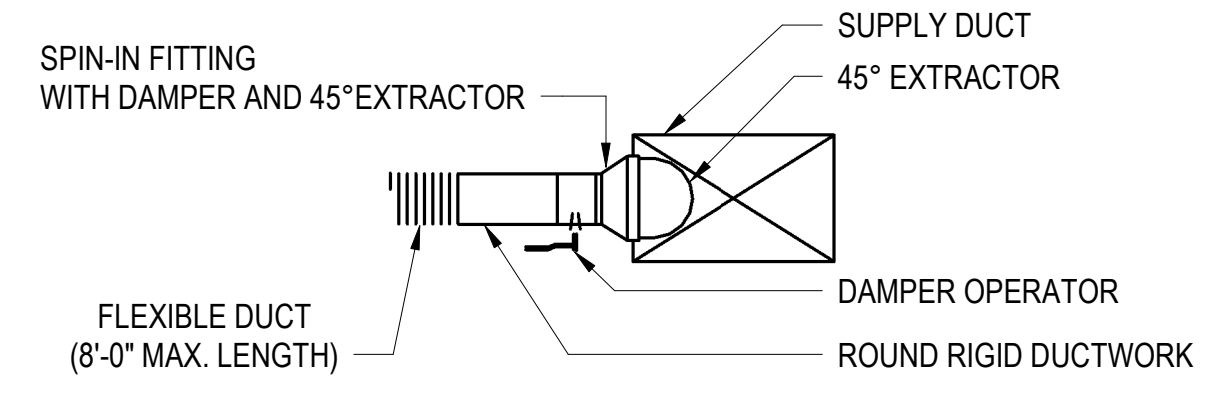


NOTES:  
1. USE SPIN-IN FITTING WHERE TAP SIZE IS 2\"/>

6 SPIN-IN FITTING DETAIL  
M-201-A

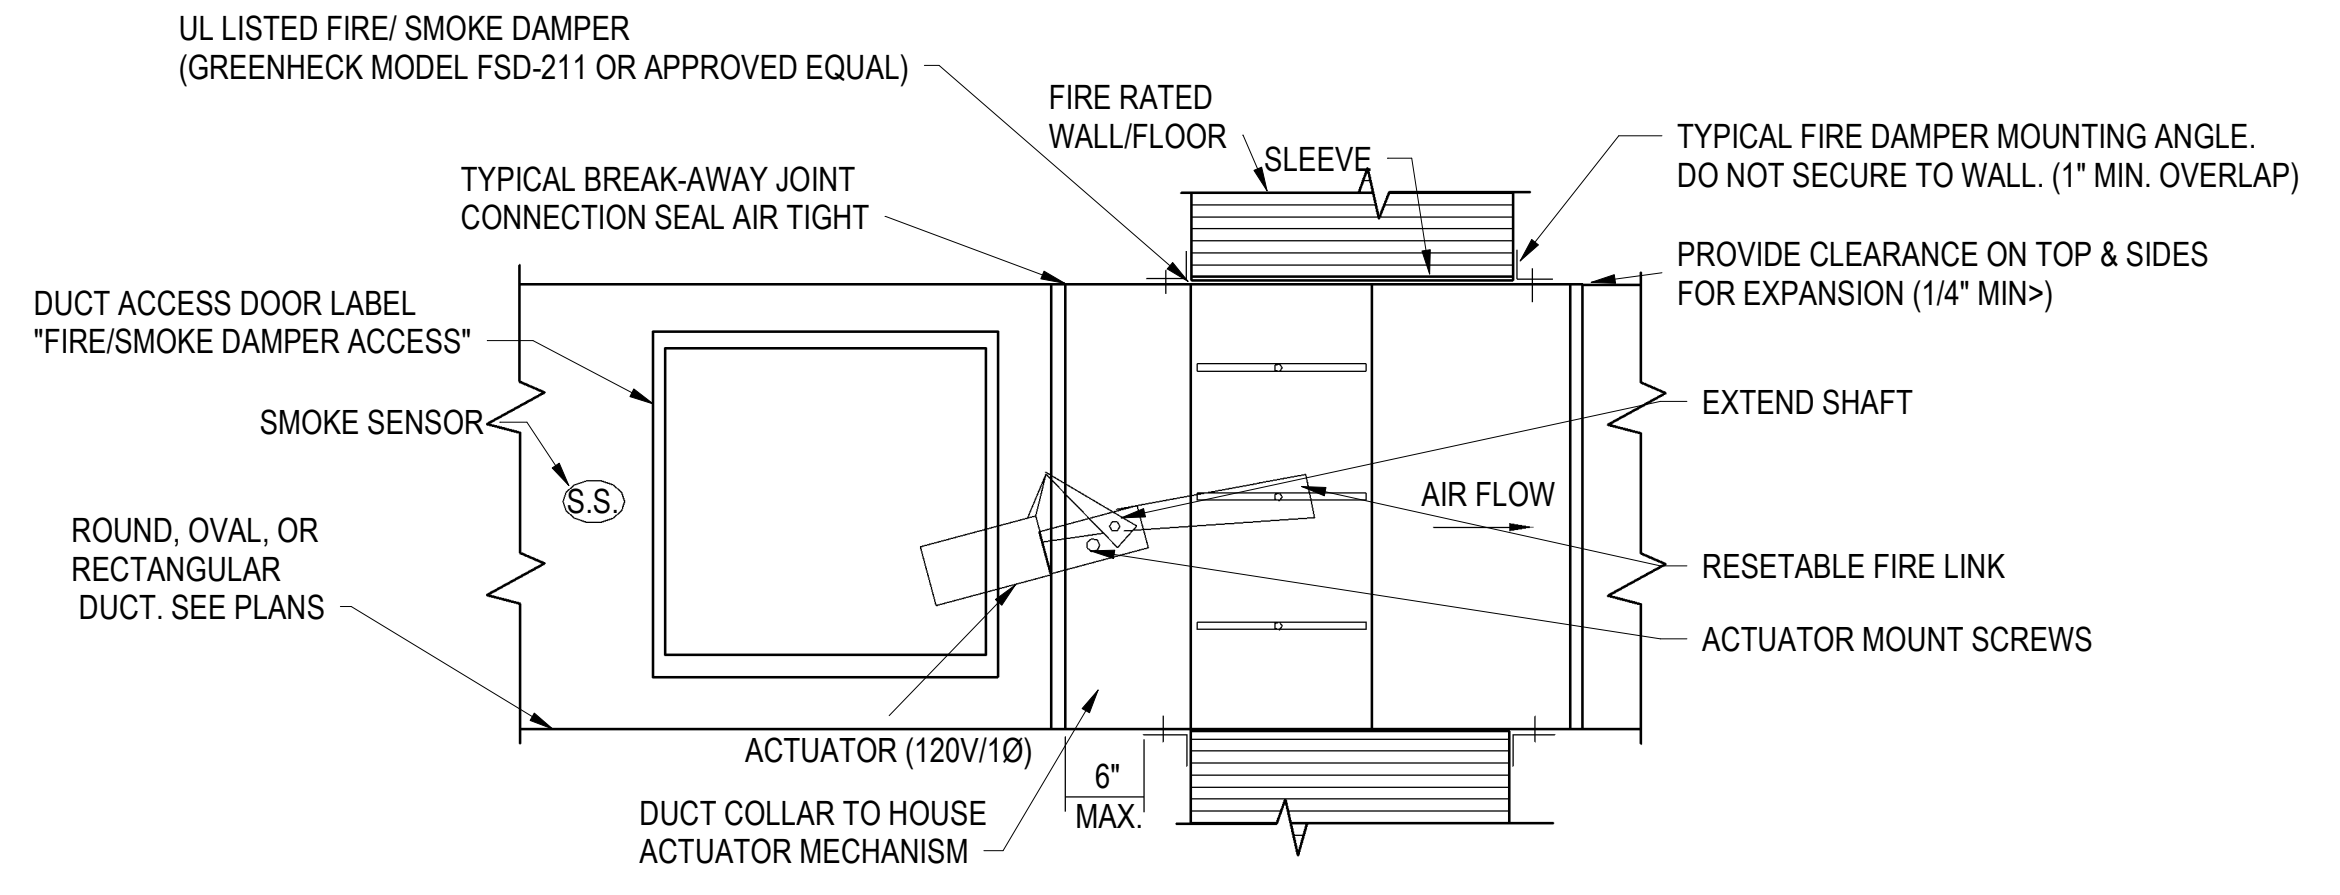

NOTES:  
1. INSTALL DAMPER WHERE VERTICAL FD/SD IS SHOWN DWGS.  
2. INSTALL PER NFPA AND LOCAL CODES.  
3. EXTERNAL DUCT INSULATION SHALL STOP AT WALL.  
4. INFILL ANY WALL/CEILING VOID OPENING AROUND FRAMES WITH SUITABLE MATERIAL TO MAINTAIN FIRE RATING.  
5. PROVIDE WITH OPEN OR CLOSED INDICATOR.

7 FIRE SMOKE DAMPER DETAIL  
M-201-A

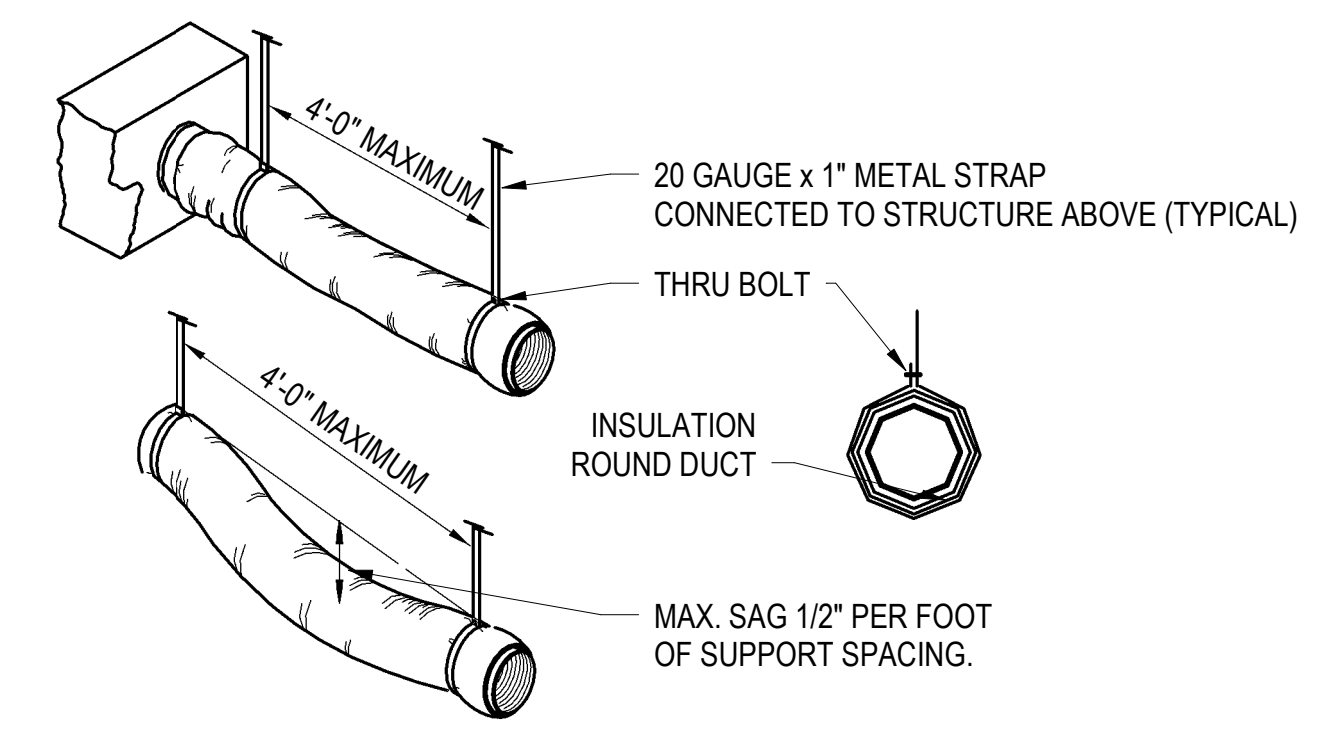

NOTES:  
1. FLEXIBLE DUCT SHOULD EXTEND STRAIGHT FOR SEVERAL INCHES FROM RECTANGULAR DUCT CONNECTION BEFORE BENDING.  
2. FLEXIBLE DUCT SHOULD NOT EXCEED 6'-0\"/>


8 FLEXIBLE DUCT RUN-OUT SUPPORT DETAIL  
M-201-A

DRAWING SET: 90% Submission  
RELEASE DATE: 12/20/2024

Allen + Shariff  
MEP Engineering  
Project Management  
205 East Market Street  
Salisbury, Maryland 21801  
443.545.1300

CHABAD OF WILMINGTON - SHUL  
JEWISH COMMUNITY CENTER  
2317 Market Street  
Wilmington, North Carolina 28403  
PROJECT NO. 21-16

KERSTING ARCHITECTURE  
4022 MARKET STREET SUITE 201 - WILMINGTON, NC 28403 - (910) 762-1348

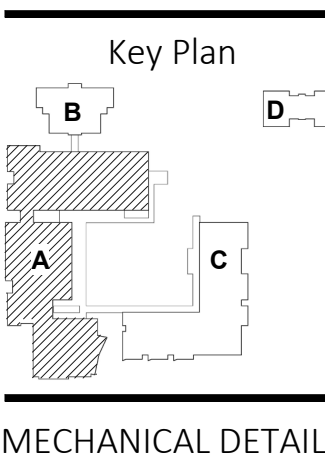

MECHANICAL DETAILS

M-201-A

EXHAUST FAN SCHEDULE									
TAG	SERVES	TYPE	MANUFACTURE	MODEL	AIR QUANTITY (CFM)	TOTAL S.P. (IN W.C.)	MIN MOTOR SIZE (HP)	VOLTAGE/ PH	REMARKS
EF-1	WOMEN'S, MEN'S RESTROOM	ROOF DOWNBLAST	GREENHECK	G-103HP	770	1.5	1/2	208V/1	1,2,3,4
EF-2	TOILET ROOM	CEILING CABINET	GREENHECK	SP-B90	70	0.2	20W	120V/1	1,2,3

- REMARKS:
1. PROVIDE INLET SCREEN.
  2. PROVIDE BACKDRAFT DAMPER.
  3. PROVIDE DISCONNECT SWITCH.
  4. PROVIDE ROOF CURB.

ELECTRIC HEATER SCHEDULE										
TAG	MANUFACTURER	MODEL	DESCRIPTION	KW	VOLT AGE	PHASE	AMPS	MOCP	THERMOSTAT	LOCATION
EH-1	QMARK	CWH3150F	CEILING HEATER	1.5	120	1	12.5	20	INTEGRAL	RISER ROOM

SYSTEM	SYSTEM- LOCATION	OPERATING TEMPERATURE	MATERIAL	SMACNA CLASS					REMARKS
				TYPE	THICKNESS IN S	DENSITY LB/CU. FT.	INSTALLED "R" VALUE/ CONDUCTIVITY	JACKET	
DUCT	SUPPLY AIR DUCT - INDOOR CONCEALED, ACCESSIBLE	40-120	MINERAL-FIBER	BLANKET	2.0"	0.75	6.0	FSK	1, 4
DUCT	SUPPLY AIR DUCT - INDOOR CONCEALED, INACCESSIBLE	40-120	MINERAL-FIBER	BOARD	1.5"	2.25	6.5	FSK	2
DUCT	SUPPLY / RETURN AIR DUCT - ACOUSTICAL LINER	40-120	MINERAL-FIBER	LINER	1.5"	2.25	6.0	N/A	4
DUCT	SUPPLY AIR DUCT - INDOOR EXPOSED	40-120	MINERAL-FIBER	LINER	1.5"	2.25	6.0	N/A	1, 4
DUCT	SUPPLY, RETURN, RELIEF, EXHAUST DUCT - OUTDOORS AND UNCONDITIONED	40-120	*	*	*	*	12	FSK	4
DUCT	EXHAUST DUCT WITHIN 10 FEET OF EXTERIOR OPENING - INDOOR	40-120	MINERAL-FIBER	BOARD	1.0"	2.25	4.3	FSK	

- NOTES:
- GENERAL:
- ALL DUCTWORK SHALL BE ACOUSTICALLY LINED UPSTREAM OF THE CONCERT VENUE. THE DUCTWORK SHALL ALSO BE SUBJECT TO THE PROPER INSULATION VALUES AS DICTATED IN THE THERMAL INSULATION SCHEDULE. ALL BRANCH DUCTWORK THAT SERVES ACOUSTICALLY SENSITIVE AREAS SHALL BE ACOUSTICALLY LINED. ALL DUCTWORK BRANCH LINES THAT SHARE A MAIN WITH A BRANCH LINE SERVING AN ACOUSTICALLY SENSITIVE AREA SHALL BE ACOUSTICALLY LINED FOR 25 ODDS IN THE DIRECTION OF THE ACOUSTICALLY SENSITIVE AREA TO PREVENT SOUND TRANSFER FROM ONE SPACE TO THE OTHER.
1. CONCEALED, ACCESSIBLE LOCATIONS - ABOVE LAY-IN OR ACCESSIBLE CEILINGS, ACCESSIBLE MECHANICAL SHAFTS.
  2. CONCEALED, INACCESSIBLE LOCATIONS - ABOVE HARD CEILINGS, (DRY WALL, PLASTER), MECHANICAL SHAFTS, BEHIND WALLS.
  3. DO NOT INSULATE:
    - MAKE-UP AIR DUCTWORK OPERATING AT SURROUNDING AMBIENT CONDITIONS
    - RETURN AND EXHAUST AIR DUCTWORK LOCATED INDOORS.
    - TRANSFER AIR DUCTWORK (ACOUSTICALLY LINED DUCT)
    - EXPOSED SUPPLY DUCTWORK LOCATED IN CONDITIONED SPACE. (DOES NOT INCLUDE RETURN AIR PLENUM)
  4. MULTIPLE INSULATION METHODS MAY BE USED TO ACHIEVE THE TOTAL REQUIRED R-VALUE.

SYSTEM	LOCATION IN DUCT SYSTEM	MATERIAL	SMACNA CLASS				DUCT TEST PRESS. IN S W.C.	REMARKS
			STATIC PRESSURE IN S W.C.	SEAL CLASS	LEAKAGE CLASS (RECT./ROUND)	POS. or NEG.		
RTU-	SUPPLY AIR DUCT	GALVANIZED STEEL	1"	B	24/12	POS.	1	
RTU-	RETURN AIR DUCT	GALVANIZED STEEL	1"	B	24/12	NEG.	1	
EF-	GENERAL EXHAUST DUCT OVER 46" RUN	GALVANIZED STEEL	2"	A	12/6	NEG.	2	
EF-	GENERAL EXHAUST DUCT RUNS UNDER 45" RUN	GALVANIZED STEEL	1"	B	24/12	NEG.	1	
EF-	GENERAL EXHAUST DUCT RUNS UNDER 10" RUN	GALVANIZED STEEL	1/2"	C	24/12	NEG.	1	
ALL	KITCHEN CANOPY HOOD EXHAUST	304 STAINLESS STEEL	2"	LIQUID TIGHT	6	NEG.	2	

- NOTES:
1. CONSTRUCT PER NFPA 96 STANDARDS FOR KITCHEN EXHAUST. PROVIDE WATERPROOF JOINTS FOR DISHWASHER EXHAUST. MAKE DISHWASHER EXHAUST WITH THREE SIDED DUCT WITH LONGITUDINAL JOINTS LOCATED ON TOP. SLOPE DUCT TO DRAIN WATER BACK TO DISHWASHER. SEAL JOINTS WATER TIGHT WITH WATER-PROOF MASTIC.
  2. CONSTRUCT WITH CHEMICAL RESISTANT JOINTS SEALED WITH EITHER SILICONE SEALER OR USE FLANGED JOINTS WITH NEOPRENE GASKETS WITH LONGITUDINAL JOINTS SEALED WITH SILICONE SEALER. SEAL JOINTS LIQUID TIGHT.

TAG	NOM. TONS	MIN. O/A CFM	SUPPLY FAN DATA				EER	DX COOLING COIL DATA				HEATING CAPACITY			AIR FILTER		ELECTRICAL DATA			W.T. (LBS)	BASIS OF DESIGN /MODEL	REMARKS		
			CFM	E.S.P. IN. WG	RPM	HP		E.A.T. DB/WB	L.A.T. DB/WB	TOTAL MBH	SENS. MBH	REFGT. TYPE	HEAT TYPE	STG.S	INPUT MBH	OUTPUT MBH	MERV RATING	DEPTH	VOLTS/ PH				MCA	MOP
RTU-1	25.0	1630	8100	1.5	1589	4.6	9.8	80.6/67.0	57.3/55.8	278.8	203.3	R-454B	GAS	2	400	324.0	13	2"	208/3	128	175	2944	TRANE/YSK300A3S0H	1
RTU-2	20.0	2720	6800	1.5	1485	3	9.8	80.2/67.0	56.4/55.4	242.1	175.1	R-454B	GAS	2	400	324.0	13	2"	208/3	113	150	2714	TRANE/YSJ240A3S0H	1

- REMARKS NOTES:
1. PROVIDE DISCONNECT SWITCH
  2. ELECTRICAL CONTRACTOR TO PROVIDE SUPPLY AND RETURN AIR DUCT SMOKE DETECTORS WITH AUXILIARY CONTACTS, INSTALLED BY MECHANICAL CONTRACTOR, AND WIRED BY ELECTRICAL CONTRACTOR.

GRILLE, REGISTER & DIFFUSER SCHEDULE											
TAG	FACE SIZE (SLOT WIDTH)	# SLOTS/ BAR GRID SPACE	DEFLECTION/ THROW	CONNECTION SIZE	MAX CFM	P.D. IN. W.C.	THROW @ 50 FPM	MAX NC	BASIS OF DESIGN	MODEL	REMARKS
S-1	24/24	N/A	4W	PER SCH.	300	0.05	11	<15	TITUS	OMNI	1,2
S-2	22/22	3/4"	ADJ.	16"O W/ BOOT	1600	0.05	73	25	TITUS	301FL	1,2
S-3	12/12	N/A	4W	PER SCH.	419	0.05	6	<15	TITUS	OMNI	1,2
R-1	24/24	1/2 GRID	N/A	N/A	1000	-0.05	N/A	20	TITUS	45F	1,2
R-2	36/12	3/4"	35"	36/12	1500	-0.02	N/A	20	TITUS	350RL	1,2
R-3	36/24	3/4"	35"	36/24	2830	-0.05	N/A	20	TITUS	350RL	1,2
E-1	12/12	N/A	N/A	PER SCH.	150	-0.05	N/A	<15	TITUS	8R	1,2

- REMARKS:
1. SEE ARCHITECTURAL REFLECTED CEILING PLAN FOR CEILING TYPES AND MOUNTING REQUIREMENTS.
  2. DIFFUSER FINISH AND COLOR BY ARCHITECT.

VAV BOX SCHEDULE											
TAG	BASIS OF DESIGN			PRIMARY AIR			HEATING COIL DATA		ELECTRICAL		REMARKS
	MANUFACTURER	MODEL	UNIT SIZE	DESIGN CFM	MINIMUM CFM	INLET S.P. (IN.W.G)	EAT/LAT	CFM	KW	VOLTS/PHASE	
VAV-1	PRICE	SDV	10	700	210	0.01	55/96.4	420	5.5	208/1	SEE BELOW
VAV-2	PRICE	SDV	10	700	210	0.01	55/96.4	420	5.5	208/1	SEE BELOW
VAV-3	PRICE	SDV	8	540	170	0.01	55/94.0	340	4.0	208/1	SEE BELOW
VAV-4	PRICE	SDV	10	870	261	0.01	55/94.3	522	6.5	208/1	SEE BELOW
VAV-5	PRICE	SDV	12	1920	580	0.01	55/94.8	1150	14.5	208/3	SEE BELOW
VAV-6	PRICE	SDV	16	3360	1010	0.01	55/81.6	2020	17.0	208/3	SEE BELOW

- NOTE:
1. PROVIDE HANGER BRACKETS.
  2. PROVIDE 1" ROTARY FIBERGLASS INSULATION WITHIN BOX.
  3. ELECTRIC REHEAT COIL SHALL HAVE SCR CONTROL.
  4. DESIGN PERFORMANCE: 60°F PRIMARY AIR TEMPERATURE / 70°F RETURN AIR TEMPERATURE.

A/C UNIT SCHEDULE												
TAG	SERVES	NOM. TONS	CFM	SUPPLY FAN DATA			ELECTRICAL DATA			W.T. (LBS)	BASIS OF DESIGN /MODEL	REMARKS
				CFM	E.S.P. IN. WG	TYPE	VOLTS/ PH	MCA	MOP			
AC-1	MDF ROOM	1.0	400	400	0.3	Cross Flow	208/1	12.5	20	23.4	SAMSUNG/RNS12ABC	1
AC-2	STOR/AV. ROOM	1.0	400	400	0.3	Cross Flow	208/1	12.5	20	23.4	SAMSUNG/RNS12ABC	1

- REMARKS NOTES:
1. PROVIDE DISCONNECT SWITCH.

A/C CONDENSING UNIT SCHEDULE											
TAG	SERVES	NOM. TONS	IEER	REFR.	EAT MIN/MAX	ELECTRICAL DATA			W.T. (LBS)	BASIS OF DESIGN /MODEL	REMARKS
						VOLTS/ PH	MCA	MOP			
CU-1	AC-1	1.0	13.5	R410A	44.6/95.0	208/1	12.5	20	75.8	SAMSUNG /KTN130D4 2UFR	1
CU-2	AC-2	1.0	13.5	R410A	44.6/95.0	208/1	12.5	20	75.8	SAMSUNG /KTN130D4 2UFR	1

- REMARKS NOTES:
1. PROVIDE DISCONNECT SWITCH.


DRAWING SET: 90% Submission  
RELEASE DATE: 12/20/2024

PRINTED OR ELECTRONIC DRAWING AND DOCUMENTATION MAY NOT BE REPRODUCED IN ANY FORM WITHOUT WRITTEN PERMISSION FROM FIRSTING ARCHITECTURE, INC.  
COPYRIGHT 2022. ALL RIGHTS RESERVED.

**Allen + Shariff**  
MEP Engineering  
Project Management  
205 East Market Street  
Salisbury, Maryland 21801  
443.545.1300

**CHABAD OF WILMINGTON - SHUL**  
JEWISH COMMUNITY CENTER  
2317 Market Street  
Wilmington, North Carolina 28403  
PROJECT NO. 24-1

**KERSTING ARCHITECTURE**  
4022 MARKET STREET SUITE 201 - WILMINGTON, NC 28403 - (910) 763-1348

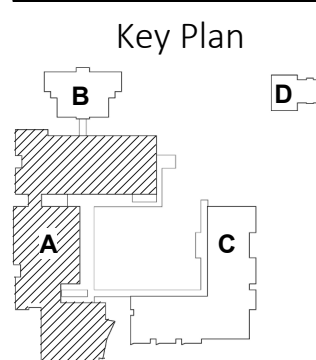

MECHANICAL SCHEDULES

M-301-A