



July 6, 2026

ADDENDUM 1

BID DATE EXTENDED TO JULY 16, 2026 AT 10:00 AM

- Referencing Finish Schedule (Sheet A-701), there is no product information provided for Rubber Base (RB-1). Please advise what we should include for RB-1. **RB -1, Roppe 178 Pewter 4"**
 - Referencing Partial Finish Plans (Sheets A-711A & A-711B), there are certain areas that call out for "CPT-4". When referencing the Finish Schedule, there is no CPT-4 listed (only CPT-1, 2, 3, and WO-1). Please advise what item is desired for CPT-4. **Milliken Heavy Metal Alloy, Aly13*-220, Alluvial, Ashlar**
 - Referencing Finish Schedule (Sheet A-701), there is no info provided for Wall Base desired for areas receiving Porcelain Tile. Are we to assume the areas with Wall Tile will have no Wall Base and bump directly up to Floor Tile. Should we include Schluter Dilex Cove at the joint between Floor and Wall Tile? Also, for walls without Wall Tile, what should we include here? **NO BASE JUST WALL TILE**
 - Referencing Specifications – Ceramic Tile (Section 09310), there is no information provided for Waterproofing. I do see notes on Sheets A-501 and A-504 pertaining to Waterproofing in Shower Areas. Can you confirm that the only areas that are to receive Waterproofing are Shower Floors and Shower Walls? Also, is there any specific product that is desired or can we just include a standard fluid-applied option (ex. Mapei Waterstop)? **Yes - waterproofing on shower floors + walls. Re: 2/A-504**
 - Referencing Specifications – Ceramic Tile (Section 09310), there is no information provided for the type of Grout desired. Referencing Finish Schedule (Sheet A-701), Tile Grouts are listed as G-1 (Laticrete in color 39 Mushroom) and G-2 (Laticrete in color 93 Fossil); however, this doesn't specify what type of grout is desired. Can you please confirm if they want standard cementitious grout or if they want Epoxy grout? **Standard cementitious**
1. The Reflected Ceiling Plans on sheets A-103, A-103A and A-103B do not line up with the information provided on the Finish Schedule on page A-701. The RCP refers to CL200, CL300, CL400, and CL600, but none of these materials are referenced in the Finish Schedule. The legend mentions ACT-1, ACT-2, and ACT-3, but the descriptions do not match what seems to be the intent per the RCP. **See updated ceiling material legend that refers back to finish schedule. Finish schedule also updated with materials**



2. It is unclear which item corresponds to which material. BAF1 and BAF2 are mentioned in the Finish Schedule, but the materials do not match what the Ceiling Material Legend shows on the RCP. **TD updated schedule + ceiling material legend for clarity**
3. There seem to be baffles under CL400 per the RCP, but these are not labeled. Please clarify which materials go here. **These are BAF6 (1/A-416). Need to coordinate how the baffle tracks work with the suspended ceiling. These baffles are the same ones we used in the TD office**
4. The RCP refers to “Acoustic Tekton Panels” in Training 103, but it seems the materials for this application are not described. **TD updated schedule + ceiling material legend for clarity**

We are going to assume fluid applied membrane on all exterior walls - **Approved**

3/A413 detail calls for EQ-9 (docking station) I believe this is labeled wrong and should probably be EQ-8 please clarify -- **YES! EQ8 UNDER COUNTER MINI FRIDGE**

3/A414 legend shows EQ-5, should this be EQ-3 and EQ-5 in the bar area as it is the sanitizing model? **Correct, in the Grounds Area, dishwasher to be EQ3.**

EQ5 should be in the Line Service area, TD will update drawings + will need to coordinate with MEP. See attached spec sheet.


There is a separate equipment schedule for the Bar Area per our consultant - see attached bar equipment spec sheets PDF

3/A418 & 6/A418 detail shows what looks like a dishwasher or UC refridge and is called out by owner. Please confirm what this is? **Spec not confirmed yet for C-Suite furniture and associated built-ins. This will more than likely be provided by the furniture vendor.**

8/A422 please label bar equipment to correspond with equipment schedule. **Please see attached equipment specs per the Bar Consultant. Floor plan tags correspond with tags on final spec PDF**

Please confirm that we will need to install fire shutters at doors 001A, 103B, 103A and that the fire rated glass shown will be regular tempered glass.

**001A - SIDELIGHT TO BE REMOVED, HM DOOR WITH HM FRAME. 100 SQ.INCH RATED GLAZING
103A AND 103B WILL HAVE FIRE SHUTTERS IN THE SOFFITS ABOVE THOSE ENTRIES.**



TURPENTINE DESIGN


1007 Procure Street
Fuquay-Varina, NC 27526

919.412.9138
turpentine-design.com

REVISIONS

A	PRICING REV	Date 1	July 1, 2026
---	-------------	--------	--------------

SEALS

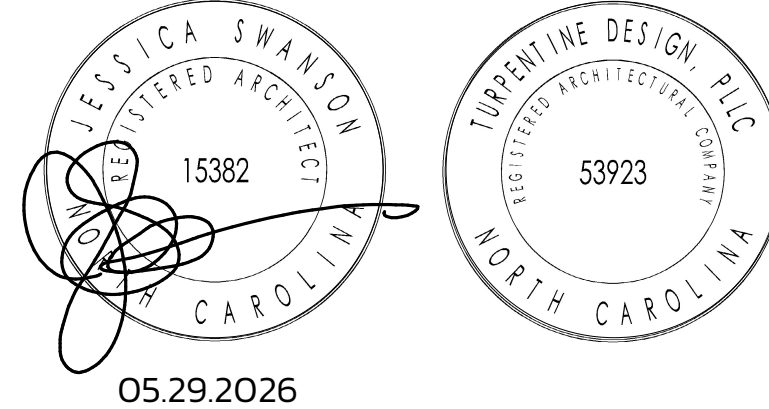

ARQ AVIATION

FLIGHT SCHOOL + FBO

Wilmington International Airport (ILM)
Wilmington, NC 28405

OWNER
ARQ Realty

COPYRIGHT 2025 - ALL RIGHTS RESERVED
PRINTED OR ELECTRONIC DRAWINGS & DOCUMENTATION MAY
NOT BE REPRODUCED OR REDISTRIBUTED IN ANY WAY WITHOUT
WRITTEN PERMISSION FROM TURPENTINE DESIGN

PHASE	PERMIT SET
DATE	05.29.2026
TD PROJECT #	25-009

DRAWING TITLE

OVERALL RCP

DRAWING NUMBER

A-103

RCP SYMBOLS

H1		HIGH BAY, TGS #CHB-E-L-40-WD-U-D-1-PH-M
L8		15' LINEAR RECESSED, 3G LIGHTING #3G-LRL-D750-S80-30K-UNV-DIM-XTR-DASY-S(8)
L9		15' LINEAR RECESSED, 3G LIGHTING #3G-LRL-D750-S80-30K-UNV-DIM-XTR-FL-S(9)
L16		15' LINEAR RECESSED, 3G LIGHTING #3G-LRL-D750-S80-30K-UNV-DIM-GCX-FL-S(16)
L50		2' PERIMETER LED, FINELITE #HP-W5-4W-4D-50'-V-830-SW-277-SC-FC-1%-WB-C1-TXL-L-TXL-R-SW
L68		2' PERIMETER LED, FINELITE #HP-W5-4W-4D-68'-V-830-SW-277-SC-FC-1%-WB-C1-TXL-L-TXL-R-SW
L86		2' PERIMETER LED, FINELITE #HP-W5-4W-4D-86'-V-830-SW-277-SC-FC-1%-WB-C1-TXL-L-TXL-R-SW
P1		6.5' X 10' CYLINDER, HE WILLIAMS #HCR-TL-16-L15/930-WHT-DIM-UNV-LW-CS-AD-CH96-S9658/W
PIE		PIE SAME AS P1 WITH BATTERY
P2		6.5' X 10' CYLINDER, HE WILLIAMS #HCR-TL-16-L15/930-ALUM-DIM-UNV-LW-AL-AD-CH96/ALUM-S9658/B
P2E		P2E SAME AS P2 WITH BATTERY
P3		LOBBY LOUNGE PENDANT, KUZCO LIGHTING #493216-WH/GD
P4, P4E		ACOUSTICAL MULTI FIN PENANT, ECHO #28QTV E4712-A-1-CG (5square Grid)-930CK-2500LM-WFL-LV01-STD-WPC-WH
P5		BAR DECORATIVE PENDANT, KUZCO LIGHTING #PD22907-GY
P8		OVAL PENDANT, BINA #RRNG-OVL-48'Straight Run X 12' Radius-PD-CC-A-1-DN-D1-30K-90-750lmf-IC-D10-11"
P9		LINEAR PENDANT, TECHOLED #BX-1-D-6-18-30-U-1-P-DMTX-NL-M
PI0, PIOE		15' LINEAR PENDANT DIRECT, 3G LIGHTING #3G-LRL-D-DC800-S80-30K-UNV-DIM-DWSO-BK-60'-WCM-BC-1/4"
R1, R1E		6' RECESSED CAN, HE WILLIAMS #RDR-TL-L20/930-DIM-UNV-OW-OF-CS-N-CA1
R2, R2E		6' RECESSED CAN, HE WILLIAMS #RDR-TL-L15/930-DIM-UNV-OW-OF-CS-N-CA1
R3, R3E		6' RECESSED CAN (WET), HE WILLIAMS #RDR-TL-L15/930-DIM-UNV-LW-OF-CS-AD-WET/CC-CA1
R4, R4E		8' EXTERIOR RECESSED CAN, HE WILLIAMS #RDR-L20/930-DIM-277-OW-CS-WET/CC-N-CA1
R5		4' WALL WASHER RECESSED CAN, HE WILLIAMS #DR-TL-L10/830-DIM-UNV-OWN-OF-CS-N-CA1
S1		FIELD SELECT STRIP, HE WILLIAMS #96-4-L40/830-SFRA-DIM-UNV
SM1		4' SURFACE MOUNT CYLINDER, HE WILLIAMS #4CR-13-L9/830-WHT-DIM-UNV-OW-CS-SM
T2, T2E		2X2 LED TROFFER, HE WILLIAMS #WDO-S22-L32/830-AD-DIM-UNV
T4, T4E		2X4 LED TROFFER, HE WILLIAMS #WDO-S24-L50/830-AD-DIM-UNV
W1		BATHROOM WALL SCONCE, SCOTT ARCH LIGHTING #53A75-L12-30K-PT-FEC
W2, W2E		EXTERIOR CYLINDER WALL SCONCE, VISA OW2308-L30K-MVOLT-1-RMD
W3, W3E		EXTERIOR WALL SCONCE, GARDCO GEOFORM #GCM-A05-930-T2M-UNV-FAWS
W4, W4E		EXTERIOR WALL SCONCE, MIMIK20 #A20-M-26-T2-1-80-3K-UNV-O-10V
W5		DECORATIVE WALL SCONCE, SCOTT ARCH LIGHTING #SC-WC100-L-09-30K-BN-FRST
EM		EMERGENCY WALLPACK (W/ BATTERY), MULE #SQ-LED-W-SD
INV		EMERGENCY MICRO LIGHTING INVERTER, MULE #CEPS-25W-RT

FIRST FLOOR RCP - OVERALL

1

1/16" = 1'-0"

GENERAL RCP NOTES

- THE ARCHITECTURAL CEILING PLANS SHALL GOVERN ALL LOCATIONS OF LIGHT FIXTURES, MECHANICAL DIFFUSERS AND CLG. GRID LAYOUTS.
- UNO, ALL CEILING FIXTURES INCLUDING FIRE ALARM HORNS, STROBES, ENUNCIATORS, SPRINKLER HEADS ETC. SHALL BE WHITE IN COLOR AND CEILING MOUNTED AS CODE ALLOWS. IF BUILDING STANDARD EXISTS WHICH CONFLICTS WITH THIS CONDITION, COORDINATE FINISH WITH ARCHITECT.
- SEE ELEC. DWGS. FOR EXACT LIGHTING SPECS. ARCHITECT TO APPROVE FIXTURE SPECS PRIOR TO GC ORDER. DESCRIPTIONS OF FIXTURES ON THIS DRAWING ARE FOR REFERENCE ONLY.
- UNO, ON DRAWINGS, REMOVE ALL UNUSED CABLE, CONDUIT, DUCTWORK, HANGER WIRES, CLAMPS, PIPING, ETC.
- SEE ELECTRICAL DRAWINGS FOR INFORMATION REGARDING LOCATIONS OF EMERGENCY LIGHTING, FIRE ALARM DEVICES, OCCUPANCY SENSORS, AND OTHER CEILING DEVICES NOT SHOWN.
- UNO, CENTER ALL FIXTURES AND DEVICES IN CEILING TILES, SOFFITS, OR PORTALS. NOTIFY ARCHITECT OF CONFLICTS. COORDINATE FINISH OF DIFFUSERS LOCATED IN SPECIALTY CEILINGS WITH ARCHITECT.
- UNO, ALL GYPSUM WALL BOARD CEILINGS SHALL BE X-X" AFF. GC TO VERIFY HEIGHT IS ACHIEVABLE IN FIELD AND NOTIFY ARCHITECT IMMEDIATELY OF ANY CONFLICTS.
- UNO, ALL SUSPENDED ACOUSTICAL CEILINGS SHALL BE X-X" AFF TO THE FINISHED SURFACE OF THE TILE. GC TO VERIFY HEIGHT IS ACHIEVABLE IN FIELD AND NOTIFY ARCHITECT IMMEDIATELY OF ANY CONFLICTS.
- UNO, EXISTING EXTERIOR SHADE DEVICES ARE EXISTING TO REMAIN. PROVIDE PROTECTION AS REQUIRED DURING CONSTRUCTION. GC TO NOTIFY ARCHITECT OF ANY DAMAGED DEVICES.
- UNO, FACE OF ALL GWB SOFFITS ADJACENT TO EXPOSED CEILING AREAS OR CORRIDORS SHALL HAVE GWB EXTENDING TO FLOOR STRUCTURE ABOVE. SEE CONSTRUCTION PLAN FOR WALL TYPES, AND COORD. WITH RCP AS REQUIRED


CEILING MATERIAL LEGEND


	CL100 GYP-1 INT. GYPSUM BOARD, PAINTED. SEE FINISH PLAN + SCHED.		CL400 GCP-1 GYP PANEL, 2x4, EXTERIOR GRADE		BAF1 ACOUSTIC FELT BAFFLES SEE INT. ELEVATIONS, FINISH PLAN + SCHED. FOR COLORS AND LOCATIONS
	CL200 ACT-2 2x4 - WHITE		CL700 APC-1 ACOUSTIC PLASTER CEILING		BAF2 BAF-6 WOOD ACOUSTIC BAFFLES
	CL300 ACT-1 2x4 - LIGHT GRAY		CL800 T-3 TILE CEILING		PAN1 ATP-1 TECTUM CLG PANEL, WHITE
	CL400 MTL-1 PERF. METAL PANEL, 1x4		OPEN TO DECK		
	CL500 GYP-2 EXT. GYPSUM BOARD SOFFIT		CL900 ACT-6 2x4 - WHITE		

AV/IT LEGEND

SECURITY CAMERA
REFERENCE SECURITY SHEETS

KEY PLAN

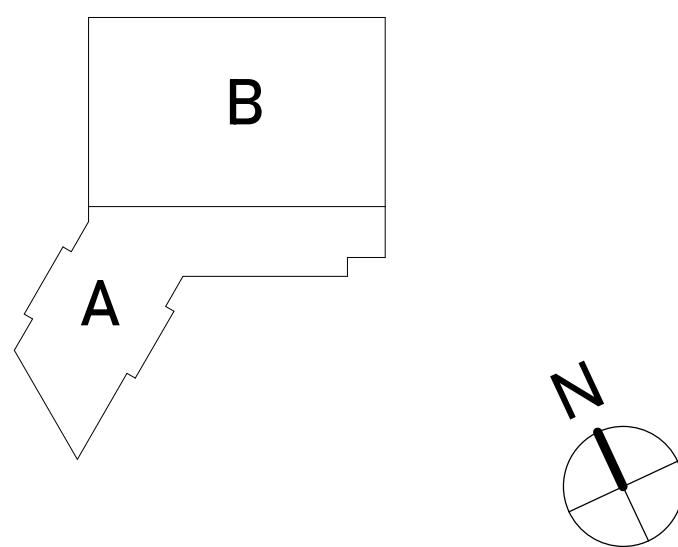



TURPENTINE
DESIGN


1007 Procure Street
Fuquay-Varina, NC 27526

919.412.9138
turentine-design.com

REVISIONS

A PRICING REV Date 1 July 1, 2026

SEALS

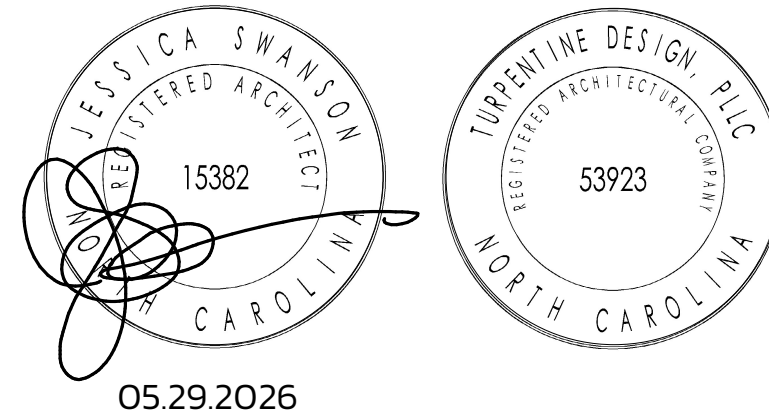

ARQ AVIATION

FLIGHT SCHOOL + FBO

Wilmington International Airport (ILM)
Wilmington, NC 28405

OWNER
ARQ Realty

COPYRIGHT 2025 - ALL RIGHTS RESERVED
PRINTED OR ELECTRONIC DRAWINGS & DOCUMENTATION MAY
NOT BE REPRODUCED OR REDISTRIBUTED IN ANY WAY WITHOUT
WRITTEN PERMISSION FROM TURPENTINE DESIGN

PHASE PERMIT SET
DATE 05.29.2026
TD PROJECT # 25-009

DRAWING TITLE

PARTIAL RCP - AREA

A

DRAWING NUMBER

A-103A

RCP SYMBOLS

H1		HIGH BAY, TGS #CHB-E-L-40-WD-U-D-1-PM-M
L8		15" LINEAR RECESSED, 3G LIGHTING #3G-IRLI-D750-580-30K-UNV-DIM-XTR-DASY-S(8)
L9		15" LINEAR RECESSED, 3G LIGHTING #3G-IRLI-D750-580-30K-UNV-DIM-XTR-FL-S(9)
L16		15" LINEAR RECESSED, 3G LIGHTING #3G-IRLI-D750-580-30K-UNV-DIM-6CX-FL-S(16)
L50		2" PERIMETER LED, FINELITE #HP-W5-4W-40-50-V-830-SW-277-SC-FC-1%-WB-CL-TXL-L-TXL-R-SW
L68		2" PERIMETER LED, FINELITE #HP-W5-4W-40-68-V-830-SW-277-SC-FC-1%-WB-CL-TXL-L-TXL-R-SW
L86		2" PERIMETER LED, FINELITE #HP-W5-4W-40-86-V-830-SW-277-SC-FC-1%-WB-CL-TXL-L-TXL-R-SW
P1		6.5" X 10" CYLINDER, HE WILLIAMS #RCL-TL-16-L30/930-WHT-DIM-UNV-LW-CS-AD-CH96-S96SW P1E SAME AS P1 WITH BATTERY
P1E		
P2		6.5" X 10" CYLINDER, HE WILLIAMS #RCL-TL-16-L30/930-ALUM-DIM-UNV-LW-AL-AD-CH96/ALUM-S96SW/B P2E SAME AS P2 WITH BATTERY
P2E		
P3		LOBBY LOUNGE PENDANT, KUZCO LIGHTING #49325-WWVGD
P4, P4E		ACOUSTICAL MULTI FIN PENANT, ECHO #28QTY 6472-A-CG (Square Grid)-930CK-2500LM-WFL-LV01-STD-WPC-WH P4E SAME AS P4 WITH BATTERY
P5		BAR DECORATIVE PENDANT, KUZCO LIGHTING #PD2907-QY
P8		OVAL PENDANT, BINA #RING-OVL-48" Straight Run X 12" Radius-PD-CC-A-A-DN-DI-30K-90-750lmf-IC-DIO-11-
P9		LINEAR PENDANT, TECOLEED #BX-1-D-6-H-30-U-1-P-DIM%-NL-M
P10, P10E		15" LINEAR PENDANT DIRECT, 3G LIGHTING #3G-IRLI-D-DC800-580-30K-UNV-DIM-DW50-IR-60" (60" HX-50") P10E SAME AS P10 WITH BATTERY
R1, R1E		6" RECESSED CAN, HE WILLIAMS #RDR-TL-L20/930-DIM-UNV-OW-OF-CS-N-CA1 R1E SAME AS R1 WITH BATTERY
R2, R2E		6" RECESSED CAN, HE WILLIAMS #RDR-TL-L16/930-DIM-UNV-DW-OF-CS-N-CA1 R2E SAME AS R2 WITH BATTERY
R3, R3E		6" RECESSED CAN (WET), HE WILLIAMS #RDR-TL-L15/930-DIM-UNV-LW-OF-CS-AD-WETIC-N-CA1 R3E SAME AS R3 WITH BATTERY
R4, R4E		8" EXTERIOR RECESSED CAN, HE WILLIAMS #RDR-L20/830-DIM-277-OW-CS-WET(C-N-CA1 R4E SAME AS R4 WITH BATTERY
R5		4" WALL WASHER RECESSED CAN, HE WILLIAMS #DR-TL-L10/830-DIM-UNV-OWW-OF-CS-N-CA1
S1		FIELD SELECT STRIP, HE WILLIAMS #96-4-L40/830-SFRA-DIM-UNV
SM1		4" SURFACE MOUNT CYLINDER, HE WILLIAMS #4CR-13-L9/830-WHT-DIM-UNV-OW-CS-SM
T2, T2E		2X2 LED TROFFER, HE WILLIAMS #DRG-S22-L32/830-AD-DIM-UNV T2E SAME AS T2 WITH BATTERY
T4, T4E		2X4 LED TROFFER, HE WILLIAMS #DRG-S24-L30/830-AD-DIM-UNV T4E SAME AS T4 WITH BATTERY
W1		BATHROOM WALL SCONCE, SCOTT ARCH LIGHTING #S3A75-L12-30K-PT-FEC
W2, W2E		EXTERIOR CYLINDER WALL SCONCE, VISA OW2308-L30K-MVOLT-1-RMD W2E SAME AS W2 WITH BATTERY
W3, W3E		EXTERIOR WALL SCONCE, GARDCO GEOFORM #GCM-A05-830-T2M-UNV-FAWS W3E SAME AS W3 WITH BATTERY
W4, W4E		EXTERIOR WALL SCONCE, MIMIK20 #M20-H-26-T2-1-80-3K-UNV-O-10V W4E SAME AS W4 WITH BATTERY
W5		DECORATIVE WALL SCONCE, SCOTT ARCH LIGHTING #SC-WC100-L-09-30K-BN-FRST
EM		EMERGENCY WALLPACK (W/ BATTERY), MULE #SQ-LED-W-50
INV		EMERGENCY MICRO LIGHTING INVERTER, MULE #CEPS-25W-RT

FIRST FLOOR RCP - AREA A

1/8" = 1'-0"

1

GENERAL RCP NOTES

- THE ARCHITECTURAL CEILING PLANS SHALL GOVERN ALL LOCATIONS OF LIGHT FIXTURES, MECHANICAL DIFFUSERS AND CLG. GRID LAYOUTS.
- UNO, ALL CEILING FIXTURES INCLUDING FIRE ALARM HORNS, STROBES, ENUNCIATORS, SPRINKLER HEADS ETC. SHALL BE WHITE IN COLOR AND CEILING MOUNTED AS CODE ALLOWS. IF BUILDING STANDARD EXISTS WHICH CONFLICTS WITH THIS CONDITION, COORDINATE FINISH WITH ARCHITECT.
- SEE ELEC. DWGS. FOR EXACT LIGHTING SPECS. ARCHITECT TO APPROVE FIXTURE SPECS PRIOR TO GC ORDER. DESCRIPTIONS OF FIXTURES ON THIS DRAWING ARE FOR REFERENCE ONLY.
- UNO, ON DRAWINGS, REMOVE ALL UNUSED CABLE, CONDUIT, DUCTWORK, HANGER WIRES, CLAMPS, PIPING, ETC.
- SEE ELECTRICAL DRAWINGS FOR INFORMATION REGARDING LOCATIONS OF EMERGENCY LIGHTING, FIRE ALARM DEVICES, OCCUPANCY SENSORS, AND OTHER CEILING DEVICES NOT SHOWN.
- UNO, CENTER ALL FIXTURES AND DEVICES IN CEILING TILES, SOFFITS, OR PORTALS. NOTIFY ARCHITECT OF CONFLICTS. COORDINATE FINISH OF DIFFUSERS LOCATED IN SPECIALTY CEILINGS WITH ARCHITECT.
- UNO, ALL GYPSUM WALL BOARD CEILINGS SHALL BE X'-X" AFF. GC TO VERIFY HEIGHT IS ACHIEVABLE IN FIELD AND NOTIFY ARCHITECT IMMEDIATELY OF ANY CONFLICTS.
- UNO, ALL SUSPENDED ACOUSTICAL CEILINGS SHALL BE X'-X" AFF TO THE FINISHED SURFACE OF THE TILE. GC TO VERIFY HEIGHT IS ACHIEVABLE IN FIELD AND NOTIFY ARCHITECT IMMEDIATELY OF ANY CONFLICTS.
- UNO, EXISTING EXTERIOR SHADE DEVICES ARE EXISTING TO REMAIN. PROVIDE PROTECTION AS REQUIRED DURING CONSTRUCTION. GC TO NOTIFY ARCHITECT OF ANY DAMAGED DEVICES.
- UNO, FACE OF ALL GWB SOFFITS ADJACENT TO EXPOSED CEILING AREAS OR CORRIDORS SHALL HAVE GWB EXTENDING TO FLOOR STRUCTURE ABOVE. SEE CONSTRUCTION PLAN FOR WALL TYPES, AND COORD. WITH RCP AS REQUIRED


CEILING MATERIAL LEGEND


	CL100 GYP-1 INT. GYPSUM BOARD, PAINTED. SEE FINISH PLAN + SCHED.		CL400 GCP-1 GYP PANEL, 2x4, EXTERIOR GRADE		BAF1 ACOUSTIC FELT BAFFLES SEE INT. ELEVATIONS, FINISH PLAN + SCHED. FOR COLORS AND LOCATIONS
	CL200 ACT-2 2x2 - WHITE		CL700 APC-1 ACOUSTIC PLASTER CEILING		BAF2 BAF-6 WOOD ACOUSTIC BAFFLES
	CL300 ACT-1 2x4 - LIGHT GRAY		CL800 T-3 TILE CEILING		PANI ATP-1 TECTUM CLG PANEL, WHITE
	CL400 MTL-1 PERF. METAL PANEL, 1x4		OPEN TO DECK		
	CL500 GYP-2 EXT. GYPSUM BOARD SOFFIT		CL900 ACT-4 2x4 - WHITE		

AV/IT LEGEND

SECURITY CAMERA
REFERENCE SECURITY SHEETS

KEY PLAN

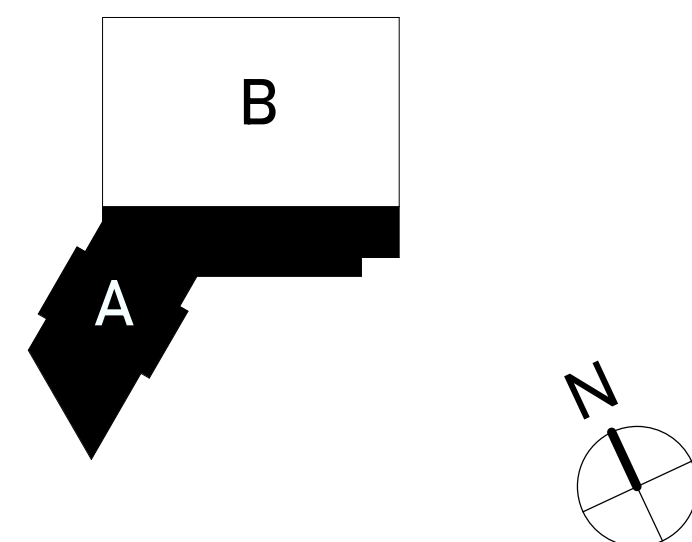

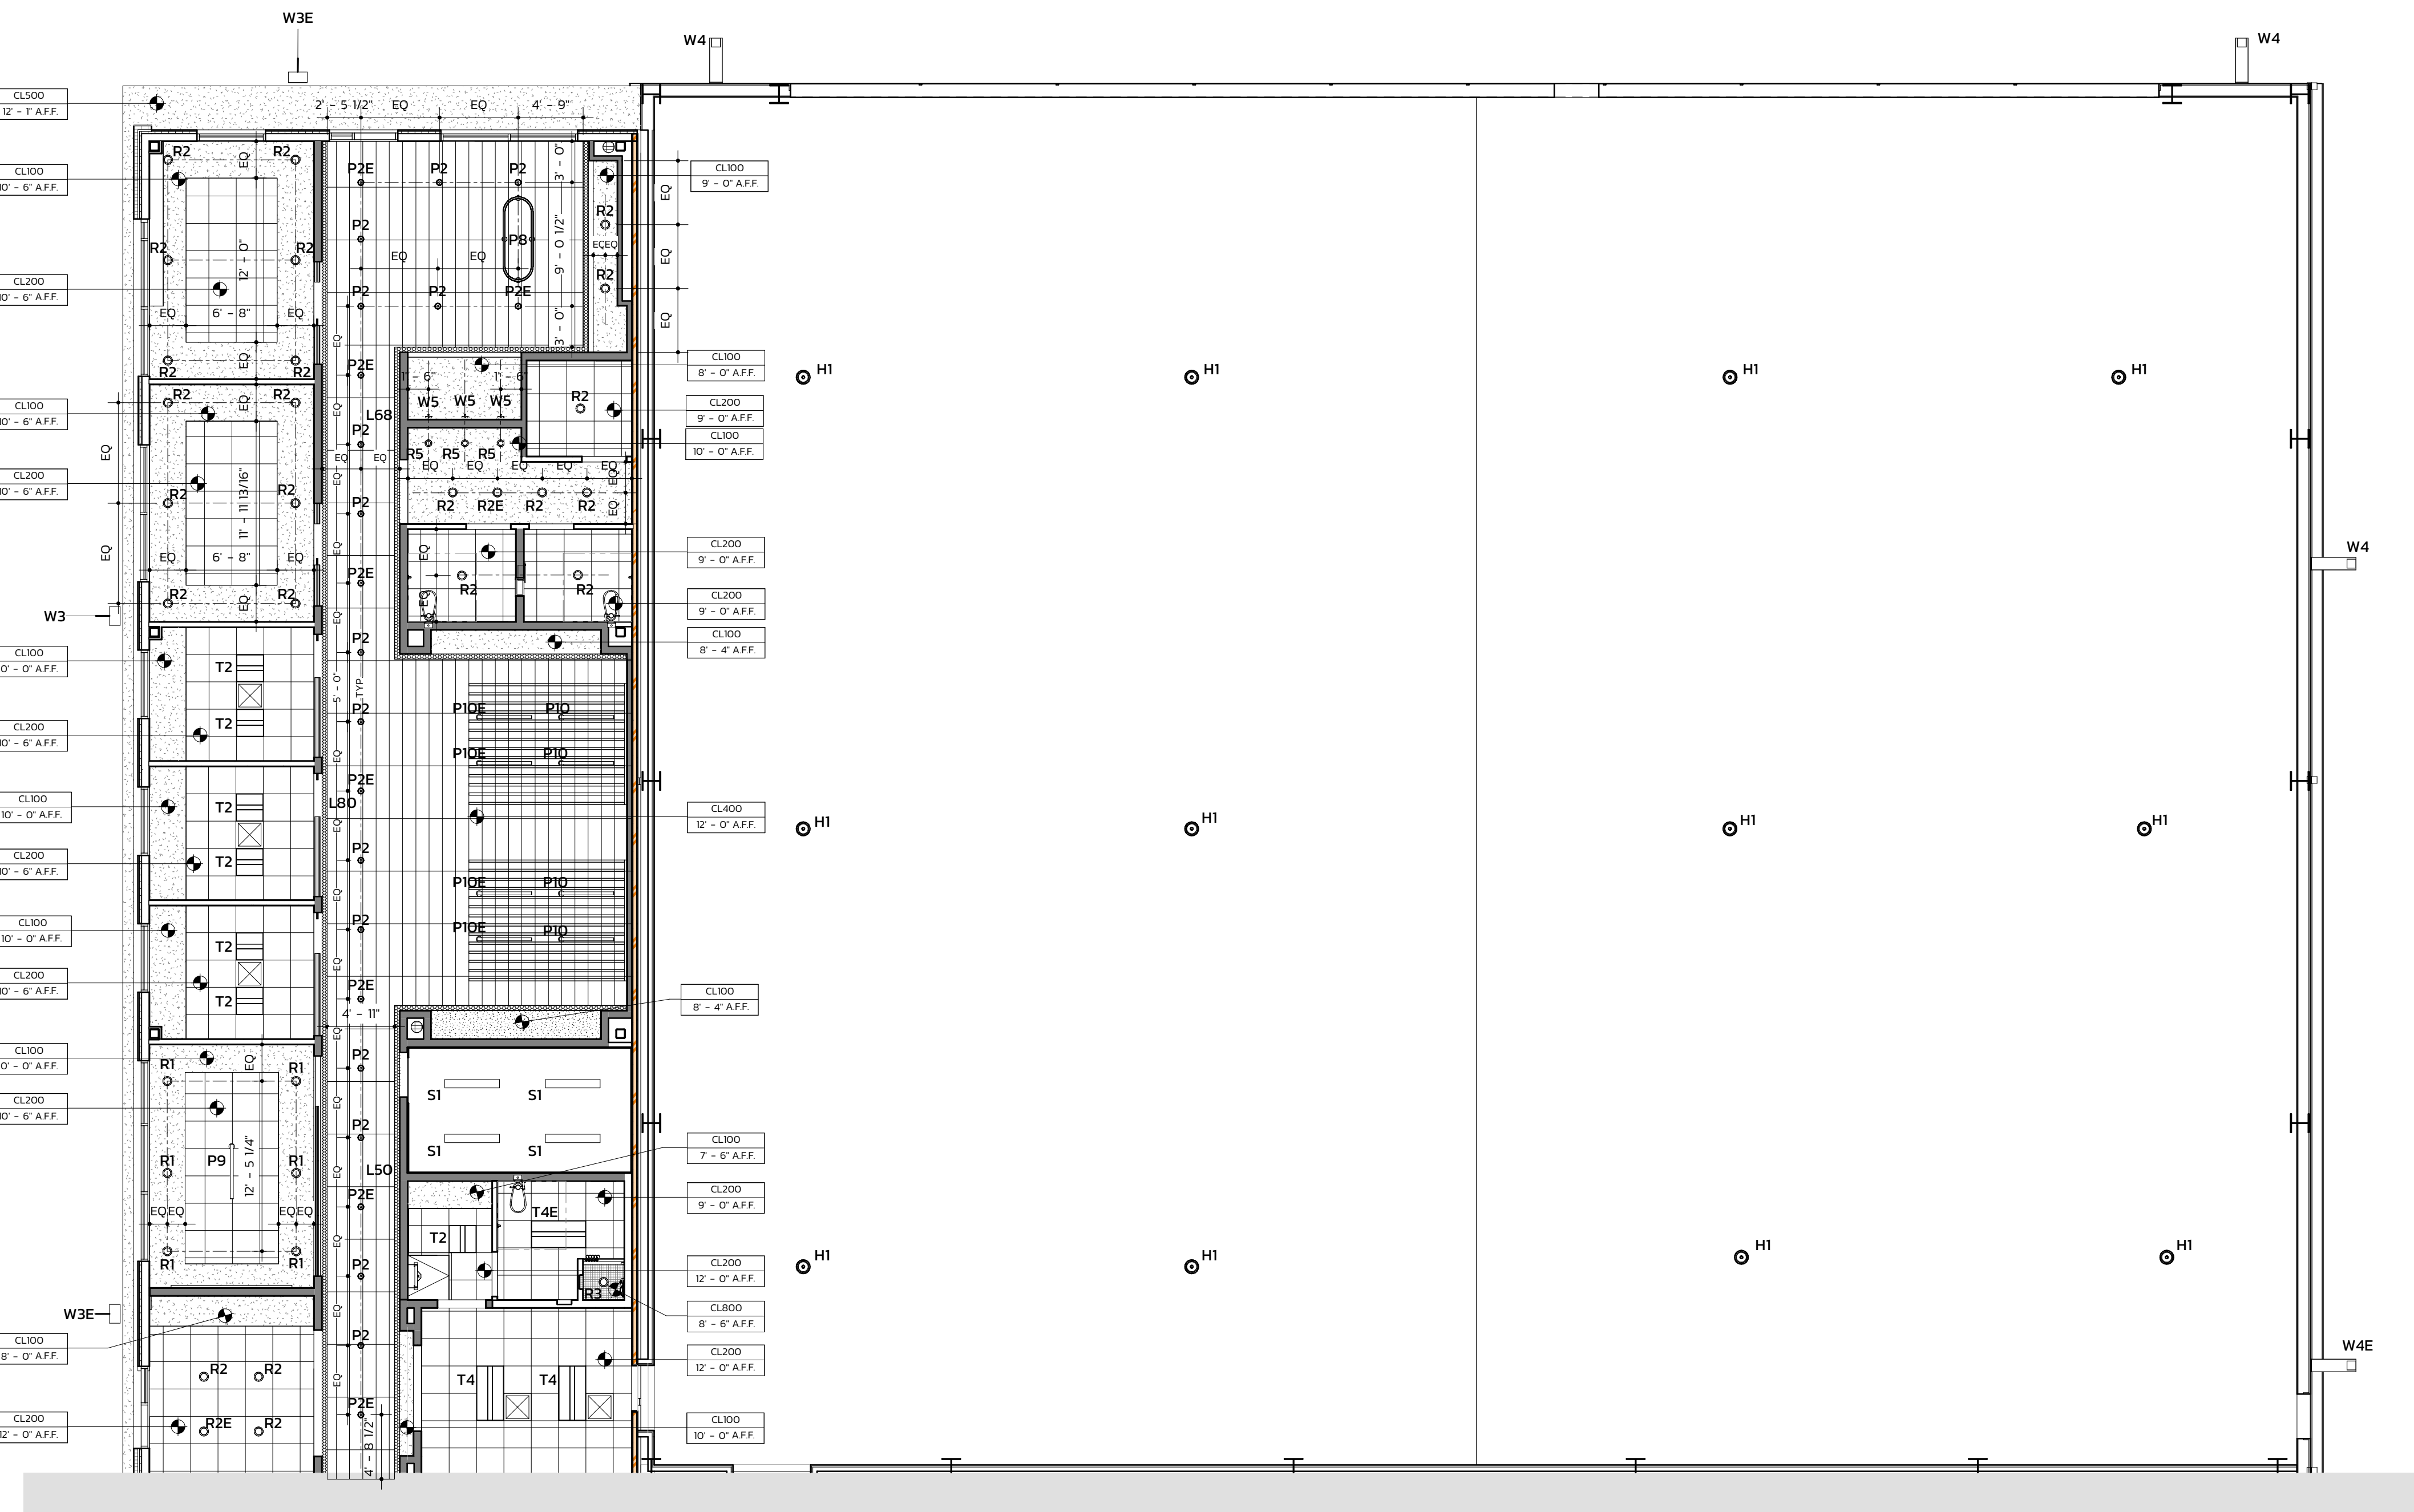

FIRST FLOOR RCP - AREA B
1/8" = 1'-0"

RCP SYMBOLS

H1		HIGH BAY, TGS #CHB-E-L-40-WD-U-D-1-PM-M
L8		15' LINEAR RECESSED, 3G LIGHTING #3G-IRLI-D750-580-30K-UNV-DIM-XTR-DASY-S(8)
L9		15' LINEAR RECESSED, 3G LIGHTING #3G-IRLI-D750-580-30K-UNV-DIM-XTR-FL-S(9)
L16		15' LINEAR RECESSED, 3G LIGHTING #3G-IRLI-D750-580-30K-UNV-DIM-6CX-FL-S(16)
L50		2' PERIMETER LED, FINELITE #HP-W5-4W-40-50-V-830-SW-277-SC-FC-1%-WB-CL-TXL-L-TXL-R-SW
L68		2' PERIMETER LED, FINELITE #HP-W5-4W-40-68-V-830-SW-277-SC-FC-1%-WB-CL-TXL-L-TXL-R-SW
L86		2' PERIMETER LED, FINELITE #HP-W5-4W-40-86-V-830-SW-277-SC-FC-1%-WB-CL-TXL-L-TXL-R-SW
P1		6.5' X 10' CYLINDER, HE WILLIAMS #6CR-TL-H-15/930-WHT-DIM-UNV-LW-CS-AD-CM96-S96SW P1E SAME AS P1 WITH BATTERY
PIE		6.5' X 10' CYLINDER, HE WILLIAMS #6CR-TL-H-15/930-ALUM-DIM-UNV-LW-AL-AD-CM96/ALUM-S96SW/B P1E SAME AS P1 WITH BATTERY
P2		6.5' X 10' CYLINDER, HE WILLIAMS #6CR-TL-H-15/930-ALUM-DIM-UNV-LW-AL-AD-CM96/ALUM-S96SW/B P2E SAME AS P2 WITH BATTERY
P2E		6.5' X 10' CYLINDER, HE WILLIAMS #6CR-TL-H-15/930-ALUM-DIM-UNV-LW-AL-AD-CM96/ALUM-S96SW/B P2E SAME AS P2 WITH BATTERY
P3		LOBBY LOUNGE PENDANT, KUZCO LIGHTING #49325-WHVG
P4, P4E		ACOUSTICAL MULTI FIN PENANT, ECHO #28QTY 6472-A-CG (Square) G10-930CK-2500LM-WFL-LV01-STD-WPC-WH P4E SAME AS P4 WITH BATTERY
P5		BAR DECORATIVE PENDANT, KUZCO LIGHTING #PD2907-GY
P8		OVAL PENDANT, BINA #RING-OVL-48"Straight Run X 12" Radius-PO-CC-A-1-DN-DI-30K-90-750lmf-IC-DIO-11- P8E SAME AS P8 WITH BATTERY
P9		LINEAR PENDANT, TECHOLED #BX-1-D-6-H-30-U-1-P-DM15-NL-M
P10, P10E		15' LINEAR PENDANT DIRECT, 3G LIGHTING #3G-IRLI-D-CK800-580-30K-UNV-DIM-DW50- BW-60"180W-BC-S(4) P10E SAME AS P10 WITH BATTERY
R1, R1E		6' RECESSED CAN, HE WILLIAMS #6CR-TL-L20/930-DIM-UNV-OW-OF-CS-N-CA1 R1E SAME AS R1 WITH BATTERY
R2, R2E		6' RECESSED CAN, HE WILLIAMS #6CR-TL-L19/930-DIM-UNV-OW-OF-CS-N-CA1 R2E SAME AS R2 WITH BATTERY
R3, R3E		6' RECESSED CAN (WET), HE WILLIAMS #6CR-TL-L15/830-DIM-UNV-LW-OF-CS-AD-WETIC-N-CA1 R3E SAME AS R3 WITH BATTERY
R4, R4E		8' EXTERIOR RECESSED CAN, HE WILLIAMS #8CR-L20/830-DIM-277-OW-CS-WETICC-N-CA1 R4E SAME AS R4 WITH BATTERY
R5		4' WALL WASHER RECESSED CAN, HE WILLIAMS #DR-TL-L10/830-DIM-UNV-OWW-OF-CS-N-CA1
S1		FIELD SELECT STRIP, HE WILLIAMS #96-4-L40/830-SFRA-DIM-UNV
SM1		4' SURFACE MOUNT CYLINDER, HE WILLIAMS #4CR-13-L9/830-WHT-DIM-UNV-OW-CS-SM
T2, T2E		2X2 LED TROFFER, HE WILLIAMS #DRG-S22-L32/830-AD-DIM-UNV T2E SAME AS T2 WITH BATTERY
T4, T4E		2X4 LED TROFFER, HE WILLIAMS #DRG-S24-L36/830-AD-DIM-UNV T4E SAME AS T4 WITH BATTERY
W1		BATHROOM WALL SCONCE, SCOTT ARCH LIGHTING #53A75-L12-30K-PT-FEC
W2, W2E		EXTERIOR CYLINDER WALL SCONCE, VISA OW2308-L30K-MVOLT-1-RMD W2E SAME AS W2 WITH BATTERY
W3, W3E		EXTERIOR WALL SCONCE, GARDCO GEOFORM #GCM-A05-830-T2M-UNV-FAWS W3E SAME AS W3 WITH BATTERY
W4, W4E		EXTERIOR WALL SCONCE, MIMIKO #M20-H-26-T2-1-80-3K-UNV-O-10V W4E SAME AS W4 WITH BATTERY
W5		DECORATIVE WALL SCONCE, SCOTT ARCH LIGHTING #SC-WC100-L-09-30K-BN-FRST
EM		EMERGENCY WALLPACK (W/ BATTERY), MULE #5Q-LED-W-SD
INV		EMERGENCY MICRO LIGHTING INVERTER, MULE #CEPS-25W-RT

GENERAL RCP NOTES

- THE ARCHITECTURAL CEILING PLANS SHALL GOVERN ALL LOCATIONS OF LIGHT FIXTURES, MECHANICAL DIFFUSERS AND CLG. GRID LAYOUTS.
- UNO, ALL CEILING FIXTURES INCLUDING FIRE ALARM HORNS, STROBES, ENUNCIATORS, SPRINKLER HEADS ETC. SHALL BE WHITE IN COLOR AND CEILING MOUNTED AS CODE ALLOWS. IF BUILDING STANDARD EXISTS WHICH CONFLICTS WITH THIS CONDITION, COORDINATE FINISH WITH ARCHITECT.
- SEE ELEC. DWGS. FOR EXACT LIGHTING SPECS. ARCHITECT TO APPROVE FIXTURE SPECS PRIOR TO GC ORDER. DESCRIPTIONS OF FIXTURES ON THIS DRAWING ARE FOR REFERENCE ONLY.
- UNO, ON DRAWINGS, REMOVE ALL UNUSED CABLE, CONDUIT, DUCTWORK, HANGER WIRES, CLAMPS, PIPING, ETC.
- SEE ELECTRICAL DRAWINGS FOR INFORMATION REGARDING LOCATIONS OF EMERGENCY LIGHTING, FIRE ALARM DEVICES, OCCUPANCY SENSORS, AND OTHER CEILING DEVICES NOT SHOWN.
- UNO, CENTER ALL FIXTURES AND DEVICES IN CEILING TILES, SOFFITS, OR PORTALS. NOTIFY ARCHITECT OF CONFLICTS. COORDINATE FINISH OF DIFFUSERS LOCATED IN SPECIALTY CEILINGS WITH ARCHITECT.
- UNO, ALL GYPSUM WALL BOARD CEILINGS SHALL BE X-X" AFF. GC TO VERIFY HEIGHT IS ACHIEVABLE IN FIELD AND NOTIFY ARCHITECT IMMEDIATELY OF ANY CONFLICTS.
- UNO, ALL SUSPENDED ACOUSTICAL CEILINGS SHALL BE X-X" AFF TO THE FINISHED SURFACE OF THE TILE. GC TO VERIFY HEIGHT IS ACHIEVABLE IN FIELD AND NOTIFY ARCHITECT IMMEDIATELY OF ANY CONFLICTS.
- UNO, EXISTING EXTERIOR SHADE DEVICES ARE EXISTING TO REMAIN. PROVIDE PROTECTION AS REQUIRED DURING CONSTRUCTION. GC TO NOTIFY ARCHITECT OF ANY DAMAGED DEVICES.
- UNO, FACE OF ALL GWB SOFFITS ADJACENT TO EXPOSED CEILING AREAS OR CORRIDORS SHALL HAVE GWB EXTENDING TO FLOOR STRUCTURE ABOVE. SEE CONSTRUCTION PLAN FOR WALL TYPES, AND COORD. WITH RCP AS REQUIRED


CEILING MATERIAL LEGEND

	CL100 GYP-1 INT. GYPSUM BOARD, PAINTED. SEE FINISH PLAN + SCHED.		CL400 GCP-1 GYP PANEL, 2x4, EXTERIOR GRADE		BAF1 ACOUSTIC FELT BAFFLES SEE INT. ELEVATIONS, FINISH PLAN + SCHED. FOR COLORS AND LOCATIONS
	CL200 ACT-2 2x2 - WHITE		CL700 APC-1 ACOUSTIC PLASTER CEILING		BAF2 BAF-6 WOOD ACOUSTIC BAFFLES
	CL300 ACT-1 2x4 - LIGHT GRAY		CL800 T-3 TILE CEILING		PAN1 ATP-1 TECTUM CLG PANEL, WHITE
	CL400 ACT-1 PERF. METAL PANEL, 1x4		OPEN TO DECK		
	CL500 GYP-2 EXT. GYPSUM BOARD SOFFIT		CL900 ACT-4 2x4 - WHITE		

AV/IT LEGEND

-
- SECURITY CAMERA
REFERENCE SECURITY SHEETS

KEY PLAN

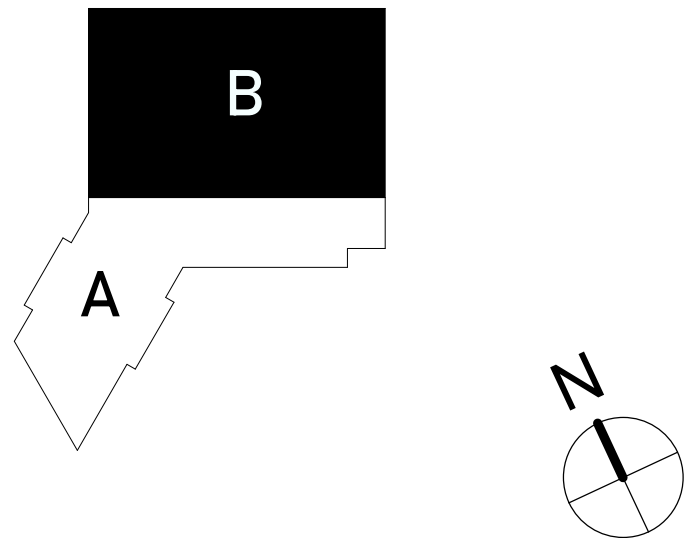


1007 Procure Street
Fuquay-Varina, NC 27526

919.412.9138
turpentine-design.com

REVISIONS

A	PRICING REV	Date 1	July 1, 2026

SEALS

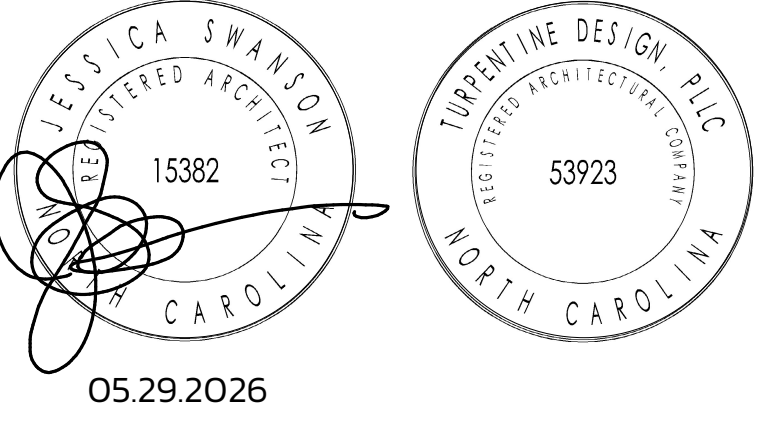

ARQ AVIATION

FLIGHT SCHOOL + FBO

Wilmington International Airport (ILM)
Wilmington, NC 28405


OWNER
ARQ Realty

COPYRIGHT 2025 - ALL RIGHTS RESERVED
PRINTED OR ELECTRONIC DRAWINGS & DOCUMENTATION MAY
NOT BE REPRODUCED OR REDISTRIBUTED IN ANY WAY WITHOUT
WRITTEN PERMISSION FROM TURPENTINE DESIGN

PHASE	PERMIT SET
DATE	05.29.2026
TD PROJECT #	25-009

DRAWING TITLE
PARTIAL RCP - AREA
B

DRAWING NUMBER
A-103B



TURPENTINE
DESIGN


1007 Procure Street
Fuquay-Varina, NC 27526

919.412.9138
turpentine-design.com

REVISIONS

A PRICING REV Date 1 July 1, 2026

SEALS

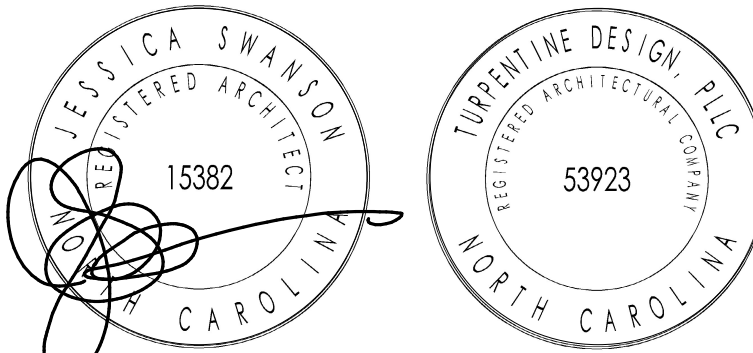

05.29.2026

ARQ AVIATION
FLIGHT SCHOOL + FBO

Wilmington International Airport (ILM)
Wilmington, NC 28405

OWNER
ARQ Realty






COPYRIGHT 2025 - ALL RIGHTS RESERVED
PRINTED OR ELECTRONIC DRAWINGS & DOCUMENTATION MAY
NOT BE REPRODUCED OR REDISTRIBUTED IN ANY WAY WITHOUT
WRITTEN PERMISSION FROM TURPENTINE DESIGN

PHASE PERMIT SET
DATE 05.29.2026
TD PROJECT # 25-009

DRAWING TITLE
ENLARGED PLAN +
ELEVATIONS -
TRAINING ROOM















DRAWING NUMBER

A-413

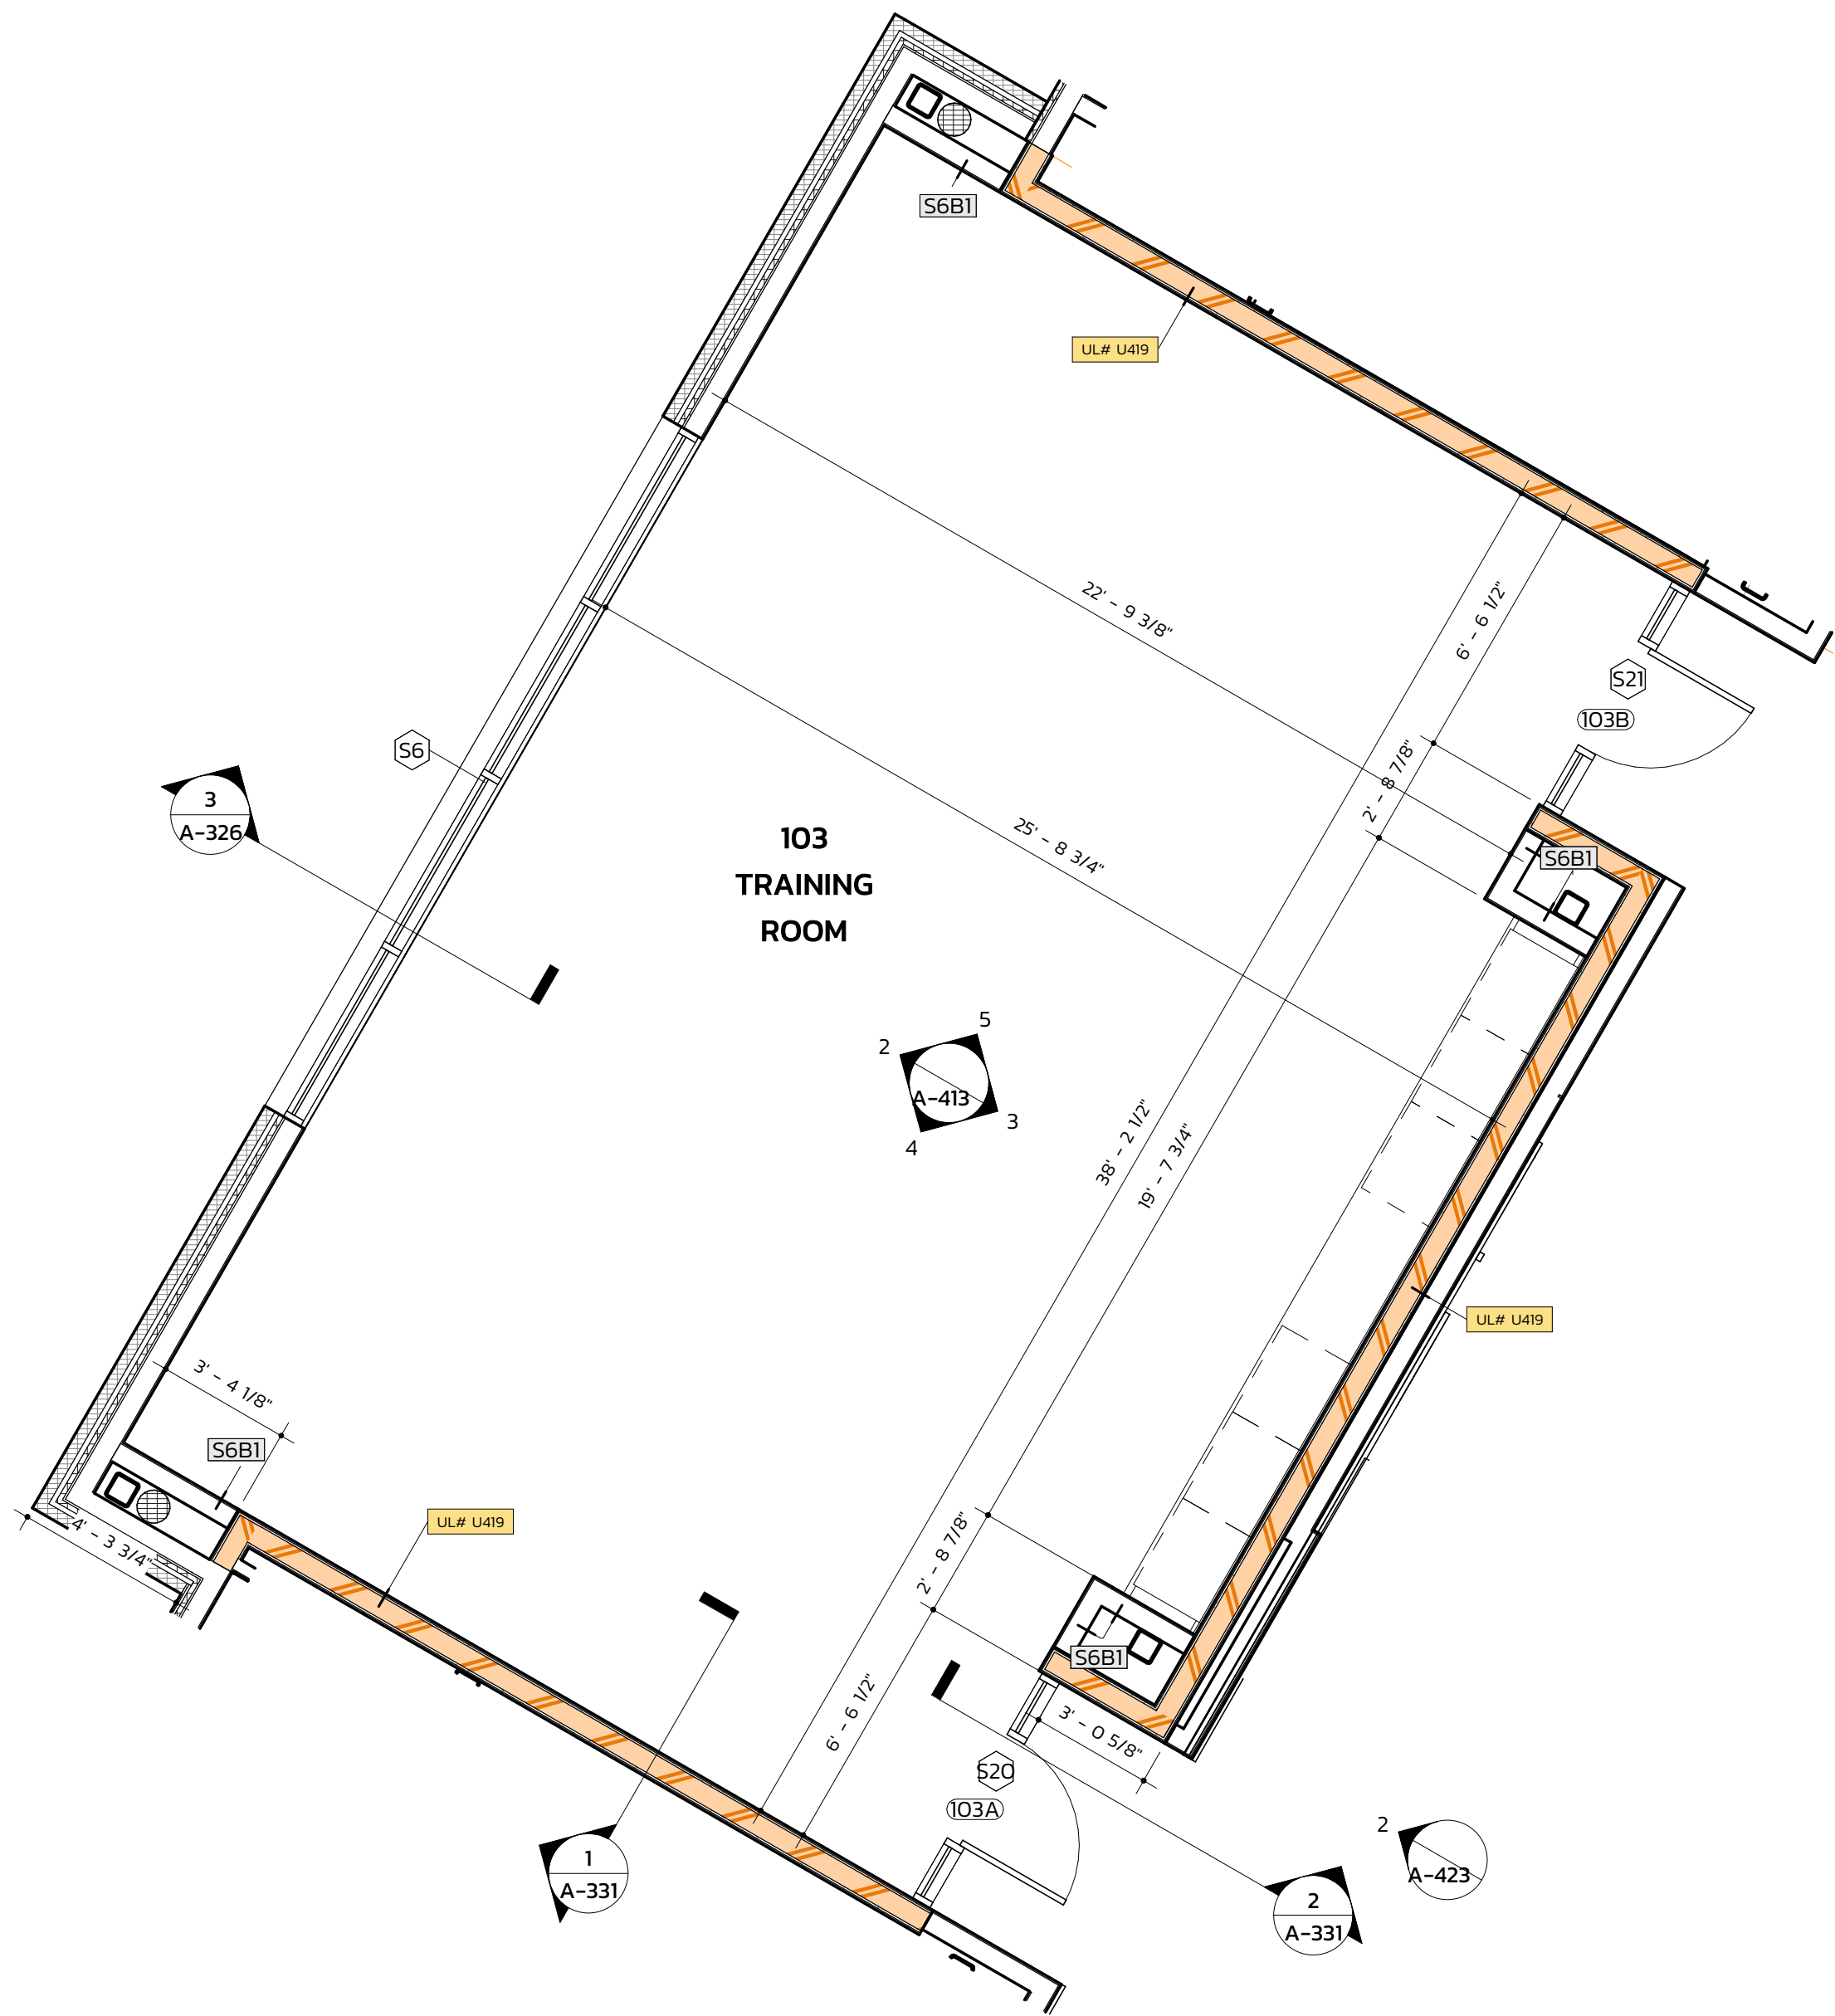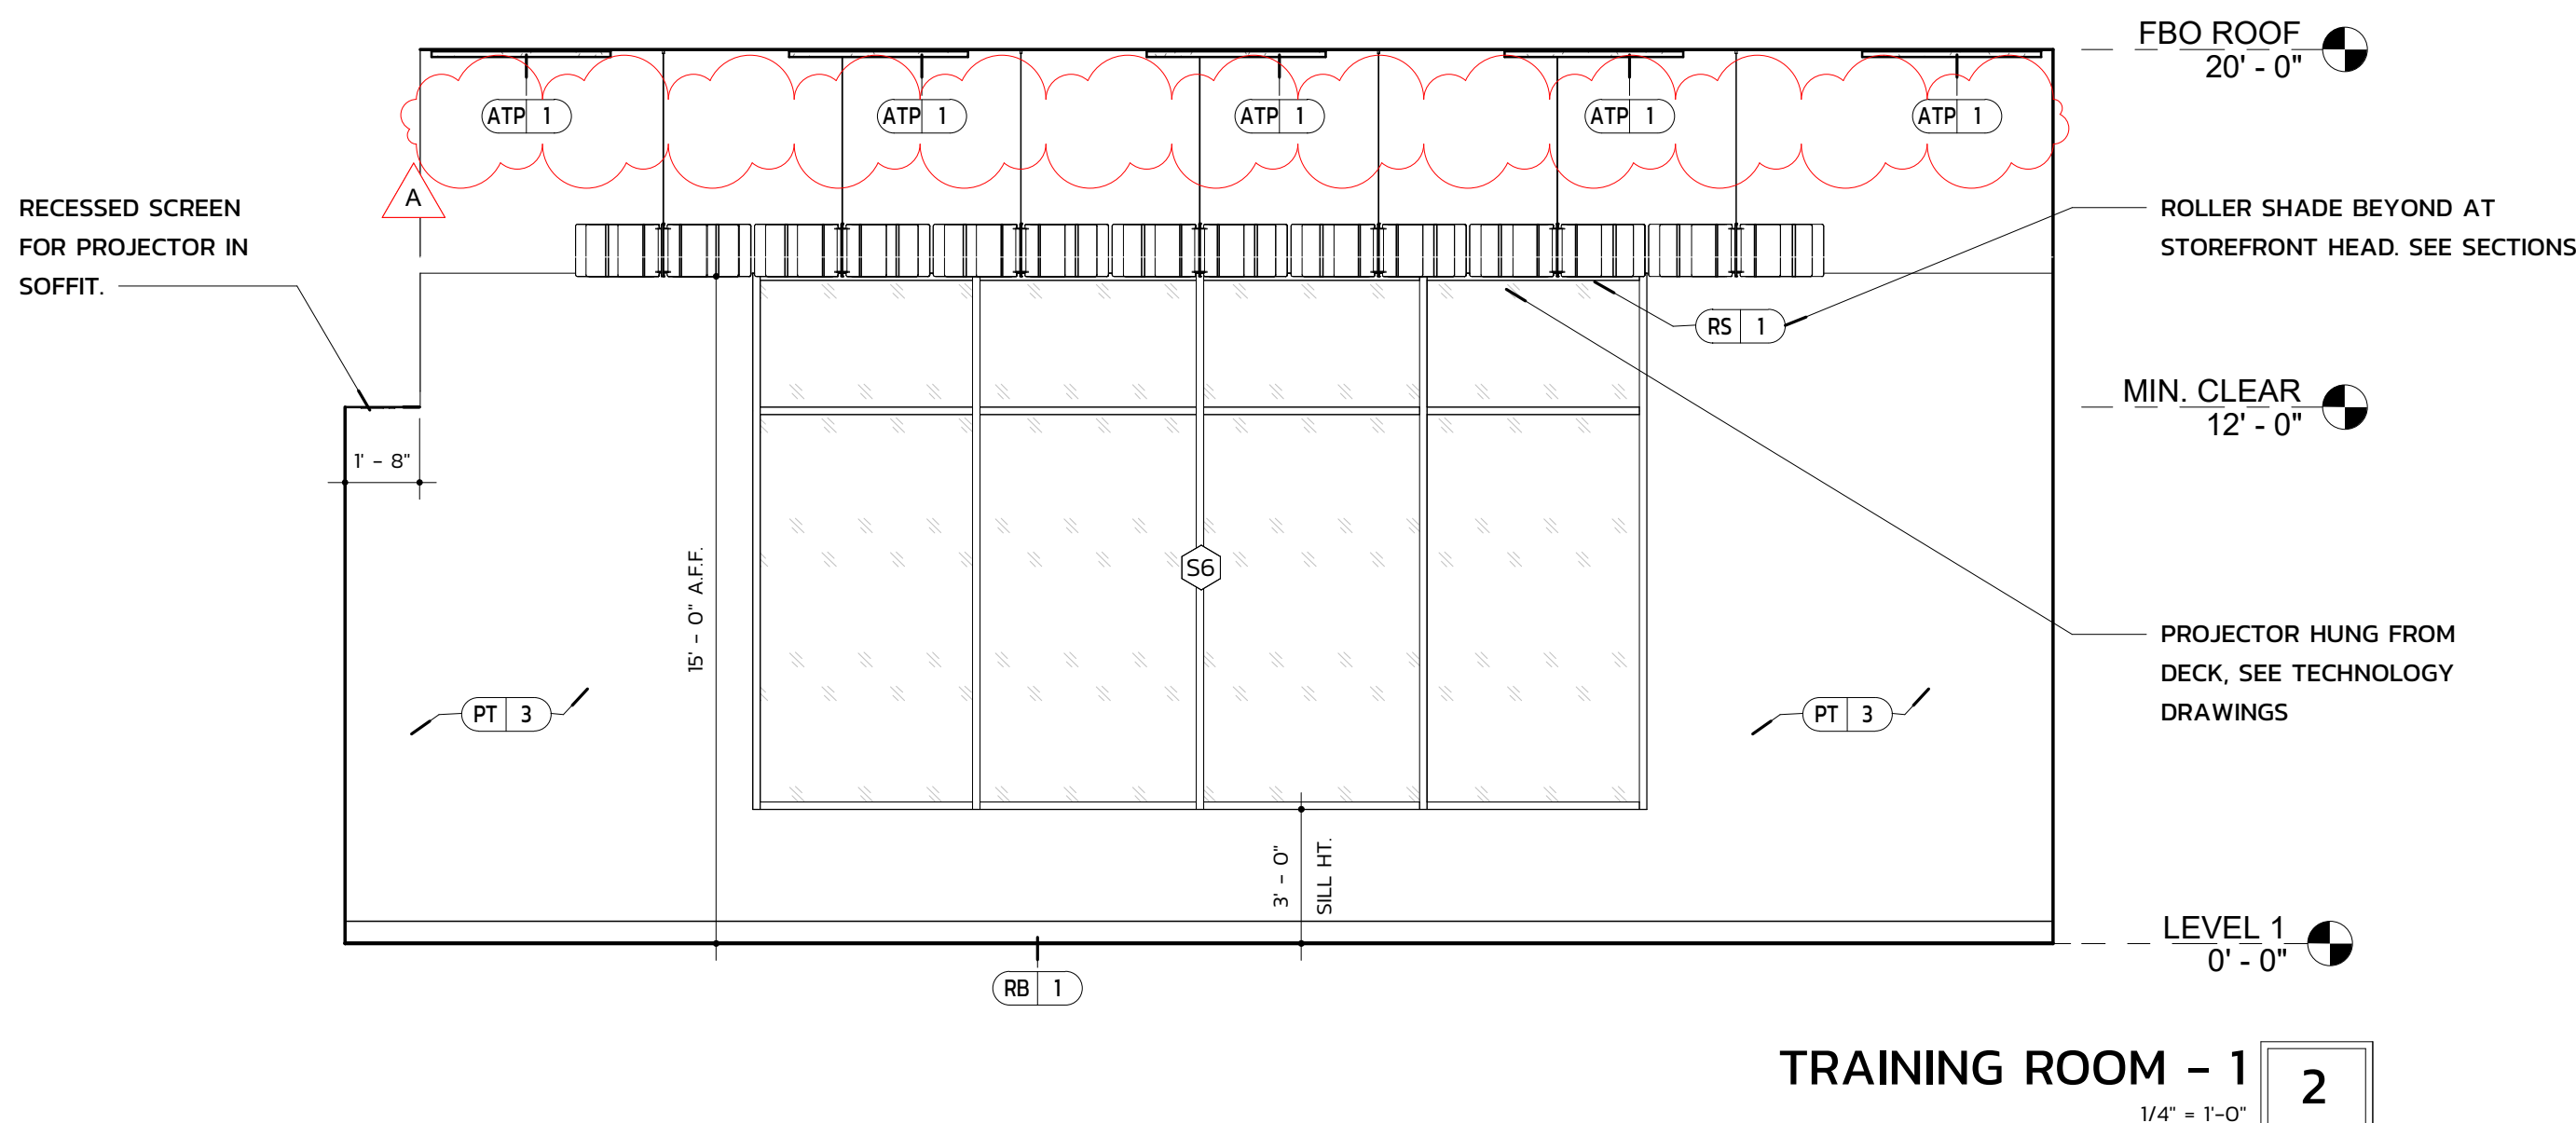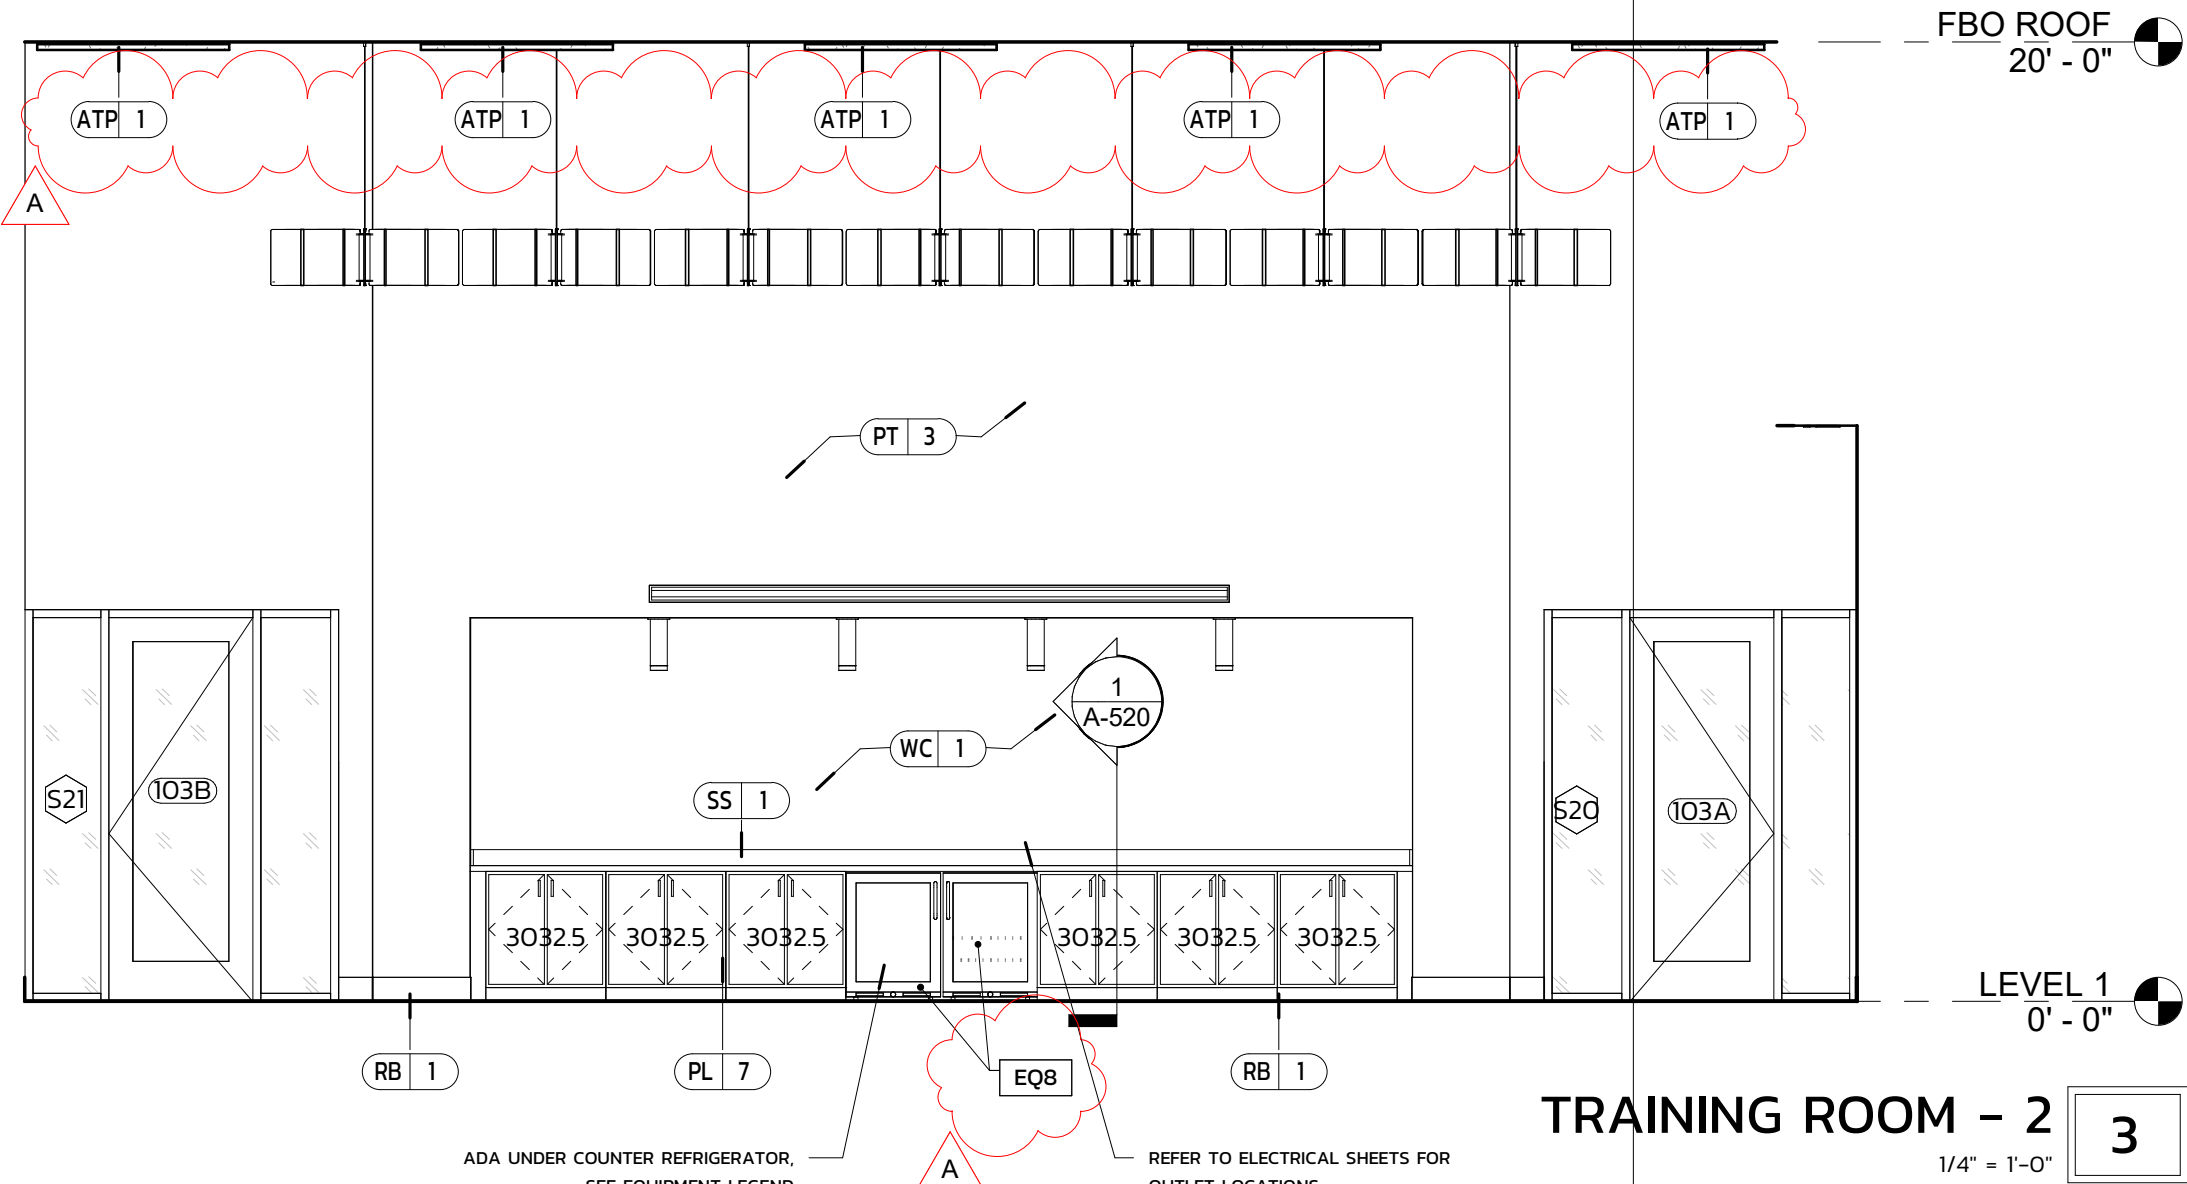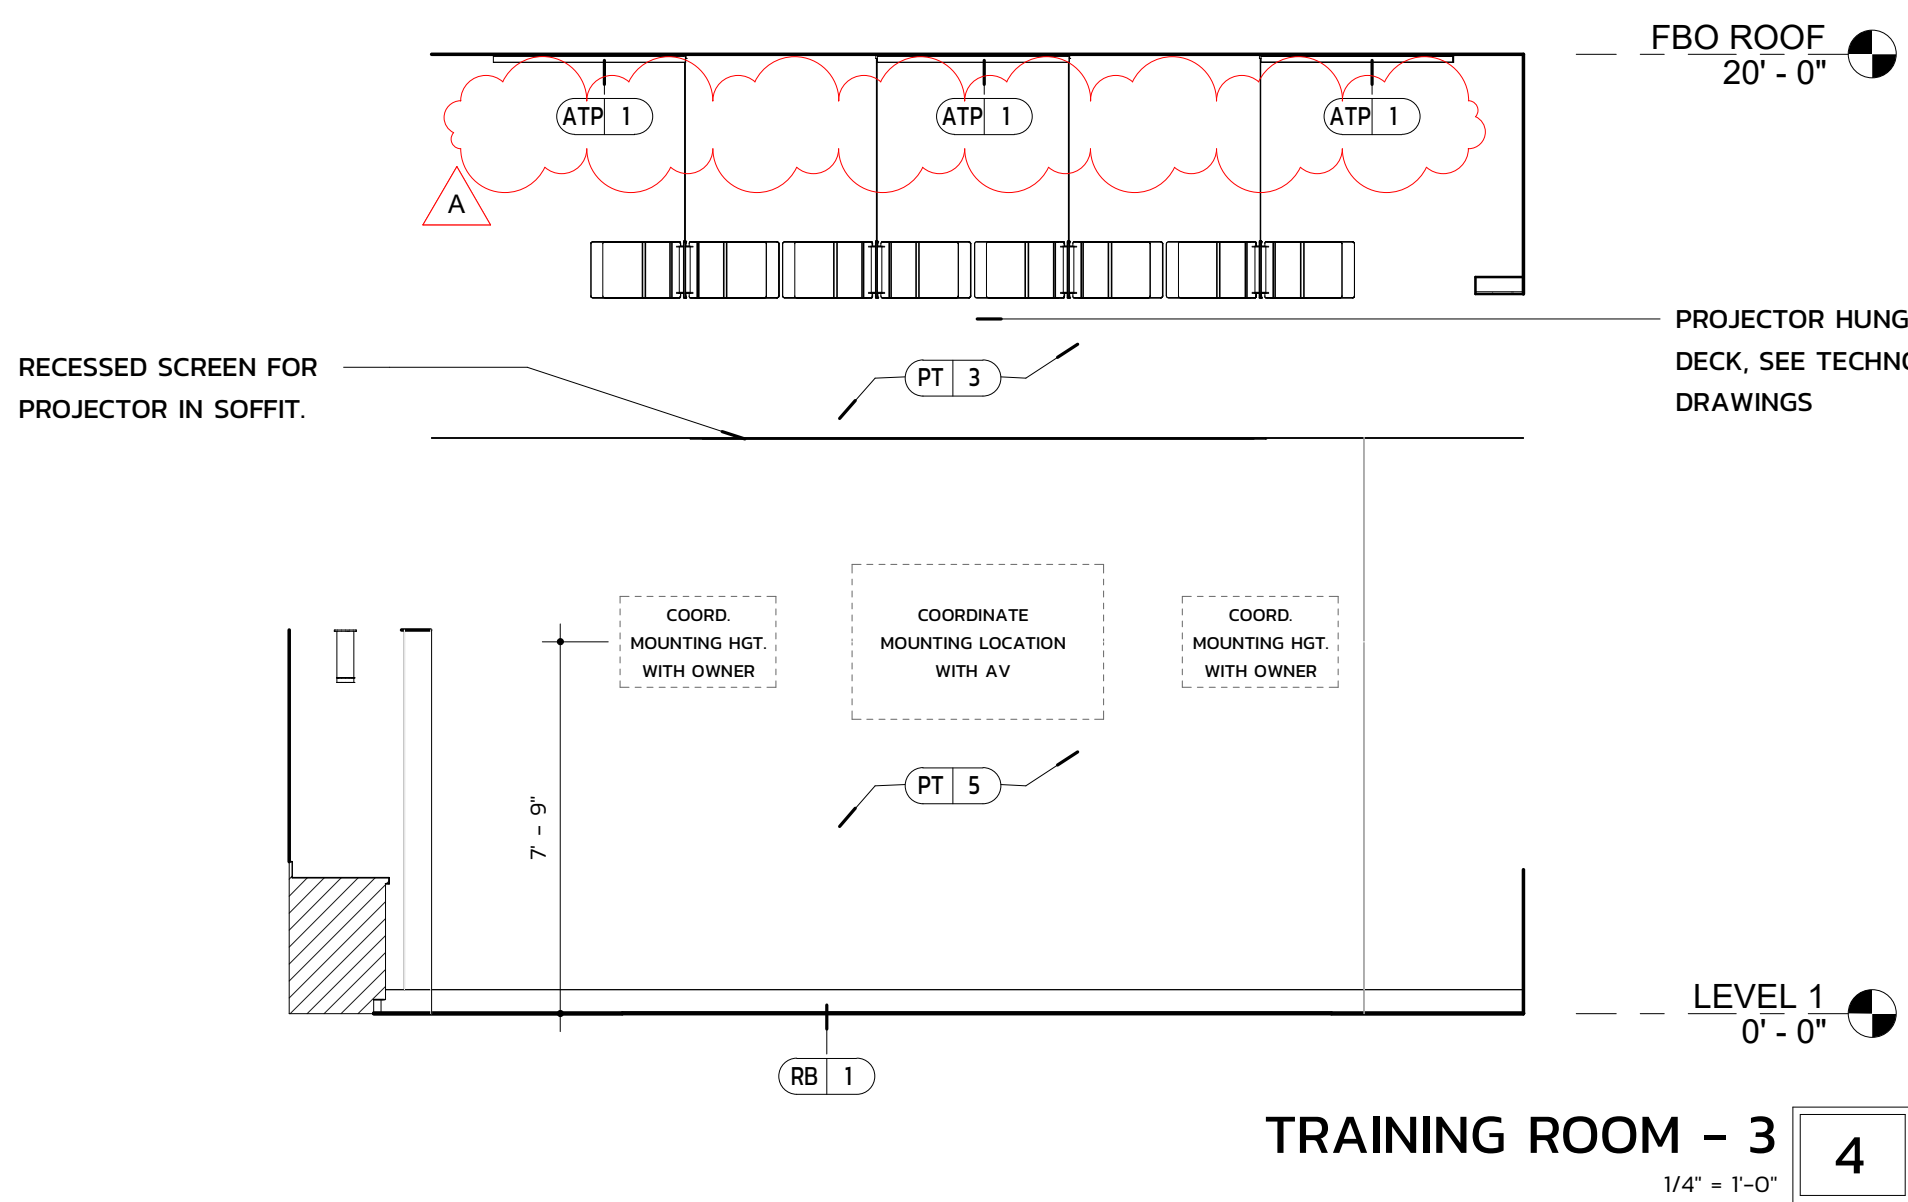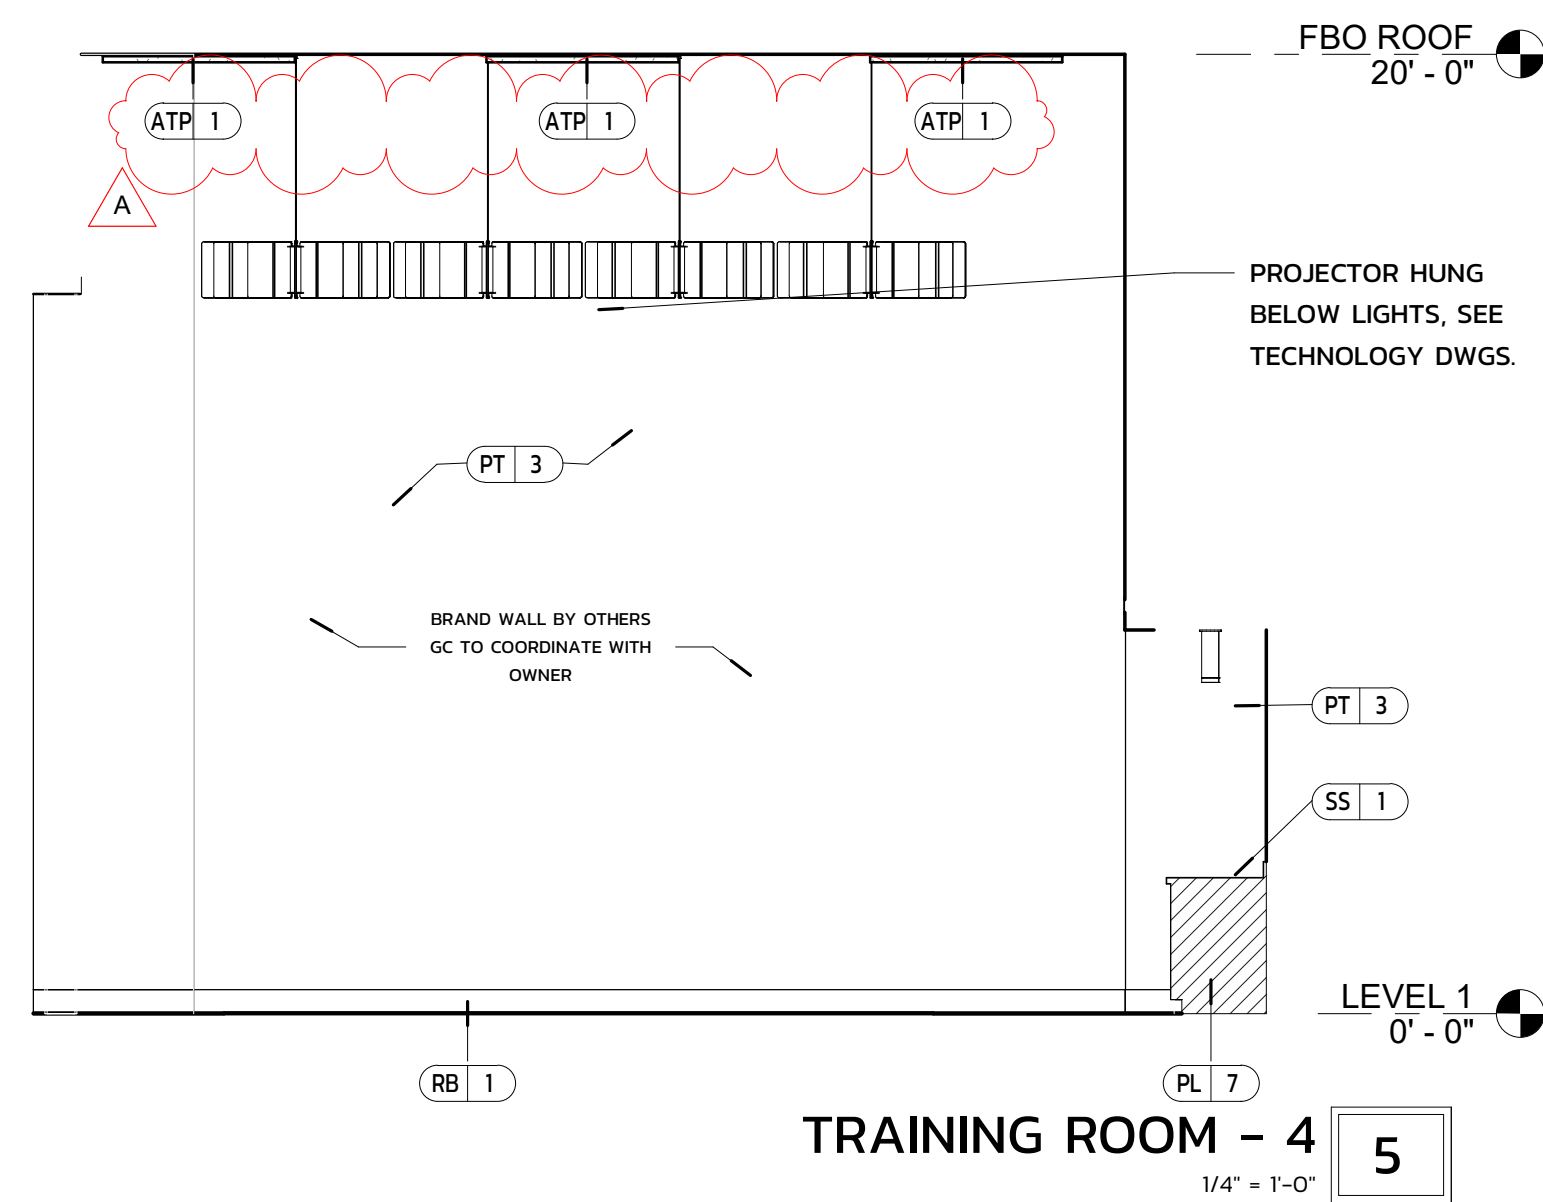


ENLARGED FLOOR PLAN - TRAINING ROOM

1

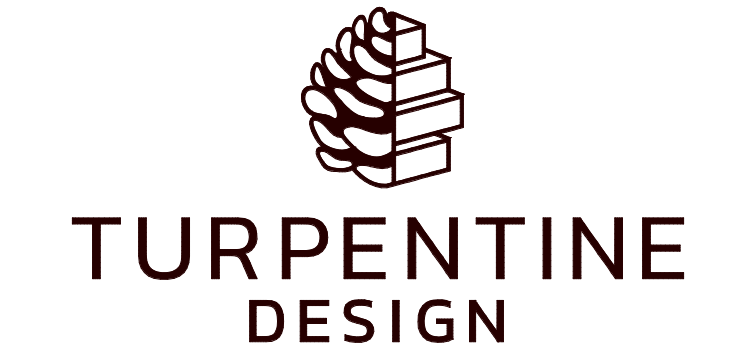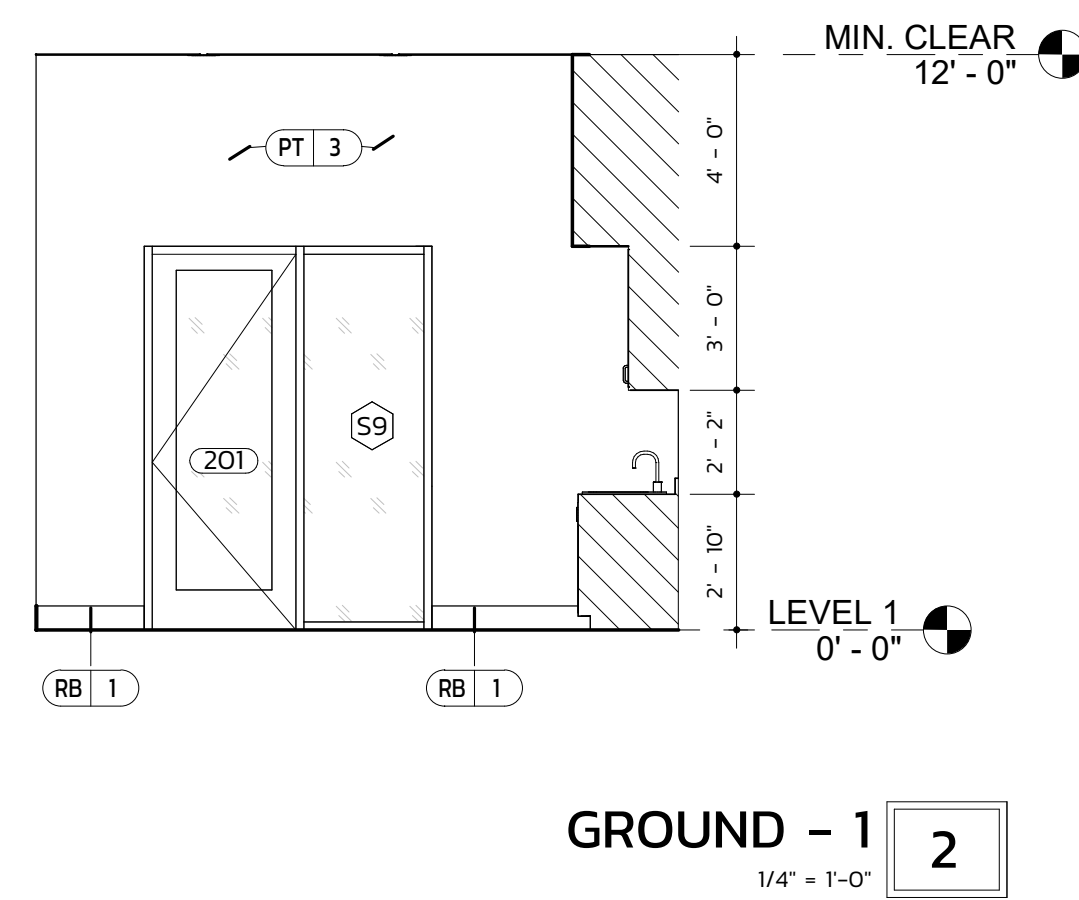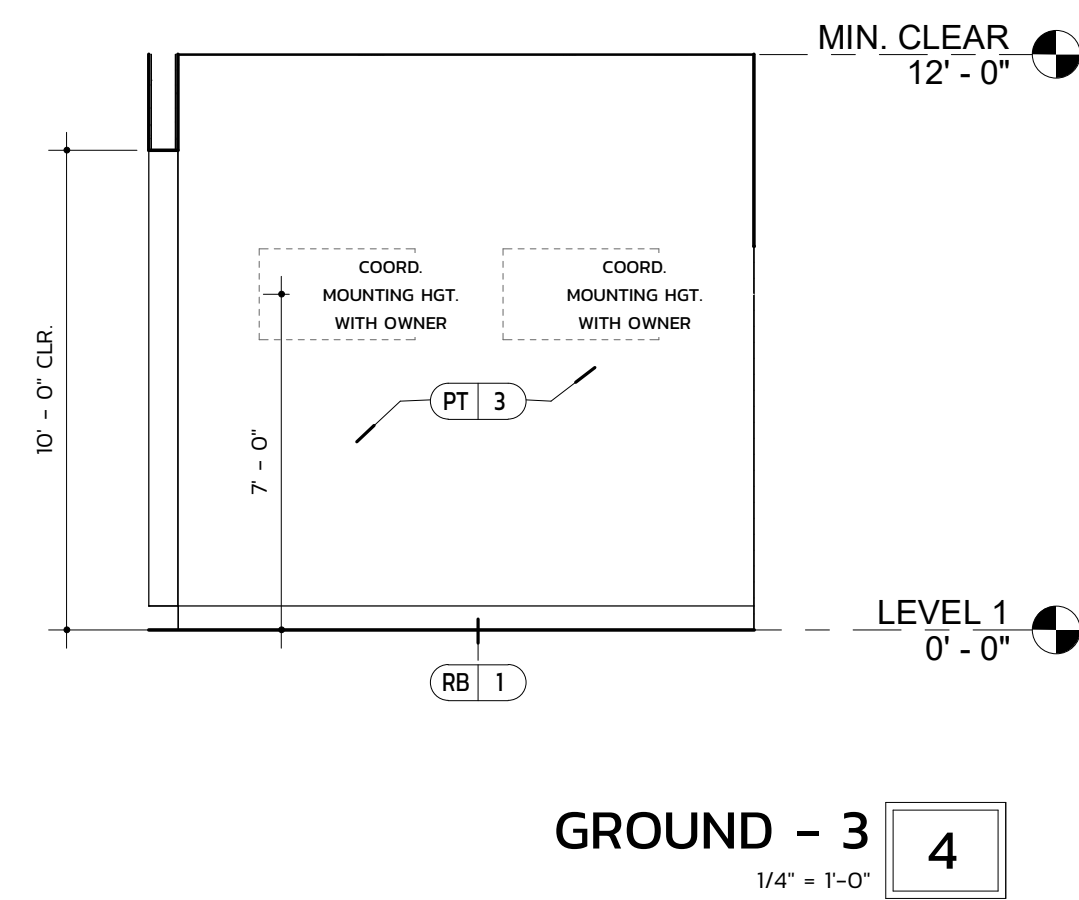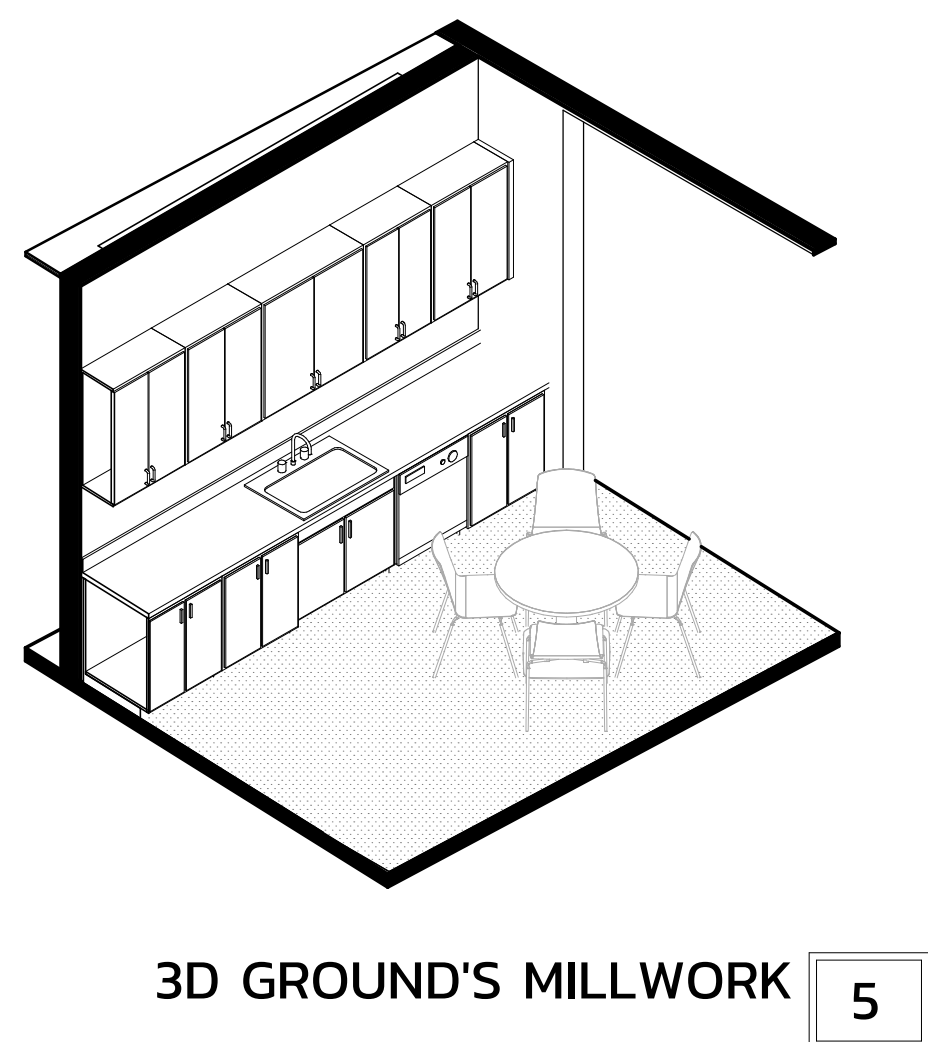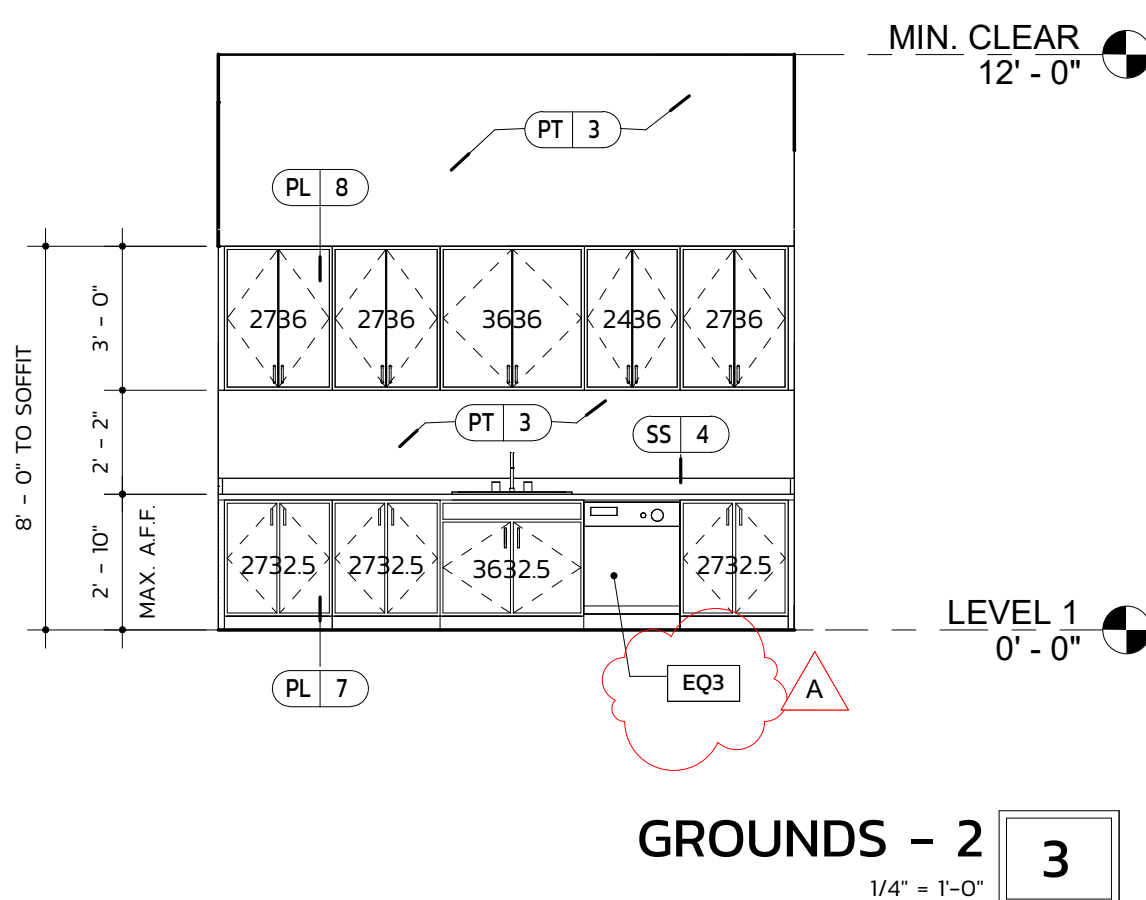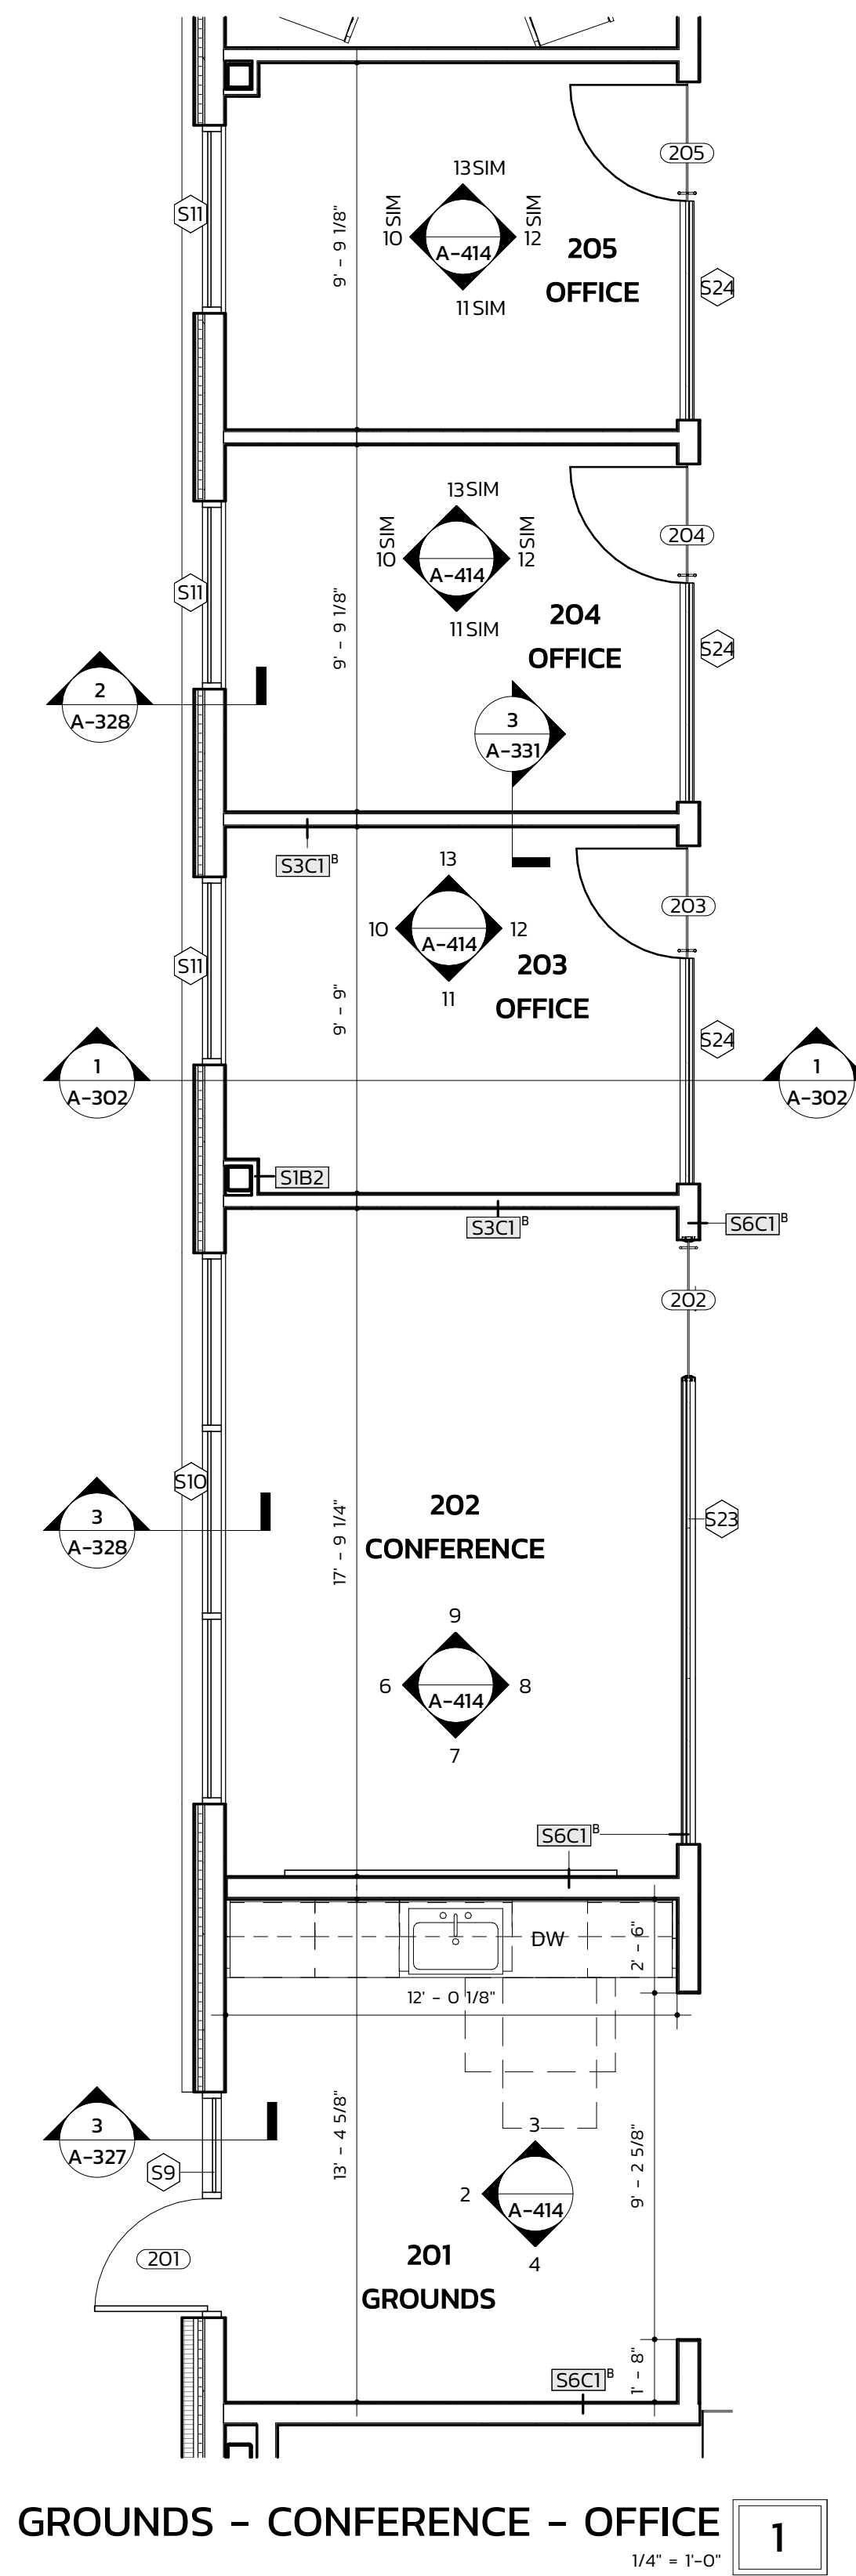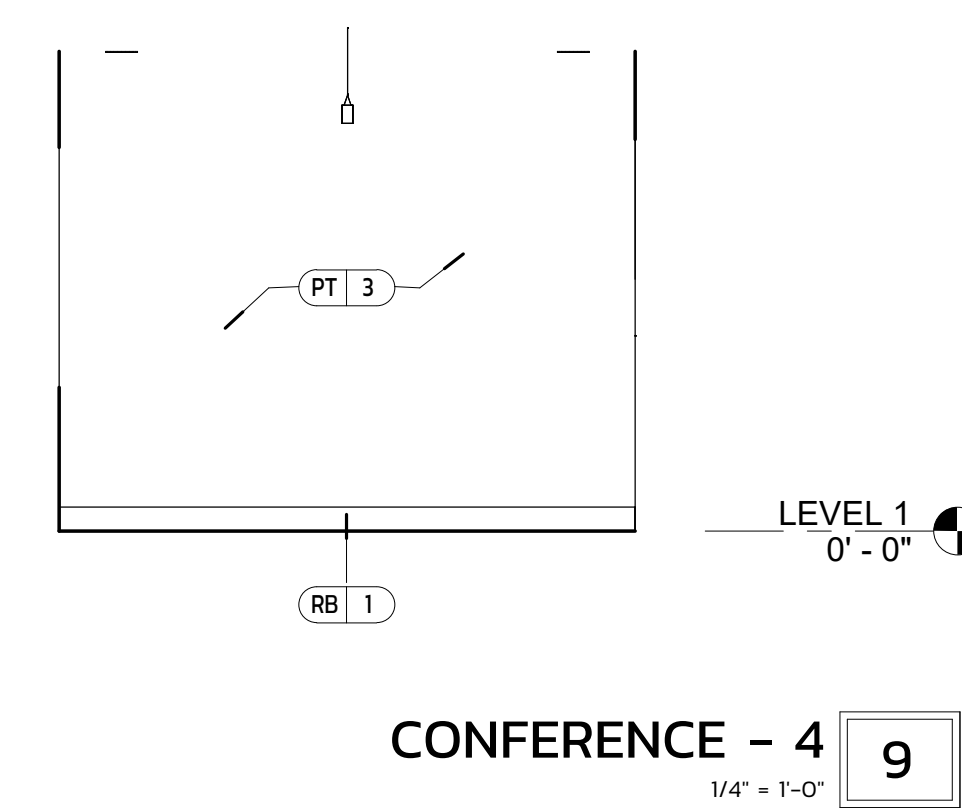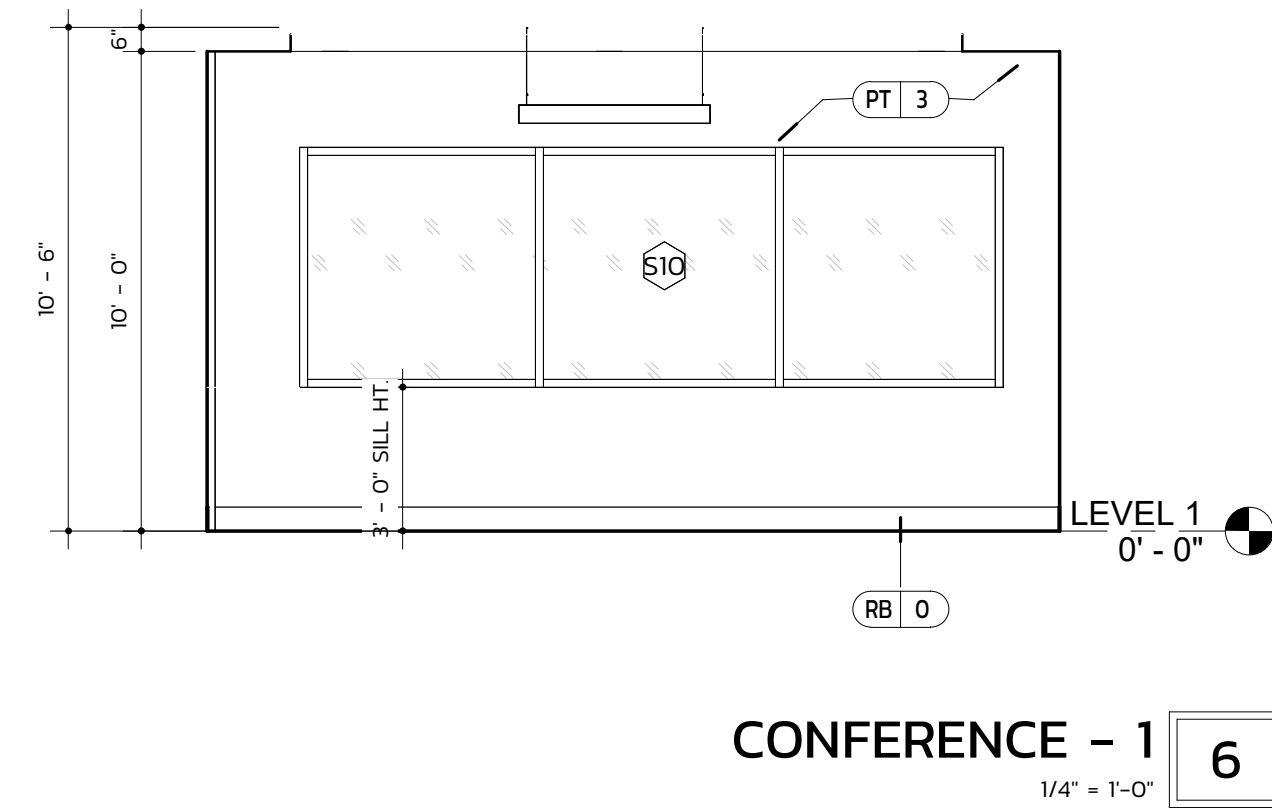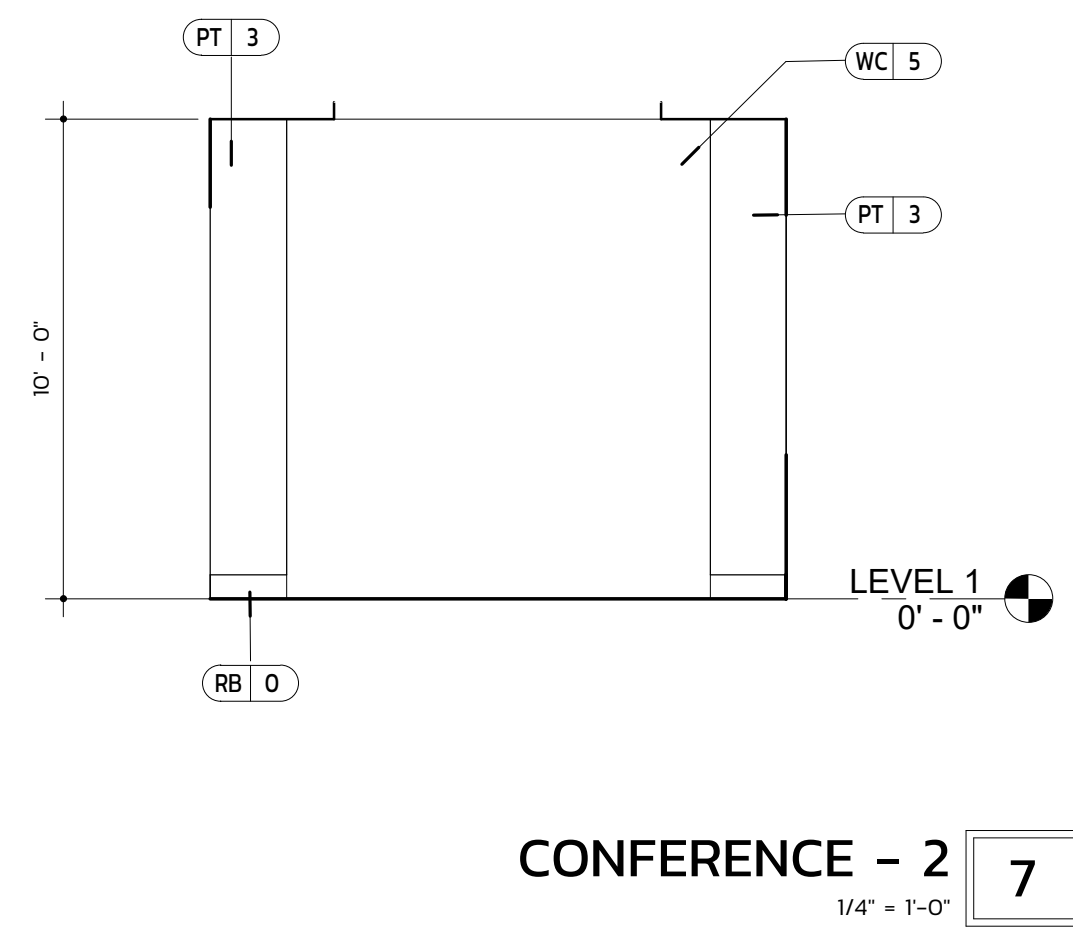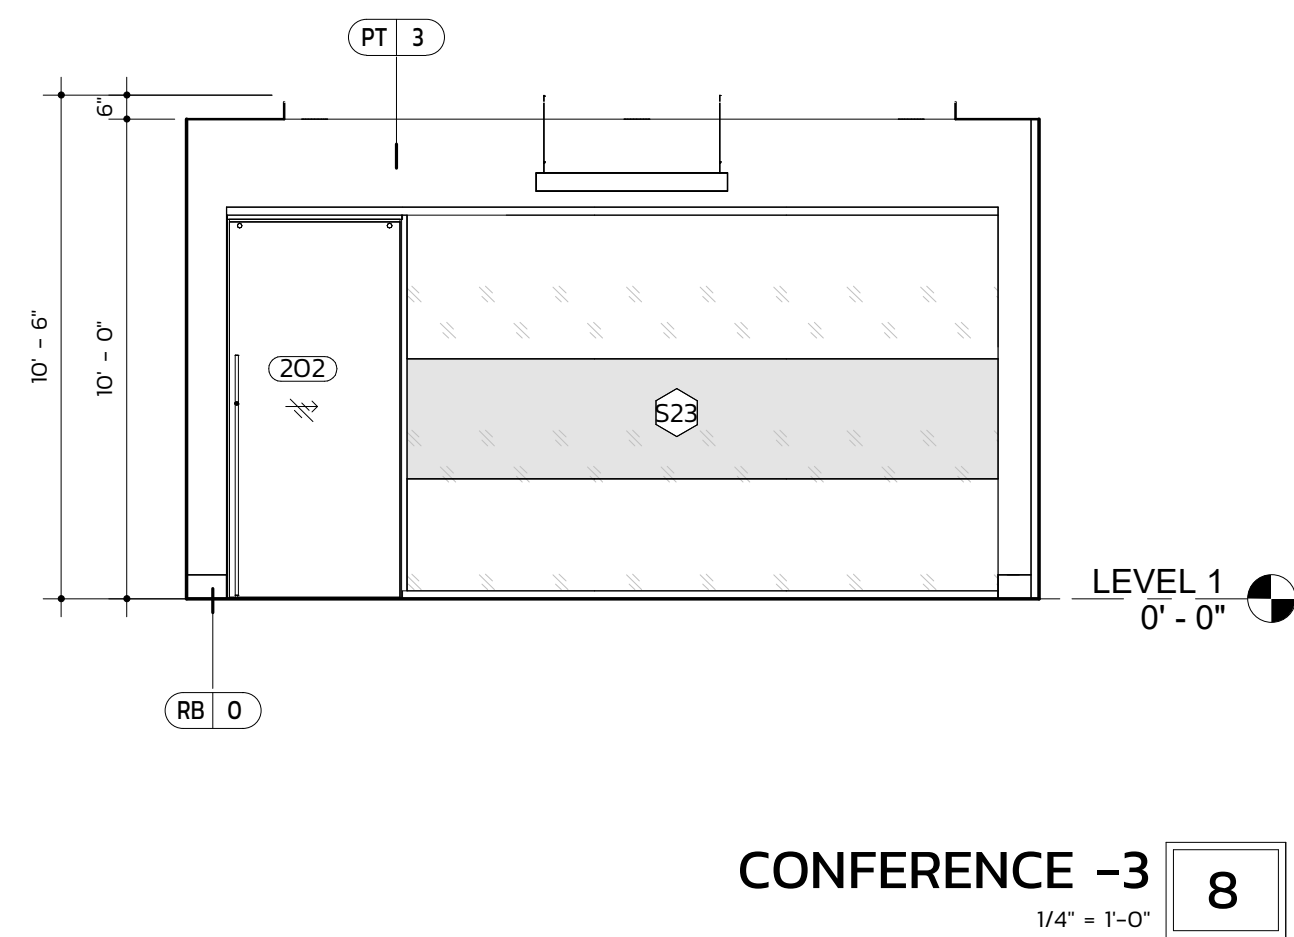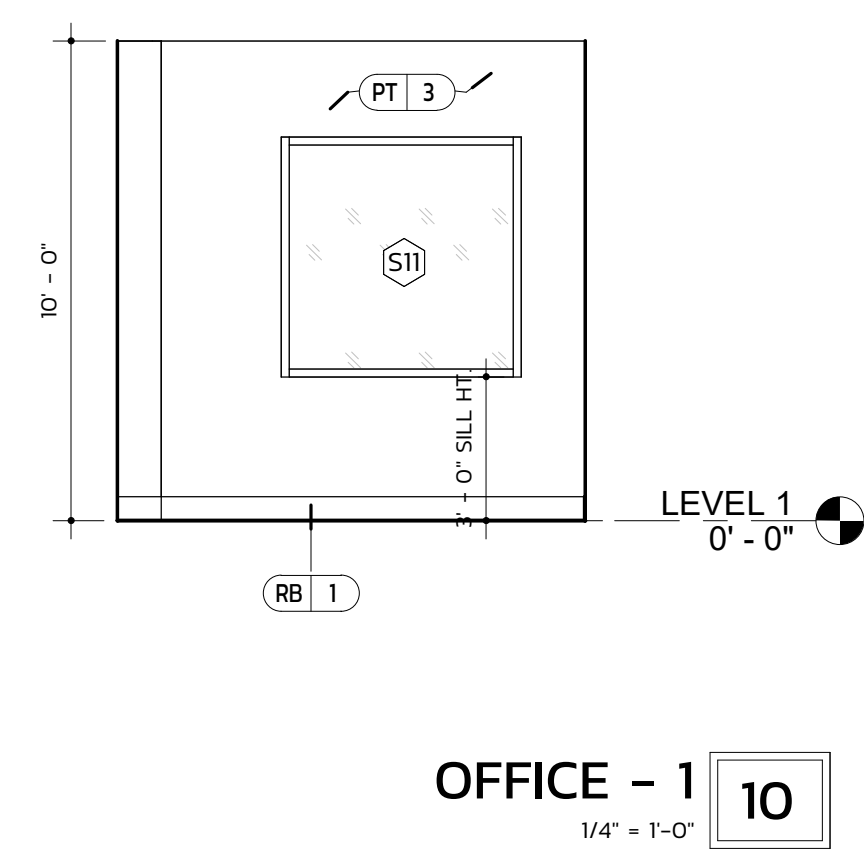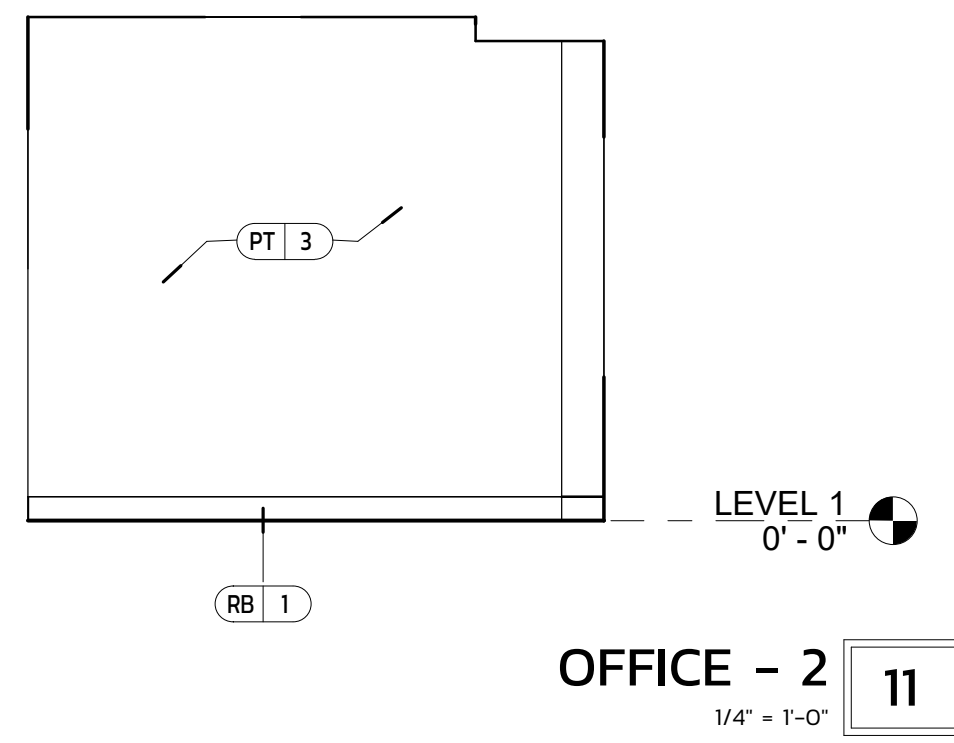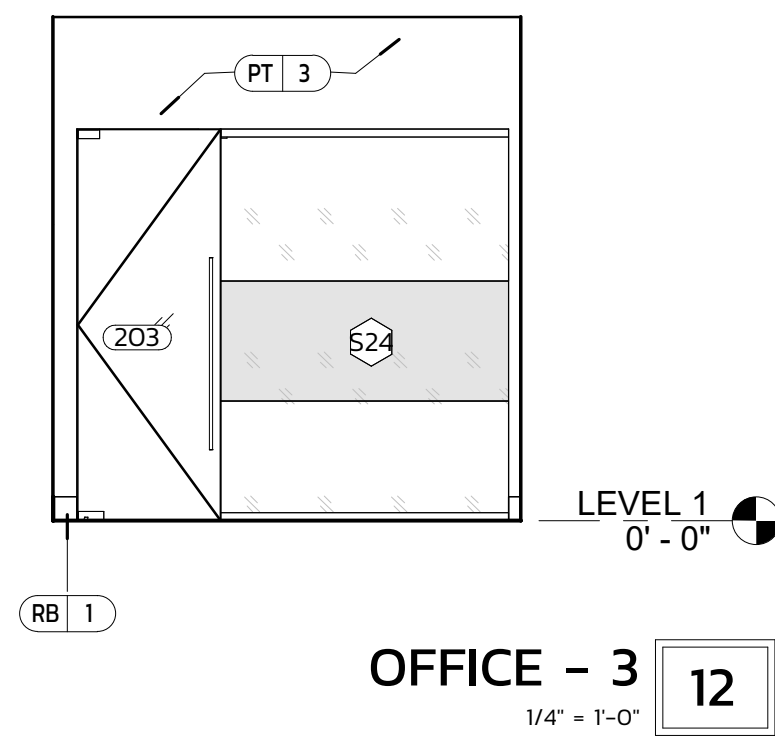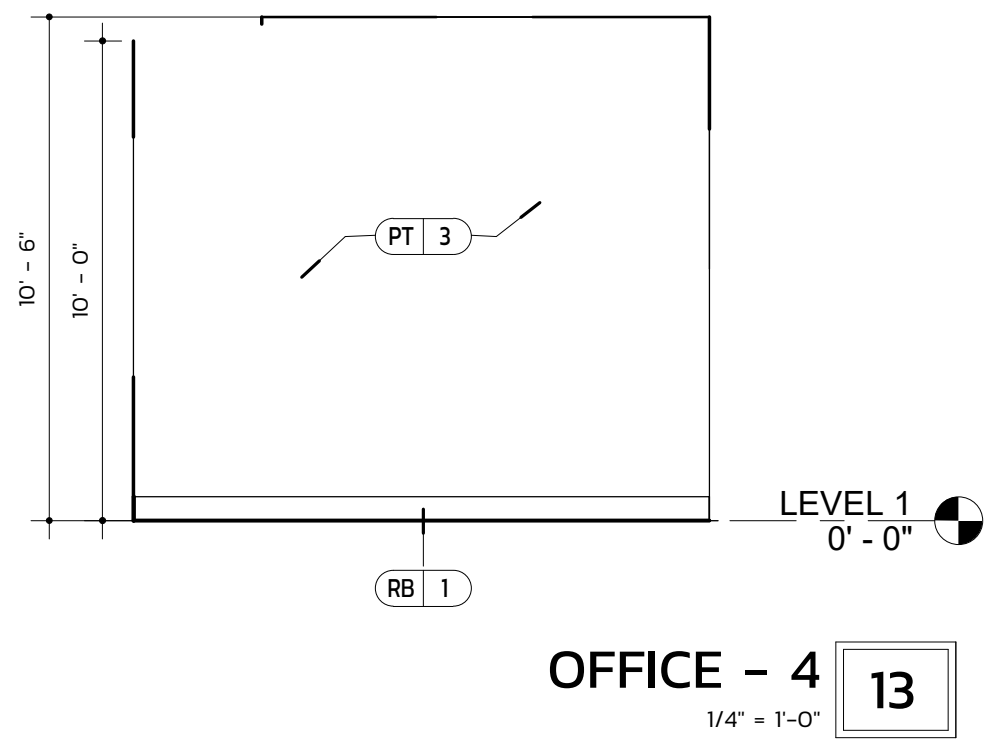

1007 Procure Street
Fuquay-Varina, NC 27526
919.412.9138
turpentine-design.com

REVISIONS		
A	PRICING REV	Date 1 July 1, 2026

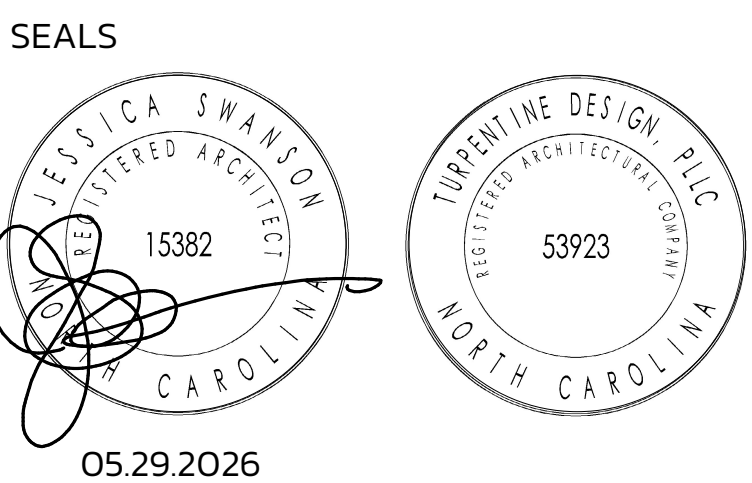

ARQ AVIATION
FLIGHT SCHOOL + FBO

Wilmington International Airport (ILM)
Wilmington, NC 28405


OWNER
ARQ Realty

COPYRIGHT 2025 - ALL RIGHTS RESERVED
PRINTED OR ELECTRONIC DRAWINGS & DOCUMENTATION MAY
NOT BE REPRODUCED OR REDISTRIBUTED IN ANY WAY WITHOUT
WRITTEN PERMISSION FROM TURPENTINE DESIGN

PHASE PERMIT SET
DATE 05.29.2026
TD PROJECT # 25-009

DRAWING TITLE
ENLARGED PLAN +
ELEVATIONS -
GROUNDS, CONF.,
OFFICE

DRAWING NUMBER
A-414



TURPENTINE
DESIGN


1007 Procure Street
Fuquay-Varina, NC 27526

919.412.9138
turpentine-design.com

REVISIONS

A PRICING REV Date 1 July 1, 2026

SEALS

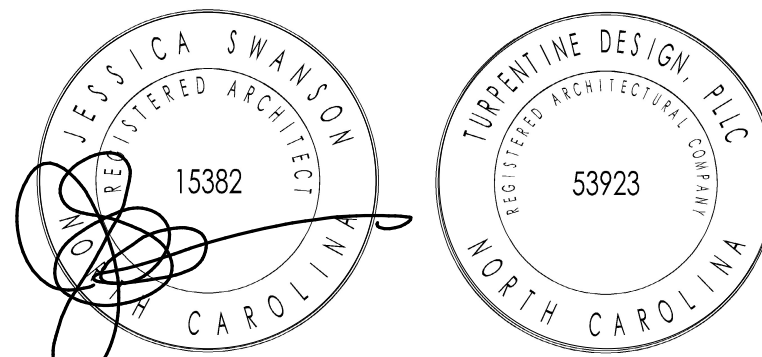

05.29.2026

ARQ AVIATION

FLIGHT SCHOOL + FBO

Wilmington International Airport (ILM)
Wilmington, NC 28405

OWNER
ARQ Realty

COPYRIGHT 2025 - ALL RIGHTS RESERVED
PRINTED OR ELECTRONIC DRAWINGS & DOCUMENTATION MAY
NOT BE REPRODUCED OR REDISTRIBUTED IN ANY WAY WITHOUT
WRITTEN PERMISSION FROM TURPENTINE DESIGN


PHASE PERMIT SET
DATE 05.29.2026
TD PROJECT # 25-009

DRAWING TITLE

ENLARGED PLAN +
ELEVATIONS - LINE
SERVICE AREA

DRAWING NUMBER


A-415

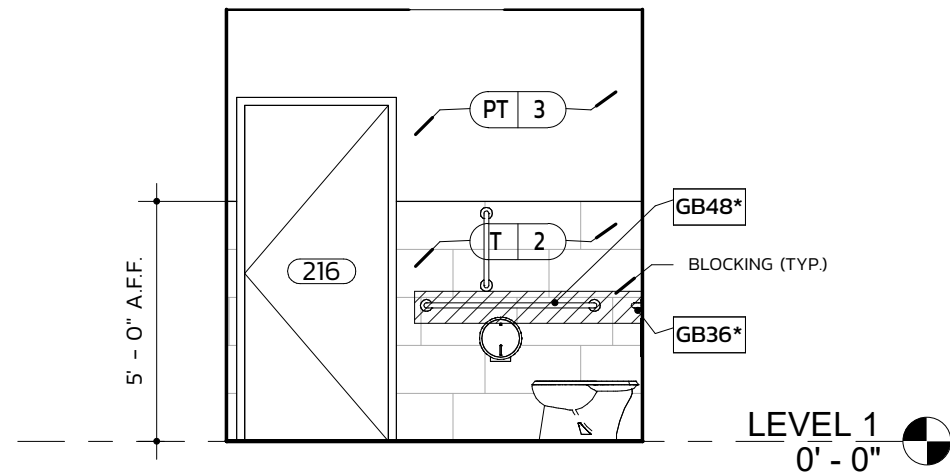

WASHROOM - 4

1/4" = 1'-0"


12

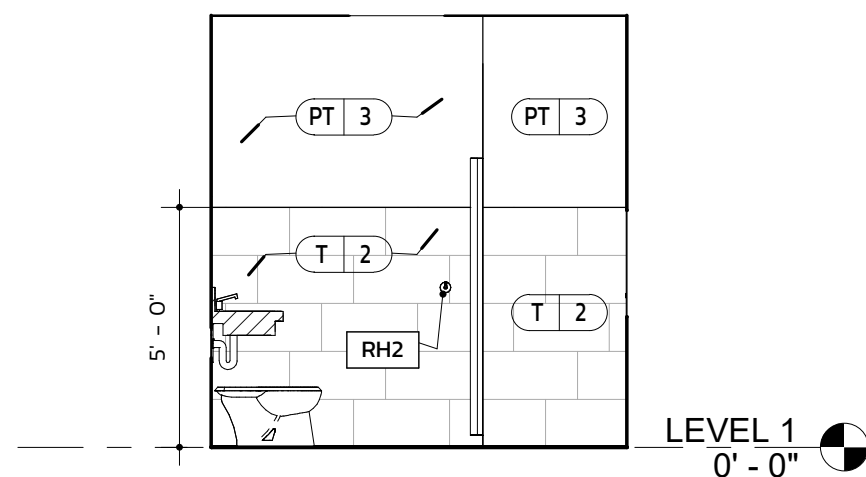

WASHROOM - 1

1/4" = 1'-0"


9

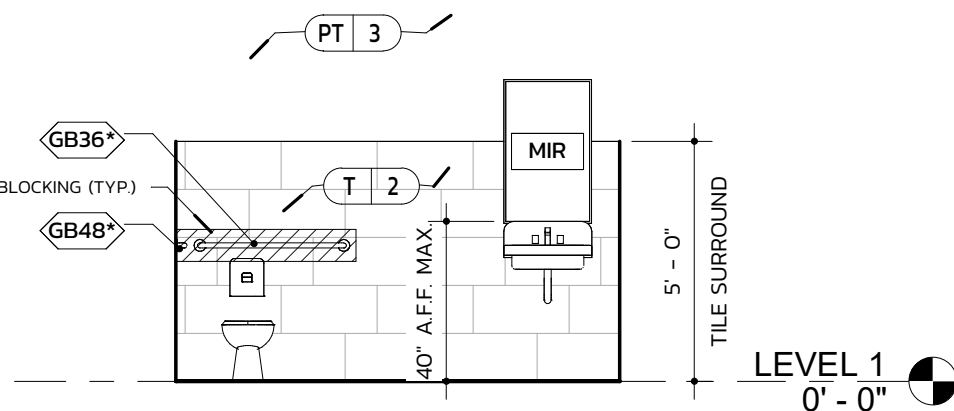

WASHROOM - 2

1/4" = 1'-0"


10

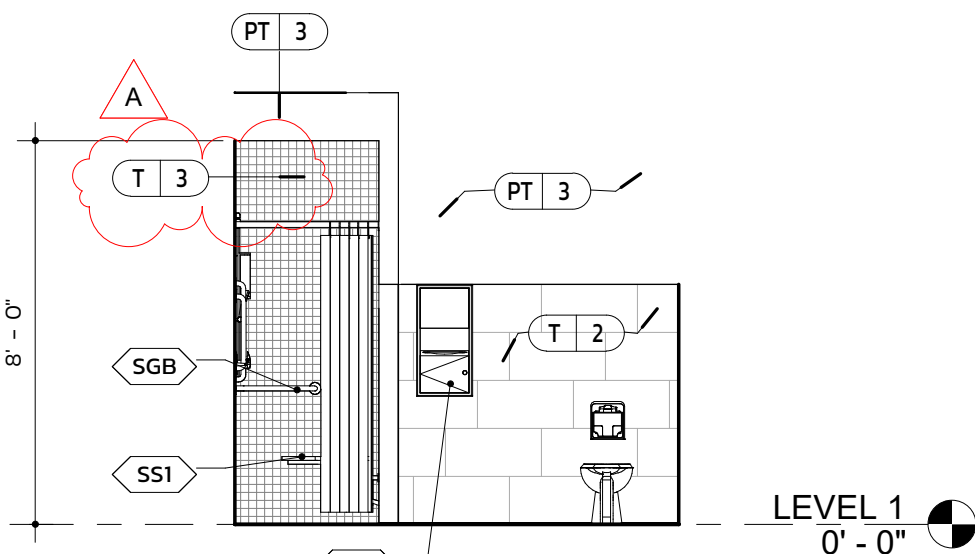

WASHROOM - 3

1/4" = 1'-0"


11

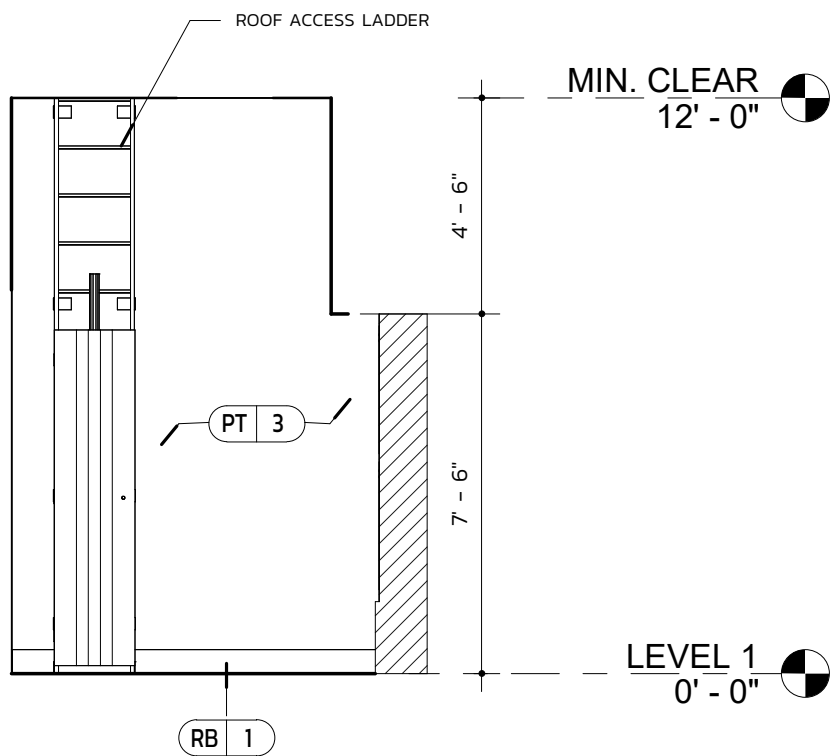

LOCKERS - 3

1/4" = 1'-0"


8

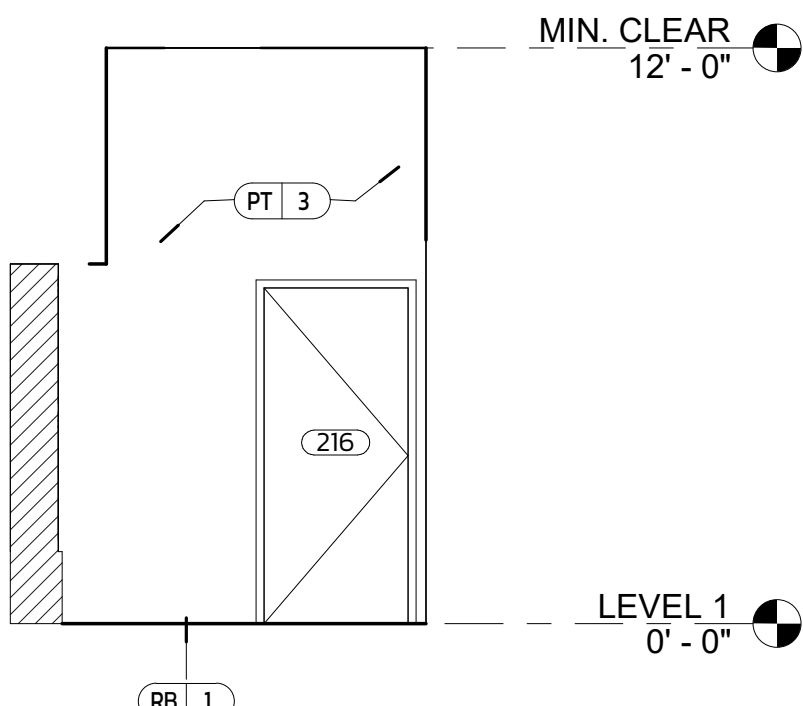

LOCKERS - 2

1/4" = 1'-0"


7

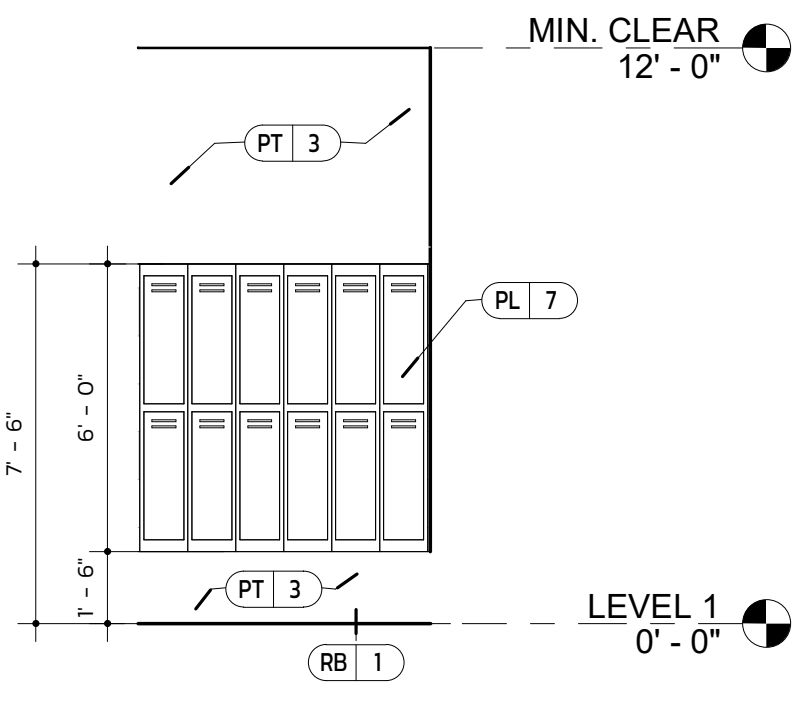

LOCKERS - 1

1/4" = 1'-0"


6

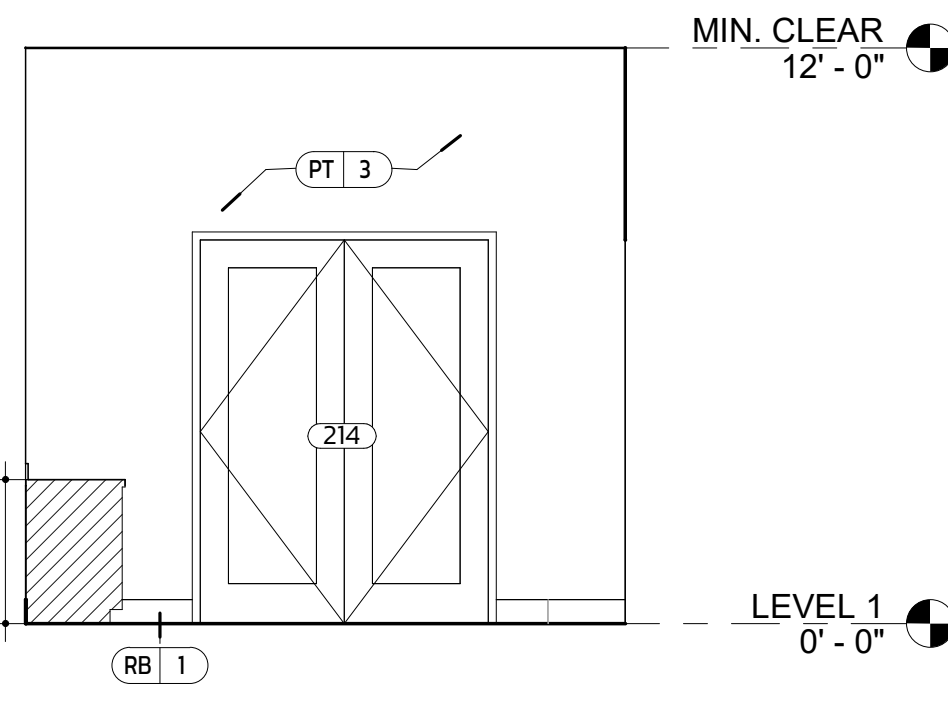

LINE SERVICE - 4

1/4" = 1'-0"


5

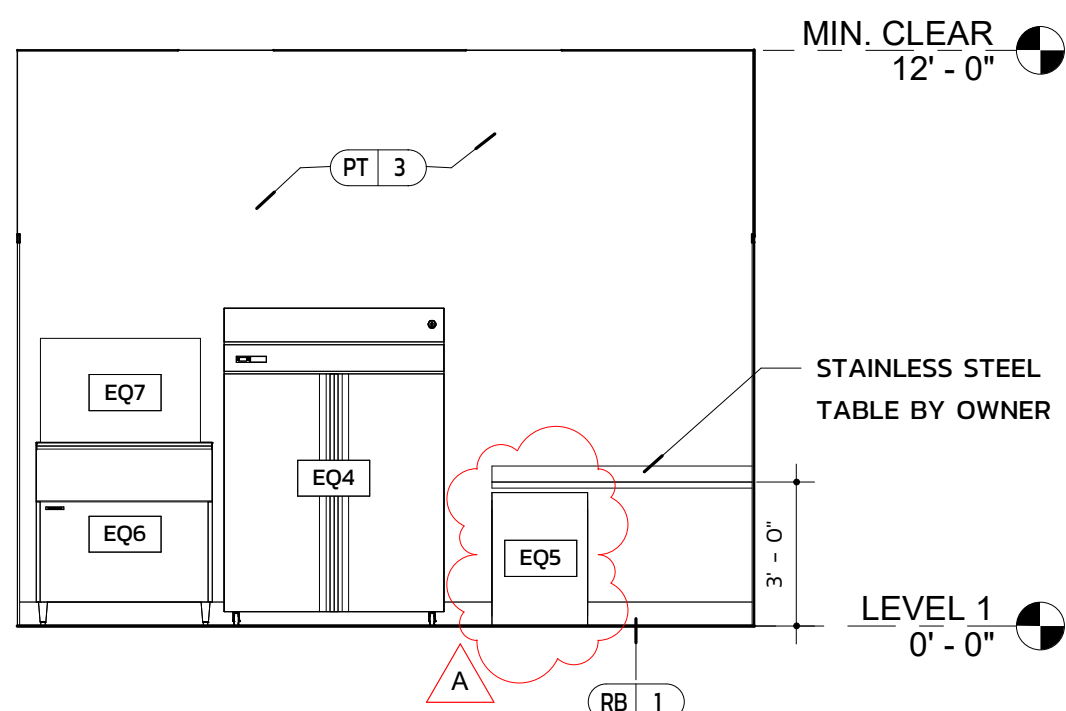

LINE SERVICE - 3

1/4" = 1'-0"


4

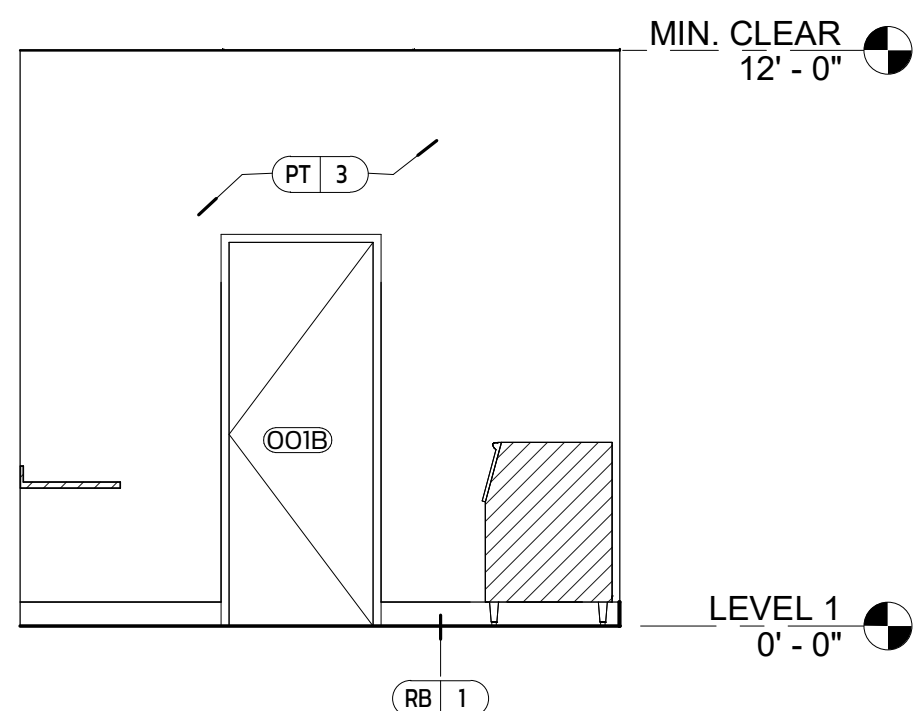

LINE SERVICE - 2

1/4" = 1'-0"


3

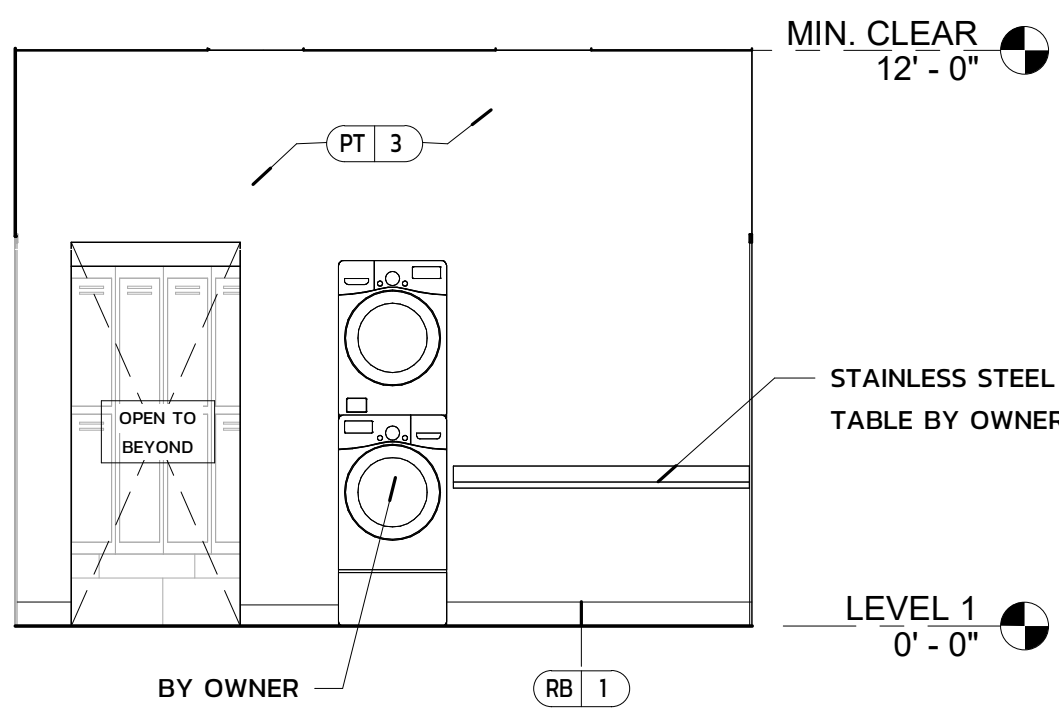

LINE SERVICE - 1

1/4" = 1'-0"

2

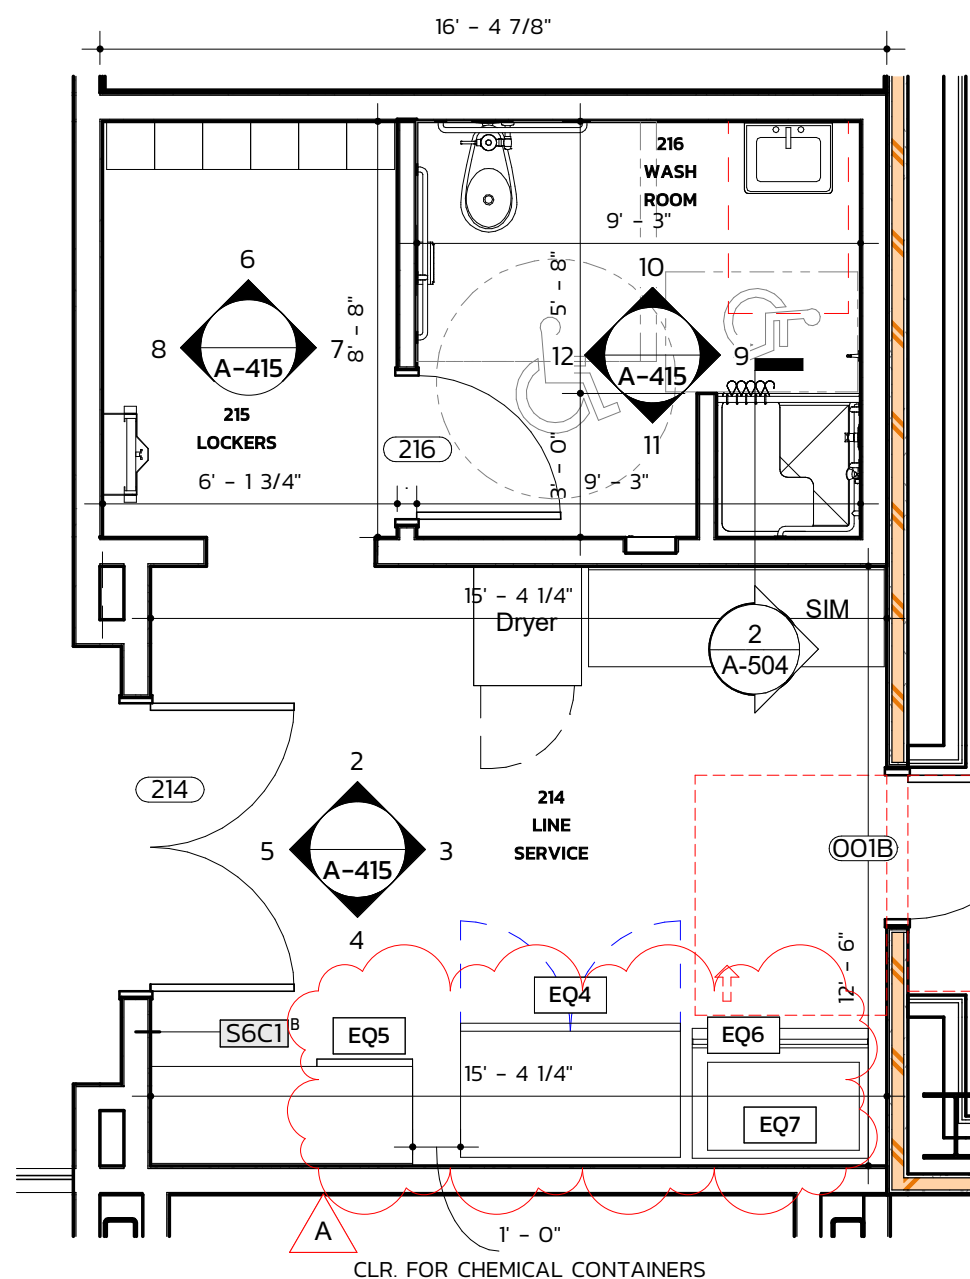

LINE SERVICE AREA


1/4" = 1'-0"

1


COMMERCIAL DOOR SCHEDULE											
DOOR #	ROOM	DOOR TYPE	HEIGHT	WIDTH	THICKNESS	DOOR MATERIAL	FRAME TYPE	FRAME MATERIAL	FIRE RATING	HARDWARE SET	COMMENTS
000A	HANGAR	FNG	8'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	1	
000B	JAM SERVICE	FG	8'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	1	
000C	HANGAR	F	8'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	1	
000D	HANGAR	F	8'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	1	
100A	MAIN ENTRY	F	7'-8"	14'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	2	
100B	VEHICULAR ENTRY		7'-8"	14'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	2	
100C	RAM ENTRY		7'-8"	14'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	2	
102	PILOTS LOUNGE	F	8'-0"	6'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	4	HORTON HD STORM - LEVEL E - SLIDING DOOR WITH PANIC
1021	PL QUIET ROOM	F	8'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	4	HORTON HD STORM - LEVEL E - SLIDING DOOR WITH PANIC
1022	PL STORAGE ROOM	F	8'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	4	HORTON HD STORM - LEVEL E - SLIDING DOOR WITH PANIC
103A	TRAINING ROOM	FG	8'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	7	
103B	TRAINING ROOM	FG	8'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	8	
104	MEAS RESTROOM	F	8'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	10	
105	WOMEN'S RESTROOM	F	8'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	10	
200A	ADMIN CORRIDOR	FG	8'-2"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	11	
200B	ADMIN CORRIDOR	FG	8'-2"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	11	
201	DRINKING	FG	7'-10"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	12	
202	CONFERENCE	FG	8'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	13	
203	OFFICE	FG	8'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	14	
204	OFFICE	FG	8'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	14	
205	OFFICE	FG	8'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	14	
206	C-SUITE OFFICE	FG	8'-2"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	14	
207	C-SUITE OFFICE	FG	8'-2"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	14	
208	RR	F	7'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	10	
209	RR	F	7'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	10	
210	RR	F	7'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	10	
211	RR	F	7'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	10	
212	IT	FG	8'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	16	
214	JAM SERVICE	FG	8'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	16	
216	WASHROOM	F	7'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	17	
300	TRAINING CORRIDOR	FG	8'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	18	
301	MED-SM	F	7'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	19	
302	MED-SM	F	7'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	19	
303	SM	F	7'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	19	
304	JANITOR	F	7'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	7	
305	SM	F	7'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	19	
306A	LARGE SH	F	7'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	19	
306B	LARGE SH	F	7'-0"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	19	
307	DEBREF	F	7'-10"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	13	
308	DEBREF	F	7'-10"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	13	
309	DEBREF	F	7'-10"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	13	
310	DEBREF	F	7'-10"	3'-0"	2" - 1 3/4"	HM	OI	HM	90 MIN	13	



FRAME TYPE ELEVATIONS

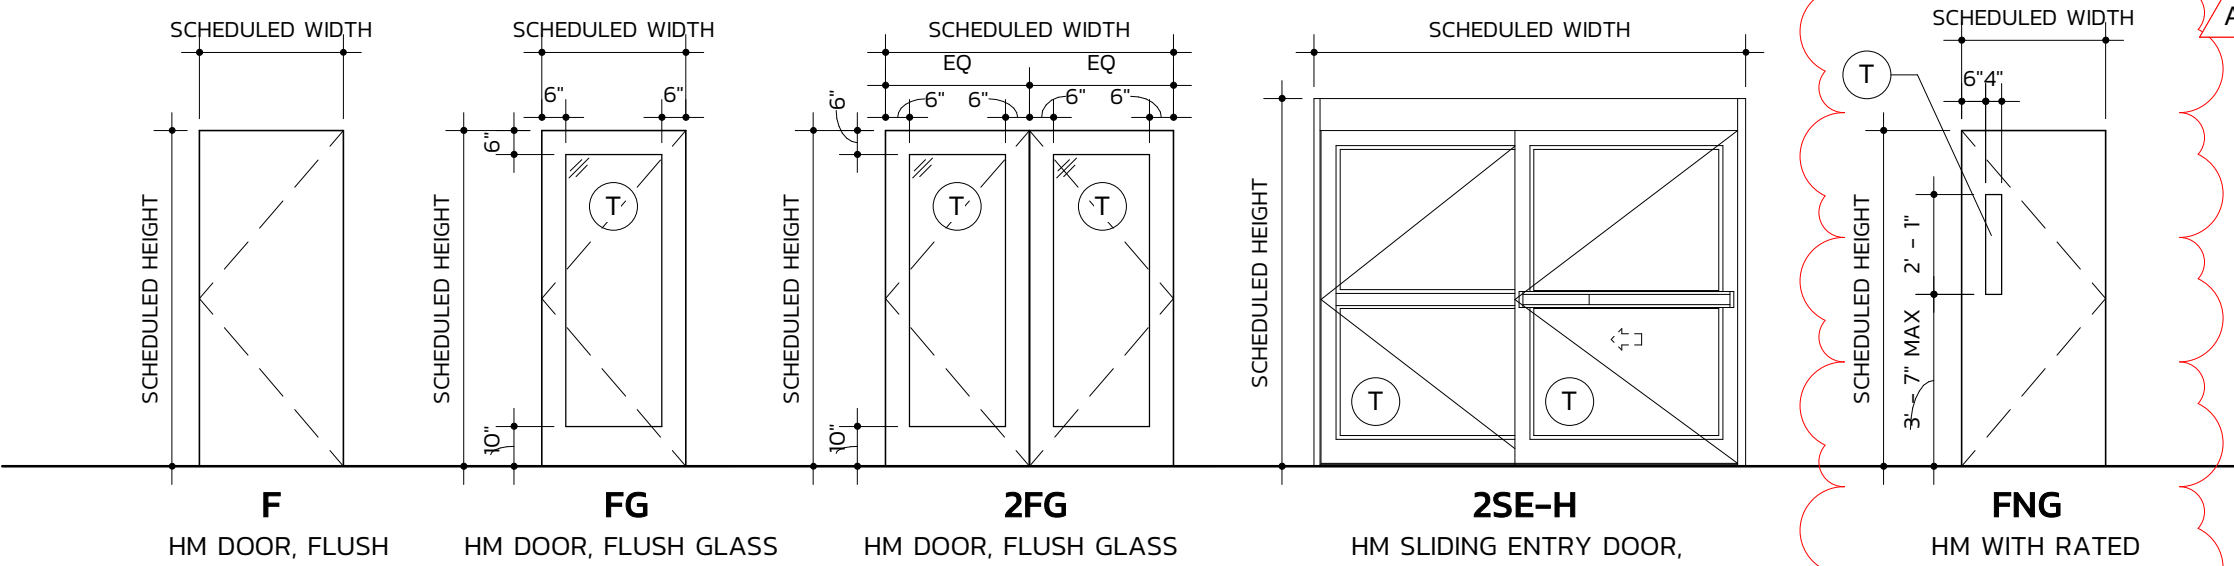

METAL DOOR TYPE ELEVATIONS

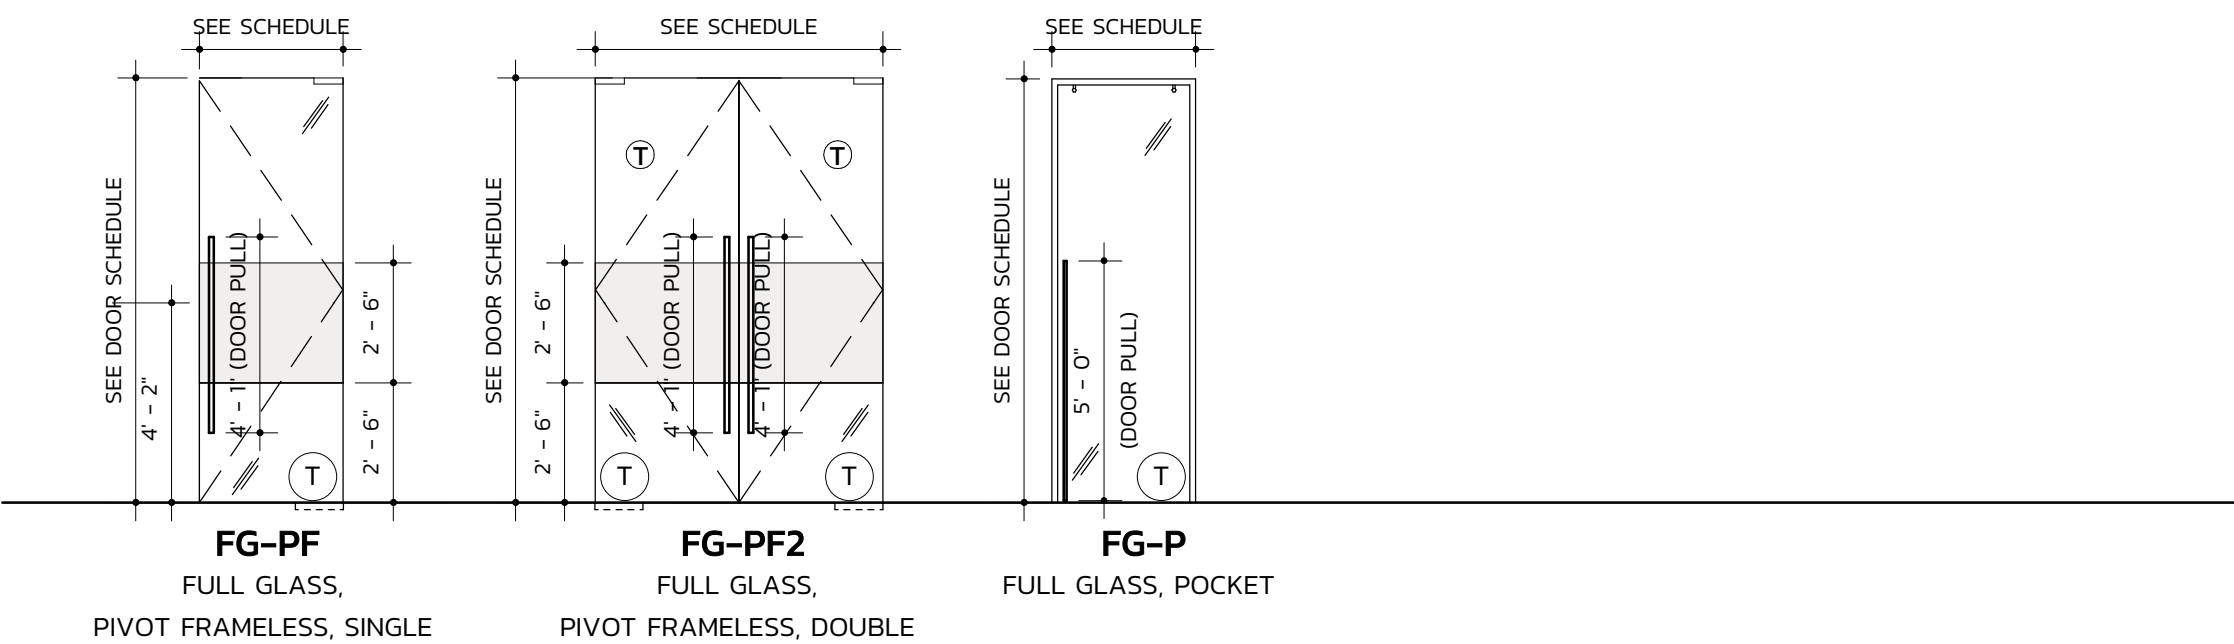

STOREFRONT DOOR TYPE ELEVATIONS



MISCELLANEOUS DOOR TYPE ELEVATIONS

HARDWARE GROUPS

NOTE: MASTER KEY ALL LOCKS AND EXITS. HARDWARE DISTRIBUTOR TO PROVIDE CORES/CYLINDERS AS NEEDED FOR STOREFRONT DOORS.

- RATED DOOR. PANIC HARDWARE, CARD READER, KICK PLATE, CLOSER.
- CYLINDER DEADBOLT W/ LEVER HANDLE. MASTER KEY.

- ENTRY SET, CLOSER, CARD READER. MASTER KEY.

- DOOR HARDWARE BY MANUFACTURER, WITH PANIC.

- PASSAGE SET, CLOSER, PUSH/PULL. FLUSH BOLT.

- PRIVACY SET W/ OCCUPIED INDICATOR, DOOR STOP.

- STOREROOM SET, MASTER KEY, WALL STOP.

- PASSAGE SET, DOOR STOP, CLOSER.
*CLOSER + LATCHING LOCK FOR FIRE RATED OPENINGS.

- PASSAGE SET.

- PASSAGE SET, CLOSER, DOOR STOP, KICK PLATE.

- CARD READER, CLOSER, PUSH/PULL.

- CARD READER, CLOSER, KICK PLATE. MASTER KEY.

- DOOR HARDWARE BY STOREFRONT POCKET SYSTEM MANUFACTURER, PUSH/PULL.

- DOOR HARDWARE BY STOREFRONT SWING DOOR SYSTEM MANUFACTURER, PUSH/PULL. KEYED LOCK.

- STOREROOM SET, CARD READER. MASTER KEY.

- PASSAGE SET, PUSH/PULL, KICK PLATE INTERIOR SIDE. FLUSH BOLT.

- PRIVACY SET W/ OCCUPIED INDICATOR, CLOSER, DOOR STOP.

- ENTRY SET WITH PANIC HARDWARE, CLOSER, CARD READER. MASTER KEY.

- CLASSROOM SET, DOOR STOP WITH CLOSER.


DOOR + HARDWARE NOTES

- INTERIOR DOORS OPENING TO A PERPENDICULAR WALL MUST HAVE WALL STOPS WITH CONCEALED MOUNTING MOUNTED TO SOLID IN WALL BLOCKING. REFER TO HARDWARE SCHEDULE.
- DOORS WITHIN ACCESSIBLE PATH OF TRAVEL TO BE OPENABLE WITH A SINGLE EFFORT BY LEVER, PANIC BAR OR PUSH/PULL HARDWARE. DOOR OPENING HARDWARE TO BE BETWEEN 30" TO 44" A.F.F., EXCEPT AS PROVIDED BY CODE (SEE 1 ABOVE).
- DOORS RECEIVING CLOSERS OR SPRING HINGES, AS INDICATED IN SCHEDULE ARE TO BE ADJUSTED TO PROVIDE FOR A MAXIMUM EFFORT TO OPERATE OF 5 POUNDS FOR INTERIOR DOORS AND EXTERIOR DOORS. CLOSERS MUST ALLOW THREE SECONDS TO MOVE DOOR FROM A 70 DEGREE OPEN POSITION TO A POINT 3" FROM THE LATCH. IF CONFLICT WITH CODE, FIRE & LIFE SAFETY CODE SHALL PREVAIL. DO NOT USE HOLD OPEN DEVICES.
- THRESHOLDS SHALL NOT EXCEED 1/2" IN HEIGHT
- WOOD AND H.M. DOORS TO HAVE 3 FULL BEARING MORTISE HINGES WITH NON-REMOVABLE HINGE PINS, DOOR CLOSERS, AND DOOR STOPS (INTERIOR DOORS), FINISH US26D (SATIN CHROME). (U.N.O.)
- HOLLOW METAL FRAMES SHALL BE 18 GA. PRESSED, FLUSH TYPE WITH MITERED KNOCK DOWN STYLE CORNERS. CASH OFFICE FRAME SHALL BE 16 GA. H.M. FLUSH TYPE WITH DOUBLE STUDS AT JAMBS. FRAMES ARE TO BE REINFORCED AND PREPARED FOR HARDWARE. PROVIDE 4" HEAD FOR FRAMES IN EXTERIOR CMU OPENINGS WHERE APPROPRIATE TO MATCH MASONRY COURSING.
- HM DOORS ARE TO BE 18 GA., FACTORY PRIMED STEEL, FLUSH TYPE WITH INSULATED WEATHER SEALED CORE; STIFFENING; HARDWARE REINFORCING; CLOSED TOP & BOTTOM CHANNELS; AND HANDED FOR INDICATED SWING. DO NOT USE UNIVERSAL TYPE DOORS.
- SOLID CORE WOOD DOORS SHALL BE PREPARED FOR PLASTIC LAMINATE FINISH.
- GENERAL CONTRACTOR TO PROVIDE CONSTRUCTION CORES FOR ALL EXTERIOR DOORS PRIOR TO TURN OVER. AT TIME OF TURN OVER CONTRACTOR IS TO TURN OVER CORE EXTRACTION KEY TO OWNER'S REPRESENTATIVE.
- UNLESS OTHERWISE REQUIRED BY LOCAL AUTHORITY, INSTALL ACCESSIBLE TOILET ROOM SIGN AND ALL OTHER SIGNING REQUIRED BY ADA OR LOCAL AUTHORITY, WHETHER AT TOILET ROOMS OR ELSEWHERE IN THE BUILDING, MUST BE PROVIDED AND INSTALLED BY THE GENERAL CONTRACTOR, SUPPLIED BY GENERAL CONTRACTOR.
- ALL EXTERIOR DOORS ARE TO BE FULLY WEATHERSTRIPPED INCLUDING A RAIN DRIP AND DOOR BOTTOM, HAVE ACCESSIBLE THRESHOLDS AND CONCRETE LANDINGS (OR SIDEWALK).
- COORDINATE ALL HARDWARE KEYING WITH THE OWNER'S REPRESENTATIVE PRIOR TO PLACING HARDWARE ORDER.
- FOR EXTERIOR HOLLOW METAL DOORS, PAINT FRAME AND DOOR ON INTERIOR SIDE PER DOOR SCHEDULE. PAINT FRAME AND DOOR ON EXTERIOR SIDE PER LANDLORDS REQUIREMENTS.

DOOR TYPE NOTES

THE FOLLOWING ARE THE MINIMUM ACCESSIBILITY REQUIREMENTS FOR OPERABLE INTERIOR / EXTERIOR DOORS:

- DOORS MUST BE A MINIMUM OF 3'-0" WIDE AND 6'-8" HIGH.
- DOORS MUST OPEN A MINIMUM OF 90 DEGREES.
- CLEAR WIDTH OF DOORWAYS MUST BE 32" MINIMUM.
- DOUBLE DOORS / AUTOMATIC DOORS AT LEAST ONE LEAF MUST COMPLY WITH ITEMS 1 THROUGH 3 ABOVE.
- THE BOTTOM 10" OF ALL DOORS, EXCEPT AUTOMATIC AND SLIDING DOORS, SHALL HAVE A SMOOTH, UNINTERRUPTED SURFACE TO ALLOW THE DOOR TO BE OPENED BY A WHEELCHAIR FOOTREST WITHOUT CREATING A TRAP OR HAZARDOUS CONDITION. WHERE NARROW FRAME DOORS ARE USED, A 10" HIGH SMOOTH PANEL SHALL BE INSTALLED ON THE PUSH SIDE OF THE DOOR, WHICH ALLOWS THE DOOR TO BE OPENED BY A WHEELCHAIR FOOTREST WITHOUT A TRAP OR HAZARDOUS CONDITION.
- MAXIMUM EFFORT TO OPERATE DOORS SHALL NOT EXCEED 5 LBS FOR EXTERIOR AND INTERIOR DOOR, SUCH PULL OR PUSH EFFORT BEING APPLIED AT RIGHT ANGLES TO HINGED DOORS AND AT THE CENTER PLANE OF SLIDING OR FOLDING DOORS. COMPENSATING DEVICES OR AUTOMATIC DOOR OPERATORS MAY BE UTILIZED TO MEET THE ABOVE STANDARDS. WHEN FIRE DOORS ARE REQUIRED THE MAXIMUM EFFORT TO OPERATE THE DOOR MAY BE INCREASED TO THE MINIMUM ALLOWABLE BY THE APPROPRIATE ADMINISTRATIVE AUTHORITY, BUT SHALL NOT EXCEED 15 LBS.
- IF THE DOOR HAS A CLOSER, THEN THE SWEEP PERIOD OF THE CLOSER SHALL BE ADJUSTED SO THAT FROM AN OPEN POSITION OF 70 DEGREES, THE DOOR WILL TAKE AT LEAST 3 SECONDS TO MOVE TO A POINT 3" FROM THE LATCH, MEASURED TO THE LANDING EDGE OF DOOR.
- HAND ACTIVATED DOOR OPENING HARDWARE (IF PROVIDED) SHALL BE CENTERED BETWEEN 30" AND 44" ABOVE THE FLOOR. LATCHING AND LOCKING DOORS THAT ARE HAND ACTIVATED AND WHICH ARE IN A PATH OF TRAVEL SHALL BE OPERABLE WITH A SINGLE EFFORT BY LEVER TYPE HARDWARE, PANIC B AS, PUSH-PULL ACTIVATING BARS OR OTHER HARDWARE DESIGNED TO PROVIDE PASSAGE WITHOUT REQUIRING THE ABILITY TO GRASP THE OPENING HARDWARE.
- WHERE THE PLANE OF THE DOORWAY IS OFFSET 8 OR MORE INCHES FROM ANY OBSTRUCTION WITHIN 18" MEASURED LATERALLY ON THE LATCH SIDE, THE DOOR SHALL BE PROVIDED WITH MANEUVERING CLEARANCE FOR FRONT APPROACH.
- FLOOR OR LANDING ON EACH SIDE OF THE DOOR TO BE LEVEL AND CLEAR LEVEL AREA IN THE DIRECTION OF THE DOOR SWING IS A MINIMUM OF 60" IN LENGTH. LEVEL AREA OPPOSITE THE DIRECTION OF THE DOOR SWING IS A MINIMUM OF 44-48" IN LENGTH, DEPENDENT UPON DIRECTION OF THE APPROACH & EXISTENCE OF A LATCH & CLOSER. SURFACE SLOPE OF THE LEVEL AREA SHALL NOT EXCEED 150 GRADIENT (2%).
- THE WIDTH OF THE LEVEL AREA ON THE SIDE TO WHICH THE DOOR SWINGS SHALL EXTEND 24" PAST THE STRIKE EDGE OF THE DOOR FOR EXTERIOR DOORS & 18" PAST THE STRIKE EDGE FOR INTERIOR DOORS.



**TURPENTINE
DESIGN**


1007 Procure Street
Fuquay-Varina, NC 27526

919.412.9138
turpentine-design.com

REVISIONS

A PRICING REV Date 1 July 1, 2026

SEALS

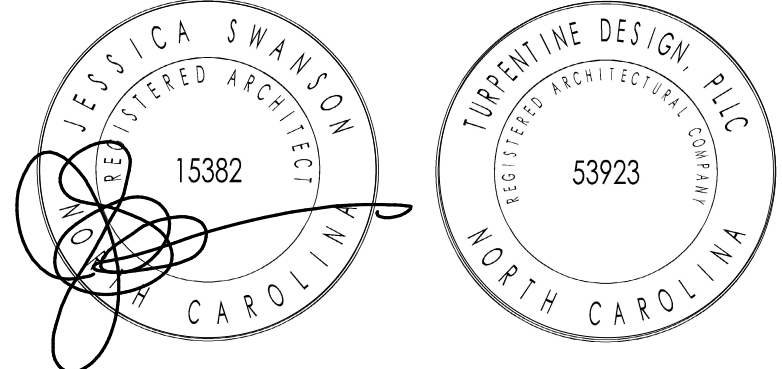

05.29.2026

ARQ AVIATION

FLIGHT SCHOOL + FBO

Wilmington International Airport (ILM)
Wilmington, NC 28405

OWNER
ARQ Realty

COPYRIGHT 2025 - ALL RIGHTS RESERVED
PRINTED OR ELECTRONIC DRAWINGS & DOCUMENTATION MAY NOT BE REPRODUCED OR REDISTRIBUTED IN ANY WAY WITHOUT WRITTEN PERMISSION FROM TURPENTINE DESIGN

PHASE PERMIT SET
DATE 05.29.2026
TD PROJECT # 25-009

DRAWING TITLE

DOOR SCHEDULES

DRAWING NUMBER

A-601

DOOR TYPES

1/4" = 1'-0"

3


AVANTI SYSTEMS USA STOREFRONT SYSTEM AS BASIS OF DESIGN.
STYLES INCLUDE TYPICAL SWING DOOR SYSTEMS AND SLIDING POCKET
DOOR STOREFRONT SYSTEM. SEE ELEVATIONS AND DOOR SCHEDULE FOR
DOOR TYPE.

KAWNEER SYSTEMS AS BASIS OF DESIGN FOR ALL RATED STOREFRONT
SYSTEMS.

NOTE: ALL STOREFRONTS INDICATED WITH GRAY HATCH TO RECEIVE
PRIVACY FILM OR SANDBLASTED ETCHING, GC TO COORDINATE WITH
ARCHITECT TO SPEC.

REVISIONS		
A	PRICING REV	Date 1 July 1, 2026

SEALS

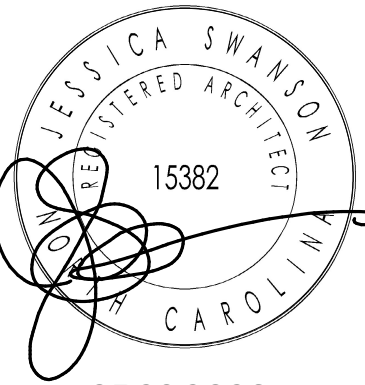

05.29.2026

ARQ AVIATION
FLIGHT SCHOOL + FBO

Wilmington International Airport (ILM)
Wilmington, NC 28405


OWNER
ARQ Realty

COPYRIGHT 2025 - ALL RIGHTS RESERVED
PRINTED OR ELECTRONIC DRAWINGS & DOCUMENTATION MAY
NOT BE REPRODUCED OR REDISTRIBUTED IN ANY WAY WITHOUT
WRITTEN PERMISSION FROM TURPENTINE DESIGN


PHASE	PERMIT SET
DATE	05.29.2026
TD PROJECT #	25-009

DRAWING TITLE
**INT. STOREFRONT
SCHEDULE**


DRAWING NUMBER
A-612

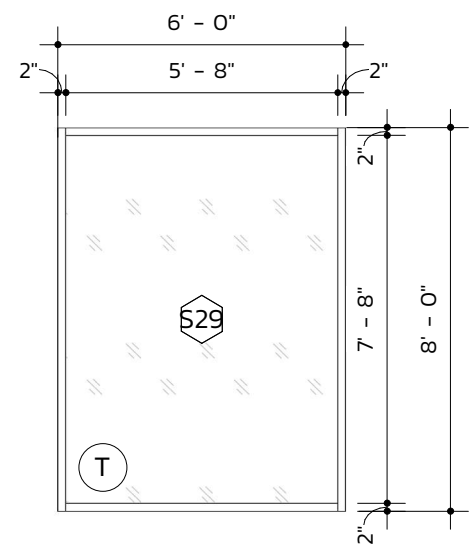

STOREFRONT S29 12
1/4" = 1'-0"

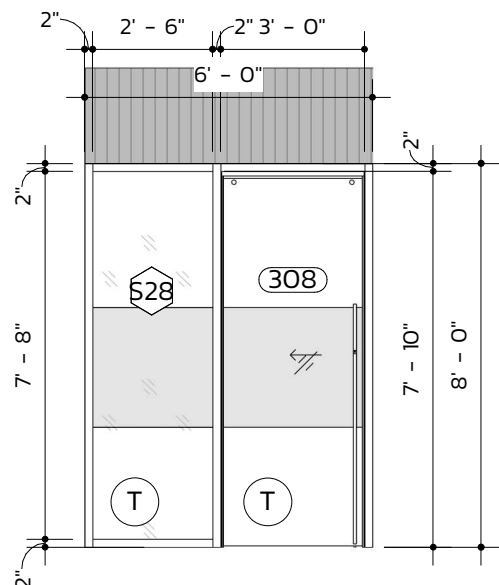


STOREFRONT S28 11
1/4" = 1'-0"

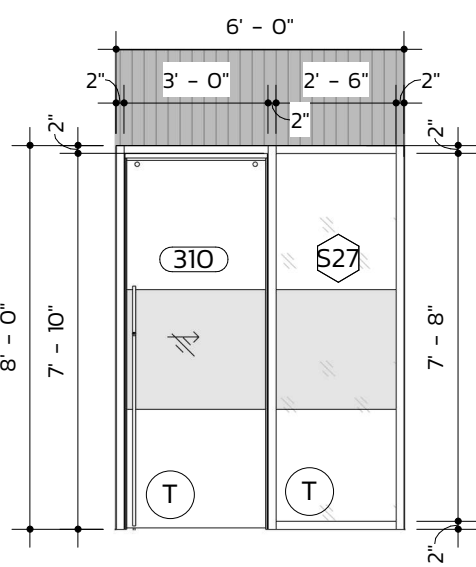


STOREFRONT S27 10
1/4" = 1'-0"


**STOREFRONT S26
REMOVED FROM
PROJECT**

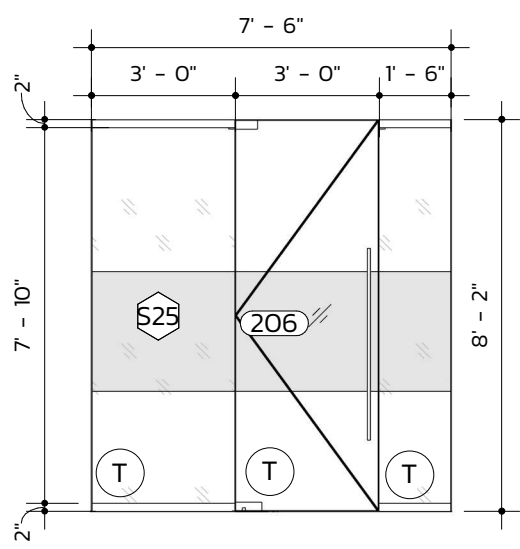


STOREFRONT S25 8
1/4" = 1'-0"

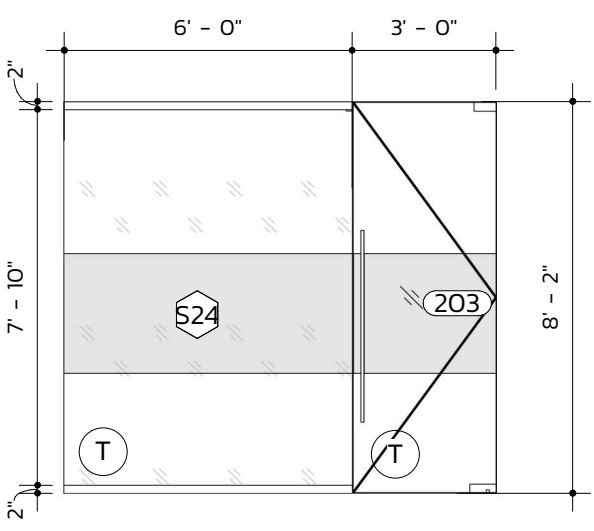


STOREFRONT S24 7
1/4" = 1'-0"

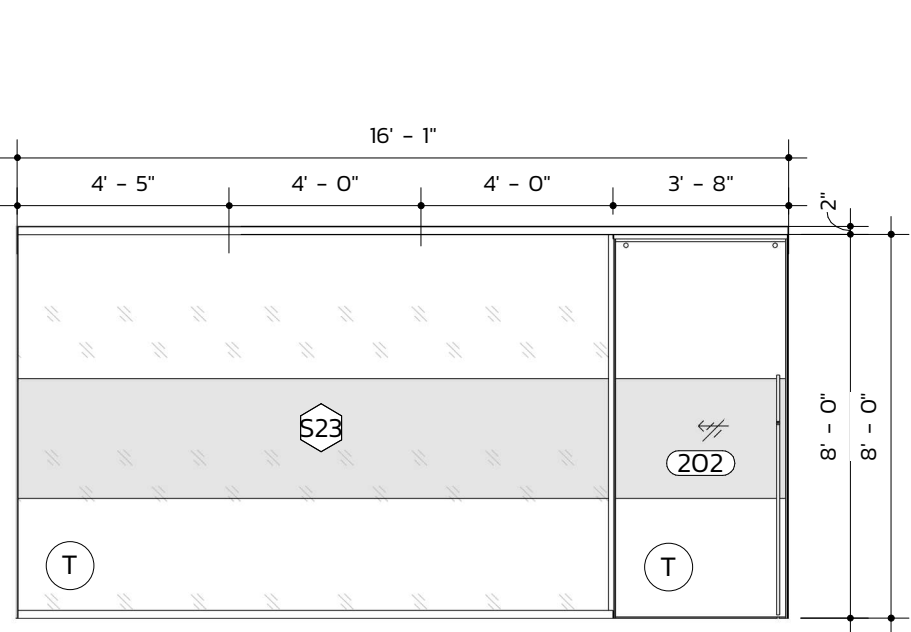


STOREFRONT S23 6
1/4" = 1'-0"

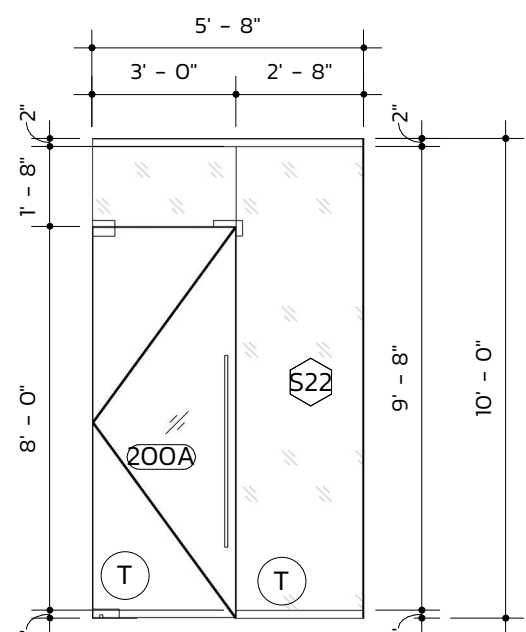


STOREFRONT S22 5
1/4" = 1'-0"

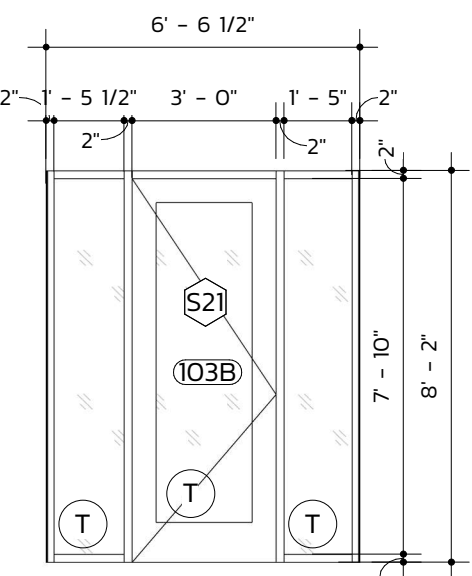


STOREFRONT S21 4
1/4" = 1'-0"

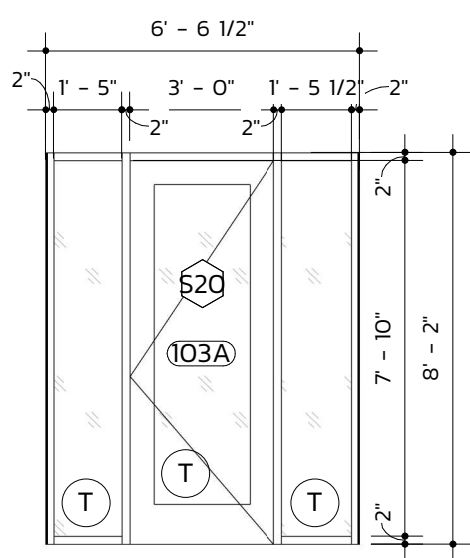

STOREFRONT S20 3
1/4" = 1'-0"

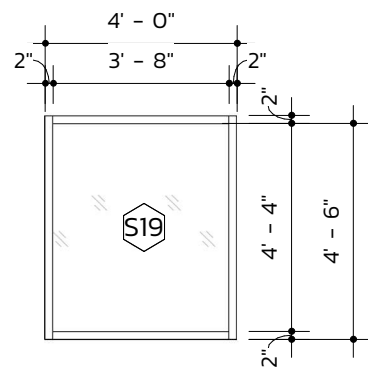

STOREFRONT S19 2
1/4" = 1'-0"

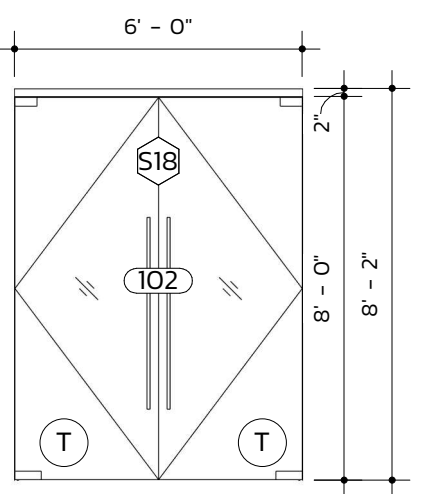

STOREFRONT S18 1
1/4" = 1'-0"

TRANSITION DETAILS	EQUIPMENT LEGEND	TOILET ACCESSORIES LEGEND	FINISH SCHEDULE
NOTE: ALL TRANSITIONS TO MEET ANSI & ADA REQUIREMENTS. GC TO PROVIDE FINISH SUBMITTAL CARPET TO VINYL FLOOR CARPET TO CONCRETE CONCRETE TO TILE CARPET TO TILE	EQ1 24" MICRO DRAWER MICROWAVE MD24B5 FLUSH INSTALLATION NOTES: BREAK ROOM BUILT-IN EQ2 26 CU FT. REFRIGERATOR LRFXC2606 FLUSH INSTALLATION NOTES: BREAK ROOM BUILT-IN EQ3 24" BUILT-IN DISH WASHER FDPH431LAF FLUSH INSTALLATION NOTES: BREAK ROOM BUILT-IN EQ4 MOTAK TWO-SECTION REACH-IN REFRIGERATOR MSD-ZDR-BAL-54-G-X NOTES: LINE SERVICE AREA EQ5 HOBART SANITIZING UNDER COUNTER DISH WASHING MACHINE LXnC SERIES UNDER COUNTER NOTES: GROUNDS AREA EQ6 ICE STORAGE BIN D510 NOTES: LINE SERVICE AREA EQ7 ICE CUBE MACHINE IT0750N (FOR D-370 BIN) NOTES: LINE SERVICE AREA EQ8 UNDER COUNTER MINI FRIDGE AL370 UNDER COUNTER NOTES: PILOT'S LOUNGE EQ9 1 PORT DOCKING STATIONS 72309 COUNTERTOP PLACEMENT NOTES: RECEPTION AREA	TP1 MULTI ROLL TOILET PAPER DISPENSER, SURFACE MOUNTED BRADLEY ELVARI 5B2 SERIES, MODEL# 5B2-110000, BRUSHED NICKEL TP2 DUAL ROLL TOILET PAPER DISPENSER, SURFACE MOUNTED BRAD EX MODEL# 5402 STAINLESS STEEL TR1 MEDIUM TRASH RECEPTACLE - 14 GAL. SURFACE MOUNTED BRADLEY ELVARI MODEL#3B1-110000BN, BRUSHED NICKEL PT1 PAPER TOWEL DISPENSER, SURFACE MOUNTED BRADLEY ELVARI 2B1 SERIES MODEL# 2B1-110000-BN BRUSHED NICKEL PT2 PAPER TOWEL DISPENSER, SURFACE MOUNTED BRAD EX MODEL# 250-15 STAINLESS STEEL SN1 SANITARY NAPKIN DISPOSAL, SURFACE MOUNTED BRADLEY ELVARI 4B2-11 SERIES MODEL# 4B2-11-BN BRUSHED NICKEL SN2 SANITARY NAPKIN DISPOSAL, SURFACE MOUNTED BRAD EX MODEL# 4722-15 STAINLESS STEEL HS1 HARDWIRED SOAP DISPENSER, SURFACE MOUNTED, AC PLUG BRADLEY ELVARI MODEL# 6B1-119473T-BN BRUSHED NICKEL TW1 PAPER TOWEL AND WASTE COMBO UNIT, RECESSED BRADLEY MODEL# 238 SATIN STAINLESS STEEL TW2 PAPER TOWEL AND WASTE COMBO UNIT, RECESSED BRADLEY MODEL# 238 SATIN STAINLESS STEEL SS1 PHENOLIC BARIATRIC SHOWER SEAT BRADLEY MODEL# 9591 SGB SHOWER GRAB BAR BRADLEY SERIES 832 RH1 COAT/ROBE HOOK, SURFACE MOUNTED BRADLEY 9B1-1100-BN BRUSHED NICKEL RH2 COAT/ROBE HOOK, SURFACE MOUNTED BRADLEY MODEL# 9119-18 SATIN CHROME FINISH GB1B 18" GRAB BAR BRADLEY 8B1-110180-BN BRUSHED NICKEL, SATIN FINISH GB1B* 18" GRAB BAR BRADLEY MODEL# 832-001-18" STAINLESS STEEL GB3B 36" GRAB BAR BRADLEY 8B1-10360-BN BRUSHED NICKEL, SATIN FINISH GB3B* 36" GRAB BAR BRADLEY MODEL# 832-001-36" STAINLESS STEEL GB4B 48" GRAB BAR BRADLEY 8B1-10480-BN BRUSHED NICKEL, SATIN FINISH GB4B* 48" GRAB BAR BRADLEY MODEL# 832-001-48" STAINLESS STEEL MIR FRAMELESS MIRROR BRADLEY ELVARI MODEL# 7B1-1030360 BRUSHED NICKEL	CEILING FINISHES GYP 1 MATERIAL: INTERIOR GYPSUM BOARD MANUFACTURER: USG STYLE: 5/8" TYPE X FINISH: LEVEL 4, PAINTED U.N.O. NOTES: INTERIOR CEILINGS, SEE FINISH PLAN + SCHEDULE FOR PAINT GYP 2 MATERIAL: EXTERIOR GYPSUM BOARD MANUFACTURER: USG STYLE: 5/8" EXTERIOR SOFFIT BOARD FINISH: LEVEL 4, EXT. GRADE PAINTED U.N.O. NOTES: EXTERIOR SOFFITS, SEE FINISH PLAN + SCHEDULE FOR PAINT APC 1 MATERIAL: ACOUSTIC PLASTER CEILING MANUFACTURER: BASWA ACOUSTIC STYLE: PHON CLASSIC BASE THICKNESS: 70MM COLOR: WHITE ACT 1 MATERIAL: ACOUSTICAL CEILING TILE MANUFACTURER: ARMSTRONG STYLE: CALLA SQ. LAY IN, TEGULAR SIZE: 2' X 4' - 1" THICK COLOR: LIGHT GRAY NOTES: LIGHT GRAY GRID / PILOT'S LOUNGE ACT 2 MATERIAL: ACOUSTICAL CEILING TILE MANUFACTURER: ARMSTRONG STYLE: CALLA SQ. LAY IN, TEGULAR SIZE: 2' X 2' - 1" THICK COLOR: WHITE NOTES: WHITE GRID / SPEC. ON DRAWINGS ACT 3 MATERIAL: ACOUSTICAL CEILING TILE MANUFACTURER: ARMSTRONG STYLE: CALLA SQ. LAY IN, TEGULAR SIZE: 2' X 4' - 1" THICK COLOR: WHITE NOTES: WHITE GRID / SPEC. ON DRAWINGS GCP 1 MATERIAL: SHEETROCK EXT. GYP. CLG PANEL STYLE: 3270 SIZE: 2' X 4' - 1/2" THICK COLOR: WHITE NOTES: WHITE GRID MTL 1 MATERIAL: ACOUSTICAL CEILING TILE MANUFACTURER: ARMSTRONG STYLE: METALWORKS COLOR: GUN METAL GRAY / PERFORATION M4 NOTES: SPEC. ON DRAWINGS ATP 1 MATERIAL: ACOUSTIC TECTUM PANELS MANUFACTURER: ARMSTRONG STYLE: DIRECT ATTACH CEILING PANEL COLOR: WHITE NOTES: APPLIED TO TRAINING ROOM CLG CEILING FINISHES - BAFFLES BAF 1 MATERIAL: ACOUSTICAL BAFFLE MANUFACTURER: ARCHISONIC COLOR: LICHEN 160 NOTES: LOBBY LOUNGE BAF 2 MATERIAL: ACOUSTICAL BAFFLE MANUFACTURER: ARCHISONIC COLOR: MILK 404 NOTES: APPLY TO THE WALL IN PILOT'S LOUNGE BAF 3 MATERIAL: ACOUSTICAL BAFFLE MANUFACTURER: ARCHISONIC COLOR: TRUE NAVY 194 NOTES: APPLY TO THE WALL IN PILOT'S LOUNGE BAF 4 MATERIAL: ACOUSTICAL BAFFLE MANUFACTURER: ARCHISONIC COLOR: CHARCOAL 542 NOTES: APPLY TO THE WALL IN PILOT'S LOUNGE BAF 5 MATERIAL: ACOUSTICAL BAFFLE MANUFACTURER: TBD COLOR: TBD NOTES: PAINT PT-5 FOR TIME BEING / TRAINING ROOM BAF 6 MATERIAL: ACOUSTICAL BAFFLE MANUFACTURER: SOUND PLY COLOR: PLAIN SLICE WALNUT NOTES: ABOVE CAFÉ AREA FINISH SCHEDULE CEILING FINISHES GYP 1 MATERIAL: INTERIOR GYPSUM BOARD MANUFACTURER: USG STYLE: 5/8" TYPE X FINISH: LEVEL 4, PAINTED U.N.O. NOTES: INTERIOR CEILINGS, SEE FINISH PLAN + SCHEDULE FOR PAINT GYP 2 MATERIAL: EXTERIOR GYPSUM BOARD MANUFACTURER: USG STYLE: 5/8" EXTERIOR SOFFIT BOARD FINISH: LEVEL 4, EXT. GRADE PAINTED U.N.O. NOTES: EXTERIOR SOFFITS, SEE FINISH PLAN + SCHEDULE FOR PAINT APC 1 MATERIAL: ACOUSTIC PLASTER CEILING MANUFACTURER: BASWA ACOUSTIC STYLE: PHON CLASSIC BASE THICKNESS: 70MM COLOR: WHITE ACT 1 MATERIAL: ACOUSTICAL CEILING TILE MANUFACTURER: ARMSTRONG STYLE: CALLA SQ. LAY IN, TEGULAR SIZE: 2' X 4' - 1" THICK COLOR: LIGHT GRAY NOTES: LIGHT GRAY GRID / PILOT'S LOUNGE ACT 2 MATERIAL: ACOUSTICAL CEILING TILE MANUFACTURER: ARMSTRONG STYLE: CALLA SQ. LAY IN, TEGULAR SIZE: 2' X 2' - 1" THICK COLOR: WHITE NOTES: WHITE GRID / SPEC. ON DRAWINGS ACT 3 MATERIAL: ACOUSTICAL CEILING TILE MANUFACTURER: ARMSTRONG STYLE: CALLA SQ. LAY IN, TEGULAR SIZE: 2' X 4' - 1" THICK COLOR: WHITE NOTES: WHITE GRID / SPEC. ON DRAWINGS GCP 1 MATERIAL: SHEETROCK EXT. GYP. CLG PANEL STYLE: 3270 SIZE: 2' X 4' - 1/2" THICK COLOR: WHITE NOTES: WHITE GRID MTL 1 MATERIAL: ACOUSTICAL CEILING TILE MANUFACTURER: ARMSTRONG STYLE: METALWORKS COLOR: GUN METAL GRAY / PERFORATION M4 NOTES: SPEC. ON DRAWINGS ATP 1 MATERIAL: ACOUSTIC TECTUM PANELS MANUFACTURER: ARMSTRONG STYLE: DIRECT ATTACH CEILING PANEL COLOR: WHITE NOTES: APPLIED TO TRAINING ROOM CLG CEILING FINISHES - BAFFLES BAF 1 MATERIAL: ACOUSTICAL BAFFLE MANUFACTURER: ARCHISONIC COLOR: LICHEN 160 NOTES: LOBBY LOUNGE BAF 2 MATERIAL: ACOUSTICAL BAFFLE MANUFACTURER: ARCHISONIC COLOR: MILK 404 NOTES: APPLY TO THE WALL IN PILOT'S LOUNGE BAF 3 MATERIAL: ACOUSTICAL BAFFLE MANUFACTURER: ARCHISONIC COLOR: TRUE NAVY 194 NOTES: APPLY TO THE WALL IN PILOT'S LOUNGE BAF 4 MATERIAL: ACOUSTICAL BAFFLE MANUFACTURER: ARCHISONIC COLOR: CHARCOAL 542 NOTES: APPLY TO THE WALL IN PILOT'S LOUNGE BAF 5 MATERIAL: ACOUSTICAL BAFFLE MANUFACTURER: TBD COLOR: TBD NOTES: PAINT PT-5 FOR TIME BEING / TRAINING ROOM BAF 6 MATERIAL: ACOUSTICAL BAFFLE MANUFACTURER: SOUND PLY COLOR: PLAIN SLICE WALNUT NOTES: ABOVE CAFÉ AREA FINISH SCHEDULE PLASTIC LAMINATE PL 1 MATERIAL: ALUMINUM SHEET METAL MANUFACTURER: FORMICA STYLE: DECOMETAL COLOR: BRUSHED ALUM. M605 NOTES: MAIN LOBBY WALL / TOE KICK IN BAR AREA PL 2 MATERIAL: WOOD VENEER MANUFACTURER: LAMINART COLOR: GOLDEN OAK 983 SIZE: 4X10 SHEET NOTES: MAIN LOBBY WALL PL 3 MATERIAL: WOOD VENEER MANUFACTURER: LAMINART STYLE: ACOUSTIC COLOR: GOLDEN OAK / LI002WG SIZE: 4X10 SHEET NOTES: MAIN LOBBY WALL PL 4 MATERIAL: PLASTIC LAMINATE MANUFACTURER: WILSONART STYLE: BRITE BRUSHED COLOR: STERLING L6411-00-40B NOTES: ALUMINUM TOE KICK IN LOBBY LOUNGE PL 5 MATERIAL: PLASTIC LAMINATE MANUFACTURER: FORMICA STYLE: COLORCORE2 COLOR: 92C-58 STORM MATTE NOTES: LOBBY LOUNGE / LOWER CABINETS IN OPENWORK AREA / LOWER CABINETS IN BREAK ROOM PL 6 MATERIAL: PLASTIC LAMINATE MANUFACTURER: WILSONART STYLE: PREMIUM LAMINATE COLOR: UPTOWN WALNUT 7971K-12 NOTES: PILOT'S LOUNGE MILLWORK / BACK WALL WHERE TV IS / PILOT'S LOUNGE DOOR / ISLAND VERTICAL IN BREAK ROOM / RECEPTION AREA TV WALL / BAR MILLWORK PL 7 MATERIAL: PLASTIC LAMINATE MANUFACTURER: WILSONART STYLE: STANDARD LAMINATE COLOR: NILE MIST D512-40 MATTE NOTES: TRAINING ROOM MILLWORK / RECEPTION DESK / LOWER CABINETS IN GROUNDS AREA / LOCKERS PL 8 MATERIAL: PLASTIC LAMINATE MANUFACTURER: WILSONART STYLE: STANDARD LAMINATE COLOR: DESIGNER WHITE D354-60 MATTE NOTES: UPPER CABINETS IN GROUNDS ROOM PL 9 MATERIAL: PLASTIC LAMINATE MANUFACTURER: WILSONART STYLE: STANDARD LAMINATE COLOR: CEMENT D503-60 NOTES: UPPER CABINETS IN OPENWORK AREA PL 10 MATERIAL: PLASTIC LAMINATE MANUFACTURER: FORMICA STYLE: STANDARD LAMINATE COLOR: BASALT SLATE 3690-34 NOTES: RECEPTION DESK/RAISED AREAS ON DESK SOLID SURFACE SS 1 MATERIAL: SOLID SURFACE MANUFACTURER: MSI - Q STYLE: PREMIUM NATURAL QUARTZ COLOR: CALACATTA TRENTO NOTES: PILOT'S LOUNGE / TRAINING ROOM / RECEPTION / OPEN WORK AREA SS 2 MATERIAL: SOLID SURFACE MANUFACTURER: SILESTONE COLOR: PARISIEU BLEU POLISHED NOTES: COUNTERTOP BAR SS 3 MATERIAL: SOLID SURFACE MANUFACTURER: VADARA COLOR: MEDINA V846 NOTES: BATHROOM COUNTERS SS 4 MATERIAL: SOLID SURFACE MANUFACTURER: WILSONART COLOR: DESIGNER WHITE D354SL NOTES: GROUNDS ROOM SS 5 MATERIAL: SOLID SURFACE MANUFACTURER: SILESTONE COLOR: PIETRA POLISHED NOTES: BREAK ROOM COUNTERS SS 6 MATERIAL: SOLID SURFACE MANUFACTURER: DEKTON STYLE: AMAZONIK COLOR: KEDAR THICKNESS: NOTES: AROUND FIREPLACE IN LOBBY LOUNGE WALL FINISHES - WALL COVERINGS WC 1 MATERIAL: WALL COVERING MANUFACTURER: MOMENTUM STYLE: BAREGE TEXTURE COLOR: AVF14-885 GRANITE NOTES: WALL BEHIND MILLWORK WC 2 MATERIAL: WALL COVERING MANUFACTURER: FLUTTO STYLE: FLEXIBLE TAMBOUR WOOD PANEL COLOR: WALNUT RIDGE NOTES: FLUTED WOOD AROUND BAR WC 3 MATERIAL: WALL COVERING MANUFACTURER: KOROSEAL STYLE: ASTORIA ACCENT COLOR: GOSSAMER GREY SG-33-07 NOTES: SPECIFIED WALLS IN BATHROOMS WC 4 MATERIAL: WALL COVERING MANUFACTURER: PIONEER MILLWORKS STYLE: ENGINEERED PANELING COLOR: RAKED WALNUT / STANDARD UNFINISHED SIZE: 5/8" THICKNESS NOTES: OUTSIDE WALL OF DEBRIEF ROOM WC 5 MATERIAL: WALL COVERING MANUFACTURER: ARMSTRONG STYLE: WOODWORKS VENEER COLOR: WALNUT NOTES: SPEC. ON DRAWINGS WC 5 MATERIAL: WALL COVERING MANUFACTURER: THE WOOD VENEER HUB STYLE: LUXURY ACOUSTIC SLAT WOOD COLOR: AMERICAN WALNUT NOTES: TV WALL WV 1 MATERIAL: WALL VENEER MANUFACTURER: PORCELANOSA GROUP COLOR: WALNUT VENEER NOTES: UNDER FIREPLACE IN LOBBY LOUNGE WALL FINISHES - PAINT PT 3 MATERIAL: PAINT MANUFACTURER: BENJAMIN MOORE COLOR: STONE HARBOR 2111-50 FINISH: EGGSHELL NOTES: FIELD PAINT / CEILING IN PILOT'S LOUNGE / DOOR FRAME PAINT (TYP.) PT 4 MATERIAL: PAINT MANUFACTURER: BENJAMIN MOORE COLOR: SNOW WHITE 0C-66 FINISH: DRY FALL NOTES: FIELD PAINT FOR GYP CEILING - UNO PT 5 MATERIAL: PAINT MANUFACTURER: BENJAMIN MOORE COLOR: ANCHOR GRAY 2126-30 FINISH: EGGSHELL NOTES: TRAINING ROOM WALL BEHIND PROJECTOR / OPEN WORK AREA PT 6 MATERIAL: PAINT MANUFACTURER: BENJAMIN MOORE COLOR: ANCHOR GRAY 2126-30 FINISH: EPOXY NOTES: 5FT AND ABOVE IN SINGLE BATHROOMS TOILET PARTITIONS TP 1 MATERIAL: TOILET PARTITIONS MANUFACTURER: BRADLEY STYLE: EURO PARTITIONS - LUCENT SERIES COLOR: ALABASTER NOTES: BATHROOM STALLS REP: KAREN AGNELLO, SMITH & STEVENSON, 704.796.3337 UPHOLSTERY UPH 1 MATERIAL: UPHOLSTERY MANUFACTURER: RICHLoom STYLE: ROMEO COLOR: ADMIRAL SIZE: 53"W NOTES: BANQUET IN LOBBY LOUNGE UPH 2 MATERIAL: BLACK OUT CURTAIN MANUFACTURER: SNOWSOUND STYLE: FIBER & VELVET COLOR: COL. 611 NOTES: BLACK OUT CURTAINS NOTES: PILOT'S LOUNGE UPH 3 MATERIAL: UPHOLSTERY MANUFACTURER: MOMENTUM STYLE: SILICA LEATHER COLOR: INK NOTES: BREAKROOM WOODEN SHELVING WD 1 MATERIAL: WOODEN SHELVES MANUFACTURER: WALNUT WOOD WORKS COLOR: BLACK WALNUT NOTES: FLOATING SHELVES IN BREAKROOM SEALED CONCRETE SC 1 MATERIAL: FLOORING MANUFACTURER: TBD COLOR: TBD NOTES: TBD SC 2 MATERIAL: FLOORING MANUFACTURER: TBD COLOR: TBD NOTES: TBD FLOORING CPT 1 MATERIAL: CARPET TILE MANUFACTURER: INTERFACE FLAT ROCK STYLE: FLAT ROCK COLOR: GRANITE MOUNTAIN SIZE: 50CM X 50CM NOTES: UNDER FIREPLACE IN LOBBY LOUNGE CPT 2 MATERIAL: CARPET TILE MANUFACTURER: SIENNA STYLE: ABSTRACT TILE COLOR: SPONTANEOUS 28C49 SIZE: 24" X 24" NOTES: RECEPTION DESK CPT 3 MATERIAL: CARPET TILE MANUFACTURER: MOHAWK STYLE: ARTISANAL BLENDED TWIST BT 413 COLOR: 7559 JEWEL NOTES: OPEN WORK AREA CPT 4 MATERIAL: CARPET TILE MANUFACTURER: MILLIKEN STYLE: HEAVY META ALLOY COLOR: ALY13-220 ALLUVIAL INSTALL: ASHLAR NOTES: DEBRIEF ROOM WO 1 MATERIAL: WALKOFF CARPET MANUFACTURER: VAN GELDER STYLE: CHAMPION SUPER NOP COLOR: TAUPE 2345 NOTES: VESTIBULE EPX 1 MATERIAL: FLOORING MANUFACTURER: TBD COLOR: TBD NOTES: -- TERR 1 MATERIAL: FLOORING MANUFACTURER: TBD COLOR: TBD NOTES: TBD TERR 2 MATERIAL: FLOORING MANUFACTURER: TBD COLOR: TBD NOTES: TBD TILE T 1 MATERIAL: PORCELAIN TILE MANUFACTURER: BEST TILE STYLE: BOND JUTE COLOR: BEIGE GROUT: G - 1 SIZE: 12" X 24" NOTES: SPECIFIED RESTROOM WET WALLS T 2 MATERIAL: PORCELAIN TILE MANUFACTURER: BEST TILE STYLE: 3123 CEDAR PARK COLOR: SIMPLE MODERN CREME GLAZED GROUT: G - 2 SIZE: 12" X 24" NOTES: WASHROOM WALLS AND FLOOR AROUND SHOWER T 3 MATERIAL: PORCELAIN TILE MANUFACTURER: BEST TILE STYLE: 3123 CEDAR PARK COLOR: SIMPLE MODERN CREME GLAZED GROUT: G - 2 SIZE: 2 X 2 MOSAIC NOTES: SHOWER FLOOR REP: NANCY, BEST TILE, 919-986-6256 TILE GROUT G 1 MATERIAL: TILE GROUT MANUFACTURER: LATICRETE COLOR: 39 MUSHROOM NOTES: USE WITH T - 1 G 2 MATERIAL: TILE GROUT MANUFACTURER: LATICRETE COLOR: 93 FOSSIL NOTES: USE WITH T-2 AND T - 3 RUBBER BASE RB 1 MATERIAL: RUBBER BASE MANUFACTURER: ROPPE SIZE: 4" COLOR: 178 PEWTER STONE ST 1 MATERIAL: DEKTON WALL STONE MANUFACTURER: COSENTINO - DEKTON STYLE: X GLOSS COLOR: HELENA 22 / STONKA INSTALLATION: VERTICAL NOTES: LOBBY + BAR AREA




1007 Procure Street
Fuquay-Varina, NC 27526

919.412.9138
turpentine-design.com

REVISIONS

A PRICING REV Date 1 July 1, 2026

SEALS

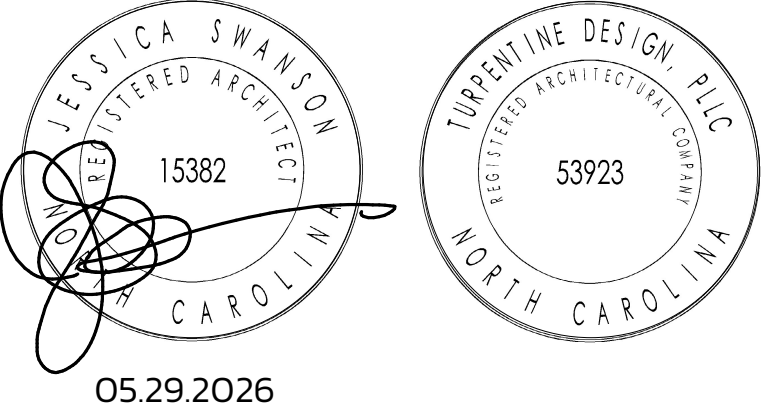

ARQ AVIATION FLIGHT SCHOOL + FBO

Wilmington International Airport (ILM)
Wilmington, NC 28405

OWNER
ARQ Realty

COPYRIGHT 2025 - ALL RIGHTS RESERVED
PRINTED OR ELECTRONIC DRAWINGS & DOCUMENTATION MAY
NOT BE REPRODUCED OR REDISTRIBUTED IN ANY WAY WITHOUT
WRITTEN PERMISSION FROM TURPENTINE DESIGN

PHASE PERMIT SET
DATE 05.29.2026
TD PROJECT # 25-009

DRAWING TITLE FINISH SCHEDULE + ACCESSORIES SCHEDULE

DRAWING NUMBER
A-701



FINISH PLAN - AREA A

1/8" = 1'-0"

1


GENERAL FINISH PLAN NOTES

- ALL INTERIOR WALL AND CEILING FINISHES SHALL COMPLY WITH 803.11 OF THE NCBC. ALL FLOORING FINISHES SHALL COMPLY 804 OF THE 2018 NCBC.
- ALL FINISHES SPECIFIED ARE APPROVED BY THE TENANT. ANY NECESSARY SUBSTITUTIONS SHALL BE SUBMITTED TO THE ARCHITECT FOR APPROVAL.
- UNLESS NOTED OTHERWISE (UNO), PROVIDE FINISH TRANSITION STRIPS BY SCHLUTER OR EQUAL AT ALL FLOOR FINISH TRANSITIONS. FINISH: VARIES -SEE SPECS. VINYL AND MARBLE THRESHOLDS WILL NOT BE ACCEPTED. UNO, TRANSITION FINISHES AT CENTER OF DOOR, FLOAT OR FEATHER ALL FLOORING MATERIALS AS REQUIRED TO ENSURE A LEVEL TRANSITION BETWEEN MATERIALS OF VARYING THICKNESS. TRANSITIONS TO COMPLY WITH ACCESSIBILITY REQUIREMENTS ICC A117.1 SECTION 303.
- SUBMIT FINISH SUBMITTALS (INCLUDING TRANSITION STRIPS) TO TURPENTINE DESIGN FOR REVIEW AND APPROVAL PRIOR TO ORDERING AND INSTALLATION. SUBMIT ALL FINISHES TOGETHER IN ONE FINISH SUBMITTAL PACKAGE.
- REFER TO THE CONSTRUCTION PLAN DIMENSIONS FOR ALL PRELIMINARY FINISH MATERIAL TAKE-OFFS. FIELD VERIFY ALL DIMENSIONS PRIOR TO ORDER PLACEMENT.
- REFER TO INTERIOR ELEVATIONS FOR ALL MILLWORK FINISH DESIGNATIONS.
- UNO, ALL PTD, HOLLOW METAL FRAMES SHALL RECEIVE A WATER BASED ALKYD SEMI-GLOSS PAINT WITH LOW VOC'S. COLOR PT-3.
- FLOORING PATTERN HATCHING IS FOR MATERIAL INFORMATION AND DESIGN INTENT ONLY AND IS NOT TO SUGGEST LAYOUT OR WORK POINTS. CONTRACTOR SHALL SUBMIT FLOORING SEAMING / PATTERN LAYOUT DIAGRAM TO TURPENTINE DESIGN FOR REVIEW AND APPROVAL PRIOR TO ORDERING AND INSTALLATION. INDICATE ON CARPET SEAMING DIAGRAM THE DIRECTION OF PATTERN INSTALLATION. CUT TILES LESS THAN 1/3 OF A FULL SIZE PIECE WILL NOT BE ACCEPTED. COORDINATE WITH ARCHITECT AS REQUIRED TO AVOID TILE "SLIVERS".
- CONTINUE FLOORING MATERIAL AS SCHEDULED UNDER MILLWORK AND INTO ALL MILLWORK RECESSES. GC TO FINISH GWB TO FINISHED FLOOR SO THAT RESILIENT BASE IS APPLIED TO A SMOOTH SURFACE. PAINTING SUBCONTRACTOR SHALL PROVIDE LOW-VOC PRIMERS AND FINISH-COAT MATERIALS THAT ARE COMPATIBLE WITH ONE ANOTHER AND WITH THE SUBSTRATES INDICATED.
- UNO, ALL GWB CEILINGS SHALL RECEIVE PAINT (PT-4), FLAT FINISH.
- UNO, ALL GYPSON BOARD WALLS TO RECEIVE PAINT (PT-3), EGGSHELL FINISH WITH BASE (RB-1).
- ALL FABRICS AND TEXTILES SHALL COMPLY WITH SECTION 803.1.4 OF THE NCSCB.
- REFER TO DOOR SCHEDULE FOR ALL DOOR FINISH INFORMATION.
- REFER TO BUILDING DETAILS FOR TRANSITION STRIP DETAILS.
- CEMENT BOARD (CONFIRM CORRECT TERM) TO BE INSTALLED IN LIEU OF DRYWALL AT ALL WALLS RECEIVING WALL TILE.

- PREPARE ALL SURFACES FOR INSTALLATION OF NEW FLOORING MATERIALS. SUBCONTRACTORS SHALL PROVIDE FINISH-COAT MATERIALS THAT ARE COMPATIBLE WITH ONE ANOTHER AND WITH THE SUBSTRATES INDICATED. PROVIDE CURING COMPOUND AS NECESSARY. PROVIDE WATERPROOF AND CRACK ISOLATION MEMBRANE IN ALL AREAS RECEIVING PORCELAIN FLOOR TILE. PROVIDE APPROPRIATE EXPANSION AND CONTROL JOINTS PER CURRENT T.C.N.A. RECOMMENDATIONS AND COORDINATE FINAL LOCATIONS WITH ARCHITECT.
- GC AND ARCHITECT TO COORDINATE WITH TENANT/OWNER FOR ATTIC STOCK REQUIREMENTS, QUANTITIES AND STORAGE AVAILABILITY FOR FLOORING MATERIALS.
- UNO, ALL EXPOSED CEILINGS INCLUDING STRUCTURE, DUCTWORK, MECHANICAL UNITS, CONDUIT, PIPING, ETC. TO RECEIVE PAINT (PT-5). SEE REFLECTED CEILING PLAN FOR NOTED EXCEPTIONS.
- WHERE INTERIOR FINISHES ARE APPLIED ON WALLS, CEILINGS OR STRUCTURAL ELEMENTS REQUIRED TO HAVE A FIRE-RESISTANCE RATING OR TO BE OF NON-COMBUSTABLE CONSTRUCTION, THEY SHALL COMPLY WITH SECTION 803.11 OF THE NCSCB.
- WHERE INTERIOR FINISHES ARE APPLIED ON WALLS, CEILINGS OR STRUCTURAL ELEMENTS REQUIRED TO HAVE A FIRE-RESISTANCE RATING OR TO BE OF NON-COMBUSTABLE CONSTRUCTION, THEY SHALL COMPLY WITH SECTION 803.11 OF THE NCSCB.


FINISH MATERIAL LEGEND

- WALK-OFF MAT
- TERRAZZO 1
- TERRAZZO 2
- STAINED CONCRETE
- STAINED CONCRETE ANTISTATIC
- EPOXY
- TILE 2
- TILE 3
- CARPET 1
- CARPET 2
- CARPET 3
- CARPET 4

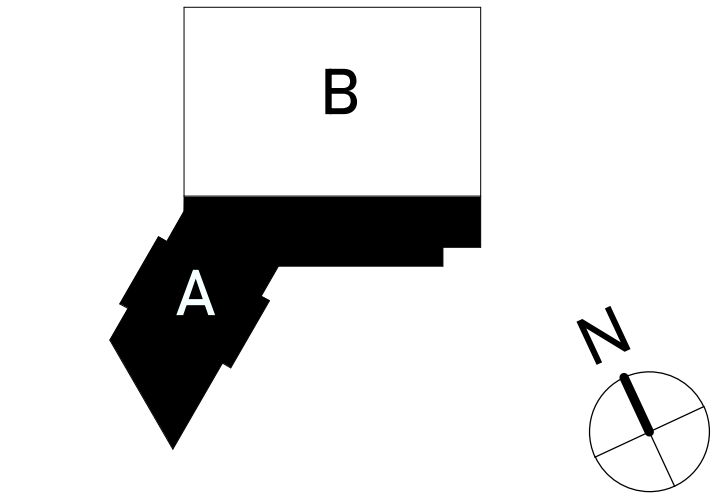

FINISH LEGEND

- FINISH FLOOR TRANSITION. SEE SHEET A701 FOR FLOORING TRANSITION DETAILS.
- FLOOR FINISH DIRECTION
- FLOOR FINISH, U.N.O.
- WALL FINISH, U.N.O.
- FLOOR BASE, U.N.O.
- CEILING FINISH, U.N.O.



TURPENTINE
DESIGN


1007 Procure Street
Fuquay-Varina, NC 27526

919.412.9138
turpentine-design.com

REVISIONS

A PRICING REV Date 1 July 1, 2026

SEALS

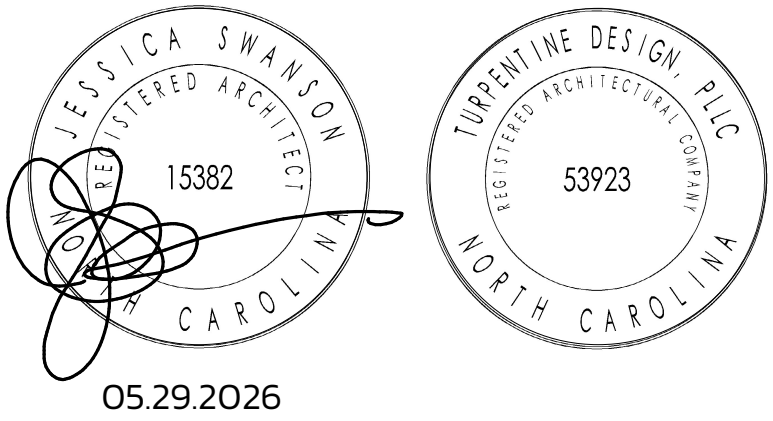

ARQ AVIATION
FLIGHT SCHOOL + FBO

Wilmington International Airport (ILM)
Wilmington, NC 28405

OWNER
ARQ Realty

COPYRIGHT 2025 - ALL RIGHTS RESERVED
PRINTED OR ELECTRONIC DRAWINGS & DOCUMENTATION MAY NOT BE REPRODUCED OR REDISTRIBUTED IN ANY WAY WITHOUT WRITTEN PERMISSION FROM TURPENTINE DESIGN


PHASE PERMIT SET
DATE 05.29.2026
TD PROJECT # 25-009

DRAWING TITLE

PARTIAL FINISH PLAN
- AREA A

DRAWING NUMBER

A-711A

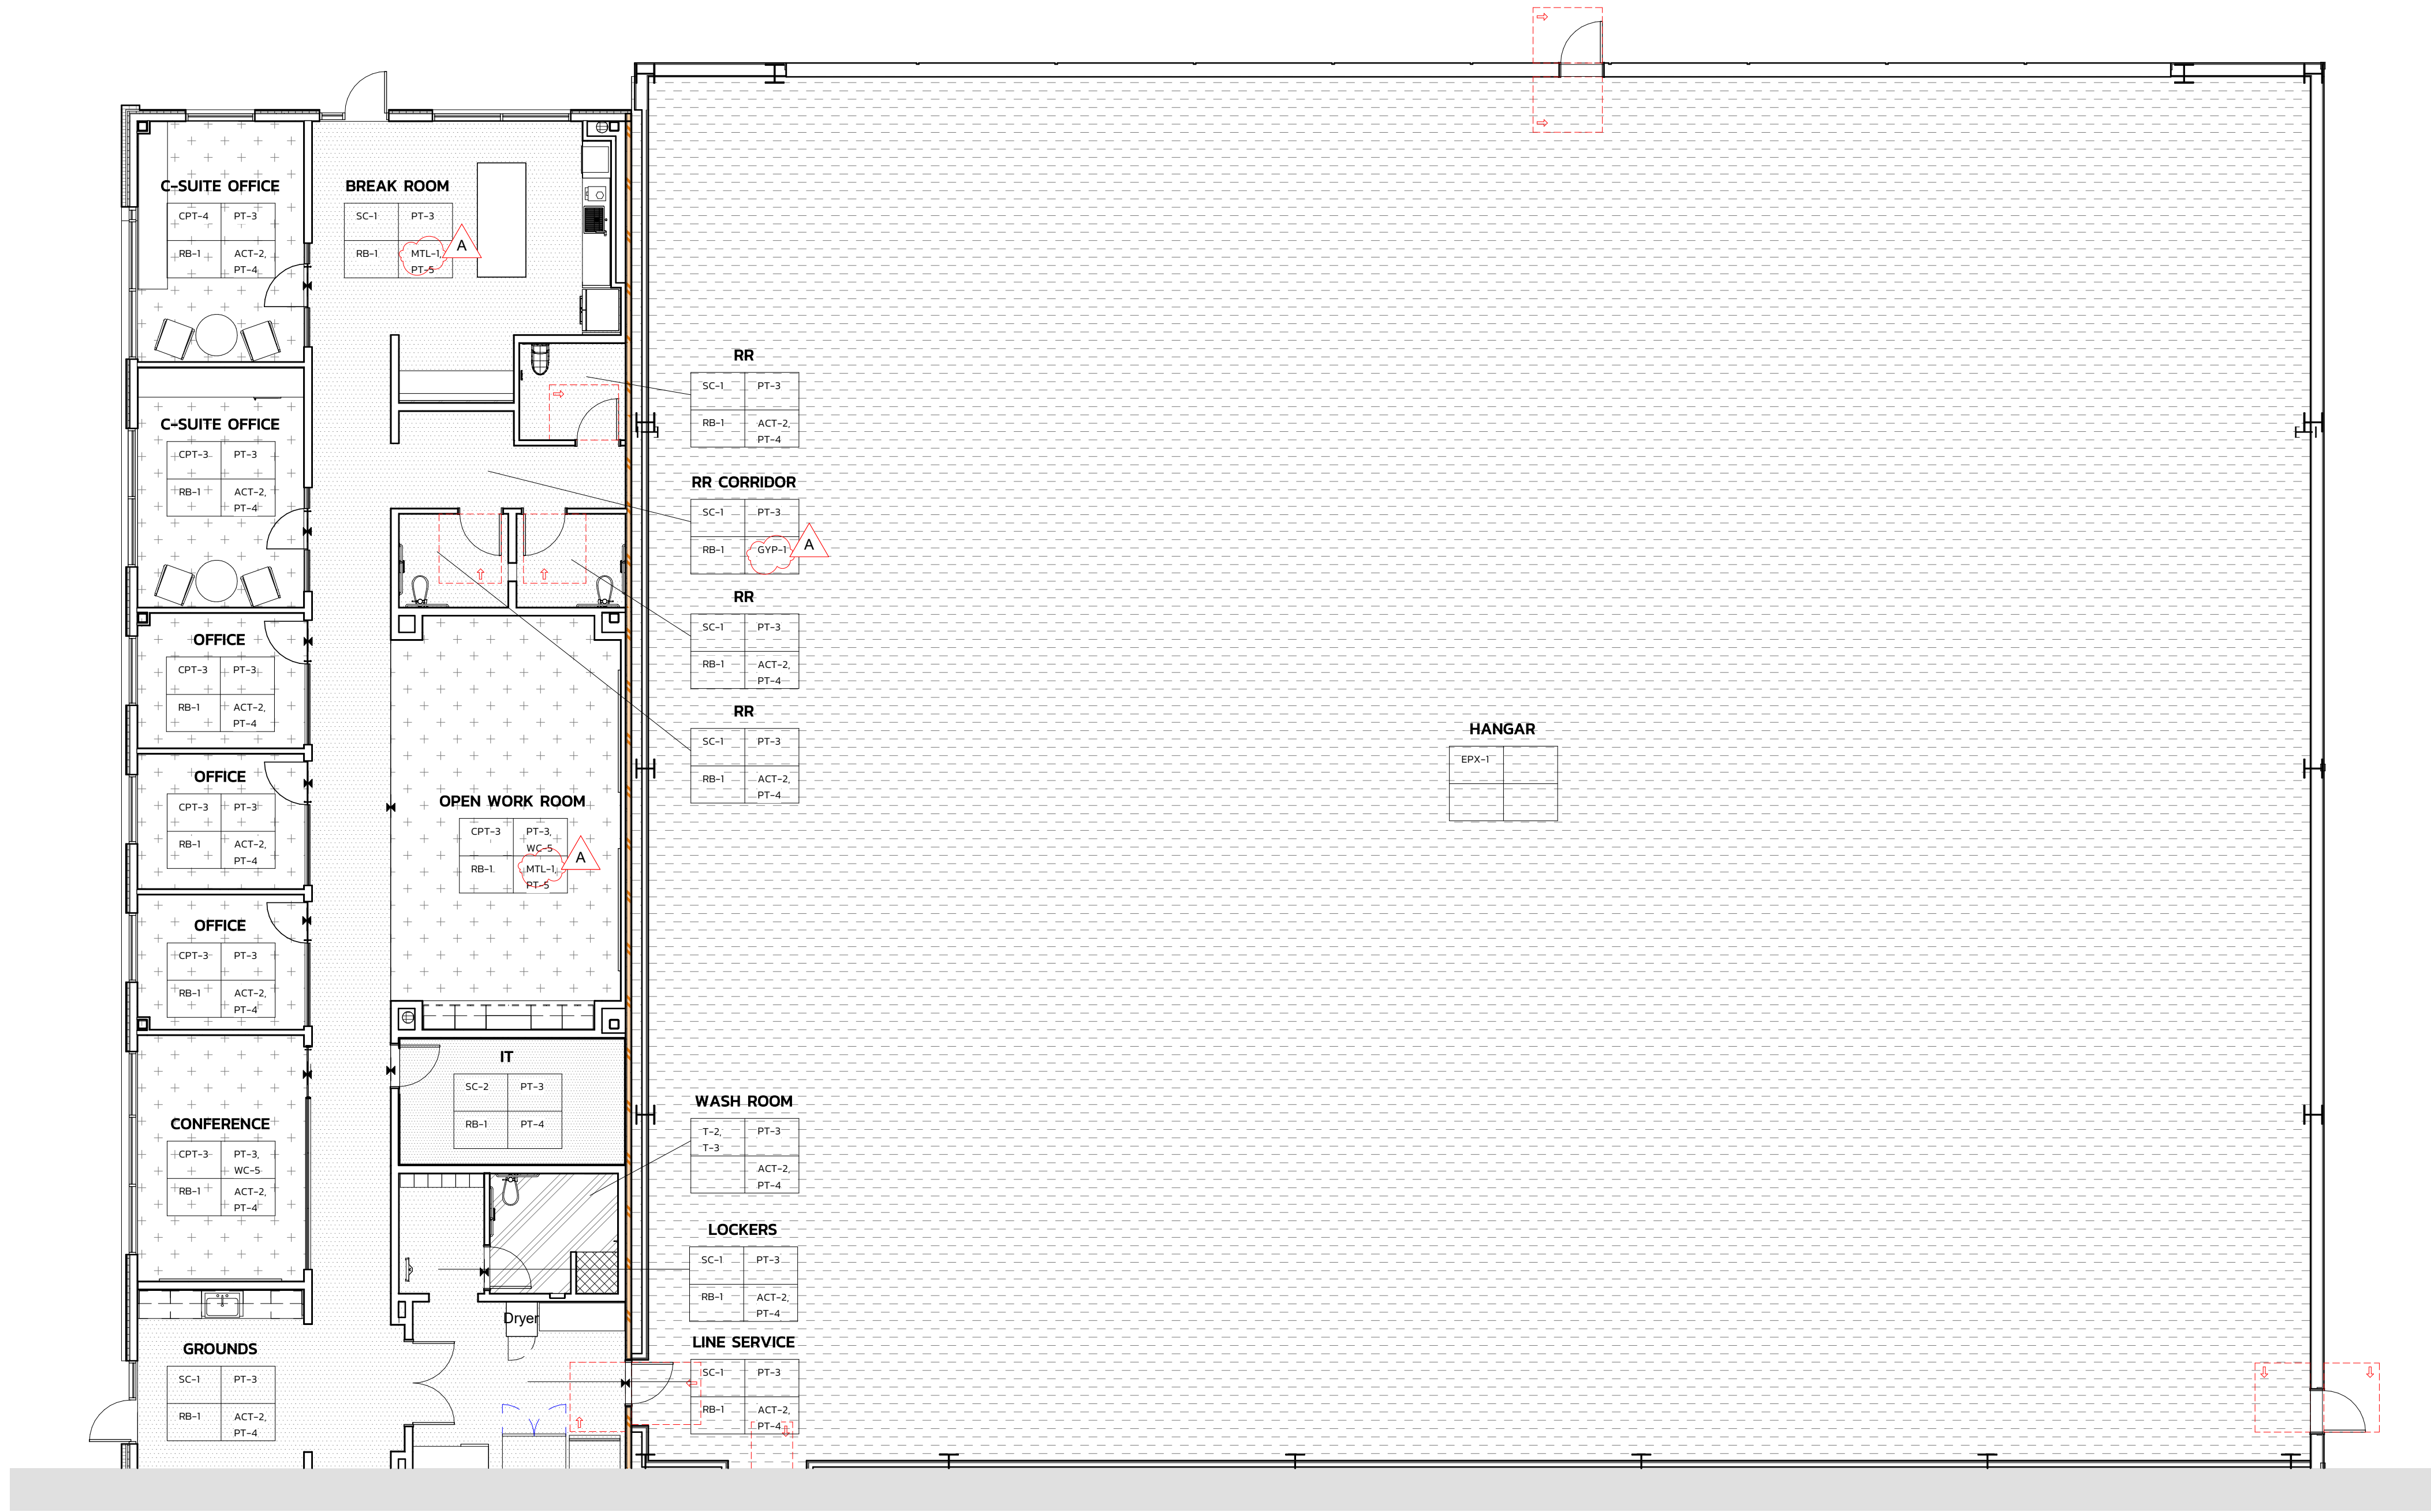

FINISH PLAN - AREA B

1/8" = 1'-0"

1


GENERAL FINISH PLAN NOTES

- ALL INTERIOR WALL AND CEILING FINISHES SHALL COMPLY WITH 803.11 OF THE NCBC. ALL FLOORING FINISHES SHALL COMPLY 804 OF THE 2018 NCBC.
- ALL FINISHES SPECIFIED ARE APPROVED BY THE TENANT. ANY NECESSARY SUBSTITUTIONS SHALL BE SUBMITTED TO THE ARCHITECT FOR APPROVAL.
- UNLESS NOTED OTHERWISE (UNO), PROVIDE FINISH TRANSITION STRIPS BY SCHLUTER OR EQUAL AT ALL FLOOR FINISH TRANSITIONS. FINISH: VARIES -SEE SPECS. VINYL AND MARBLE THRESHOLDS WILL NOT BE ACCEPTED. UNO, TRANSITION FINISHES AT CENTER OF DOOR. FLOAT OR FEATHER ALL FLOORING MATERIALS AS REQUIRED TO ENSURE A LEVEL TRANSITION BETWEEN MATERIALS OF VARYING THICKNESS. TRANSITIONS TO COMPLY WITH ACCESSIBILITY REQUIREMENTS ICC A117.1 SECTION 303.
- SUBMIT FINISH SUBMITTALS (INCLUDING TRANSITION STRIPS) TO TURPENTINE DESIGN FOR REVIEW AND APPROVAL PRIOR TO ORDERING AND INSTALLATION. SUBMIT ALL FINISHES TOGETHER IN ONE FINISH SUBMITTAL PACKAGE.
- REFER TO THE CONSTRUCTION PLAN DIMENSIONS FOR ALL PRELIMINARY FINISH MATERIAL TAKE-OFFS. FIELD VERIFY ALL DIMENSIONS PRIOR TO ORDER PLACEMENT.
- REFER TO INTERIOR ELEVATIONS FOR ALL MILLWORK FINISH DESIGNATIONS.
- UNO, ALL PTD. HOLLOW METAL FRAMES SHALL RECEIVE A WATER BASED ALKYD SEMI-GLOSS PAINT WITH LOW VOC'S. COLOR PT-3.
- FLOORING PATTERN HATCHING IS FOR MATERIAL INFORMATION AND DESIGN INTENT ONLY AND IS NOT TO SUGGEST LAYOUT OR WORK POINTS. CONTRACTOR SHALL SUBMIT FLOORING SEAMING / PATTERN LAYOUT DIAGRAM TO TURPENTINE DESIGN FOR REVIEW AND APPROVAL PRIOR TO ORDERING AND INSTALLATION. INDICATE ON CARPET SEAMING DIAGRAM THE DIRECTION OF PATTERN INSTALLATION. CUT TILES LESS THAN 1/3 OF A FULL SIZE PIECE WILL NOT BE ACCEPTED. COORDINATE WITH ARCHITECT AS REQUIRED TO AVOID TILE "SLIVERS".
- CONTINUE FLOORING MATERIAL AS SCHEDULED UNDER MILLWORK AND INTO ALL MILLWORK RECESSES. GC TO FINISH GWB TO FINISHED FLOOR SO THAT RESILIENT BASE IS APPLIED TO A SMOOTH SURFACE. PAINTING SUBCONTRACTOR SHALL PROVIDE LOW-VOC PRIMERS AND FINISH-COAT MATERIALS THAT ARE COMPATIBLE WITH ONE ANOTHER AND WITH THE SUBSTRATES INDICATED.
- UNO, ALL GWB CEILINGS SHALL RECEIVE PAINT (PT-4), FLAT FINISH.
- UNO, ALL GYPSUM BOARD WALLS TO RECEIVE PAINT (PT-3), EGGSHELL FINISH WITH BASE (RB-1).
- ALL FABRICS AND TEXTILES SHALL COMPLY WITH SECTION 803.1.4 OF THE NCSCB.
- REFER TO DOOR SCHEDULE FOR ALL DOOR FINISH INFORMATION.
- REFER TO BUILDING DETAILS FOR TRANSITION STRIP DETAILS.
- CEMENT BOARD (CONFIRM CORRECT TERM) TO BE INSTALLED IN LIEU OF DRYWALL AT ALL WALLS RECEIVING WALL TILE.

- PREPARE ALL SURFACES FOR INSTALLATION OF NEW FLOORING MATERIALS. SUBCONTRACTORS SHALL PROVIDE FINISH-COAT MATERIALS THAT ARE COMPATIBLE WITH ONE ANOTHER AND WITH THE SUBSTRATES INDICATED. PROVIDE CURING COMPOUND AS NECESSARY. PROVIDE WATERPROOF AND CRACK ISOLATION MEMBRANE IN ALL AREAS RECEIVING PORCELAIN FLOOR TILE. PROVIDE APPROPRIATE EXPANSION AND CONTROL JOINTS PER CURRENT T.C.N.A. RECOMMENDATIONS AND COORDINATE FINAL LOCATIONS WITH ARCHITECT.
- GC AND ARCHITECT TO COORDINATE WITH TENANT/OWNER FOR ATTIC STOCK REQUIREMENTS, QUANTITIES AND STORAGE AVAILABILITY FOR FLOORING MATERIALS.
- CHECK FINISH PLAN FOR FLOOR DIRECTION. VARIES PER LOCATION.
- UNO, ALL EXPOSED CEILINGS INCLUDING STRUCTURE, DUCTWORK, MECHANICAL UNITS, CONDUIT, PIPING, ETC. TO RECEIVE PAINT (PT-5). SEE REFLECTED CEILING PLAN FOR NOTED EXCEPTIONS.
- WHERE INTERIOR FINISHES ARE APPLIED ON WALLS, CEILINGS OR STRUCTURAL ELEMENTS REQUIRED TO HAVE A FIRE-RESISTANCE RATING OR TO BE OF NON-COMBUSTABLE CONSTRUCTION, THEY SHALL COMPLY WITH SECTION 803.11 OF THE NCSCB.
- WHERE INTERIOR FINISHES ARE APPLIED ON WALLS, CEILINGS OR STRUCTURAL ELEMENTS REQUIRED TO HAVE A FIRE-RESISTANCE RATING OR TO BE OF NON-COMBUSTABLE CONSTRUCTION, THEY SHALL COMPLY WITH SECTION 803.11 OF THE NCSCB.


FINISH MATERIAL LEGEND

- WALK-OFF MAT
- TERRAZZO 1
- TERRAZZO 2
- STAINED CONCRETE
- STAINED CONCRETE ANTISTATIC
- EPOXY
- TILE 2
- TILE 3
- CARPET 1
- CARPET 2
- CARPET 3
- CARPET 4

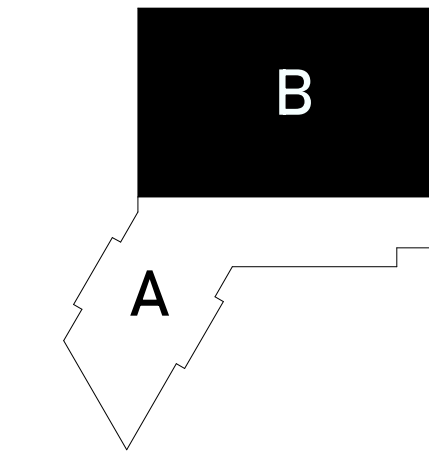

FINISH LEGEND

- FINISH FLOOR TRANSITION. SEE SHEET A701 FOR FLOORING TRANSITION DETAILS.
- FLOOR FINISH DIRECTION
- FLOOR FINISH, U.N.O.
- WALL FINISH, U.N.O.
- FLOOR BASE, U.N.O.
- CEILING FINISH, U.N.O.



TURPENTINE
DESIGN


1007 Procure Street
Fuquay-Varina, NC 27526

919.412.9138
turpentine-design.com

REVISIONS

A PRICING REV Date 1 July 1, 2026

SEALS

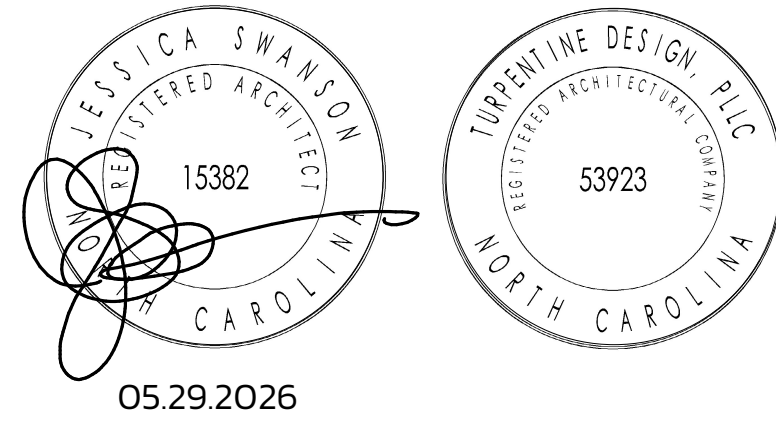

ARQ AVIATION

FLIGHT SCHOOL + FBO

Wilmington International Airport (ILM)
Wilmington, NC 28405

OWNER
ARQ Realty

COPYRIGHT 2025 - ALL RIGHTS RESERVED
PRINTED OR ELECTRONIC DRAWINGS & DOCUMENTATION MAY NOT BE REPRODUCED OR REDISTRIBUTED IN ANY WAY WITHOUT WRITTEN PERMISSION FROM TURPENTINE DESIGN

PHASE PERMIT SET
DATE 05.29.2026
TD PROJECT # 25-009

DRAWING TITLE

PARTIAL FINISH PLAN
- AREA B

DRAWING NUMBER

A-711B

Project Name	Location	Item #	Quantity	Model #	AIA #	SIS #
--------------	----------	--------	----------	---------	-------	-------



FEATURES

- R290 Hydrocarbon refrigerant.
- Temperatures of 33°F to 38°F (.5°C to 3.3°C)
- Exterior: Stainless steel.
- Interior: Stainless steel.
- True's self-cleaning RCU technology eliminates the need to clean the condenser coil, reduces energy consumption and helps maintain the coldest temperatures and freshest product.
- White LED lighting.
- NSF/ANSI standard 7 compliant for the storage and/or display of packaged or bottled product.
- UL Rated for outdoor use.
- Three (3) interior access ports.
- Field reversible doors.
- Zero clearance (side and back).
- Front air intake / front air discharge.
- Electronic temperature control with exterior digital display.
- 15" (381mm) surface mounted drip tray trough.
- 3" (77mm) diameter insulated columns with single faucet and 2-way manifold.

ROUGH-IN DATA

Specifications subject to change without notice. Chart dimensions rounded up to the nearest 1/8" (millimeters rounded up to next whole number).

Model	Doors	Shelves	Capacity					Cabinet Dimensions (inches) (mm)			115V/60/1 Voltage			Cord Length† (total ft.) (total m)	Crated Weight (lbs.) (kg)
			Home Brew Barrels	1/6 Barrels	Slim 1/4 Barrels	1/4 Barrels	1/2 Barrels	W	D†	H	HP	Amps	NEMA		
TDR48-RISZ1-L-S-SS-1	2	0	6	6	3	0	0	48	24 ⁷ / ₈	34 ³ / ₄	¹ / ₅	1.8	5-15P	10	320
								1219	631	881				3.04	145

† Depth does not include 1½" (35 mm) for door handles. * Height does not include 15¾" (400 mm) for draft towers or 1/4" (7 mm) for leg levelers.

‡ Cord length listed represents usable cord length.



APPROVALS

AVAILABLE AT



Unit completely pre-wired at factory and ready for final connection to a 115/60/1 phase, 15 amp dedicated outlet. Cord and plug set included.

ADDITIONAL FEATURES

Refrigeration System

- Factory engineered, self-contained, capillary tube system.
- Environmentally friendly R290 hydrocarbon refrigerant.
- Forced air refrigeration system which maintains 33°F to 38°F (.5°C to 3.3°C) product temperatures
- True's self-cleaning RCU technology eliminates the need to clean the condenser coil, reduces energy consumption and helps maintain the coldest temperatures and freshest product.

Cabinet Construction

- Exterior: Stainless steel front, side and countertop
- Interior: Stainless steel floor and sides with ABS plastic ceiling
- Insulation: Entire cabinet is foamed-in-place using a high density, polyurethane insulation that has zero ozone depletion and zero global warming potential.
- Base fitted with leg levelers

Doors

- Door locks standard in countertop.
- Field Reversible Doors standard (reverse hinge kit included).
- Door threshold with reinforced lip.

Model Features

- NSF/ANSI Standard 7 compliant for the storage and/or display of packaged or bottled product.
- UL approved for outdoor use.
- Electronic temp control with exterior digital display.
- Three (3) access ports standard (see drawing for locations).
- 3" (77 mm) diameter insulated columns with single faucet and 2-way manifold.
- 15" (381 mm) surface mounted drip tray troughs.
- Insulated and chilled draft columns.

Electrical


- Unit completely pre-wired at factory and ready for final connection to a 115/60/1 phase, 15 amp dedicated outlet. Cord and plug set included.

Optional Features/Accessories (upcharge and lead times may apply)


- ☐ Castors 7/8" (23 mm) rollers, 2" (51mm), 3" (77mm), 4" (102mm), 5" (127mm) castors
- ☐ 6" (153mm) legs
- ☐ 6" (153mm) seismic legs
- ☐ Alternative temperature zones available (red wine, white wine, beer)
- ☐ Right side compressor
- ☐ Shelving (wine, cut-out, additional. Available in gray or black)
- ☐ Bottle Organizers
- ☐ Draft columns (8 options, beer, coffee and wine available)
- ☐ Manifolds (2-way, 3-way, 4-way)
- ☐ Spill Pan and Grate 7", 11", 19", 23", 27", 31", 35". (15" comes standard.)
- ☐ Draft Column Hole Cover
- ☐ Access Ports
- ☐ CO₂ Pressure Regulator
- ☐ Drain Bottle & Hanger Bracket
- ☐ Unit is available in a panel ready option which changes the nomenclature. Contact factory for details

PLAN VIEWS


Plan View Notes: Dimensions in brackets are in millimeters. • Depth does not include 1½" (35 mm) for door handles. • Height does not include 15¾" (400 mm) for draft towers or ¼" (7 mm) for leg levelers.

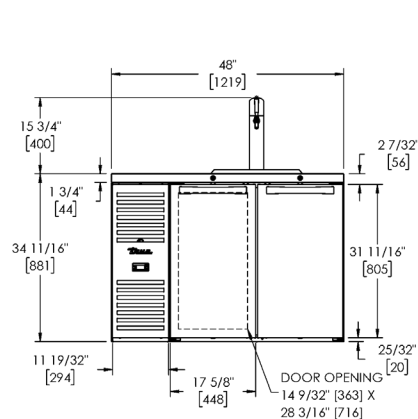


FRONT VIEW

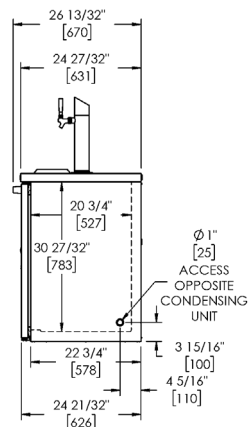

SIDE VIEW

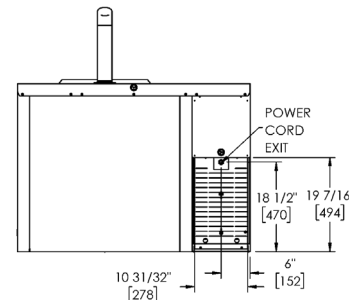

BACK VIEW

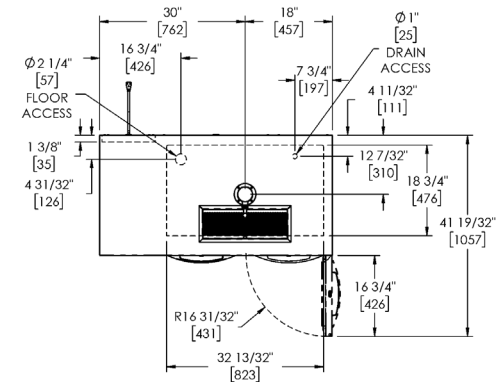

TOP VIEW

Taffer Command Station

Underbar



KR24-TCS76B with optional freezer, drip tray, CO2 chiller

Standard Features

- Crafted in collaboration between Jon Taffer and Krowne
- Included with our standard models: Insulated Elixir Bottle Storage, Insulated Ice Bin with Garnish Station, 5-Step Space Maximizing Liquor Display, Speed Unit with Glass Rinser and Dipperwell, Hybrid Speed Sink & Soda Gun Holder (soda gun holders only included with cold plate models)
- Hybrid Speed Sink includes space-saving tiered sink design with dedicated drains and faucets for each bowl.
- Single hole splash mount Diamond Series electronic sensor faucet on top sink, single hole deck mount manual faucet on bottom sink
- Removable garnish station with integrated cover and pint cups
- Insulated elixir station with stainless steel dividers and perforated bottom for ice separation
- Ice bin dividers which allow for storage of different types of ice
- 5-step space saving liquor display maximizes storage capacity
- Sound deadened speedrail included
- Tool well with dipperwell faucet
- High performance glass rinser
- 24" front to back depth
- Available on stainless legs or modular bar die
- Optional add-ons: Craft Ice Storage Freezer (KR24-12CSF), Drop-In CO2 Chiller (KR-LC2GF), Soda Gun Jetter (KR-GC100), Drop-In Drainer

Specifications

Materials	▪ Combination of 18g and 20g stainless steel ▪ 16g steel backs
Drains	▪ 1-1/2" IPS Drain (sink bowl) ▪ 1/2" NPS Drain (dipperwell) ▪ 1" NPS Drain (elixir section) ▪ 1" IPS Drain (ice bin without cold plate) ▪ 1/2" IPS Drain (ice bin with cold plate)*
Cold Plate	▪ Cast aluminum post mix plate with 10 circuits. Plate is sealed into bottom. Each circuit is 5/16" OD stainless steel tubing. Bump and swedge fittings on ends.
Faucets	▪ Diamond Series single hole wall (16-675) ▪ Royal Series 16-2XXL faucet with 1/4 turn ceramic cartridge valves on bottom sink ▪ 1/2" IPS hot & cold water ▪ 1/2" IPS cold (dipperwell faucet)
Speed Unit	▪ 1/2" IPS cold speed rinser ▪ Non-slip flush mounted cutting board
Legs	▪ 1-5/8" tubular legs w/ gray plastic bullet foot
Freezer (Optional)	▪ 11-1/2"W x 10"L





*Cold Plate Units supplied with 1/2" x 6" PVC tailpiece (1/2" - 20 male threaded). PVC tailpiece required to avoid condensation through metal to metal contact.
Model: **KR-CPN6**

Taffer Command Station



Underbar

Taffer Command Station with Cold Plate

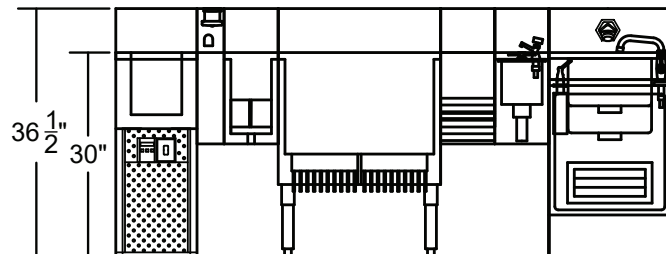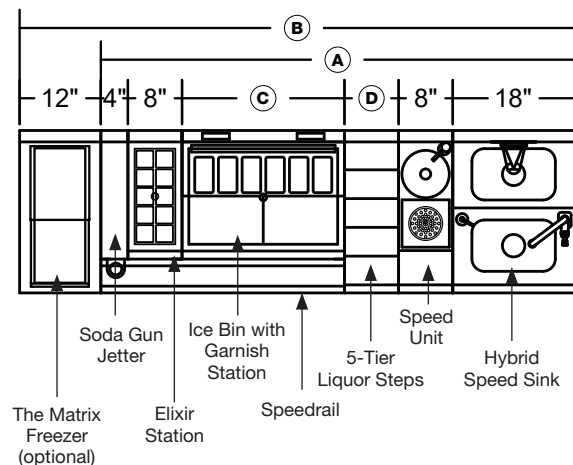

Model with Cold Plate	Overall Length (A)	Extended Length with Optional Freezer (B)	Depth	Height	Soda Gun Holder	Elixir Station Size	Elixir Bottles	Ice Bin Size (C)	Garnish Cups	Liquor Steps Size (D)	Liquor Bottles	Speed Unit Size	Hybrid Sink Bowls	Cold Plate Circuits
KR24-TCS70A-10	70"	82"	24"	36-1/2"	4"	8"	10	24"	6	8"	10	8"	2	10-Circuit
KR24-TCS76B-10	76"	88"	24"	36-1/2"	4"	8"	10	30"	8	8"	10	8"	2	10-Circuit
KR24-TCS80C-10	80"	92"	24"	36-1/2"	4"	8"	10	30"	8	12"	12	8"	2	10-Circuit

Taffer Command Stations without Cold Plate

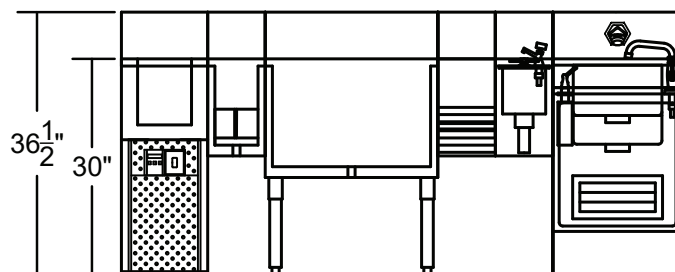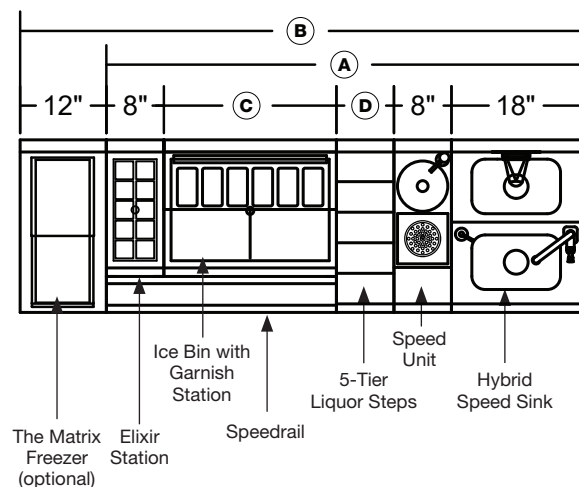

Model with Cold Plate	Overall Length (A)	Extended Length with Optional Freezer (B)	Depth	Height	Elixir Station Size	Elixir Bottles	Ice Bin Size (C)	Garnish Cups	Liquor Steps Size (D)	Liquor Bottles	Speed Unit Size	Hybrid Sink Bowls
KR24-TCS66D	66"	78"	24"	36-1/2"	8"	10	24"	6	8"	10	8"	2
KR24-TCS72E	72"	84"	24"	36-1/2"	8"	10	30"	8	8"	10	8"	2
KR24-TCS76F	76"	88"	24"	36-1/2"	8"	10	30"	8	12"	12	8"	2

Royal Series Liquor Displays

Royal Series Underbar



KR24-24RD



Standard Features

- Tiered bottle storage system that is easily accessible for bartenders
- Sound deadening technology
- Available in 3-step, 4-step, or 5-step
- Locking covers available for 4-step models

Specifications

Material


- Bottle Steps: 20 gauge stainless steel
- Guardrails: 20 gauge stainless steel
- Backsplash: 20 gauge stainless steel
- Sides: 18 gauge stainless steel
- Back & Bottom: 20 gauge galvanized steel

Legs

- 1-5/8" tubular 16 gauge stainless steel with grey plastic bullet foot


3-Step Liquor Displays

Model	Length (A)	Depth (Front to Back)	Bottle Storage	Wgt. (lbs.)
KR19-12RD	12"	19"	9	32
KR19-18RD	18"	19"	12	40
KR19-24RD	24"	19"	18	50

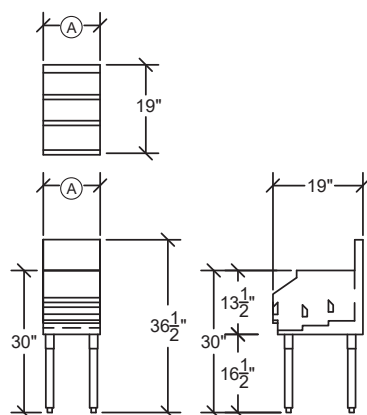

4-Step Liquor Displays


Model	Length (A)	Depth (Front to Back)	Bottle Storage	Wgt. (lbs.)
KR24-12RD	12"	24"	12	40
KR24-18RD	18"	24"	16	48
KR24-24RD	24"	24"	24	60
KR24-30RD	30"	24"	32	70
KR24-36RD	36"	24"	36	80
KR24-12RD-LC	12"	24"	12	45
KR24-18RD-LC	18"	24"	16	55
KR24-24RD-LC	24"	24"	24	65

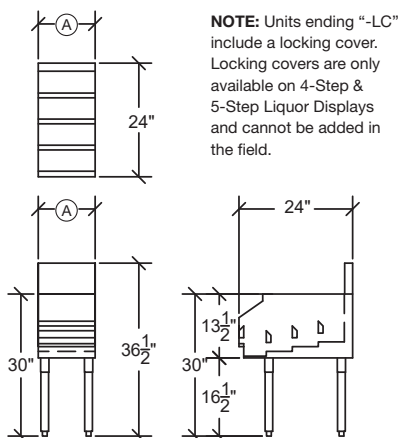

NOTE: Units ending "-LC" include a locking cover. Locking covers are only available on 4-Step & 5-Step Liquor Displays and cannot be added in the field.

5-Step Liquor Displays

Model	Length (A)	Depth (Front to Back) (B)	Bottle Storage	Wgt. (lbs.)
KR24-ML8	8"	24"	10	35
KR24-ML12	12"	24"	15	40
KR24-ML16	16"	24"	20	45
KR24-ML20	20"	24"	25	50
KR29-12RD	12"	29"	15	55
KR29-18RD	18"	29"	20	65
KR29-24RD	24"	29"	28	75
KR24-ML8-LC	8"	24"	10	3
KR24-ML12-LC	12"	24"	15	4
KR24-ML16-LC	16"	24"	20	5
KR29-12RD-LC	12"	29"	15	60
KR29-18RD-LC	18"	29"	20	70
KR29-24RD-LC	24"	29"	28	80

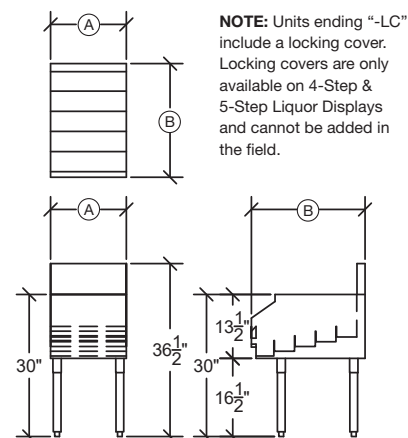

NOTE: Units ending "-LC" include a locking cover. Locking covers are only available on 4-Step & 5-Step Liquor Displays and cannot be added in the field.



Model: _____ Item #: _____ Date: _____

Project: _____ Qty: _____ Approved By: _____

Self-Contained Back Bar Refrigeration with Mixing Doors

Refrigeration



BS84R-S-D2-LS-RK shown

Models

Model	Length	Doors	Weight	Amps	HP
BS36	36"	1-Door	285 lbs.	1.7	1/5
BS60	60"	2-Door	360 lbs.	2.2	1/4
BS84	84"	3-Door	480 lbs.	2.7	1/3
BS108	108"	4-Door	525 lbs.	2.8	1/3

Specifications

Electrical	115 V, 1 Phase, 60 Hz - Furnished with 8'-0" plug-in cord, which exits left or right rear of cooler - NEMA 5-15P plug configuration
	- Dedicated 15 amp circuit recommended 1 Door Units (36"): 1.7 amps, 1/5 HP 2 Door Units (60"): 2.2 amps, 1/4 HP 3 Door Units (84"): 2.7 amps, 1/3 HP 4 Door Units (108"): 2.8 amps, 1/3 HP
	R290 Hydrocarbon Refrigerant
	30°F - 40°F operating range - Digital thermostat on front grille
Plumbing	- No drain required - Condensate evaporator pan included
Insulation	2" thick foamed-in-place polyurethane
Interior	20 gauge stainless steel with coved corners - NSF epoxy coated durable shelves - one bottom and two adjustable shelves per door (Does not include wine drawer selections) - Integrated divider prevents bottles from falling into sliding drawer

Standard Features

- 35" High without Top, 36" High with 1" Optional Top
- 24" Front to Back Depth (25" with Top)
- Coved corner stainless steel interior
- Heavy duty Self-Closing 24"W Doors
- Stainless steel door handles with built-in locks
- Digital thermostat
- Built-in Cool White LED Lighting (7000K)
- DynamicChill 360° Technology
- Heated mullion to minimize condensation
- Optional dual zone temperature control (60" & 84" only)
- Approved for NSF 7 Open Food Storage
- Pre-drilled bottom for optional legs or casters (uses 1/4-20 self tapping 1/2"L screw)
- Eco-friendly Refrigerant and Insulation
- 5-Year Compressor Warranty
- 1-Year Parts & Labor Warranty

Exterior

- Sides: 20 gauge stainless steel
- Front: 20 gauge stainless steel, black vinyl, or glass
- Back: 20 gauge galvanized steel
- Top: 20 gauge galvanized steel with option of 1" stainless steel top
- Available without a finished top for integrated bar installations.

Doors

- Self-closing 24"W doors available in black vinyl, stainless steel, glass with black vinyl, or glass with stainless steel
- 19-3/4"W x 29-11/16"H door opening

Sliding Drawers

- All stainless steel with built-in locks
- One 11" interior height drawer (15-1/2" overall)
- One 13-3/4" internal height drawer (18" overall)
- 18" drawer fits standard sized wine bottles standing up
- Soft stop technology
- Load Capacity: up to 175 lbs (80 kg) full extension



Sliding Drawers Available



This equipment is intended for the storage and display of non-potentially hazardous bottle or canned products only.



Model: _____ Item #: _____ Date: _____



Project: _____ Qty: _____ Approved By: _____

Self-Contained Back Bar Refrigeration with Mixing Doors

Refrigeration


One Door (36")

Models beginning BS36





D1 Door Style Side View

18" Drawer on Top, 15-1/2" Drawer on Bottom

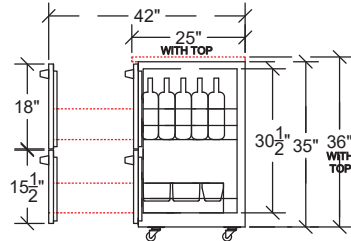


Two Door (60")

Models beginning BS60

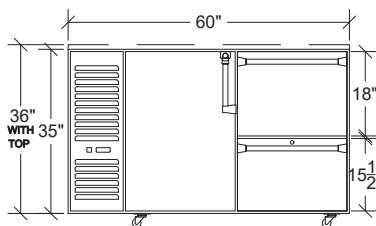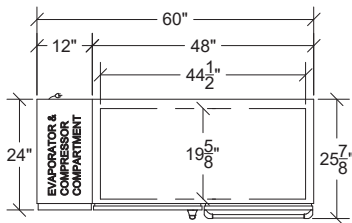



D2 Door Style Side View

15-1/2" Drawer on Top, 18" Drawer on Bottom

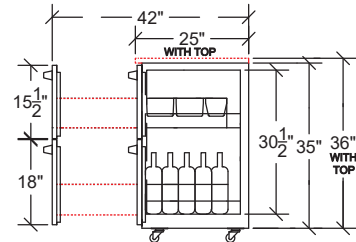



Three Door (84")

Models beginning BS84

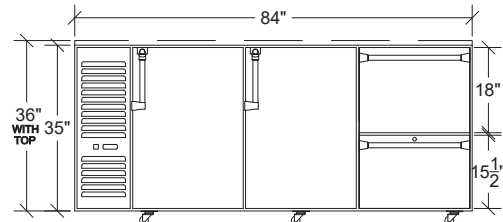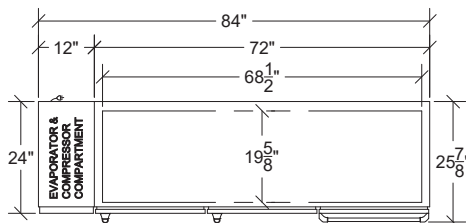

Four Door (108")

Models beginning BS108

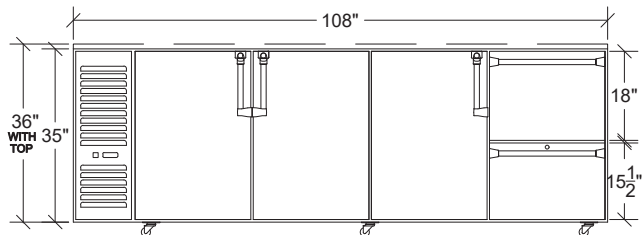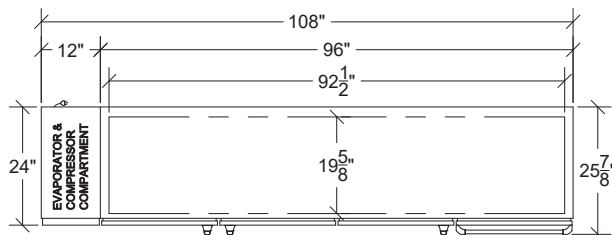

Note: Optional casters and legs available in several heights



Model: _____ Item #: _____ Date: _____

Project: _____ Qty: _____ Approved By: _____

Self-Contained Back Bar Refrigeration with Mixing Doors

Refrigeration

Mixing Door Refrigeration Configuration Table

Use this configuration table to create your back bar refrigerator. Choose a Letter in each numbered category to build your model number. See below example.


Sample Three Door Model Number

Choose a Letter in each numbered category to build your model number.

BS84R-S-D2-LS-RK

1 2 3 4 4 4

No.	Category	Letter	Description
1	Base Model	BS36	36" 1-Door
		BS60	60" 2-Door
		BS84	84" 3-Door
		BS108	108" 4-Door
2	Compressor Location	L	Compressor on Left
		R	Compressor on Right
3	Top Finish	N	Unfinished
		S	Stainless Steel
4	Door Style & Finish	D1	18" Stainless Steel on top 15-1/2" Stainless Steel Drawer on bottom
		D2	15-1/2" Stainless Steel Drawer on top 18" Stainless Steel Drawer on bottom
		LS	Left Hinge / Stainless Steel
		RS	Right Hinge / Stainless Steel
		LK	Left Hinge / Glass with Stainless Steel
		RK	Right Hinge / Glass with Stainless Steel
		LB	Left Hinge / Black Vinyl
		RB	Right Hinge / Black Vinyl
		LG	Left Hinge / Glass with Black Vinyl
		RG	Right Hinge / Glass with Black Vinyl

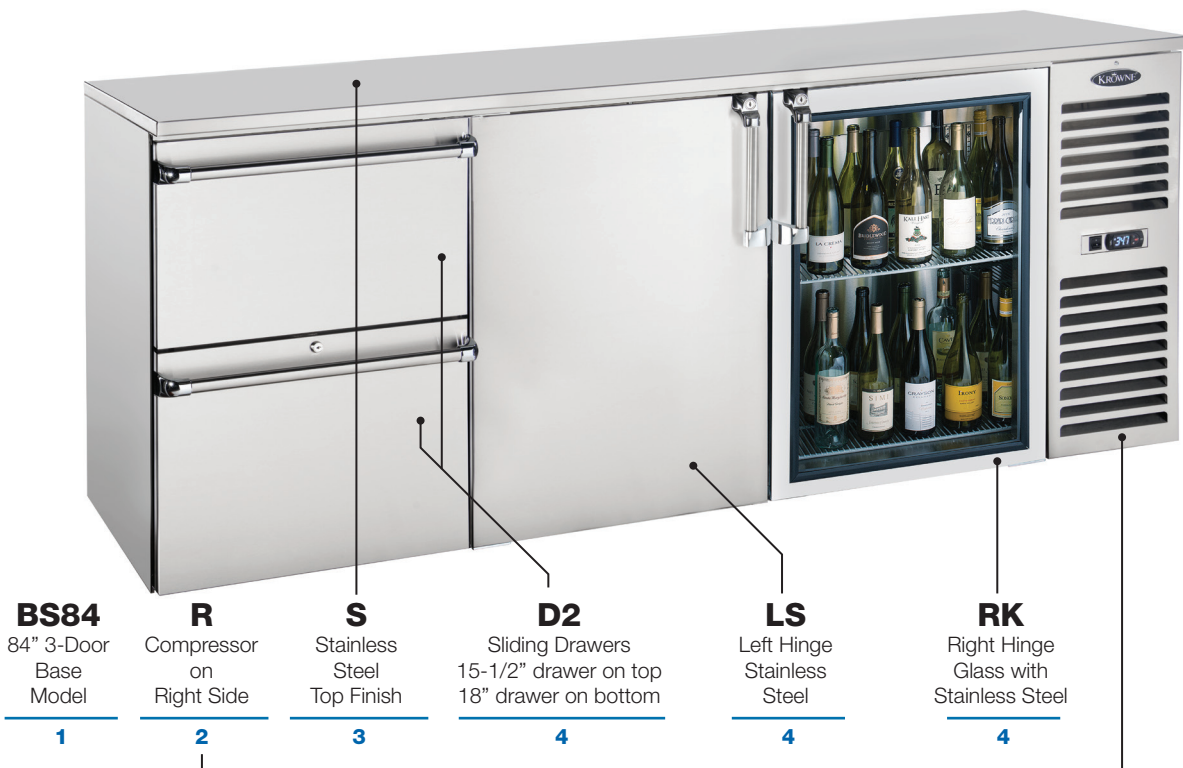

Glass Storage Cabinets

Royal Series Underbar



KR24-GSB1
Adjustable Slides (3 racks)



KR24-GSB3
Middle Shelf (2 racks)



KR24-GSB4
Middle Shelf/Cutting Board (2 racks)



KR24-GSB5
Roll Out Shelves (2 racks)



KR24-24SC
Storage with Hand Sink

Model	Description	Length	Depth	20" x 20" Glass Rack Capacity	Weight
KR24-GSB1	Glass Storage with Drainboard Top and Adjustable (3) Rack Slides	24"	24"	3	40
KR24-GSB3	Glass Storage with Drainboard Top and Middle Shelf	24"	24"	2	48
KR24-GSB4	Glass Storage with Drainboard Top, Middle Shelf, Cutting Board	24"	24"	2	60
KR24-GSB5	Glass Storage with Drainboard Top and Roll Out Shelves	24"	24"	2	60
KR24-24SC	Glass Storage with Drainboard Top and Right Side Sink	24"	24"	-	70
KR24-24SC-L	Glass Storage with Drainboard Top and Left Side Sink	24"	24"	-	70

Standard Features

- Open front base for glass storage
- Drainboard top, optional perforated insert available
- Glass racks not included
- Royal Series faucet included with hand sink models KR24-24SC and KR24-24SC-L

Optional Accessories

KR-313	Left and Right End Side Splashes
KR-314	Right End Side Splash
KR-315	Left End Side Splash
30-160	Glass Storage with Left Side Sink (For KR24-24SC and KR24-24SC-L)
30-152	Glass Storage with Right Side Sink (For KR24-24SC and KR24-24SC-L)
21-443L	E-Z Install Flexible Water Line Kit (For KR24-24SC and KR24-24SC-L)
KR24-PE24	24" Perforated Insert (For KR24-GSB1 and KR24-GSB3 and KR24-GSB5)

Specifications

Drainboard	▪ 20 gauge embossed stainless steel reinforced with welded braces every 6" ▪ 3/4" radius on all vertical and horizontal edges ▪ Perforated insert is optional except for model KR24-GSB4 where it is included
Material	▪ Front apron: 20 gauge stainless steel ▪ Shelf: 20 gauge stainless steel ▪ Backsplash: 20 gauge stainless steel ▪ Sides: 20 gauge stainless steel ▪ Back and bottom: 20 gauge galvanized steel
Legs	▪ 1-5/8" tubular 16 gauge stainless steel with grey plastic bullet foot
Plumbing	▪ 1/2" drain on right rear of drainboard (23-110) (KR24-24SC and KR24-24SC-L does not have this drain as liquid drains directly to sink bowl) ▪ 1" bottom shelf drain (23-111) ▪ 1-1/2" drain on KR24-24SC sink bowl (23-122)
Cutting Board	▪ Non-slip flush mounted cutting board on model KR24-GSB4 (CB-127)






Glass Storage Cabinets




Royal Series Underbar






KR24-GSB1

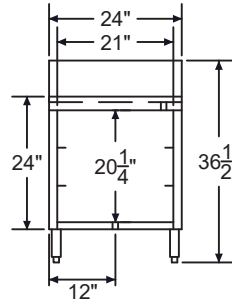




KR24-GSB3

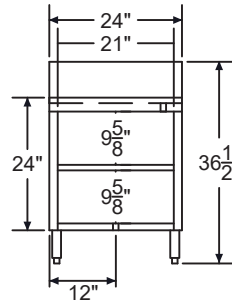

KR24-GSB4






KR24-GSB5



**KR24-24SC
KR24-24SC-L**

KR24-24SC shown

KR24-24SC-L
is exact opposite
with sink on left.



Project _____

Item No. _____

Quantity _____

601HTG

Undercounter High Temperature
Glasswasher with Built-in Booster



SPECIFIER STATEMENT

Specified unit will be the Moyer Diebel model 601HTG undercounter high temperature glasswasher at 29-5/8" standard height with built-in booster.

Features include a 7-1/4" height stand, 12-1/8" door opening, built-in 6kW booster, 2 kW tank heater, LED temperature display, Rinse Sentry, rinse aid and detergent pumps, flexible fill and drain hoses as well as an auto-clean cycle which flushes tank interior at shutdown.

Wash tank constructed of type 316 stainless steel.

1 year parts and labor warranty.

Vent hood is not recommended as unit does not produce excessive steam. Always follow local building code guidelines.


STANDARD FEATURES

- **Ergonomic**, practical, 22-1/2" [572] loading height
- **Soft Start**, protect glasses and mugs from chipping and breaking
- **Industry leading**, deep drawn, type 316 stainless steel tank
- **12-1/8" [308] door opening**, ideal for racked glasses
- Heavy duty cycle provides versatility for heavily soiled glassware
- Dedicated rinse arms for sparkling results
- Delime feature allows easy deliming of wash cavity
- Auto-clean flushes tank interior at end of serving period
- Rinse sentry ensures 180°F final rinse
- Microprocessor controls and digital temperature displays
- Pumped drain provides for easy installation
- Counter-balanced door
- Multi-power, allows for easy field conversion to three phase
- Built-in 6 kW booster for 180°F final rinse
- Advanced service diagnostics
- Two 20"x20" racks – one peg, one flat


OPTIONS & ACCESSORIES

- | | |
|--|---------------|
| ☐ 9kW high speed recovery booster | – |
| ☐ 3 Phase Connection (prewired at factory) | – |
| ☐ Drain Water Tempering Kit
(factory installed) | P/N 0712382 |
| ☐ Low Chemical Alarm | P/N 0712314-2 |
| ☐ Power Cord Kit (for 6kW / 70° rise only) | P/N 0713741 |
| ☐ 17RS – 17" Stand (replaces existing stand) | P/N 0708757 |
| ☐ 4" Stand (converts to a standard
counter height) | P/N 0714292 |
| ☐ 1" Roller kit (adds 1" to height) | P/N 0712480-1 |
| ☐ Flat bottom dishrack | P/N 101273 |
| ☐ Peg dishrack | P/N 101285 |


Dimensions shown in inches and [millimeters]

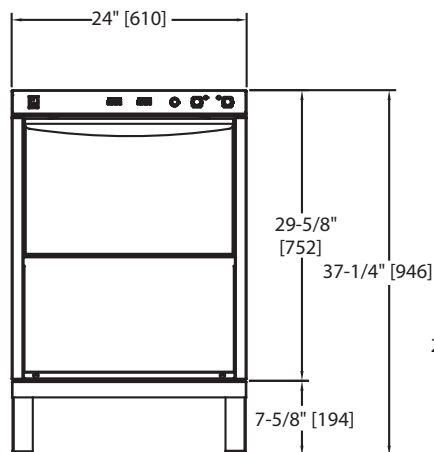

Front View

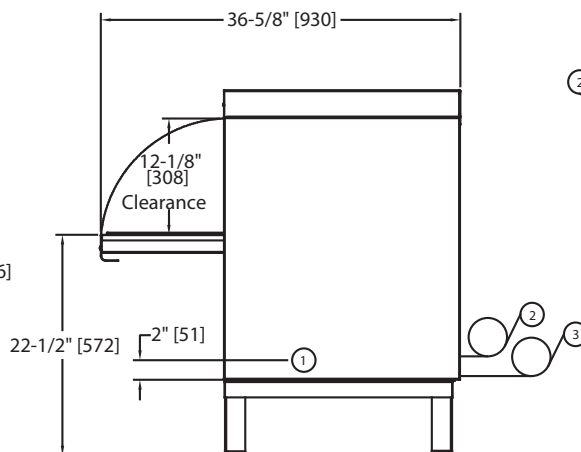

Side View

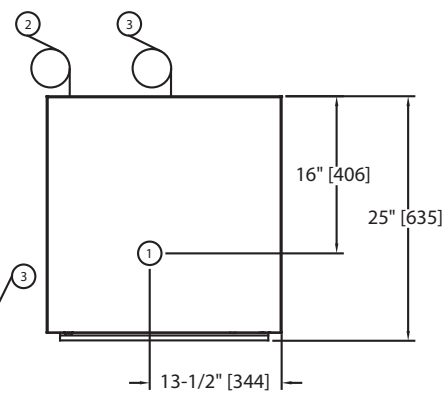

Plan View

SPECIFICATIONS

Capacities

*Racks per hr. 25

Motor horsepower

Wash 1

Water consumption

U.S. gal per hr (max use) 39

U.S. gal per rack 1.8

Temperatures °F

Wash (minimum) 150

Rinse (minimum) 180

Heating

Tank heat, electric (kW) 2

Electric booster (kW required for 70°F rise) 6

(kW required for high speed recovery) 9

Time Cycle in Seconds

Wash 90

Rinse 26

Drain/fill 25

Total cycle 141

* Excludes 30 second NSF load/unload time

Utilities

1 Electrical Connection

115/208-240/60/1; 3 wire plus ground. **Hard wiring required** (see box)

115/208-240/60/3; 4 wire plus ground.

2 Water Connection

110°F Min., hot water for 6kW rise booster.

5 ft. long 1/2" I.D. flexible fill hose with 3/4" garden hose connection provided.

Flow pressure: 25-95 psi

3 Drain Connection

5 ft. long, 5/8" I.D. flexible drain hose provided. **For Y connection into 1-1/2" drain.**

Max. drain flow: 7 US gpm; maximum **3' height above floor**

601HTG with **6kW** Rise Booster

Electrical Specs.	Rated Amps	Minimum Supply Ckt. Conductor Ampacity	Maximum Overcurrent Protective Device
208/60/1	32	40	40
240/60/1	36	40	40
208/60/3	22	30	30
240/60/3	24	30	30

601HTG with **9kW** High Speed Recovery Booster

Electrical Specs.	Rated Amps	Minimum Supply Ckt. Conductor Ampacity	Maximum Overcurrent Protective Device
208/60/1	45	60	60
240/60/1	50	60	60
208/60/3	29	35	35
240/60/3	33	40	30

	Uncrated	Crated
Height*	33-3/4" [860]	39-1/2" [1003]
Width	24" [610]	25" [635]
Depth	24" [610]	25-1/2" [647]
Ship Wt. Lbs/kg	178/79	198/90

* Front leveling feet provided.

Warning Plumbing and electrical connections should be made by qualified personnel who will observe all the applicable plumbing, sanitary and safety codes.

***Note:** Electrical supply service must be a 3 or 4 wire plus ground for connection as shown.



Due to an ongoing value analysis program at Moyer Diebel, specifications in this catalog are subject to change without notice.

Moyer Diebel – USA

3765 Champion Blvd., NC 27105

336/661-1992 • Fax: 336/661-1979

moyerdiebel.com

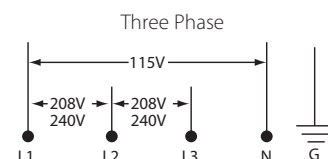

System data sheet

BASWA Phon Classic Base



Description & application

The BASWA Phon Classic Base acoustical plaster system absorbs sound to reduce reverberation time in a space. The system consists of the BASWA Phon Panels adhered to a stable, solid substrate using BASWA Adhesive, a coating of microporous BASWA Base, and a finish of microporous BASWA Base.

To achieve high frequency sound absorption, sound wave energy passes through the microporous finished surface, into the mineral wool backing of the BASWA Phon Panels, and is converted into heat energy. Low frequency sound absorption is achieved when sound energy vibrates the microporous finished surface diaphragmatically, transforming the sound energy into heat energy.

System Data

System characteristics	System thickness: 30 mm, 40 mm, or 70 mm
	Apply to seamless, flat, curved, domed, or vaulted surfaces
	Easily cleaned or repaired with BASWA acoustic Refresh Line
	Standard color: NCS S0500-N
	Tinted to match any color with BASWA Colors Tint Additive
	Swiss engineered components made in US
	Durable marble finishes
	Factory coated and sanded panel. No panel separating, compressing, or seam-telegraphing.
	Certified local independent installers
	In stock and ready for immediate delivery


Finish characteristics	Smooth marble aggregate finish
	Hand troweled, 2 coat finish on BASWA Phon Panel
	Finish coat aggregate grain diameter of 0.7 mm
	NRC Ratings ranging from 0.80 to 1.00

Thermal conductivity	Thickness	1/U	U (W / m ² K)	λ (W / m K)	R (m ² K / W)
	30 mm	0.68	1.47	0.044	0.68
	40 mm	0.97	1.03	0.041	0.97
	70 mm	1.82	0.55	0.038	1.82

Weight	30 mm	1.24 lbs/sf	(6.05 kg / m ²)
	40 mm	1.46 lbs/sf	(7.13 kg / m ²)
	70 mm	2.00 lbs/sf	(9.76 kg / m ²)
	*Weight may vary depending on the installers application.		

Maintenance	For further information about the cleaning and maintenance, or repair, of BASWA acoustical plaster systems, refer to the BASWA cleaning and maintenance guidelines.
-------------	---

System construction

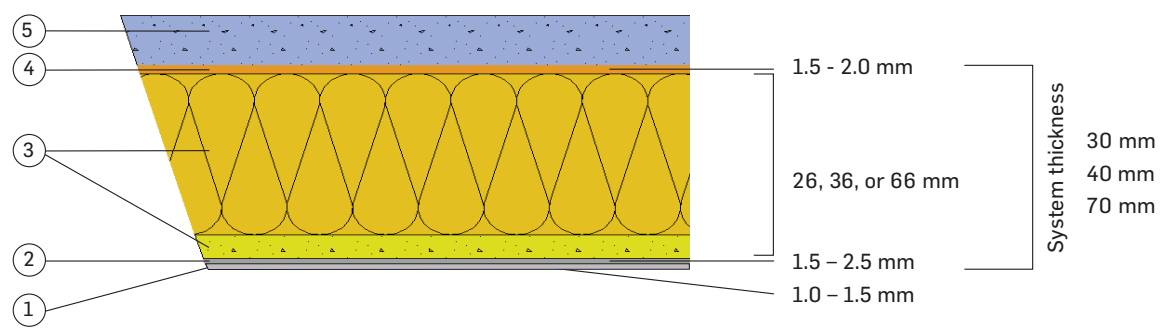

1. BASWA Base finish coat 2. BASWA Base base coat 3. BASWA Phon factory-coated panel 4. BASWA Adhesive 5. Substrate
*Not depicted: BASWA Fill (in panel seams) and BASWA Trim (used as needed)

System components	BASWA Phon Panel A 26, 36, or 66 mm, factory coated and sanded panel of randomly spun mineral wool and recycled glass bead granulate. BASWA Adhesive A lightweight gypsum-based adhesive. BASWA Fill A glass granulate mixture, identical to Phon Panel coating. BASWA Base A crushed marble aggregate loose bodied slurry.
Assembly	Once BASWA Phon Panels are properly adhered to stable substrate, beveled seams are filled and trims are coated with BASWA Fill. Once dry, a coat of BASWA Base is trowel applied. Once dry, a second coat of BASWA Base is trowel applied.
Substrate	Must be air-tight ≥½" standard drywall (framing conditions dependent), new or existing Concrete Plaster, in good condition
Installer requirements	BASWA Acoustical Plaster systems can only be installed by companies that have been trained by BASWA acoustic North America and are in possession of a BASWA acoustic certificate. BASWA acoustic only supplies to certified companies. The latest BASWA planning documents and installation guidelines also apply.
Install environment	Follow ASTM C842 Environmental Conditions for installation. Temperature <80°F / >55°F (<30°C/>15°C). Temporary temperature must be maintained until permanent HVAC is activated. Air drying bonding characteristics.

Installation timeline 4-5 day installation time. Assumes an installation team of 3-4 persons and a flat surface size of 850 - 1,100 sf (80–100m²).

General For further information about product coverages or product information, refer to the BASWA product data sheets.

Technical information

Acoustical absorption A Mounting ASTM C423 System on concrete slab. No plenum.

Thickness	NRC	SAA
30 mm	0.80	0.79
40 mm	0.85	0.87
70 mm	1.00	0.98

E Mounting ASTM C423 System with plenum. Typical installed conditions.

Thickness	NRC	SAA
30 mm	0.80	0.80
40 mm	0.85	0.83
70 mm	0.90	0.94

Fire rating Class A fire rated per ASTM E84

Mold and mildew Rated 10 / 10, signifying no mold growth per ASTM D 3273-16

VOC content ≤ 0.5 mg/m³, Passing CA Dept. of Public Health CDPH/EHLB/Standard Method Vers 1.2, 2017
USGBC LEED Version 4, BD&C, ID&C
The WELL Building Standard
ANSI/GBI 01, Green Building Assessment Protocol
ANSI/ASHRAE/USGBC/IES Standard 189.1

Light reflectance Light Reflectance L Value of 0.91 per the ASTM E 1477-98

Thermal conductivity	Thickness	1/U	U (W/m² K)	λ (W/m K)	R (m² K/W)
	30 mm	0.68	1.47	0.044	0.68
	40 mm	0.97	1.03	0.041	0.97
	70 mm	1.82	0.55	0.038	1.82

Sustainability

81 - 83% recycled content in final system, thickness depending. Formeldyhede free. Components made in US. VOC free. No LBC Red List materials. LEED, WELL, Mindful Materials, and Portico documentation available.

For further information about the sustainability aspects of BASWA systems and products refer to the BASWA Sustainability data sheets.

Safety data

For further information about safety during transportation, storage and handling, and/or disposal, refer to the BASWA Safety data sheets.

Disclaimer

The present information, and suggestions for installation and application are based on knowledge and experience in typical situations, providing that products are properly shipped, stored, handled and applied. Due to the widely varying working conditions, a guarantee for installed materials cannot be reliant either on this information. Installer must verify products are suitable for the intended application. Product specifications are subject to change without notice. All rights reserved. Changes, reprints and copies, as well as electronic, reproduction, even in excerpts, require the explicit permission from BASWA acoustic North America.

working conditions, a guarantee for installed materials cannot be reliant either on this information. Installer must verify products are suitable for the intended application. Product specifications are subject to change without notice. All rights reserved. Changes, reprints and copies, as well as electronic, reproduction, even in excerpts, require the explicit permission from BASWA acoustic North America.

TECTUM® Direct-Attach TECTUM Direct-Attach High NRC Acoustical Wall Panels coarse texture




FAST134
Select Items Ship Fast
armstrong.com/fast134



Tectum Direct-Attach wall panels in custom colors

CAD/Revit® drawings at:
armstrong.com/cadrevit

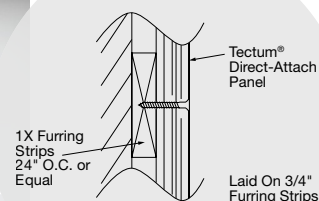

Tectum® Direct-Attach and Direct-Attach High NRC wall panels provide durable, sustainable, acoustical options for a wide variety of applications.

KEY SELECTION ATTRIBUTES

- Tectum Direct-Attach panels have an NRC of up to 1.00 and UL® Certified acoustics with acoustical testing and reporting that align with industry-wide best practices
- Tectum Direct-Attach High NRC panels have a proprietary, factory-applied acoustical backer, adding sound absorption that is certified by UL
- Select products included in the FAST134 program – ready to ship in 4 weeks or less
- **new** All panel thicknesses (1", 1-1/2", and 2") are now part of the Sustain® portfolio and meet the most stringent industry sustainability compliance standards today. Listed colors and custom sizes are included.
- Long and short beveled edges are available as a standard option
- Great retrofit solution for noise reduction
- Can be field painted up to 6 times without impacting acoustic or fire performance
- Variety of premium color options available
- Can be mechanically fastened to a wide variety of surfaces including masonry and drywall
- CleanAssure™ family of products – includes disinfectable panels, suspension systems, and trim (standard colors only)
- USDA Biobased Content: 98%
- Made in the U.S.A. of domestic and global content
- Build America, Buy America (BABA) Act compliant

DETAILS



1. Tectum Direct-Attach panel in White
2. Tectum Direct-Attach panels in White
3. Tectum Direct-Attach High NRC proprietary acoustical backer

TECTUM® Direct-Attach TECTUM Direct-Attach High NRC Acoustical Wall Panels coarse texture


USDA
CERTIFIED
BIOBASED
PRODUCT
PRODUCT 95%



LEED V5		
COMMON MATERIALS FRAMEWORK		
Climate Health		EPD
Human Health	Declare Label	EPD
	HPD	FSC
	3rd Party CDPH	✓
OCCUPANT EXPERIENCE		
Acoustics		✓

TECTUM DESIGN CAPABILITIES

COLORS Due to printing limitations, shade may vary from actual product.

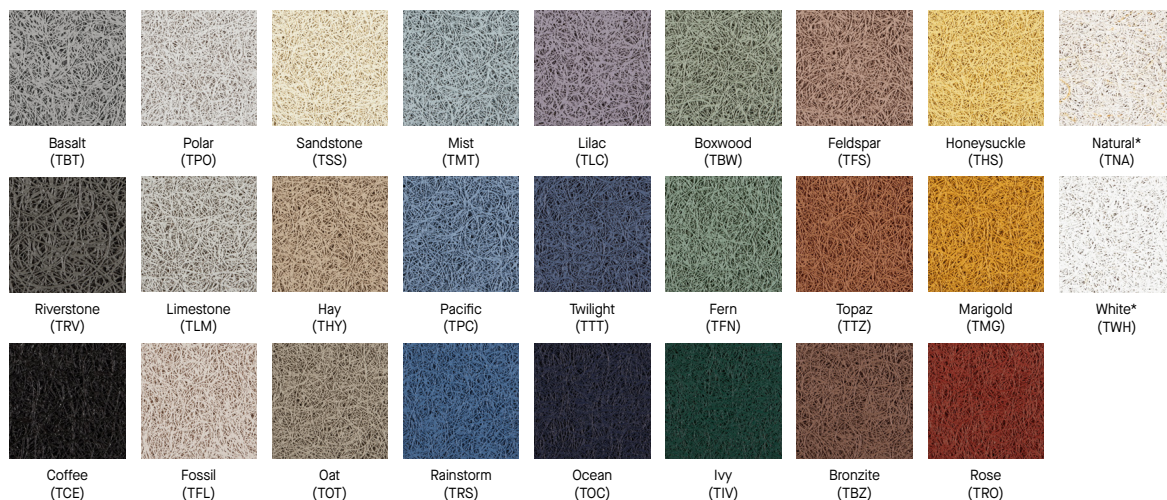

Custom Colors
Available**

* **Standard color options:** Nature-inspired colors are premium. All colors shown are pre-qualified to meet Sustain® portfolio requirements. Due to manufacturing processes, the face of Natural (TNA) panels may appear whiter than the back and edges.

** Custom, made-to-order colors must be evaluated if sustainability criteria is required. Lead time will increase. Contact ASQuote@armstrong.com

QUOTED PANEL SIZES

Get Tectum
Direct-Attach
panels in sizes
up to 144"


1", 1-1/2", or 2" Thickness

Width	Length
12" - 48"	12" - 144"

HIGH DESIGN IN STANDARD PRODUCTS A New Way to Think About Tectum



Tectum® DesignArt®
Mix and match Shapes and Lines
for a truly unique visual!
armstrong.com/designart

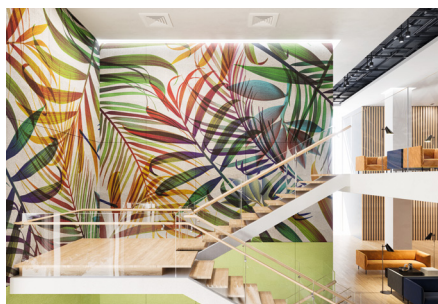

Tectum® Create!™
Create beautiful, unique spaces
with printed imagery!
armstrong.com/tectumcreate



Tectum® Direct-Attach Ceilings
Transform your spaces
with strength and style!
armstrong.com/tectumdirect

Acoustical Wall Panels
coarse texture



SUSTAIN®
High Performance
Sustainable Ceiling Systems



LEED v5

COMMON MATERIALS FRAMEWORK		Climate Health	EPD
Human Health	Declare Label HPD	Ecosystem Health	EPD FSC
	3rd Party CDPH	Circular Economy	✓
OCCUPANT EXPERIENCE		Acoustics	✓

VISUAL SELECTION

PERFORMANCE Dots represent high level of performance.

ACOUSTICAL INFORMATION

FAST
4 WEEKS
or Less

◆ When specifying or ordering, include the appropriate 3-digit color suffix:
(e.g. 8182T10TNA – Direct-Attach Wall Panels with Long Edges Beveled/Short Edges Square – 23-3/4 x 48 x 1" in Natural)

* Scratch-resistance is applicable to Natural and White panels only.

** Four-sided beveled edge panels are recommended in adjoining panel installations.

TECTUM® Direct-Attach TECTUM Direct-Attach High NRC Acoustical Wall Panels coarse texture

USDA
CERTIFIED
BIOBASED
PRODUCT
PRODUCT 95%



SUSTAIN*
High Performance
Sustainable Ceiling Systems

Declare.

LEED V5

COMMON MATERIALS FRAMEWORK		Climate Health	EPD
Human Health	Declare Label	Ecosystem Health	EPD
	HPD		FSC
	3rd Party CDPH	Circular Economy	✓
OCCUPANT EXPERIENCE		Acoustics	✓

VISUAL SELECTION

	Item No. ♦	Dimensions W x L x H (Inches)
	TECTUM Direct-Attach High NRC Wall Panels	5338W2L04T10_ _ _ 23-3/4 x 48 x 1"
		5338W2L08T10_ _ _ 23-3/4 x 96 x 1"
		5338W4L04T10_ _ _ 47-3/4 x 48 x 1"
		5338W4L08T10_ _ _ 47-3/4 x 96 x 1"
Quoted Panel Sizes		W 12" - 48" L: 12" - 144" 1", 1-1/2", or 2" thickness

♦ When specifying or ordering, include the appropriate 3-digit color suffix:
(e.g. 5338W2L04T10TNA - Direct-Attach High NRC Wall Panels with Long Edges Beveled/Short Edges Square - 23-3/4 x 48 x 1" in Natural)
* Scratch-resistance is applicable to Natural and White panels only.

PERFORMANCE

Dots represent high level of performance.

Fire Rating	Light Reflect	Anti-Mold/Mildew	Sag Resist	Certified Low VOC Emissions	CleanAssure™ Disinfectable Panels	Fog	Impact	Scratch*	30-Yr Warranty
Class Up to A	Up to 0.75	*	*	*	*	*	*	*	*
Class Up to A	Up to 0.75	*	*	*	*	*	*	*	*
Class Up to A	Up to 0.75	*	*	*	*	*	*	*	*
Class Up to A	Up to 0.75	N/A	N/A	*	*	*	*	*	*

ACOUSTICAL INFORMATION

UL Classified Acoustics		
Panel Thickness	NRC	Mounting Method
1" High NRC	0.60	D-20
	0.85	E-400

ACCESSORIES


Item No. ♦	Description	Quantity
5456GAL1 _ _ _	Touch up paint	1 gallon
8187L16TWH†	#6 x 1-5/8" Painted Head - Sharp point Screws	1000/CTN
8187L22TWH†	#8 x 2-1/4" Painted Head - Sharp point Screws	1000/CTN
8187L30TWH†	#8 x 3" Painted Head - Sharp point Screws	1000/CTN
8188L16TWH†	#6 x 1-5/8" Painted Head - Drill point Screws	1000/CTN
8188L23TWH†	#6 x 2-1/4" Painted Head - Drill point Screws	1000/CTN
8188L30TWH†	#8 x 3" Painted Head - Drill point Screws	1000/CTN
8189L22TWH†	1/4" x 2-1/4" Painted Head - CMU Screws	500/CTN
8189L27TWH†	1/4" x 2-11/16" Painted Head - CMU Screws	500/CTN
8189L32TWH†	1/4" x 3-1/4" Painted Head - CMU Screws	100/CTN

NOTE: Projects may require alternative screw lengths and types depending on site conditions. Please consult installation instructions for guidance.


♦ When specifying or ordering, include the appropriate 3-digit color suffix:
(e.g. 5456GAL1TNA - Touch up paint in Natural)
† Touch up paint is available to paint screw heads in field if desired or specified.

ACOUSTICAL MOUNTING METHODS


Mounting A




Mounting D-20

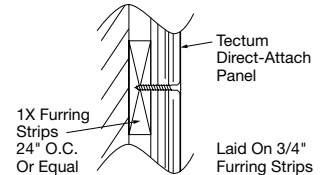

Mounting C-20

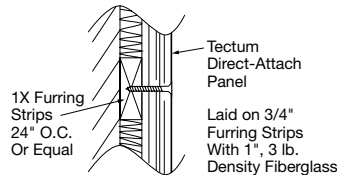

Mounting C-40

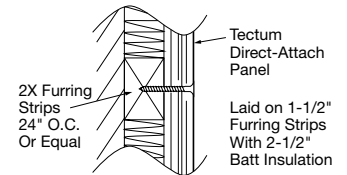

TECTUM® Direct-Attach TECTUM Direct-Attach High NRC Acoustical Wall Panels coarse texture


USDA
CERTIFIED
BIOBASED
PRODUCT
PRODUCT 95%



LEED V5

COMMON MATERIALS FRAMEWORK		Climate Health	EPD
Human Health	Declare Label	Ecosystem Health	EPD
	HPD		FSC
	3rd Party CDPH	Circular Economy	✓
OCCUPANT EXPERIENCE		Acoustics	✓

EDGE DETAIL

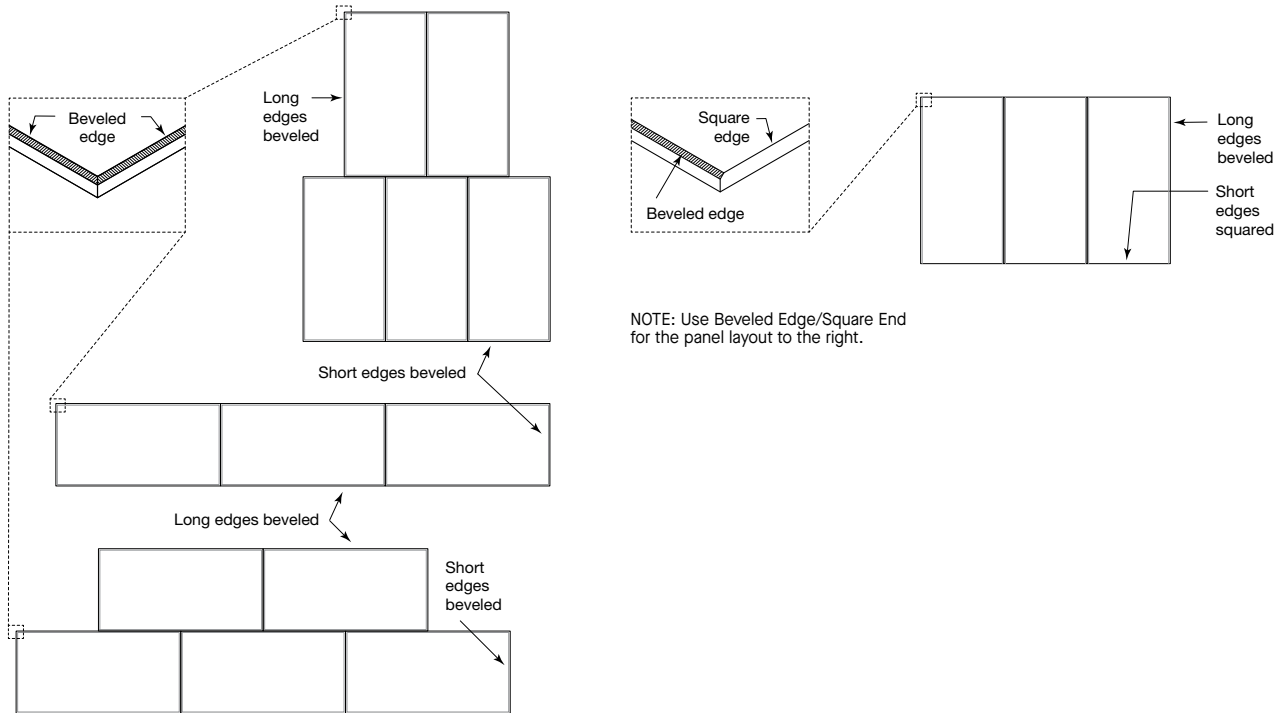

NOTE: Use Beveled Edge/Square End for the panel layout to the right.

NOTE: Use Beveled Edge/Beveled End panels for all adjoining panel installations.

PHYSICAL DATA

Material

Cementitious Wood Fiber; Tectum High NRC panels have an acoustical fleece.

Surface Finish

Factory-applied latex paint on abuse-resistant silicate surface coating. Natural finish is unpainted, but after the coating is applied, panels may appear light in color.

Panels are painted on the edge, however due to fibrous texture of panels, certain angles and lighting conditions will make edge appear less or more painted.

Can be field painted up to 6 times without impacting acoustic or fire performance. See installation instructions for details on paint and application method.

Fire Performance

Class A. Flame Spread Index 25 or less and Smoke Developed Index 50 or less when tested in accordance with ASTM E84.

VOC Emissions

Third-party certified compliant with California Department of Public Health CDPH/EHLB/Standard Method Version 1.2, 2017. This standard is the guideline for low emissions in LEED®, WELL Building Standard®, CalGreen Title 24, ANSI/ASHRAE/USGBC/IES Standard 189; ANSI/GBI Green Building Assessment Protocol.

Humidity/Sag Resistance

HumiGuard® Plus performance panels are recommended for areas subject to high humidity, up to, but not including, standing water and outdoor applications.

Anti-Mold/Mildew

Ceiling panels with BioBlock® performance resist the growth of mold and mildew on the panel surface.

Installation Considerations

Panels must be mechanically attached to approved substrate per installation instructions. To achieve proper finished visual, panels should be installed in an ashlar pattern. Four-sided beveled edge panels are recommended in adjoining panel installations.

Use caution and wear appropriate hand, eye, and dust mask protection when cutting and installing Tectum panels. Refer to installation instructions for complete details and cutting recommendations.

Primary (Embodied) Energy

See all LCA information on our EPDs.

Application Considerations

Color variation among panels is common due to the natural characteristics of the wood on White and Natural panels.

Wood fibers may appear orange on natural-colored panels due to the characteristics of the wood.

Design Considerations

For walls that may experience condensation or moisture, such as uninsulated exterior walls, D- or C- mounting is required to create a gap between the structure and the panel.

Cleaning and Disinfecting

Cleaning and CDC-approved disinfecting options available on armstrong.com/cleaning

Seismic Restraint

Tectum Direct-Attach panels are approved for application in all seismic areas when installed per the seismic guidelines in the Armstrong Ceilings & Walls Installation Instructions.

Warranty

30-Year Warranty. Details at armstrong.com

FAST134 Program Considerations

Size of Job Matters: Big jobs over 2500 SF, or 50 pieces for shapes/vertical elements, will have longer lead times.

Location Matters: Transit time not included. We are ready to ship in 1 week on FAST1 items. However, transit to the states west of Wyoming may add time.

Distributor Truck Schedule Matters: We rely on distribution to help move products around the country. When speed matters, work with your local distributor to ensure FAST134 service.

Stock vs Made-to-Order Matters: FAST3 & FAST4 items are made-to-order and will ship direct to distributor. FAST1 (stocked items) will go through distribution and depend on distributor truck schedules.

Weight, Pcs and SF/Pallet

1" - 1.65 LBS/SF

1-1/2" - 2.53 LBS/SF

2" - 3.3 LBS/SF

8180T10, 8173T10 - 36 pcs/pallet; 1152 SF/pallet

8181T10, 8174T10 - 72 pcs/pallet; 1152 SF/pallet

8182T10, 8175T10 - 72 pcs/pallet; 572 SF/pallet

8174T15, 8181T15 - 48 pcs/pallet; 768 SF/pallet

8175T15, 8182T15 - 48 pcs/pallet; 384 SF/pallet

8173T20, 8180T20 - 18 pcs/pallet; 576 SF/pallet

8174T20, 8181T20 - 36 pcs/pallet; 576 SF/pallet

8175T20, 8182T20 - 36 pcs/pallet; 288 SF/pallet

5338W4L08T10, 5338W4L04T10, 5338W2L08T10, 5338W2L04T10 - sold by the piece

LEED® is a registered trademark of the U.S. Green Building Council; Declare® and Living Building Challenge® (LBC) are registered trademarks of the International Living Future Institute; WELL® and WELL Building Standard® are trademarks of the International WELL Building Institute; Revit® is a registered trademark of Autodesk, Inc.; FSC® is a registered trademark of Forest Stewardship Council®, A.C., license code FSC-C007626; UL® is a registered trademark of UL LLC; all other trademarks used herein are the property of AWI Licensing LLC and/or its affiliates © 2026 AWI Licensing LLC


TechLine / 877 276-7876
armstrong.com/tectum
BPCS-5716-526

Armstrong®
World Industries





Project _____
AIA # _____ SIS # _____
Item # _____ Quantity _____ C.S.I. Section 114000



LXnR advansys HIGH TEMPERATURE Undercounter Dishwashing Machine



SPECIFIER STATEMENT

Specified unit will be a NSF rated high temperature Advansys™ ventless undercounter dishwasher operating on a cold water supply with steam elimination and energy recovery. Features two-level racking capability, Complete Delime™ with Delime Notification, Auto Dispensing and Booster Guard™, AutoClean, a 17" door opening, snap-in revolving upper and lower rinse arms, three selectable cycle times, 2-stage filtration, up to 30 racks per hour, .62 gallons per cycle, color touchscreen with Wi-Fi and SmartConnect App connectivity, low temperature and chemical alerts, advanced diagnostics and service connection, NSF certified pot and pan mode, detergent, rinse aid and delime pumps. Constructed of stainless steel.

1 year parts and labor warranty.

STANDARD FEATURES

- + Racks per hour – Light 30 / Normal 24 / Heavy 13
- + .62 gallons of water per cycle
- + Two-level racking capability
- + High temperature sanitization unit
- + User-friendly smart touchscreen controls
- + Wi-Fi connectivity
- + SmartConnect App with machine status, temperature logs, error code reporting, and usage analysis
- + Steam elimination and energy recovery
- + AutoClean cycle washes down inside of machine at shutdown
- + NSF certified pot and pan cycle on heavy cycle
- + 17" door opening
- + Temperature and chemical alerts (lockouts available)
- + Sense-A-Temp™ 70°F rise electric booster heater
- + Chemical pumps with auto-prime for detergent and rinse-aid
- + Soft start to protect glassware
- + Advanced diagnostics and service connection
- + Complete Delime™ with Delime Notification, Auto Dispensing and Booster Guard™
- + Deep drawn stainless steel tank
- + Revolving upper and lower anti-clogging interchangeable wash arms
- + Snap-in revolving upper and lower interchangeable rinse arms
- + 2-stage wash tank filtration
- + Energy saver mode
- + Automatic pumped rinse and drain
- + Automatic fill
- + Electric tank heat
- + Combination rack
- + Peg rack (excludes LXnR-2L)
- + Two-level rack kit (LXnR-2L only)

OPTIONS & ACCESSORIES (Available at extra cost)


- ☐ Hobart exclusive two-level racking kit boosts capacity up to 48 racks per hour
- ☐ Door lock (keeps door locked until condensing cycle is complete)
- ☐ Power cord kit
- ☐ 6" stainless steel legs
- ☐ 17" stainless steel stand with storage
- ☐ External height adjustable casters
- ☐ Internal height adjustable casters (3")
- ☐ Drain water tempering kit
- ☐ Water hammer arrestor kit
- ☐ Splash reduction panel
- ☐ Trim strip
- ☐ Pressure regulator valve
- ☐ Pumped drain air gap kit

LXnR SERIES – LXnR advansys HIGH TEMPERATURE


Approved by _____ Date _____ Approved by _____ Date _____




LXnR advansys HIGH TEMPERATURE Undercounter Dishwashing Machine

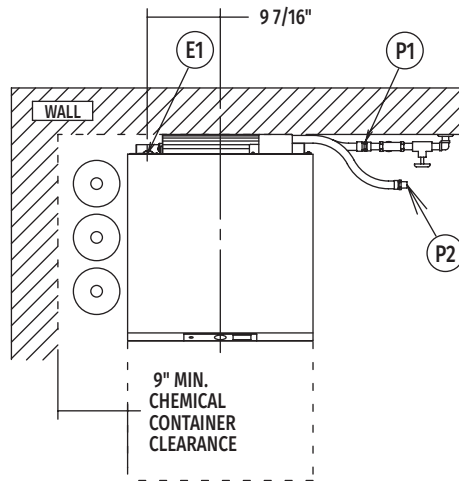


Top View

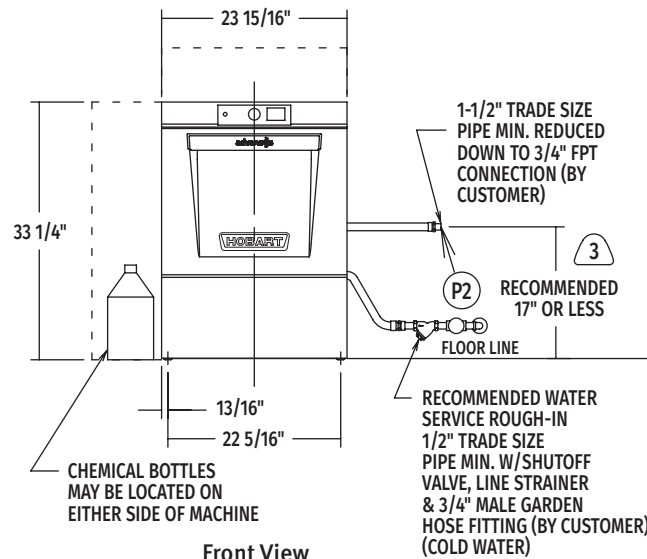

Front View

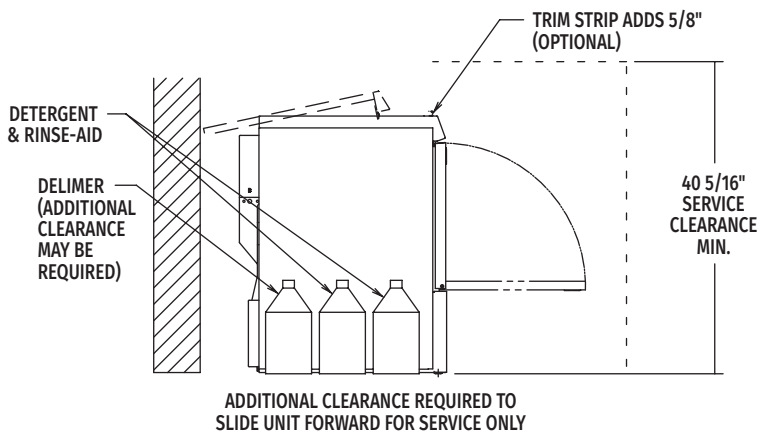

Left Side View

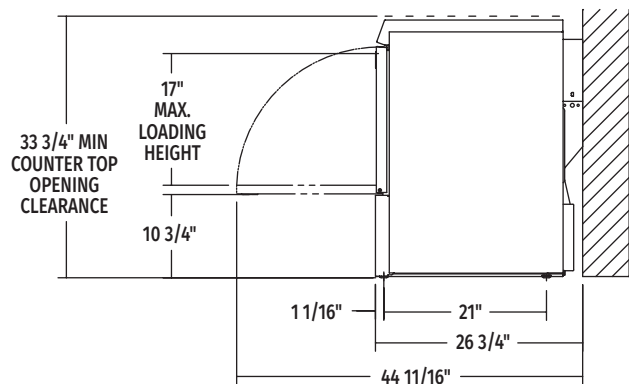

Right Side View

MODEL:
LXnR
00-563661
REV: A5

CAD and/or Revit Files Available



LEGEND

Electrical Connections	
E1	Electrical connection: 1-3/8" dia. hole for 1" trade size conduit; 4-5/8" AFF.
Plumbing Connections	
P1	Single fill and rinse connection: 3/4" female garden hose fitting on 6' long hose supplied with machine; 55-80°F (cold) recommended for LXnR.
P2	Common drain connection: 5/8" barb fitting with 6' long hose supplied with machine.

WARNING: Electrical and grounding connections must comply with the applicable portions of the National Electrical Code and/or other local electrical codes.

Plumbing connections must comply with applicable sanitary, safety and plumbing codes. Drain and fill line configurations vary, some methods are shown on this drawing.

NOTICE

Required flowing water pressure to the dishmachine is 15-65 PSIG. If pressures higher than 65 PSIG are present, a pressure regulating valve must be installed in the water line to the dishmachine (by others).

Pressure gauge not required on pumped rinse machines.

Important: Chemical containers should be placed no higher than 10" above floor.

If chemical containers are to be placed in cabinet adjacent to machine, a 1/2" dia. hole is required in the cabinet to run chemical supply line.

Notes:

1. All vertical machine dimensions taken from floor may be increased by 1".
2. Moist air escapes from the door.
Use only moisture resistant materials adjacent to dishmachine sides and top.
3. A vent hood is not recommended above the undercounter dishmachine since it does not produce excessive vapors.

Plumbing Notes:

1. Water hammer arrestor (meeting ASSE-1010 Standard or equivalent) to be supplied (by others) in common water supply line at service connection.
2. Recommended water hardness to be 3 grains or less for best results.
- ③ If drain hose is looped above a sink, the loop must not exceed 38" AFF.
4. Backflow prevention provided by NSF-approved air gap device.

Miscellaneous Note:

1. For optimal performance, Hobart recommends maintaining a dishroom temperature of 65°F (18°C) or higher, as lower temperatures may hinder the machine's capacity to operate effectively (with lower performance as ambient temperature decreases).

SPECIFICATIONS

Capacities

Cycle Time (seconds) Light 119 / Normal 148 / Heavy 278
Racks per Hour Light 30 / Normal 24 / Heavy 13
Tank Capacity – Gallons 2.9

Motor Horsepower

Wash 0.85
Rinse 0.19

Water Consumption

U.S. Gallons per Cycle 0.62
U.S. Gallons per Hour (maximum use) 18.6
Peak Drain Flow – U.S. Gallons (gallons per minute) 4.0

Temperatures °F

Wash 150
Rinse 180
Incoming Water Temperature (minimum recommended) . 55-80

Heating

Tank Heat, electric (kW) 1.8
Electric Booster (kW) 4.9

Standard 20" x 20" Rack Complement

Combination 1
Peg (excludes LXnR-2L) 1
Two Level (LXnR-2L only) 1

Shipping Weight (approximate) 215 lbs.

Crated Dimensions 27"W x 30"L x 40"H

Heat Output, BTU/Hour	
Latent	Sensible
1,100	2,000

(E1) Standard Electrical Options

Tank Heat, Booster, Pump & Controls			
Voltage	Rated Amps	Minimum Supply Circuit Ampacity	Maximum Protective Device
208-240/60/1	33.7	40	40
120/208-240(3W)60/1*	34.0	40	40
208-240/60/3	24.9	30	30
220-240/50/1	33.4	40	40
120/208(3W)60/1*,**	23.7	30	30

NOTE: For supply connections, use copper wire only rated at 90°C minimum.

*This system requires three power wires which includes a current carrying neutral, an additional fourth wire must be provided for machine ground.

**Booster and tank heater not energized concurrently.

Dishmachine not provided with internal GFCI protection.

SPECIAL-USE PANELS

USG Sheetrock® Brand
Lay-In Gypsum Ceiling Panel 3260

TO ORDER SAMPLES, GO TO [USG.COM](https://www.usg.com)

USG Sheetrock® Brand Lay-In Gypsum Ceiling Panel

FEATURES AND BENEFITS

- USG Sheetrock® Brand Lay-In Gypsum Panels meet the United States Department of Agriculture Food Safety and Inspection Service requirements for food processing areas.
- Washable and scrubbable finish-impact and scratch resistant.
- Perfect for exterior soffits, parking garages, kitchens, food preparation areas, restrooms, utility areas, locker rooms, and marine environments.
- ClimaPlus™ 30 year limited system warranty against visible sag.

PRODUCT SPECIFICATIONS



Product Certified for Low Chemical Emissions:
• UL.COM/GG
• UL 2818

30 Year LIMITED System Warranty:
• No Visible Sag



USG SHEETROCK®
BRAND LAY-IN
GYPSUM CEILING
PANEL 1, 2, 3

GRID PROFILE
OPTIONS


PHYSICAL DATA

Item No.	Edge	Panel Size	Pcs./ Carton	Sq. Ft./ Carton	Ctns./ Pallet	Fire Class	UL Sound Control			Grid Options	VOC	Sag Resistance	Abuse Resistant	USG Commercial Equivalent
							NRC	CAC	LR					
R3260	SQ	2'x2'x1/2"	4	16	92		—	35	0.77	A, B, C	Low			USG Sheetrock® Brand Lay-In Panel 3260
R3270	SQ	2'x4'x1/2"	4	32	46		—	40	0.77	A, B, C	Low			USG Sheetrock® Brand Lay-In Panel 3270

Low Emissions (VOC)
Certified for low emitting performance, meets CDPH 01350 v1.2 - 2017. Certificates of Compliance for Low VOC Emissions are available on usg.com and at usg.ecomedes.com.

Firecode®
**Abuse
Resistant**

A
USG SDX®/SDXL™



ASTM E84 surface-burning characteristics
Class A
Flame Spread: 25 or less
Smoke Developed: 50 or less

Maintenance
USG Sheetrock® Brand Lay-In Panel: Can be cleaned easily with a damp sponge. Use mild detergent and water—do not use acetate, ammonia or high concentration of chlorine, bromide or other harsh chemicals.

UL Type
FC-CB

Weight
1/2" = 2.00 lb./sq. ft.

Recycled content
8%

Thermal resistance
R-0.45

- Notes**
1. Panels meet USDA/FSIS requirements for food processing areas.
 2. This product has achieved both BioPreferred initiatives: Federal Procurement Preference and Certified Product Labeling. See complete listing of all USG ceiling panels on biopreferred.gov website.
 3. Available in full pallet quantities only.
 4. Firecode® products are approved for use in fire-resistance rated UL designs, where the designs allow for the UL Type Designation.